DocuSign Envelope ID: 10CAD4AD-A880-45D3-A900-F45EE2306008



HEAVY DUTY CLEVIS HANGER

NOTE:

1. SEE SPECIFICATION FOR HANGER SIZES.
2. PIPING SHALL BE HUNG FROM STEEL ONLY.
3. PIPING SHALL NOT BE HUNG FROM METAL DECK OR SLABS

1 PIPE HANGER SUPPORT DETAIL

SCALE: NONE

INSULATION SHIELD SCHEDULE			
PIPE SIZE	DIMENSION "A"	GAUGE OF SHIELD	SHIELD THICKNESS
1/2" TO 4"	12"	18	0.0480
5" TO 6"	18"	16	0.0600
ABOVE 6"	24"	14	0.0750

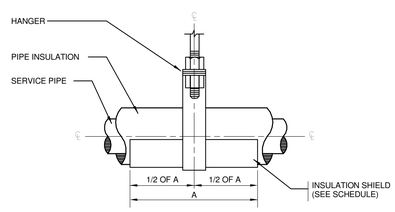

NOTE:

1. SEE SPECIFICATION FOR FLANGER SIZES
2. PIPING SHALL BE HUNG FROM STEEL ONLY.
3. PIPING SHALL NOT BE HUNG FROM METAL DECK OR SLABS

2 PIPE HANGER SHEILD DETAIL

SCALE: NONE

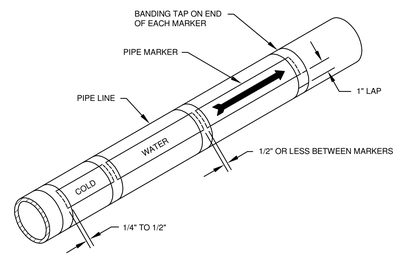

NOTES:

1) USE DOUBLE HEADED ARROWS WHERE FLOW CAN BE IN BOTH DIRECTIONS.

3 HORIZONTAL & VERTICAL PIPE LABELS

SCALE: NONE

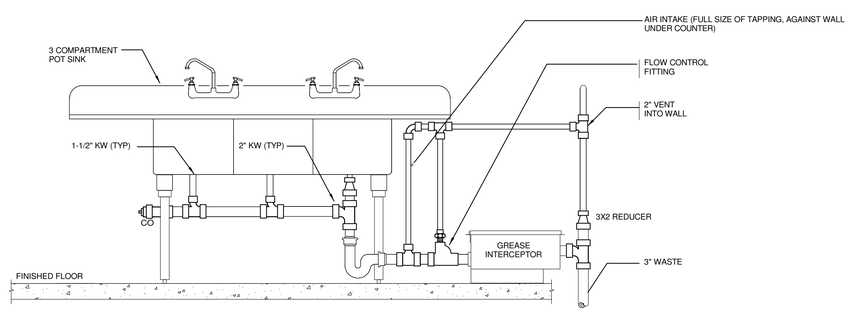

NOTES:

1. REFER TO FLOOR PLANS FOR PIPE SIZES
2. REFER TO SPECIFICATIONS FOR PIPE MATERIALS AND SPECIALTIES

4 WASTE PIPING TO POT SINK & GREASE TRAP

SCALE: NONE

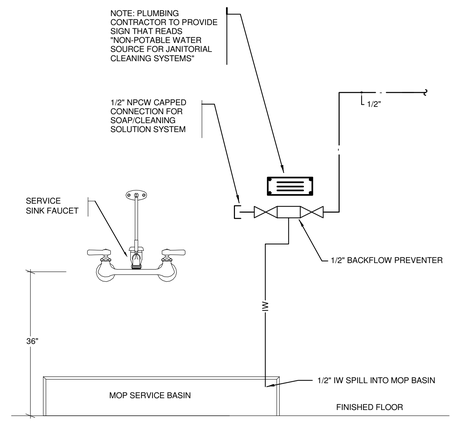

NOTE:
PROVIDE AND INSTALL CHECK VALVES ON HOT & COLD WATER SUPPLY PIPING.

5 MOP SERVICE BASIN

SCALE: NONE

Project:

JOINT HEALTH SCIENCES CENTER - CAFE FITOUT

Prepared For:

Rowan University - Rutgers Camden
Board of Governors
200 Federal Street, Suite 300
Camden, NJ 08103

Contract No: 16.07011.12

HOK

One Logan Square, Suite 1510
Philadelphia, PA 19103 USA
t +1 215 940 3570 f +1 215 940 3571

All reproduction & intellectual property rights reserved © 2016

In Association with:

J.F. McKernan Jr. Architects & Assoc., LLC
100 Dobbs Lane, Suite 204
Cherry Hill, NJ 08034

VANDERWEIL R.G. Vanderweil Engineers, LLP
101 Grovers Mill Road
Lawrenceville, NJ 08648

Key Plan



Professional Seals



No.	Description	Date
1	ISSUED FOR CONSTRUCTION	01/17/2020

Drawn by: Author Reviewed by: Checker
Project No: 16.07011.12

ISSUED FOR CONSTRUCTION - 01.17.20

Sheet Title

PLUMBING DETAILS

Original drawing is 42 x 30. Do not scale contents of this drawing.

Sheet Number

P-501.CF

1/16/2020 11:37:39 AM