SPECIFICATIONS
for the

EWING LAWRENCE SEWERAGE AUTHORITY
VEHICLE STORAGE BUILDING

Prepared for
Ewing Lawrence Sewerage Authority
Lawrence Township, Mercer County, New Jersey

March 2025

REMINGTON & VERNICK ENGINEERS

2059 Springdale Road
Cherry Hill, NJ 08003
(856) 795-9595

Dennis Yoder, P.E., Lic. No. 31866

3.25.25
Date

RVE Project No. 1102M026

NOTICE TO BIDDERS

PUBLIC NOTICE IS HEREBY GIVEN that sealed bids will be received by the Ewing Lawrence Sewerage Authority (ELSA) for the Vehicle Storage Building in Ewing Township, Mercer County, New Jersey.

Bid forms, contracts and specifications are available by contacting Remington & Vernick Engineers. Contact shall be made by phone or by email to make bid purchase arrangements. At 856 795 9595 or by submitting RVEbidinterest@rve.com.

Said Bids will be received, opened and read aloud in public at the Ewing Lawrence Sewerage Authority, 600 Whitehead Road, Lawrenceville, New Jersey, 08648, Mercer County, New Jersey on **April 30, 2025** at **11:00 AM** prevailing time.

Electronic download link for copies of the bid forms, contracts and specifications may be obtained from said Remington & Vernick Engineers, by prospective bidders upon request, upon payment of the sum of $50.00 for each set. Should interested bidders not have the ability to handle electronic download sets, a set may be arranged to be sent overnight by calling 856 795 9595.

NO BIDS ARE TO BE PICKED UP AT THE ENGINEER'S OFFICE OR AT THE MUNICIPALITY OFFICES.

PAYMENT MUST BE RECEIVED PRIOR TO OBTAINING SAID SPECIFICATIONS.

NO BIDS ARE TO BE DROPPED OFF AT THE ENGINEER'S OFFICE.

The Ewing-Lawrence Sewerage Authority reserves the right to consider the bids for sixty (60) days after the receipt thereof, and further reserves the right to reject any or all bids, either in whole or in part and also to waive any informality in any and make such awards or take action as may be in the best interest of the Ewing-Lawrence Sewerage Authority, in accordance with applicable law.

Bids must be on the bid form prepared by Remington & Vernick Engineers, in the manner designated therein and required by the specifications, must be enclosed in sealed envelopes bearing the name and address of the bidder on the outside and also bearing on the outside reference to the particular work bid upon. Said bids shall be addressed to S. Robert Filler, Executive Director, 600 Whitehead Road, Lawrenceville, New Jersey, 08648.

Each bid shall be accompanied by a certified check, cashier's check or bid bond duly executed by the bidder as principal and having as surety thereon a surety company approved by the Ewing-Lawrence Sewerage Authority in an amount not less than ten percent (10%) but in no case in excess of $20,000.00 of the amount bid. Any such bid bond shall be without endorsement or conditions. Bid shall also be accompanied by a certificate letter from a surety company stating that it will provide the bidder with the completion bond.

The award of the contract shall be made subject to the necessary moneys to do the work being provided by the Ewing-Lawrence Sewerage Authority in a lawful manner. The contract to be executed by the successful bidder will provide that it shall not become effective until the necessary moneys to do the work have been provided by the Ewing-Lawrence Sewerage Authority in a lawful manner. The award shall further be subjected to the securing of necessary State, Federal or Local permits governing the work.

Bidders are required to comply with the requirements of N.J.S.A. 10:5-31 et seq., N.J.A.C. 17:27 (Affirmative Action), N.J.S.A. 34:11-56.25 et seq. (New Jersey Prevailing Wage Act), and Americans with Disabilities Act of 1990 (42 U.S.C. S12101, et seq.).

The contractor is further notified that he must comply with N.J.S.A. 52:25-24.2 and submit a Disclosure Statement listing stockholders with his bid.

The contractor is further notified that he must comply with N.J.S.A. 34:11-56.48 et seq. Public Works Contractor Registration Act and he and any subcontractors must be registered in accordance with the act.

The contractor is also further notified that he must comply with N.J.S.A. 52:32-44 and submit proof of business registration and submit proof of business registration for any named subcontractors in accordance with the act.

By Order of the
Ewing-Lawrence Sewerage Authority

Dated: April 3, 2025

PROPOSAL SECTION

BID DOCUMENT SUBMISSION CHECKLIST

Ewing Lawrence Sewerage Authority
(Name of Local Contracting Unit)

Vehicle Storage Building
(Name of Project)

1102M026
(Project or Bid Number)

A. Failure to submit the following documents is a mandatory cause for the bid to be rejected. (N.J.S.A. 40A:11-23.2)

Required with Submission of Bid (Owner's checkmarks)		Initial Each Item Submitted With Bid (Bidder's Initials)
X	Bidder's acknowledgement of receipt of any notice(s) or revision(s) or addenda to an advertisement, specifications or bid document(s)	
X	A statement of ownership disclosure, pursuant to N.J.S.A. 52:25-24.2 (Stockholders Statement)	
X	A listing of subcontractors as required by N.J.S.A. 40A:11-16 (Subcontractor's Declaration)	
X	A bid guarantee as required by N.J.S.A. 40A:11-21 (Bid Bond, Certified Check or Cashier's Check)	
X	A certificate from a surety company, pursuant to N.J.S.A. 40A:11-22 (Consent of Surety)	

B. Failure to submit the following documents may be a cause for the bid to be rejected. (N.J.S.A. 40A:11-23.1b.)

Required with Submission of Bid (Owner's checkmarks)		Initial Each Item Submitted With Bid (Bidder's Initials)
X	Public Works Contractor Registration Form	
X	New Jersey "Business Registration Certificate" Form	
X	Background Questionnaire	
X	Debarred List Affidavit	
X	Submission of a Non-Collusion Affidavit (this form must be notarized)	
X	Affirmative Action Requirements	
X	Bidder Certificate showing ability to perform contract, pursuant to N.J.S.A. 40A:11-20	

	Disclosure of Investment Activities in Iran, pursuant to P.L. 2012, c. 25.	
	Prohibited Russia-Belarus Activities pursuant to P.L. 2022, c. 3.	
	Certification on Non-Debarment for Federal Government Contracts Form, pursuant to N.J.S.A. 52:32-44.1	
	Lowest Bidder Prevailing Wage Certification pursuant to N.J.S.A. 34:11-56.25, et seq., N.J.A.C. 12.60-9.1	
X	Bid Form	

C. Owner's Statement with respect to N.J.S.A. 40:11-23.1c: See technical specifications whether uniformed law enforcement officers will or will not be required for traffic control.

D. SIGNATURE: The undersigned hereby acknowledges and has submitted the above listed requirements.

Name of Bidder: _____

By Authorized Representative:

Signature: _____

Print Name and Title: _____

Date: _____

Company Name: _____

Mailing Address: _____

Physical Address: _____

Phone Number : _____

Fax Number: _____

E-Mail: _____

ACKNOWLEDGEMENT OF RECEIPT OF CHANGES TO BID DOCUMENTS FORM

Ewing Lawrence Sewerage Authority
(Name of Local Contracting Unit)

Vehicle Storage Building
(Name of Project)

1102M026
(Project or Bid Number)

Pursuant to N.J.S.A. 40A:11-23.1a., the undersigned bidder hereby acknowledges receipt of the following notices, revisions, or addenda to the bid advertisement, specifications or bid documents. By indicating date of receipt, bidder acknowledges the submitted bid takes into account the provisions of the notice, revision or addendum. Note that the local unit's record of notice to bidders shall take precedence and that failure to include provisions of changes in a bid proposal may be subject for rejection of the bid.

Local Unit Reference Number Or Title of Addendum/Revision		How Received (mail, fax, pick-up, etc.)	Date Received	Bidder's Initials
Notice, Revision or Addenda No.	Title or Description			

Acknowledged by bidder:

Name of Bidder: _____

By Authorized Representative:

Signature: _____

Printed Name and Title: _____

Date: _____

STATEMENT OF OWNERSHIP DISCLOSURE

N.J.S.A. 52:25-24.2 (P.L. 1977, c.33, as amended by P.L. 2016, c.43)

This statement shall be completed, certified to, and included with all bid and proposal submissions. Failure to submit the required information is cause for automatic rejection of the bid or proposal.

Name of Organization: _____

Organization Address: _____

_____

Part I Check the box that represents the type of business organization:

☐Sole Proprietorship (skip Parts II and III, execute certification in Part IV)
☐Non-Profit Corporation (skip Parts II and III, execute certification in Part IV)
☐For-Profit Corporation (any type) ☐Limited Liability Company (LLC)
☐Partnership ☐Limited Partnership ☐Limited Liability Partnership (LLP)
☐Other (be specific): _____

Part II

☐ The list below contains the names and addresses of all stockholders in the corporation who own 10 percent or more of its stock, of any class, or of all individual partners in the partnership who own a 10 percent or greater interest therein, or of all members in the limited liability company who own a 10 percent or greater interest therein, as the case may be. (**COMPLETE THE LIST BELOW IN THIS SECTION**)

OR

☐ No one stockholder in the corporation owns 10 percent or more of its stock, of any class, or no individual partner in the partnership owns a 10 percent or greater interest therein, or no member in the limited liability company owns a 10 percent or greater interest therein, as the case may be. (**SKIP TO PART IV**)

(Please attach additional sheets if more space is needed):

Name of Individual or Business Entity	Address

Part III DISCLOSURE OF 10% OR GREATER OWNERSHIP IN THE STOCKHOLDERS, PARTNERS OR LLC MEMBERS LISTED IN PART II

If a bidder has a direct or indirect parent entity which is publicly traded, and any person holds a 10 percent or greater beneficial interest in the publicly traded parent entity as of the last annual federal Security and Exchange Commission (SEC) or foreign equivalent filing, ownership disclosure can be met by providing links to the website(s) containing the last annual filing(s) with the federal Securities and Exchange Commission (or foreign equivalent) that contain the name and address of each person holding a 10% or greater beneficial interest in the publicly traded parent entity, along with the relevant page numbers of the filing(s) that contain the information on each such person. **Attach additional sheets if more space is needed.**

Website (URL) containing the last annual SEC (or foreign equivalent) filing	Page #'s

Please list the names and addresses of each stockholder, partner or member owning a 10 percent or greater interest in any corresponding corporation, partnership and/or limited liability company (LLC) listed in Part II **other than for any publicly traded parent entities referenced above**. The disclosure shall be continued until names and addresses of every noncorporate stockholder, and individual partner, and member exceeding the 10 percent ownership criteria established pursuant to N.J.S.A. 52:25-24.2 has been listed. **Attach additional sheets if more space is needed.**

Stockholder/Partner/Member and Corresponding Entity Listed in Part II	Address

Part IV Certification

I, being duly sworn upon my oath, hereby represent that the foregoing information and any attachments thereto to the best of my knowledge are true and complete. I acknowledge: that I am authorized to execute this certification on behalf of the bidder/proposer; that the ***<name of contracting unit>*** is relying on the information contained herein and that I am under a continuing obligation from the date of this certification through the completion of any contracts with ***<type of contracting unit>*** to notify the ***<type of contracting unit>*** in writing of any changes to the information contained herein; that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification, and if I do so, I am subject to criminal prosecution under the law and that it will constitute a material breach of my agreement(s) with the, permitting the ***<type of contracting unit>*** to declare any contract(s) resulting from this certification void and unenforceable.

Full Name (Print):		Title:	
Signature:		Date:	

SUBCONTRACTOR DECLARATION

Each bidder shall set forth in the bid the names, addresses and license number (when required) of each subcontractor for the furnishing of plumbing, and gas fitting and all kindred work, and of the steam power plants, steam and hot water heating and ventilating and refrigeration apparatus and all kindred work, steam power plants and kindred work, and electrical work, including any electrical power plants, tele-data, fire alarm, or security system, and structural steel and ornamental iron work, if any, for the construction, alteration or repair of any public buildings.

A general contractor that intends to utilize a specific subcontractor to perform work in one or more of the specialty trade categories shall provide the required information with regard to that subcontractor in the appropriate space for each specialty trade category applicable to the contract

Whenever a bid sets forth more than one subcontractor for any of the categories listed below, the bidder shall submit to the contracting unit a certificate signed by the bidder listing each subcontractor named in the bid for that category. The certificate shall set forth the scope of work, goods and services for which the subcontractor has submitted a price quote and which the bidder has agreed to award to each subcontractor should the bidder be awarded the contract. The certificate shall be submitted to the contracting unit simultaneously with the list of the subcontractors. The certificate may take the form of a single certificate listing all subcontractors or, alternatively, a separate certificate may be submitted for each subcontractor. If a bidder does not submit a certificate or certificates to the contracting unit, the contracting unit shall award the contract to the next lowest responsible bidder.

All bidders seeking to perform plumbing work on a publicly bid contract are required to comply with N.J.S.A. 45:14C-2 and N.J.A.C. 13:32-1.3. These provisions require that plumbing work on such contract may only be performed by an entity in which a licensed master plumber owns not less than 10% of the issued and outstanding shares of stock in the corporation, or not less than 10% of the capital of the partnership, or not less than 10% of the ownership of any other firm or legal entity. Accordingly, if a bidder intends to perform plumbing work on a publicly bid contract with its own employees or by the bidder himself, a master plumber must possess an ownership interest that complies with N.J.S.A. 45:14C-2 and N.J.A.C. 13:32-1.3 in the entity submitting the bid. Alternately, if a bidder intends to perform such work through a subcontractor, a master plumber must possess an ownership interest that complies with N.J.S.A. 45:14C-2 and N.J.A.C. 13:32-1.3 in the subcontractor.

There shall be submitted proof that each subcontractor is qualified in accordance with the rules and regulations of the State of New Jersey when such rules and regulations exist.

A general contractor that intends to perform work in one or more of the specialty trade categories through the use of its own employees or the general contractor himself rather than through the utilization of a subcontractor shall write the word "**IN-HOUSE**" next to each applicable category and then insert the name, and license number where required, of each such employee of the general contractor or the general contractor himself in the appropriate spaces for each specialty trade category applicable to the contract.

If the contract does not involve the any of the specialty trade categories below, please insert the word "**NONE**" in each appropriate space provided.

Plumbing Work: _____

Name _____ Phone # _____
Address _____
License Number: _____

Gas Fitting and All Kindred Work: _____

Name _____ Phone # _____
Address _____
License Number: _____
Certification Number (for Medical Gas Piping Installation): _____

Steam Power Plants, Steam and Hot Water Heating and Ventilating and Refrigeration Apparatus and all Kindred Work:

Name _____ Phone # _____
Address _____
License Number: _____

Electrical Work, including any Electrical Power Plants _____

Name _____ Phone # _____
Address _____
License Number: _____

Tele-data Systems: _____

Name _____ Phone # _____
Address _____
License Number: _____
Telecommunications Exemption (Provide copy of letter and ID card) Number: _____

Fire Alarm Systems: _____

Name _____ Phone # _____
Address _____
License Number: _____
Fire Protection Equipment Business or Fire Protection Contractor Business Permit Number: _____

Security Systems: _____

Name _____ Phone # _____
Address _____
License Number: _____

Structural Steel and Ornamental Iron Work:

Name _____ Phone # _____
Address _____
License Number: Not Applicable

BID SECURITY

Attach bid bond, cashier's check or certified check in the amount of 10% of the bid, but not in excess of $20,000.00.

CONSENT OF SURETY

Attach Consent of Surety from a Surety Company, meeting the requirements, described herein, stating that if the bidder is awarded the contract that the surety company will supply the bonds for the contract.

1. Must be an irrevocable, unconditional commitment by the surety to issue on behalf of the bidder the bond or bonds set forth in the contract documents upon award of the project in the full amounts specified.
2. Must include all bonds required by the contract documents i.e. performance, labor and material payment, maintenance, environmental, etc.
3. Certificate (Consent) of Surety is not waiveable and will be considered a material defect resulting in rejection of bid if omitted from bid package.
4. Must not contain any provision that would serve to limit the surety's liability to the "spread to second" bidder in the event the bidder fails to enter into a contract upon award.

Sample wording is as shown below:

CONSENT OF SURETY

KNOW ALL MEN BY THESE PRESENTS, that for and consideration of the sum of $_____, lawful money of the United States of America, the receipt whereof is hereby acknowledged, paid the undersigned, and for other valuable consideration, the

SAMPLE

_____ Insurance Company,

(Name)

_____

(Address)

existing under the laws of the State of New Jersey and licensed to do business in the State of New Jersey certifies and agrees, that if the contract for (Contracting Agency)_____
for: (Project)_____
is awarded to (Bidder)_____
the undersigned will execute the bond or bonds as required of the contract documents and will become Surety in the full amount set forth in the contract documents for the faithful performance of all obligations of the Bidder, provided however, that this commitment shall expire sixty (60) days from the bid opening, unless agreed upon by Bidder, Owner and Surety to be extended.

Signed, sealed and dated this _____ day of _____, 20_____.

_____ INSURANCE COMPANY
(Name)

By _____
(Name)
Attorney in Fact

(To be accompanied by the usual proof of Authority of Officers of officers of the Surety Company to execute same)

PUBLIC WORKS CONTRACTOR REGISTRATION FORM

N.J.S.A. 34:11-56.48 requires that contractors and subcontractors, be registered with the New Jersey Department of Labor, Division of Wage and Hour Compliance. The definition in the law is as follows:

"Contractor means a person, partnership, association, joint stock company, trust, corporation, or other legal business entity or successor thereof who enters into a contract which is subject to the provisions of the "New Jersey Prevailing Wage Act, N.J.S.A. 34:11-56.25 et seq. and includes any subcontractor or lower tier subcontractor of a contractor as defined herein."

1. All named contractors in a bid proposal (including out-of-state contractors) must be registered with the Department of Labor's Division of Wage and Hour Compliance at the time proposals are received by the public entity.
2. All named sub-contractors must be registered with the Department of Labor pursuant to the PWCRA at the time the proposal is received, or the proposal will be determined to be non-responsive.
3. Any non-listed sub-contractor must be registered with the Department of Labor prior to physically starting work.
4. The law requires contractors to submit certificates after a bid proposal is received and prior to awarding the contract. (N.J.S.A. 34:11-56.55)
5. After bid proposals are received, and prior to contract award, the contractor must submit to the public entity copies of certifications of all listed sub-contractors.
6. Prior to the work being performed by non-listed subcontractors, the contractor must submit to the public entity copies of certifications of all non-listed subcontractors.

Please indicate below, for the bidder and all subcontractors listed on the "Subcontractor Declaration" herein, as to their registration with the NJ Department of Labor, Division of Wage and Hour Compliance in accordance with N.J.S.A. 34:11-56.48.

Name	Not Registered	Registration Number
Bidder_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____

Subscribed and sworn
before me this _____ day
of _____ 20 ___.

_____

Notary Public of _____

My Commission Expires _____, 20_____.
(Seal)

_____
Signature

_____
Name and Title
(Type or Print)

NEW JERSEY "BUSINESS REGISTRATION CERTIFICATE" FORM

N.J.S.A. 52:32-44 requires that Business Organization's, be registered with the New Jersey Department of Treasury, Division Revenue. The definition in the law is as follows:

""Contractor" means a business organization that seeks to enter, or has entered into, a contract with a contracting agency;

"Contract" means any agreement, including but not limited to a purchase order or a formal agreement for the provision of goods, performance of services, or construction of a construction project, which is a legally binding relationship enforceable by law, between a contractor and a contracting agency that agrees to compensate the contractor, as defined by and subject to the terms and conditions of the agreement; and where the goods that are received, services that are delivered, and construction that is constructed is within the geographic borders of the State of New Jersey; and where:

(1) the value of a single contract with the contractor is in excess of 15 percent of the amount of the contracting agency's bid threshold; or

(2) when the aggregate amount of contracts with the contractor, during the fiscal year of the contracting agency, exceeds 15 percent of the amount of the contracting agency's bid threshold.

Please indicate below, for the bidder and all subcontractors listed on the "Subcontractor Declaration" herein, as to their registration with the NJ Department of Treasury, Division of Revenue in accordance with N.J.S.A. 52:32-44.

The contractor shall provide the contracting agency with the business registration certificate of the contractor and that of any named subcontractor prior to the time a contract, purchase order, or other contracting document is awarded or authorized.

Name	Not Registered	Registration Number
Bidder_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____
(Subcontractor)_____	___	_____

Subscribed and sworn
before me this _____ day
of _____ 20 ___.

_____

Notary Public of _____

My Commission Expires _____, 20_____.
(Seal)

_____
Signature

_____
Name and Title
(Type or Print)

BACKGROUND QUESTIONNAIRE

In accordance with paragraph entitled "Qualifications of Bidders" of "Information for Bidders", provide the following information:

Date of Organization of Company _____

Name and address of officers:_____

President_____
Vice President_____
Secretary_____
Treasurer_____

EXPERIENCE

1. How many years has your organization been in business as a general contractor under your present business name? _____

2. How many years experience in this type of construction work has your organization had? _____

3. What are the latest projects (within the last five years) your organization has completed? (Attach additional pages if necessary)

	Contract Amount	Date Work Completed	For Whom
A.	$_____	_____	_____
B.	$_____	_____	_____
C.	$_____	_____	_____
D.	$_____	_____	_____
E.	$_____	_____	_____

Names, Addresses and Telephone Numbers of Reference for items listed above:

	Name and Address	Telephone No.
A.	_____	_____
B.	_____	_____
C.	_____	_____

	Name and Address	Telephone No.
D.	_____	_____
E.	_____	_____

4. Have you ever failed to complete any work awarded to you (within the last ten years)?_____
If so, where and why?_____
_____

5. Have you or has any officer of your organization ever been an officer or partner of some other contracting organization that failed to complete any work (within the last ten years) ?_____
If so, state the name of individual, position and the name of the other organization
_____

_____

Did this other contracting organization ever fail to complete any work awarded it (within the last ten years)? _____
If so, where and why?_____

6. Give list of uncompleted contracts at present held by you:

Name of Contract	Contracting Agency	Amount
_____		$_____
_____		$_____
_____		$_____

Name of Contract	Contracting Agency	Amount
_____		$_____
_____		$_____

7. State approximately the largest amount of work you have done in any one year (within the last five years) of a similar nature to the work being bid on.

_____

_____

8. List the equipment available for the performance of work under the proposed contract (attach additional sheets if necessary)

_____

_____

_____

_____

_____

_____

DEBARRED LIST AFFIDAVIT

STATE OF _____

COUNTY OF _____ ss:

I, _____ of the City/Town/Township/Borough, etc. _____ in the County of _____ and the State of _____ full age, being duly sworn according to law on my oath depose and say that:
I am _____ an officer of the firm of _____ _____ the bidder making the bid for the above named work, and that I executed said bid with full authority to do so; that said bidder at the time of making of this bid is not debarred at the federal level from contracting with a federal government agency as indicated in N.J.S.A. 52:32-44.1 or included on the State of New Jersey, State Treasurer's List of Debarred, Suspended and Disqualified Bidders; and that all statements contained in said bid and in this affidavit are true and correct, and made with the full knowledge that the _____ ,
(name of the contracting agency)
as the Owner relies upon the truth of the statements contained in said bid and in the statements contained in this affidavit in awarding the contract for said work.

The undersigned further warrants that should the name of the firm making this bid be debarred at the federal level from contracting with a federal government agency or appear on the State Treasurer's List of Debarred, Suspended and Disqualified Bidders at anytime prior to, and during the life of this Contract, including Guarantee Period, that the Local Unit shall be immediately so notified by the signatory of this Eligibility Affidavit.

The undersigned understands that the firm making the bid as Contractor is subject to debarment, suspension and/or disqualification in contracting with the State of New Jersey, if the Contractor, pursuant to N.J..A.C. 12:60-7.1 et seq., commits any of the acts listed therein, and as determined according to applicable law and regulation.

_____

_____

_____
(Insert Name, Telephone No., Fax No. and Address of Contractor)

_____
(Insert Name and Title of Affiant)

Subscribed and sworn
before me this _____ day
of _____ 20 __ .

_____

Notary Public of _____

My Commission Expires _____ , 20 ___.
(Seal)

NON-COLLUSION AFFIDAVIT

STATE OF _____

COUNTY OF _____ ss:

I, _____ of the (City, Town, Township, Borough, etc.)

of _____ in the County of _____ and the

State of _____, of full age, being duly sworn

according to law on my oath depose and say that:

I am _____
of the firm of _____
the bidder making the Proposal for the above named project, and that I executed the said Proposal with full authority to do so; that said bidder had not, directly or indirectly, entered into any agreement(s), participated in any collusion, or otherwise taken any action in restraint of free, competitive bidding in connection with the above named project; and that all statements contained in said Proposal and in this affidavit are true and correct, and made with full knowledge that the _____ relies upon the truth of the statements
(name of contracting agency)
contained in said Proposal and in this affidavit in awarding the contract for the said Project.

I further warrant that no person(s) or selling agency has been employed or retained to solicit, or secure such contract upon an agreement or understanding for a commission, percentage, brokerage or contingent, fee except bona fide employees or bona fide established commercial or selling agencies maintained by

_____.
(name of bidder)

_____

_____

_____
(Insert Name, Telephone No., Fax No. and Address of Contractor)

_____
(Insert Name and Title of Affiant)

Subscribed and sworn
before me this _____ day
of _____ 20 __ .

_____

Notary Public of _____

My Commission Expires _____ , 20 ___.
(Seal)

AFFIRMATIVE ACTION REQUIREMENTS

CONSTRUCTION CONTRACTS

"Bidder is required to comply with the requirements of N.J.S.A. 10:5-31 et seq. and N.J.A.C. 17:27.

1. All successful contractor(s) must submit, to the agencies named below, after notification of award but prior to the signing of the contract an Initial Project Workforce Report (Form AA201) for any contract award that meets or exceeds the Public Agency bidding threshold.

2. The successful contractor(s) must submit the appropriate copies of the Initial Project Workforce Report (Form AA201) to the Division of Contract Compliance and the appropriate copy to the Public Agency.

3. The successful contractor(s) must submit a copy of the Monthly Workforce Report (Form AA 202) once a month thereafter for the duration of this contract to the Division and to the public agency compliance officer.

The undersigned certifies that he/she is aware of the commitment to comply with the requirements of N.J.S.A. 10:5-31 et seq. and N.J.A.C. 17:27 and agrees to furnish the required forms of evidence.

The undersigned further understands that his/her bid may be rejected as non-responsive if the requirements of N.J.S.A. 10:5-31 et seq. and N.J.A.C. 17:27 are not complied with.

_____

_____

_____
(Insert Name, Telephone No., Fax No. and Address of Contractor)

_____
(Insert Name and Title of Affiant)

Subscribed and sworn
before me this _____ day
of _____ 20 __ .

_____

Notary Public of _____

My Commission Expires _____ , 20 ___.
(Seal)

CERTIFICATE OF BIDDER SHOWING ABILITY TO PERFORM CONTRACT

STATE OF _____

COUNTY OF _____ ss:

I, _____ of the (City, Town, Township, Borough, etc.)

of _____ in the County of _____ and the

State of _____ of full age, being duly sworn

according to law on my oath depose and say that:

1. I am a(n) owner, partner, shareholder or officer of the company set forth below and am duly authorized to execute this affidavit on its behalf.

(Check appropriate Statement(s))

_____ I own, lease or control the necessary equipment required by the plans, specifications, and advertisements under which bids are asked for.

_____ I do not own, lease or control all the necessary equipment required by the plans, specifications, and advertisements under which bids are asked for.
If the bidder is not the actual owner or lessee of all the necessary equipment provide the source from which the equipment will be obtained (Attach additional sheets if necessary)

_____

_____

_____

(Attach certification from the owner or person in control of the equipment definitely granting to the bidder the control of the equipment required during such time as may be necessary for the completion of that portion of the contract for which it is necessary)

_____

_____

_____

(Insert Name, Telephone No., Fax No. and Address of Contractor)

_____

(Insert Name and Title of Affiant)

Subscribed and sworn
before me this _____ day
of _____ 20 __ .

_____

Notary Public of _____

My Commission Expires _____ , 20 ___.
(Seal)

DISCLOSURE OF INVESTMENT ACTIVITIES IN IRAN

PART 1: CERTIFICATION

BIDDERS MUST COMPLETE PART 1 BY CHECKING EITHER BOX.

In accordance with Public Law 2012, c. 25, any person or entity that submits a bid or proposal or otherwise proposes to enter into or renew a contract must complete the certification below to attest, under penalty of perjury, that neither the person or entity, nor any of its parents, subsidiaries, or affiliates, is identified on the Department of Treasury's Chapter 25 list as a person or entity engaging in investment activities in Iran.
The Chapter 25 list is found on the Division's website at http://www.state.nj.us/treasury/purchase/pdf/Chapter25List.pdf. Bidders **must** review this list prior to completing the below certification. **This certification shall be completed, certified to, and submitted to the contracting unit prior to contract award.** If the Director finds a person or entity to be in violation of law, s/he shall take action as may be appropriate and provided by law, rule or contract, including but not limited to, imposing sanctions, seeking compliance, recovering damages, declaring the party in default and seeking debarment or suspension of the party.

PLEASE CHECK EITHER BOX:

☐ **I certify, pursuant to Public Law 2012, c. 25, that neither the person/entity listed below nor any of the entity's parents, subsidiaries, or affiliates is listed** on the N.J. Department of the Treasury's list of entities determined to be engaged in prohibited activities in Iran pursuant to P.L. 2012, c. 25 ("Chapter 25 List"). I further certify that I am the person listed below, or I am an officer or representative of the entity listed below and am authorized to make this certification on its behalf. **I will skip Part 2 and sign and complete the Certification**

OR

☐ **I am unable to certify as above because I or the bidding entity and/or one or more of its parents, subsidiaries, or affiliates is listed on the Department's Chapter 25 list. I will provide a detailed, accurate and precise description of the activities in Part 2 below and sign and complete the Certification below.** Failure to provide such will result in the proposal being rendered as non-responsive and appropriate penalties, fines and/or sanctions will be assessed as provided by law.

Part 2

PLEASE PROVIDE FURTHER INFORMATION RELATED TO INVESTMENT ACTIVITIES IN IRAN
You must provide a detailed, accurate and precise description of the activities of the bidding person/entity, or one of its parents, subsidiaries or affiliates, engaging in the investment activities in Iran outlined above by completing the boxes below.

PROVIDE INFORMATION RELATIVE TO THE ABOVE QUESTIONS. PLEASE PROVIDE THOROUGH ANSWERS TO EACH QUESTION. IF YOU NEED TO MAKE ADDITIONAL ENTRIES, USE ADDITIONAL PAGES

Name:_____ Relationship to Bidder/Vendor:_____

Description of Activities:

_____

_____

Duration of Engagement:_____Anticipated Cessation Date_____

Bidder/Vendor_____

Contact Name:_____Contact Phone Number:_____

Certification: I, being duly sworn upon my oath, hereby represent and state that the foregoing information and any attachments thereto to the best of my knowledge are true and complete. I attest that I am authorized to execute this certification on behalf of the below-referenced person or entity. I acknowledge that the_____ (CONTRACTING AGENCY) is relying on the information contained herein and thereby acknowledge that I am under a continuing obligation from the date of this certification through the completion of contracts with the_____ (CONTRACTING AGENCY) to notify the _____(CONTRACTING AGENCY) in writing of any changes to the answers of information contained herein. I acknowledge that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification, and if I do so, I recognize that I am subject to criminal prosecution under the law and that it will also constitute a material breach of my agreements(s) with the _____ (CONTRACTING AGENCY) and that the _____ (CONTRACTING AGENCY) at its option may declare any contract(s) resulting from this certification void and unenforceable.

Full Name (Print): _____Signature:_____

Title: _____Date:_____

Bidder/Vendor: _____

PROHIBITED RUSSIA-BELARUS ACTIVITIES

Person or Entity: _____

Part 1: Certification

COMPLETE PART 1 BY CHECKING **ONE OF THE THREE BOXES BELOW**

Pursuant to law, any person or entity that is a successful bidder or proposer, or otherwise proposes to enter into or renew a contract, for goods or services must complete the certification below prior to contract award to attest, under penalty of perjury, that neither the person or entity, nor any parent entity, subsidiary, or affiliate, is identified on the Department of Treasury's Russia-Belarus list. Before a contract for goods or services can be amended or extended, a person or entity must certify that neither the person or entity, nor any parent entity, subsidiary, or affiliate, is identified on the Department of Treasury's Russia-Belarus list. The list is found on Treasury's website at the following web address:

https://www.nj.gov/treasury/administration/pdf/RussiaBelarusEntityList.pdf

As applicable to the type of contract, the above-referenced list must be reviewed prior to completing the below certification.

A person or entity unable to make the certification must provide a detailed, accurate, and precise description of the activities of the person or entity, or of a parent entity, subsidiary, or affiliate, engaging in prohibited activities in Russia or Belarus. The person or entity must cease engaging in any prohibited activities and provide an updated certification before the contract can be entered into.

If a vendor or contractor is found to be in violation of law, action may be taken as appropriate and as may be provided by law, rule, or contract, including but not limited to imposing sanctions, seeking compliance, recovering damages, declaring the party in default, and seeking debarment or suspension of the party.

CONTRACT AWARDS AND RENEWALS

☐ I certify, pursuant to law, that neither the person or entity listed above, nor any parent entity, subsidiary, or affiliate appears on the N.J. Department of Treasury's lists of entities engaged in prohibited activities in Russia or Belarus pursuant to P.L. 2022, c. 3. I further certify that I am the person listed above, or I am an officer or representative of the entity listed above and am authorized to make this certification on its behalf. (Skip Part 2 and sign and complete the Certification below.)

CONTRACT AMENDMENTS AND EXTENSIONS

☐ I certify, pursuant to law, that neither the person or entity listed above, nor any parent entity, subsidiary, or affiliate is listed on the N.J. Department of the Treasury's lists of entities determined to be engaged in prohibited activities in Russia or Belarus pursuant to P.L. 2022, c. 3. I further certify that I am the person listed above, or I am an officer or representative of the entity listed above and am authorized to make this certification on its behalf. (Skip Part 2 and sign and complete the Certification below.)

IF UNABLE TO CERTIFY

☐ I am unable to certify as above because the person or entity and/or a parent entity, subsidiary, or affiliate is listed on the Department's Russia-Belarus list. I will provide a detailed, accurate, and precise description of the activities as directed in Part 2 below, and sign and complete the Certification below. Failure to provide such will prevent the award of the contract to the person or entity, and appropriate penalties, fines, and/or sanctions will be assessed as provided by law.

Part 2: Additional Information

PLEASE PROVIDE FURTHER INFORMATION RELATED TO PROHIBITED ACTIVITIES IN RUSSIA OR BELARUS.

You must provide a detailed, accurate, and precise description of the activities of the person or entity, or of a parent entity, subsidiary, or affiliate, engaging in prohibited activities in Russia or Belarus in the space below and, if needed, on additional sheets provided by you.

_____

_____

_____

_____

_____

_____

Part 3: Certification of True and Complete Information

I, being duly sworn upon my oath, hereby represent and state that the foregoing information and any attachments there, to the best of my knowledge, are true and complete. I attest that I am authorized to execute this certification on behalf of the above-referenced person or entity.

I acknowledge that the <**Name of Contracting Unit**> is relying on the information contained herein and hereby acknowledge that I am under a continuing obligation from the date of this certification through the completion of any contracts with the <**Name of Contracting Unit**> to notify the <**Name of Contracting Unit**> in writing of any changes to the answers of information contained herein.

I acknowledge that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification. If I do so, I recognize that I am subject to criminal prosecution under the law and that it will also constitute a material breach of my agreement(s) with the <**Name of Contracting Unit**> and that the <**Name of Contracting Unit**> at its option may declare any contract(s) resulting from this certification void and unenforceable.

Full Name :_____ **Title:**_____
(Print)

Signature :_____ **Date:**_____

CERTIFICATION OF NON-DEBARMENT
FOR FEDERAL GOVERNMENT CONTRACTS
N.J.S.A. 52:32-44.1 (P.L. 2019, c.406)

This certification shall be completed, certified to, and submitted to the contracting unit prior to contract award, except for emergency contracts where submission is required prior to payment.

PART I: VENDOR INFORMATION	
Individual or Organization Name	
Address of Individual or Organization	
Unique Entity ID (if applicable)	
CAGE Code (if applicable)	
Check the box that represents the type of business organization:	

☐Sole Proprietorship (skip Parts III and IV) ☐Non-Profit Corporation (skip Parts III and IV)

☐For-Profit Corporation (any type) ☐Limited Liability Company (LLC) ☐Partnership

☐Limited Partnership ☐Limited Liability Partnership (LLP)

☐Other (be specific): _____

PART II – CERTIFICATION OF NON-DEBARMENT: Individual or Organization			
I hereby certify that the **individual or organization listed above in Part I** is not debarred by the federal government from contracting with a federal agency. I further acknowledge: that I am authorized to execute this certification on behalf of the above-named organization; that the ***<name of contracting unit>*** is relying on the information contained herein and that I am under a continuing obligation from the date of this certification through the date of contract award by ***<type of contracting unit>*** to notify the ***<type of contracting unit>*** in writing of any changes to the information contained herein; that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification, and if I do so, I am subject to criminal prosecution under the law and that it will constitute a material breach of my agreement(s) with the ***<type of contracting unit>***, permitting the ***<type of contracting unit>*** to declare any contract(s) resulting from this certification void and unenforceable.			
Full Name (Print):		Title:	
Signature:		Date:	

PART III – CERTIFICATION OF NON-DEBARMENT: Individual or Entity Owning Greater than 50 Percent of Organization	
Section A (Check the Box that applies)	
☐	Below is the name and address of the stockholder in the corporation who owns more than 50 percent of its voting stock, or of the partner in the partnership who owns more than 50 percent interest therein, or of the member of the limited liability company owning more than 50 percent interest therein, as the case may be.
Name of Individual or Organization	
Physical Address	
OR	
☐	No one stockholder in the corporation owns more than 50 percent of its voting stock, or no partner in the partnership owns more than 50 percent interest therein, or no member in the limited liability company owns more than 50 percent interest therein, as the case may be.
Section B (Skip if no Business entity is listed in Section A above)	
☐	Below is the name and address of the stockholder in the corporation who owns more than 50 percent of the voting stock of the organization's parent entity, or of the partner in the partnership who owns more than 50 percent interest in the organization's parent entity, or of the member of the limited liability company owning more than 50 percent interest in organization's parent entity, as the case may be.
Stockholder/Partner/Member Owning Greater Than 50 Percent of Parent Entity	
Physical Address	
OR	
☐	No one stockholder in the parent entity corporation owns more than 50 percent of its voting stock, no partner in the parent entity partnership owns more than 50 percent interest therein, or no member in the parent entity limited liability company owns more than 50 percent interest therein, as the case may be.

Section C – Part III Certification			
I hereby certify that no individual or organization that is debarred by the federal government from contracting with a federal agency owns greater than 50 percent of the **Organization listed above in Part I** or, if applicable, owns greater than 50 percent of a parent entity of _____. (name of organization) I further acknowledge: that I am authorized to execute this certification on behalf of the above-named organization; that the ***<name of contracting unit>*** is relying on the information contained herein and that I am under a continuing obligation from the date of this certification through the date of contract award ***<type of contracting unit>*** to notify the ***<type of contracting unit>*** in writing of any changes to the information contained herein; that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification, and if I do so, I am subject to criminal prosecution under the law and that it will constitute a material breach of my agreement(s) with the ***<type of contracting unit>***, permitting the ***<type of contracting unit>*** to declare any contract(s) resulting from this certification void and unenforceable.			
Full Name (Print):		Title:	
Signature:		Date:	

Part IV – CERTIFICATION OF NON-DEBARMENT: Contractor – Controlled Entities		
Section A		
☐	Below is the name and address of the corporation(s) in which the **Organization listed in Part I** owns more than 50 percent of voting stock, or of the partnership(s) in which the **Organization listed in Part I** owns more than 50 percent interest therein, or of the limited liability company or companies in which the **Organization listed above in Part I** owns more than 50 percent interest therein, as the case may be.	
Name of Business Entity		**Physical Address**
Add additional sheets if necessary		
OR		
☐	The **Organization listed above in Part I** does not own greater than 50 percent of the voting stock in any corporation and does not own greater than 50 percent interest in any partnership or any limited liability company.	

Section B (skip if no business entities are listed in Section A of Part IV)	
☐	Below are the names and addresses of any entities in which an entity listed in Part III A owns greater than 50 percent of the voting stock (corporation) or owns greater than 50 percent interest (partnership or limited liability company).

Name of Business Entity Controlled by Entity Listed in Section A of Part IV	Physical Address

Add additional Sheets if necessary

OR

☐	No entity listed in Part III A owns greater than 50 percent of the voting stock in any corporation or owns greater than 50 percent interest in any partnership or limited liability company.

Section C – Part IV Certification

I hereby certify that the **Organization listed above in Part I** does not own greater than 50 percent of any entity that that is debarred by the federal government from contracting with a federal agency and, if applicable, does not own greater than 50 percent of any entity that in turns owns greater than 50 percent of any entity debarred by the federal government from contracting with a federal agency. I further acknowledge: that I am authorized to execute this certification on behalf of the above-named organization; that the ***<name of contracting unit>*** is relying on the information contained herein and that I am under a continuing obligation from the date of this certification through the date of contract award by ***<type of contracting unit>*** to notify the ***<type of contracting unit>*** in writing of any changes to the information contained herein; that I am aware that it is a criminal offense to make a false statement or misrepresentation in this certification, and if I do so, I am subject to criminal prosecution under the law and that it will constitute a material breach of my agreement(s) with the ***<type of contracting unit>***, permitting the ***<type of contracting unit>*** to declare any contract(s) resulting from this certification void and unenforceable.

Full Name (Print):		Title:	
Signature:		Date:	

LOWEST BIDDER PREVAILING WAGE CERTIFICATION

In the matter of an award of a contract for public work for a project described as:	)	STATE OF NEW JERSEY DEPARTMENT OF LABOR AND WORKFORCE DEVELOPMENT DIVISION OF
[Enter project name]	)	WAGE & HOUR COMPLIANCE
	)	
	)	
	)	Certification of Lowest Bidder

_____, of full age and under oath, duly provides the following sworn statement:

(1). I am the owner and/or highest-ranking official or officer of a company or firm named_____, which holds a currently valid public works contractor registration pursuant to the New Jersey Public Works Contractor Registration Act, N.J.S.A. 34:11-56.48 et seq., certificate number_____.

(2). I submitted a bid for a contract award in the above identified project and the public body has informed me that I am the lowest bidder by 10 percent or more as compared to the next lowest bid submitted.

(3). The amount of my bid does include paying the prevailing wage rate to all workers who perform work on the project at rates of pay, including both base wage and fringe benefits, set forth in applicable Wage Determinations, (1) for the appropriate locality, (2) for the appropriate work classification (e.g., carpenter, electrician, mason, plumber), and (3) for the appropriate job title (e.g., Apprentice, Journeyman, Forman), published by the New Jersey Department of Labor and Workforce Development (NJDOL) pursuant to the New Jersey Prevailing Wage Act (NJPWA), N.J.S.A. 34:11-56.25 et seq., and corresponding NJDOL rules, N.J.A.C. 12:60.

I certify under penalty of perjury that the foregoing statements made by me are true. I am aware that if any of the foregoing statements made by me are false, I am subject to punishment. See N.J.S.A. 2C:28-1 et seq., specifically, N.J.S.A. 2C:28-3, within the New Jersey Code of Criminal Justice.

Dated:_____ Signature:_____

Title:_____

BID FORM

Pursuant to and in compliance with your Advertisement for Bids and the Information for Bidders relating thereto, the undersigned hereby offers to furnish all plant, labor, materials, supplies, equipment and other facilities and things necessary for, or proper for, or incidental to the ELSA PEMB, as required by, and in strict accordance with the applicable provisions of plans and specifications and all addenda issued by the ELSA or its Engineer prior to the date of opening the bids, whether received by the undersigned or not, for the amount bid based on the following unit and/or lump-sum prices:

NOTE: Extension of Unit Prices must be exact.

BASE BID

Item	Qty	Units	Description	Unit Price	Amount
1	1	LS	MOBILIZATION	$	$
2	1	LS	SITE WORK	$	$
3	1	LS	SITE PIPING	$	$
4	1	LS	CONCRETE WORK	$	$
5	1	LS	PRE-ENGINEERED GARAGE METAL BUILDING	$	$
6	1	LS	MECHANICAL SYSTEMS	$	$
7	1	LS	ELECTRICAL SYSTEMS	$	$
8	1	LS	PLUMBING SYSTEMS	$	$
9	1	LS	FIRE ALARM SYSTEM	$	$
10	1	LS	FIRE RATED WALL SYSTEM	$	$
11	1	LS	LIGHTNING PROTECTION SYSTEM	$	$
12	1	LS	ALLOWANCES - GENERAL	$ 120,000.00	$ 120,000.00
13	1	LS	PROJECT CLOSEOUT (Min. Bid = $10,000.00)	$	$

Item	Qty	Units	Description	Unit Price	Amount

TOTAL AMOUNT BID BASED ON ESTIMATED QUANTITIES, BASE BID Items #1 - #13, Inclusive: $ _____

TOTAL AMOUNT BID WRITTEN OUT

_____

SIGNATURE **NAME & TITLE (TYPE OR PRINT)**

_____

BID DATE **COMPANY NAME**

TABLE OF CONTENTS
INFORMATION FOR BIDDERS

		PAGE NO.
1.0 BID PREPARATION		
1.01	Examination and Responsibility	IFB-1
1.02	Condition of Work	IFB-1
1.03	Obligations of Bidders	IFB-1
1.04	Addenda, Bid Specification Challenges and Interpretations	IFB-1
1.05	Qualifications of Bidders	IFB-2
1.06	Disclosure Statement N.J.S. A. 52:25-24.2	IFB-2
1.07	Manufactured Articles	IFB-2
1.08	Bid Security and Consent of Surety	IFB-3
1.09	New Jersey Business Registration Requirements	IFB-3
2.0 SUBMISSION OF BIDS		
2.01	General	IFB-4
2.02	Price to Include	IFB-4
2.03	Rejection of Bids	IFB-5
2.04	Award of Bid	IFB-5
3.0 CONTRACTS		
3.01	Drawings and Specifications Furnished	IFB-5
3.02	Performance, Payment and Maintenance Bonds	IFB-5
3.03	Laws and Regulations	IFB-6
3.04	Permits	IFB-6
3.05	Contract Documents	IFB-6
3.06	Notice to Proceed	IFB-6
4.0 AFFIRMATIVE ACTION AGAINST DISCRIMINATION		
4.01	Bidder Referred to Law	IFB-7
4.02	Specific Language Required	IFB-7
4.03	Contract Procedures	IFB-10
4.04	Equal Opportunity for Individuals with Disabilities	IFB-10
5.0 FORM OF CONTRACT		IFB-12
6.0 CERTIFICATE OF INSURANCE		IFB-14

INFORMATION FOR BIDDERS

1.0 BID PREPARATION

1.01 EXAMINATION AND RESPONSIBILITY

Bidders are directed to examine for themselves the drawings, specifications, estimated quantities and the location of the proposed work. They shall exercise their own judgment as to the scope and nature of the work; the difficulties to be encountered and the quantities that may actually be encountered in the work. Each bidder is fully responsible for having reviewed and understood these specifications previous to submitting his bid, that his bid covers and complies with all requirements of the Contract Documents, and shall not at any time thereafter assert any claim related to any misunderstanding of the nature or amount of work to be done.

1.02 CONDITION OF WORK

Each bidder must inform himself fully of the conditions relative to the construction under which the work is now being or will be performed. Failure to do so will not relieve a successful bidder of his obligation to furnish all materials and labor necessary to carry out the provisions of the contract documents and to complete the contemplated work for the construction as set forth in his bid. The Contractor in the carrying out of his work must employ such methods or means that will not cause any interruptions or interference with the work of any other contractor (if applicable).

1.03 OBLIGATIONS OF BIDDERS

At the time of the opening of bids each bidder will be presumed to have inspected the site and to have read and to be thoroughly familiar with the drawings and contract documents (including all addenda). The failure or omission of any bidder to receive or examine any form, instrument or documents, shall in no way relieve any bidder from any obligations contained therein.

1.04 ADDENDA, BID SPECIFICATION CHALLENGES AND INTERPRETATIONS

The Table of Contents indicates the number of pages of each section of the document. If any bidder finds that a page was miss-copied or is missing, please contact the Engineer. The page(s) will be faxed to the bidder. Issuance of any such pages will not be considered an Addendum to the contract or specifications.

No interpretations of the meaning of the drawings, specifications or other contract documents will be made to any bidder orally. Every request for such interpretation should be made in writing, addressed to the Engineer, and to be given consideration, must be received at least ten (10) days prior to the final date fixed for receiving bids. Any and all such interpretations and/or supplemental instructions will be in the form of written addenda to the specifications, which if issued, will be issued in accordance with applicable State Laws.

Any bidder who wishes to challenge a bid specification shall file such challenges in writing with the Engineer no less than three business days prior to the opening of the bids. Challenges filed after that time shall be considered void and having no impact on the contracting unit or the award of a contract.

Failure of any bidder to receive any such addendum or interpretations shall not relieve any bidder from any such obligations therein under his bid submitted. All addenda so issued shall become part of the contract documents, and shall be attached to the bid form when submitted

1.05 QUALIFICATIONS OF BIDDERS

The owner may make such investigation as is necessary to determine the responsibility of the bidder and/or the ability of the bidder to perform the work. The bidder shall furnish to the Owner all such information and data for this purpose as the Owner may request. The Owner reserves the right to reject any bid if evidence submitted by, or investigation of, such bidder fails to satisfy the Owner that said bidder is responsible or properly qualified to carry out the obligations of the contract and to complete the work therein contemplated.

Conditional bids will not be accepted. Bids which are incomplete or obscure may be rejected at Owner's option.

1.06 DISCLOSURE STATEMENT N.J.S.A. 52:25-24.2

No corporation, partnership, or limited liability company shall be awarded any contract nor shall any agreement be entered into for the performance of any work or the furnishing of any materials or supplies, the cost of which is to be paid with or out of any public funds, by the State, or any county, municipality or school district, or any subsidiary or agency of the State, or of any county, municipality or school district, or by any authority, board, or commission which exercises governmental functions, unless prior to the receipt of the bid or accompanying the bid, of said corporation, said partnership, or said limited liability company there is submitted a statement setting forth the names and addresses of all stockholders in the corporation who own 10 percent or more of its stock, of any class, or of all individual partners in the partnership who own a 10 percent or greater interest therein, or of all members in the limited liability company who own a 10 percent or greater interest therein, as the case may be. If one or more such stock holder or partner or member is itself a corporation or partnership or limited liability company, the stockholders holding 10 percent or more of that corporation's stock, or the individual partners owning 10 percent or greater interest in that partnership, or the members owning 10 percent or greater interest in that limited liability company, as the case may be, shall also be listed. The disclosure shall be continued until names and addresses of every noncorporate stockholder, and individual partner, and member, exceeding the 10 percent ownership criteria established in this act, has been listed.

To comply with this section, a bidder with any direct or indirect parent entity which is publicly traded may submit the name and address of each publicly traded entity and the name and address of each person that holds a 10 percent or greater beneficial interest in the publicly traded entity as of the last annual filing with the federal Securities and Exchange Commission or the foreign equivalent, and, if there is any person that holds a 10 percent or greater beneficial interest, also shall submit links to the websites containing the last annual filings with the federal Securities and Exchange Commission or the foreign equivalent and the relevant page numbers of the filings that contain the information on each person that holds a 10 percent or greater beneficial interest.

1.07 MANUFACTURED ARTICLES

In the specifications and on accompanying drawings, there are specified and shown certain pieces of equipment and materials, deemed most suitable for the service anticipated. This is not done, however, to eliminate other equipment and materials equally as good and efficient. When a bidder submits an equivalent, it shall be the responsibility of the bidder to document the equivalence claim. Failure to submit such documentation shall be grounds for the rejection of the claim of equivalence. The bidder shall prepare his bid on the basis of the particular equipment and materials specified or shown, and shall be responsible for the coordination, arrangement and location of all equipment and material incorporated in the work.

1.08 BID SECURITY AND CONSENT OF SURETY

Each bid shall be accompanied by a Certified Check, Cashier's Check or Bid Bond duly executed by the bidder as principal, and having as surety thereon a Surety Company approved by the Owner, in an amount not less than ten percent (10%) of the amount bid but in no case in excess of $20,000.00. Any such Bid Bond shall be without endorsement or conditions. Bid shall also be accompanied with a certificate letter from a surety company stating that it will provide the bidder with the requisite completion performance and payment bonds, i.e. a Consent of Surety.

Such bid guarantee will be returned to all bidders, except to the three apparent lowest responsible bidders, within ten days after the formal opening of bids, Sundays and holidays, excepted.

The bid guarantee will be returned to the remaining unsuccessful bidders within three days, Sundays and holidays excepted, after the Owner and the accepted bidder have executed the contract and the Owner has approved the Bidder's Performance Bond, or if no contract has been accepted within 60 days after the date of opening of bids, any bidder upon demand made after the expiration of said 60 day period, shall be entitled to the return of his bid guarantee, so long as he has not been notified by the Owner of the acceptance of his bid.

Any such bid guarantee shall be forfeited and become the property of the Owner if the bidder whose bid is accepted shall fail: to give a satisfactory performance bond and labor and material payment bond, or a combination performance and labor and material payment bond, and/or fails to execute a contract within ten (10) days after notice from the Owner to do so.

1.09 NEW JERSEY BUSINESS REGISTRATION REQUIREMENTS

Pursuant to N.J.S.A. 52:32-44, Contracting Agency is prohibited from entering into a contract with an entity unless the bidder/proposer/contractor, and each subcontractor that is required by law to be named in a bid/proposal/contract has a valid Business Registration Certificate on file with the Division of Revenue and Enterprise Services within the Department of the Treasury.

Prior to contract award or authorization, the contractor shall provide the Contracting Agency with its proof of business registration and that of any named subcontractor(s).

Subcontractors named in a bid or other proposal shall provide proof of business registration to the bidder, who in turn, shall provide it to the Contracting Agency prior to the time a contract, purchase order, or other contracting document is awarded or authorized.

During the course of contract performance:

(1) the contractor shall not enter into a contract with a subcontractor unless the subcontractor first provides the contractor with a valid proof of business registration.
(2) the contractor shall maintain and submit to the Contracting Agency a list of subcontractors and their addresses that may be updated from time to time.
(3) the contractor and any subcontractor providing goods or performing services under the contract, and each of their affiliates, shall collect and remit to the Director of the Division of Taxation in the Department of the Treasury, the use tax due pursuant to the Sales and Use Tax Act, (N.J.S.A. 54:32B-1 et seq.) on all sales of tangible personal property delivered into the State. Any questions in this regard can be directed to the Division of Taxation at (609)292-6400. Form NJ-REG can be filed online at http://www.state.nj.us/treasury/revenue/busregcert.shtml.

Before final payment is made under the contract, the contractor shall submit to the Contracting Agency a complete and accurate list of all subcontractors used and their addresses.

Pursuant to N.J.S.A. 54:49-4.1, a business organization that fails to provide a copy of a business registration as required, or that provides false business registration information, shall be liable for a penalty of $25 for each day of violation, not to exceed $50,000, for each proof of business registration not properly provided under a contract with a contracting agency.

2.0 SUBMISSION OF BIDS

2.01 GENERAL

Bidder must submit their bid on the respective "Bid Form and Package" included hereto.

No bid will be accepted or opened if received after the designated time for receipt.

For each bid made, all blank spaces in the Bid Form must be filled in, in ink, with the unit prices of the item and its extension. All bid forms submitted will be checked for arithmetic accuracy. In the event of a discrepancy between the unit price bid for any Pay Item and the extension shown for that item under the column of the Proposal Form designated "Amount," the unit price is to govern. Where a unit price is bid for a Pay Item, but no extension is provided, the Owner will provide the extension based on the unit price bid and the estimated quantity for that Pay Item. Where an extension is provided by the Bidder in the "Amount" column, but no unit price appears in the "Unit Price" column of the Proposal Form, the Owner will provide the unit price by dividing the "Amount" figure provided by the Bidder by the estimated quantity.

Award will be made on the basis of Total Contract Price. The Total Contract Price means the correctly determined summation of lump sum bids and products of all quantities for Pay Items shown in the Proposal form multiplied by the unit prices bid.

If there are minimum unit prices included in the bid form, those prices shall be the minimum acceptable unit price for the work. If bidder fails to exceed the minimum unit price in his bid, the unit price will be set to the minimum price stated on the bid form, with the appropriate increase to the extension of the unit price and total bid price.

Where no figure is provided by the Bidder in both the "Unit Price" and "Amount" columns for one or more Pay Items, or where no figure is provided in the "Amount" column for one or more lump sum Pay Items the Owner will consider the amount bid to be zero ($0.00) for that item.

Any bid may be submitted or withdrawn prior to the scheduled time for the opening of bids, or authorized postponement thereof. Any bid received after the time and date specified in the Notice to Bidders will not be considered. No bid may be withdrawn within 60 days after the actual date of opening thereof, unless otherwise provided for by law.

2.02 PRICE TO INCLUDE

The bid submitted must cover the entire cost of the contemplated construction and installation as illustrated on the drawings and in the manner and detail described in the specifications. The price bid for each item shall cover the entire cost of its installation, construction, and completion, including all materials, workmanship, and appurtenances necessary for its completion or as implied by illustration on the drawings, by description in the specifications, or to be reasonably inferred therefrom.

2.03 REJECTION OF BIDS

The owner reserves the right to reject all bids, to reject any bid or bids not complying with the specifications, and to waive any informality in any bid or bids if such waiver be deemed by the Owner to be in the best interests of the Owner in accordance with the requirements contained in N.J.S.A. 40A:11-1 et seq. Each bidder is instructed to be present in person or by representative at the time and place fixed for the opening of bids and at every subsequent meeting of the Owner at which the bidder is advised, or it has been publicly announced at the time of bids, that said bids shall receive further consideration or shall be acted upon, if said bidder desires an opportunity to be heard.

2.04 AWARD OF BID

The award of the contract will be made, subject to necessary monies to do the work being provided by the Owner in accordance with the requirements contained in N.J.A.C. 5:30, Local Finance Board either by Resolution, Ordinance, or in other lawful manner. The contract to be executed by the successful bidder will provide that it shall not become effective until the necessary monies to do the work have been provided by the Owner, either by Resolution, Ordinance or another lawful manner.

In accordance with NJSA 34:11-56.25 et seq., New Jersey State Prevailing Wage Act and NJSA 52:32-44.1 no contract shall be awarded to any contractor, subcontractor, or to any firm, corporation or partnership in which such contractor or subcontractor has an interest, who is debarred from public works or contracting with a federal government agency.

3.0 CONTRACTS

3.01 DRAWINGS AND SPECIFICATIONS FURNISHED

The Engineer shall furnish, at no additional cost to the successful bidder, one executed contract set of drawings and specifications, and two copies of the specifications and drawings. All additional copies of the drawing and/or specifications shall be furnished to the contractor at the cost of reproduction plus handling.

3.02 PERFORMANCE, PAYMENT AND MAINTENANCE BONDS

The bidder whose bid is accepted shall furnish to the Owner, a performance bond and labor and material payment bond, or a combination performance and labor and material payment bond, and upon final completion of the work, a two (2) year maintenance bond, each in the amount of 100% of the final contract price, with such sureties as shall be approved by the Owner and as detailed and described below.

All surety companies must be authorized to transact such business in New Jersey, pursuant to N.J.S.A. 17:17-10 or 17:32-1 et seq. The surety must designate a New Jersey agent on whom service of process can be made. The Contractor shall be responsible for updating the surety's expiration from the list or an agent change, to the Engineer or Owner. All surety companies must have the minimum capital and surplus or net cash assets required, pursuant to N.J.S.A. 17:17-6 or 17:17-7, whichever is applicable, on the date of advertisement for the project. All surety companies must complete a Surety Disclosure Statement and Certification for all payment and performance bonds, pursuant to N.J.S.A. 2A:44-143d.

In addition, for these public works project bids, including any and all alternates, that equals at least $850,000.00 but not more than $3.5 million, the surety company must hold a current certificate of authority issued by the U.S. Secretary of the Treasury that is valid in New Jersey as listed annually in the U. S. Treasury Circular 570. However, if the surety company has been operational for a period in excess of five years, the surety company shall also be considered to have satisfied this requirement if it is rated in one of the three highest categories by an independent nationally recognized United States rating company

that determines the financial stability of insurance companies. Such rating companies must meet standards promulgated by the N. J. Commissioner of Insurance N.J.A.C. 11:1-41.1 et seq.

In addition, for those public works project bids, including any and all alternates, is in excess of $3.5 million, the surety company must hold a current certificate of authority issued by the United States Secretary of the Treasury that is valid in the State of New Jersey listed annually in U.S. Treasury Circular 570. And, if the surety company has been operational for a period in excess of five years, it must be rated in one of the three highest categories by an independent, nationally recognized United States rating company that determines the financial stability of insurance companies. Such ratings must meet standards promulgated in N.J.A.C. 11:1-41.1 et seq.

A surety company, which seeks to provide a payment and performance bond in excess of $3.5 million, is exempt from the requirement of Treasury Circular 570 if it meets standards developed by the Commissioner of Insurance through regulations which, at least equal, and may exceed, the general criteria required for Treasury listing. These standards are found at N.J.A.C. 11:1-41.4.

3.03 LAWS AND REGULATIONS

The bidder's attention is directed to the fact that all applicable Federal, State, County and municipal laws ordinances, regulations, etc. and the rules and regulations of all authorities having jurisdiction over construction of the project shall apply to the contract throughout, and they will be deemed to be included in the contract the same as though therein written out in full including, but not limited to the "Occupational Safety and Health Act of 1970" P.L. 91-596, as amended.

3.04 PERMITS

The Contractor shall determine which construction permits and licenses shall be needed, and shall procure and pay for all such construction permits and licenses necessary for the execution of his work.

3.05 CONTRACT DOCUMENTS

Attached hereto is the "Form of Contract" that will be executed between the Owner and the Contractor.

The Contractor shall execute and return these documents with the required bonds, insurance certificates, affirmative action forms and any other documents required within ten (10) days after receipt of the request for execution.

3.06 NOTICE TO PROCEED

After approval and execution of the contract documents by all parties and a preconstruction meeting, the contractor shall be sent a "Notice to Proceed." This document serves as formal authorization to proceed with the project.

Any and all work performed by the contractor prior to receipt of the Notice to Proceed is at the contractor's risk with no claim against the Owner for such work.

4.0 AFFIRMATIVE ACTION AGAINST DISCRIMINATION

4.01 BIDDER REFERRED TO LAW

The bidder is specifically referred to N.J.S.A. 10:5-31 et seq., and N.J.A.C. 17:27 as amended and the Regulations adopted pursuant thereto, relating to affirmative action in relation to discrimination.

4.02 SPECIFIC LANGUAGE REQUIRED

In accordance with the Affirmative Action Regulations adopted pursuant to N.J.S.A. 10:5-31 et seq., and N.J.A.C. 17:27, the following is made a part of this Contract:

During the performance of this contract, the contractor agrees as follows:

a. The contractor or subcontractor, where applicable, will not discriminate against any employee or applicant for employment because of age, race, creed, color, national origin, ancestry, marital status, affectional or sexual orientation, gender identity or expression, disability, nationality or sex. Except with respect to affectional or sexual orientation and gender identity or expression, the contractor will ensure that equal employment opportunity is afforded to such applicants in recruitment and employment, and that employees are treated during employment, without regard to their age, race, creed, color, national origin, ancestry, marital status, affectional or sexual orientation, gender identity or expression, disability, nationality or sex. Such equal employment opportunity shall include, but not be limited to the following: employment, up- grading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided by the Public Agency Compliance Officer setting forth provisions of this nondiscrimination clause.

b. The contractor or subcontractor, where applicable will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to age, race, creed, color, national origin, ancestry, marital status, affectional or sexual orientation, gender identity or expression, disability, nationality or sex.

c. The contractor or subcontractor will send to each labor union, with which it has a collective bargaining agreement, a notice, to be provided by the agency contracting officer, advising the labor union or workers' representative of the contractor's commitments under this act and shall post copies of the notice in conspicuous places available to employees and applicants for employment.

d. The contractor or subcontractor, where applicable, agrees to comply with any regulations promulgated by the Treasurer, pursuant to N.J.S.A. 10:5-31 et seq., as amended and supplemented from time to time and the Americans with Disabilities Act.

e. When hiring or scheduling workers in each construction trade, the contractor or subcontractor agrees to make good faith efforts to employ minority and women workers in each construction trade consistent with the targeted employment goal prescribed by N.J.A.C. 17:27- 7.2; provided, however, that the Dept. of LWD, Construction EEO Monitoring Program may, in its discretion, exempt a contractor or subcontractor from compliance with the good faith procedures prescribed by the following provisions, A, B and C, as long as the Dept. of LWD, Construction EEO Monitoring Program is satisfied that the contractor or subcontractor is employing workers provided by a union which provides evidence, in accordance with standards prescribed by the Dept. of LWD, Construction EEO Monitoring Program, that its percentage of active "card carrying" members who are minority and women workers is equal to or greater than the targeted employment goal established in

accordance with N.J.A.C. 17:27- 7.2. The contractor or subcontractor agrees that a good faith effort shall include compliance with the following procedures:

(A) If the contractor or subcontractor has a referral agreement or arrangement with a union for a construction trade, the contractor or subcontractor shall, within three business days of the contract award, seek assurances from the union that it will cooperate with the contractor or subcontractor as it fulfills its affirmative action obligations under this contract and in accordance with the rules promulgated by the Treasurer pursuant to N.J.S.A. 10:5-31 et seq., as supplemented and amended from time to time and the Americans with Disabilities Act. If the contractor or subcontractor is unable to obtain said assurances from the construction trade union at least five business days prior to the commencement of construction work, the contractor or subcontractor agrees to afford equal employment opportunities minority and women workers directly, consistent with this chapter. If the contractor's or subcontractor's prior experience with a construction trade union, regardless of whether the union has provided said assurances, indicates a significant possibility that the trade union will not refer sufficient minority and women workers consistent with affording equal employment opportunities as specified in this chapter, the contractor or subcontractor agrees to be prepared to provide such opportunities to minority and women workers directly, consistent with this chapter, by complying with the hiring or scheduling procedures prescribed under (B) below; and the contractor or subcontractor further agrees to take said action immediately if it determines that the union is not referring minority and women workers consistent with the equal employment opportunity goals set forth in this chapter.

(B) If good faith efforts to meet targeted employment goals have not or cannot be met for each construction trade by adhering to the procedures of (A) above, or if the contractor does not have a referral agreement or arrangement with a union for a construction trade, the contractor or subcontractor agrees to take the following actions:

(l) To notify the public agency compliance officer, the Dept. of LWD, Construction EEO Monitoring Program, and minority and women referral organizations listed by the Division pursuant to N.J.A.C. 17:27-5.3, of its workforce needs, and request referral of minority and women workers;

(2) To notify any minority and women workers who have been listed with it as awaiting available vacancies;

(3) Prior to commencement of work, to request that the local construction trade union refer minority and women workers to fill job openings, provided the contractor or subcontractor has a referral agreement or arrangement with a union for the construction trade;

(4) To leave standing requests for additional referral to minority and women workers with the local construction trade union, provided the contractor or subcontractor has a referral agreement or arrangement with a union for the construction trade, the State Training and Employment Service and other approved referral sources in the area;

(5) If it is necessary to lay off some of the workers in a given trade on the construction site, layoffs shall be conducted in compliance with the equal employment opportunity and non-discrimination standards set forth in this regulation, as well as with applicable Federal and State court decisions;

(6) To adhere to the following procedure when minority and women workers apply or are referred to the contractor or subcontractor:

(i) The contactor or subcontractor shall interview the referred minority or women worker.

(ii) If said individuals have never previously received any document or certification signifying a level of qualification lower than that required in order to perform the work of the construction trade, the contractor or subcontractor shall in good faith determine the qualifications of such individuals. The contractor or subcontractor shall hire or schedule those individuals who satisfy appropriate qualification standards in conformity with the equal employment opportunity and non-discrimination principles set forth in this chapter. However, a contractor or subcontractor shall determine that the individual at least possesses the requisite skills, and experience recognized by a union, apprentice program or a referral agency, provided the referral agency is acceptable to the Dept. of LWD, Construction EEO Monitoring Program. If necessary, the contractor or subcontractor shall hire or schedule minority and women workers who qualify as trainees pursuant to these rules. All of the requirements, however, are limited by the provisions of (C) below.

(iii) The name of any interested women or minority individual shall be maintained on a waiting list, and shall be considered for employment as described in (i) above, whenever vacancies occur. At the request of the Dept. of LWD, Construction EEO Monitoring Program, the contractor or subcontractor shall provide evidence of its good faith efforts to employ women and minorities from the list to fill vacancies.

(iv) If, for any reason, said contractor or subcontractor determines that a minority individual or a woman is not qualified or if the individual qualifies as an advanced trainee or apprentice, the contractor or subcontractor shall inform the individual in writing of the reasons for the determination, maintain a copy of the determination in its files, and send a copy to the public agency compliance officer and to the Dept. of LWD, Construction EEO Monitoring Program.

(7) To keep a complete and accurate record of all requests made for the referral of workers in any trade covered by the contract, on forms made available by the Dept. of LWD, Construction EEO Monitoring Program and submitted promptly to the Dept. of LWD, Construction EEO Monitoring Program upon request.

(C) The contractor or subcontractor agrees that nothing contained in (B) above shall preclude the contractor or subcontractor from complying with the union hiring hall or apprenticeship policies in any applicable collective bargaining agreement or union hiring hall arrangement, and, where required by custom or agreement, it shall send journeymen and trainees to the union for referral, or to the apprenticeship program for admission, pursuant to such agreement or arrangement. However, where the practices of a union or apprenticeship program will result in the exclusion of minorities and women or the failure to refer minorities and women consistent with the targeted county employment goal, the contractor or subcontractor shall consider for employment persons referred pursuant to (B) above without regard to such agreement or arrangement; provided further, however, that the contractor or subcontractor shall not be required to employ women and minority advanced trainees and trainees in numbers which result in the employment of advanced trainees and trainees as a percentage of the total workforce for the construction trade, which percentage significantly exceeds the apprentice to journey worker ratio specified in the applicable collective bargaining agreement, or in the absence of a collective bargaining agreement, exceeds the ratio established by practice in the area for said construction trade. Also, the contractor or subcontractor agrees that, in implementing the procedures of (B) above, it shall, where applicable, employ minority and women workers residing within the geographical jurisdiction of the union.

After notification of award, but prior to signing a construction contract, the contractor shall submit to the public agency compliance officer and the Dept. of LWD, Construction EEO Monitoring Program an initial project workforce report (Form AA 201) electronically provided to the public agency by the Dept. of LWD, Construction EEO Monitoring Program, through its website, for distribution to and completion by the contractor, in accordance with N.J.A.C. 17:27-7. The contractor also agrees to submit a copy of the Monthly Project Workforce Report once a month thereafter for the duration of this contract to the Division and to the public agency compliance officer.

The contractor agrees to cooperate with the public agency in the payment of budgeted funds, as is necessary, for on - the - job and/or off - the - job programs for outreach and training of minorities and women.

(D) The contractor and its subcontractors shall furnish such reports or other documents to the Dept. of LWD, Construction EEO Monitoring Program as may be requested by the Dept. of LWD, Construction EEO Monitoring Program from time to time in order to carry out the purposes of these regulations, and public agencies shall furnish such information as may be requested by the Dept. of LWD, Construction EEO Monitoring Program for conducting a compliance investigation pursuant to N.J.A.C. 17:27-1.1 et seq.

4.03 CONTRACT PROCEDURES

The Contractor must sign a contract containing the mandatory language in Section 4.02 above entitled "Specific Language Required."

The construction contractors shall complete and submit an Initial Project Workforce Report Form AA-201 upon notification of award. Proper completion and submission of this Report shall constitute evidence of the contractor's compliance with the regulations. Failure to submit this form may result in the contract being terminated. The contractor also agrees to submit a copy of the Monthly Project Workforce Report, Form AA-202 once a month thereafter for the duration of the contract to the Dept. of LWD and to the Public Agency Compliance Officer.

The EEO/AA evidence must be submitted after notification of award, but prior to signing a construction contract. All Public Agencies must retain the affirmative action evidence in their files for review by the Division.

4.04 EQUAL OPPORTUNITY FOR INDIVIDUALS WITH DISABILITIES

The contractor and the Owner do hereby agree that the provisions of Title II of the Americans With Disabilities Act of 1990 (the "Act") (42 U.S.C. S12101 et seq.), which prohibits discrimination on the basis of disability by public entities, in all services, programs and activities provided or made available by public entities, and the rules and regulations promulgated pursuant thereunto, are made part of this contract. In providing any aid, benefit or service on behalf of the Owner pursuant to this contract, the contractor agrees that the performance shall be in strict compliance with the Act. In the event the contractor, its agents, servants, employees, or subcontractors violate or are alleged to have violated the Act during the performance of this contract, the contractor shall defend the Owner in any action or administrative proceeding commenced pursuant to this Act. The contractor shall indemnify, protect, and save harmless the Owner, its agents, servants and employees from and against any and all suits, claims, losses, demands, or damages of whatever kind or nature arising out of or claimed to arise out of the alleged violation. The contractor shall, at its own expense, appear, defend, and pay any and all charges for legal services and any and all costs or other expenses arising from such action or administrative proceeding or incurred in connection therewith. In any and all complaints brought pursuant to the Owner's grievance procedure, the contractor agrees to abide by any decision of the Owner which is rendered pursuant to said grievance procedure. If any action or administrative proceeding results in an

award of damages against the Owner, or if the Owner incurs any expense to cure a violation of the Act which has been brought pursuant to its grievance procedure, the contractor shall satisfy and discharge the same at its own expense.

The Owner shall, as soon as practical after a claim has been made against it, give written notice thereof to the contractor along with the full particulars of the claim. If any action or administrative proceeding is brought against the Owner or any of its agents, servants and employees, the Owner shall expeditiously forward or have forwarded to the contractor every demand, complaint, notice, summons, pleading, or other process received by the Owner or its representatives.

It is expressly agreed and understood that any approval by the Owner of the services provided by the contractor pursuant to this contract will not relieve the contractor of the obligation to comply with the Act and to defend, indemnify, protect, and save harmless the Owner pursuant to this paragraph.

It is further agreed and understood that the Owner assumes no obligation to indemnify or save harmless the contractor, its agents, servants, employees and subcontractors for any claim which may arise out of their performance of this contract. Furthermore, the contractor expressly understands and agrees that the provisions of this indemnification clause shall in no way limit the contractor's obligations assumed in this contract, nor shall they be construed to relieve the contractor from any liability, nor preclude the Owner from taking any other actions available to it under any other provisions of this contract or otherwise at law.

CONTRACT FOR *(INSERT PROJECT NAME)*

THIS AGREEMENT, between the, *(insert owner name)* a (municipal corporation, municipal utilities authority, regional sewerage authority, etc.) of the State of New Jersey, having its principal offices located at *(insert owner address)*, hereinafter referred to as Owner and *(insert contractor name)* , having its principal place of business located at *(insert contractor address)* hereinafter referred to as "Contractor;"

WITNESSETH;

That for and in consideration of the sum of and 00/100 ($000,000.00), contractor agrees to furnish to the Owner, the labor, material, equipment and services in accordance with the contract documents hereinafter set forth.

That for and in consideration of the amount payable under this agreement by the Owner, the Contractor agrees, at its own proper cost and expense, and with due skill and diligence, that it will complete the *(insert project name)* project in accordance with the contract documents and in compliance with this agreement.

Contractor agrees to receive as full compensation the amount stated herein, namely $000,000.00, for said services provided to the Owner. Contractor shall be responsible for all loss or damage arising out of the furnishing of the services aforesaid.

To prevent all disputes and litigation, it is agreed by and between the parties to the Contract that the Owner shall in all cases determine the quantity of the goods delivered and paid for under this contract, and as to the interpretation of any ambiguity in or intent of the drawings and specifications.

The Contract documents shall consist of the following:

1. Notice to Bidders.
2. Specifications.
3. Contractors Proposal (as accepted).
4. Contract Agreement.
5. Contract Drawings
6. All Addenda.

The parties to this contract agree to incorporate into this contract the mandatory language of the Regulations promulgated by the Treasurer pursuant to N.J.S.A. 10:5-31 et seq. and N.J.A.C. 17:27, as amended and supplemented from time to time and the contractor or subcontractor agrees to comply fully with the terms, provisions, and obligations of said Regulations.

AND in all respects comply with all requirements of the Labor Laws of the State of New Jersey, applicable to contracts on behalf of the Municipal Government for construction, alteration, or repair of any building or public work, including particularly, be without limitation of the foregoing, the provision that not less than the prevailing rate of daily wages in the locality where the work is performed shall be paid to mechanics, workmen and laborers employed by the contractors or subcontractors or by or in behalf of the State or any county or municipality;

(*The contract partner*) shall maintain all documentation related to products, transactions or services under this contract for a period of five years from the date of final payment. Such records shall be made available to the New Jersey Office of the State Comptroller upon request.

Payment shall be made to said Contractor by orders upon the Treasurer of said *(insert appropriate entity, i.e. Borough, City, Township...)*, founded upon estimates of the *(insert appropriate entity, i.e. Borough Council, City Council, Township Committee...)* as to the amount of work done or articles furnished and delivered, or both, and upon presentation by said Contractor, to the *(insert appropriate entity, i.e. Borough, City, Township...)* Treasurer of said *(insert appropriate entity, i.e. Borough, City, Township...)* an appropriate voucher setting forth, in writing, the amount of work done or goods furnished, and that the work done or articles furnished are according to this Contract, and according to law;

AND it is distinctly and mutually understood and agreed by and between the parties hereto, that in case a default is made in the completion of the Contract, in accordance with the terms and conditions hereof, such money as may be due to said Contractor, or such as would have become due had the terms and conditions of this Contract and agreement been complied with, shall be and is hereby forfeited to said *(insert appropriate entity, i.e. Borough, City, Township...)*, and said *(insert appropriate entity, i.e.*

Borough, City, Township...) is free to use the same in and about the completion of said contract, and in case said *(insert appropriate entity, i.e. Borough, City, Township...)* is put to any costs and expenses over and above the contract price of the Contractor, in and about the completion of the Contract, said Contractor for themselves, itself, their heirs, executors, administrators, successors and assigns, expressly agree to hold themselves, itself, their heirs, executors, administrators, successors and assigns, liable therefore, and hereby covenant and agree to make good the same to the *(insert appropriate entity, i.e. Borough, City, Township...)*. Upon *(insert appropriate entity, i.e. Borough, City, Township...)*determination that services provided by the contractor are unsatisfactory, said contract may be cancelled subject to thirty (30) days written notice being provided to the contractor;

The Contractor agrees to make payments of all proper charges for labor and materials required in the aforementioned work, and defend, indemnify and save harmless the *(insert owner name)*, its officers, agents and servants and each and every one of them against and from all suits and costs of every name and description, including attorney's fees and costs and from all damages to which said *(insert owner name)* or any of its officers, agents or servants may be put by reason of injury to the person or property of others resulting from carelessness in the performance of said work, or through the negligence of the Contractor, or through any improper or defective machinery, implements or appliances used by said Contractor in the aforesaid work or through any act or omission on the part of said Contractor, or his agent or agents. This provision applies regardless of whether insurance coverage is provided. It is also agreed and understood that the acceptance of the final payment by the Contractor shall be considered as a release in full of all claims against the *(insert appropriate entity, i.e. Borough, City, Township...)* out of, or by reason of, the work done and materials furnished under this contract; and

AND it is expressly understood and agreed that this Contract and the referenced inclusion of the bid documents represent the full understanding between the parties and any representations, whether oral or in writing, not contained herein, will not be binding on the parties hereto.

This agreement, together with the contract documents, forms the contract and they are as fully a part of this contract as if hereto attached or herein repeated.

The Owner and the Contractor, for themselves, their heirs, executors, administrators, successors or assigns, hereby agree to the full performance of the covenants herein contained.

IN WITNESS WHEREOF, they have executed this Agreement.

CONTRACTOR: ATTEST:

_____ BY_____

_____ _____

Print Name & Title **Print Name & Title (Seal)**

Dated this ____ day of _____, 20__.

OWNER: ATTEST:

_____ BY_____

(Seal)

Dated this ____ day of _____, 20__.

CERTIFICATE OF INSURANCE

Name & Address of Insured

Afforded	Required (Enter (X))	Type of Insurance	Policy Number and Insuring Company(ies)	Policy Expiration Date	Limits of Liability: Amounts of Less Than $1,000,000 Will Not Be Acceptable	Amount Required Each Occurrence	Amount Provided Each Occurrence
☐	☒	General Liability Comprehensive Gen. Form			General Aggregate	$2,000,000	$
☐	☒	Premises-Operations			Bodily Injury	$1,000,000	$
☐	☒	Explosion & Collapse Hazard					
☐	☒	Underground Hazard			Property Damage	$1,000,000	
☐	☒	Products/Completed Operations Hazard					
☐	☒	Contractual Ins. (Blanket)			Bodily Injury and Property Damage Combined	$1,000,000	$
☐	☒	Broad Form Prop. Damage					
☐	☒	Independent Contractors					
☐	☒	Personal Injury			Personal Injury	$1,000,000	$
		Automobile Liability			Bodily Injury (Each Person)	$1,000,000	$
☐	☒	Comprehensive Form			Bodily Injury (Each Accident)	$1,000,000	$
☐	☒	Owned					
☐	☒	Non-Owned			Property Damage	$1,000,000	$
☐	☐	Garagekeepers Insurance (Without regard to legal liability as direct coverage on a primary basis)			Bodily Injury and Property Damage Combined	$1,000,000	
		Excess Liability			Bodily Injury and	$1,000,000	$
☐	☒	Umbrella Form			Property Damage Combined		
☐	☐	Other Than Umbrella Form					
☐	☒	Worker's Compensation and Employers' Liability	*All States Endorsement		Statutory NJ Coverage $100,000/$500,000		
					Minimum $100,000	$100,000	$

Remarks: Additional Insured: **REMINGTON & VERNICK ENGINEERS, OWNER and OWNER'S SOLICITOR**

It is understood and agreed that in the event of any material change in, cancellation of, or expiration of the above policy or policies the undersigned Insurance Company agrees to given a written notice to the Owner, at the above address thirty (30) days in advance of such change or cancellation.

This certificate is executed and issued to the Owner on the day and date herein below written certifying that the Insured has been issued the above policy or policies with Limits of Liability of at least the required amounts.

*** PLEASE PUT "X'S" IN AFFORDED COLUMN OR CERTIFICATE WILL BE RETURNED ***

Name of Agency

Street Address

City, State & Zip Code

Signature of Authorized Representative of Insurance Company

Address Date

Agency Telephone No.

TO: INSURANCE PRODUCER

Your client, as a supplier to the Owner is required to provide a certificate of insurance for the coverages and amounts indicated on the reverse side of this insurance certificate. It is important to your client that you respond quickly since continued business relationships depend upon valid insurance. Additionally, the minimum amount and type of coverage shown on our certificate is not negotiable and is not intended to imply that is all the insurance necessary to protect him/her from all losses or liability. It is the Owner's policy to require all suppliers who make deliveries or perform assembly, repair operations or a service in, on or upon our property/premises or property/premises under our care, custody and control to maintain the insurance coverage described below; such insurance must be obtained prior to the start of any such work the Owner.

A. Comprehensive General Liability (CGL)

This coverage must include: Premises-Operations, Products/Completed Operations Hazard, Contractual Insurance (Blanket Coverage), Broad Form Property Damage, Independent Contractors, and Personal Injury and all others shown on "X" in the required column.

Minimum Coverage

Bodily Injury and Property Damage combined - as shown in the amount required column

AMOUNTS OF LESS THAN $1,000,000 WILL NOT BE ACCEPTABLE.

Contractual Insurance (Blanket Coverage)

Contractual Indemnification - Save Harmless Agreement which is incorporated into all Vouchers, General Purchase Agreements and Contracts.)

INDEMNIFICATION

Supplier shall defend, indemnify and save harmless, the Owner from and against all losses, costs, damages, expense claims or demands arising out of or caused or alleged to have been caused in any manner by a defect in any equipment or materials supplied hereunder or by doing the work herein provided, including all suits or actions of every kind of description brought against Owner, either individually or jointly with Supplier for or on account of any damage or injury to any person or persons or property, caused or occasioned or alleged to have been caused by or on account of the performance of any work pursuant to or in connection with this contract or through any negligence or alleged negligence in guarding the work or through any act, omission or fault or alleged act, omission or fault of the Supplier, its employees or agents, or others under Supplier's control.

B. Automobile Liability - Comprehensive Form (or as shown on reverse side)

Minimum Coverage

Bodily Injury and Property Damage combined - as shown in the amount required column.

C. Worker's Compensation - As required by New Jersey State Statute

and

Employer's Liability (minimum $100,000)

D. Excess Liability

Commercial Umbrella Form - $1,000,000.

E. Other Coverage(s)

As shown on reverse side.

THANK YOU

Important - Producer:

PLEASE CHECK THE AFFORDED BLOCK FOR EACH COVERAGE PROVIDED.

THE CERTIFICATE MUST BE SIGNED BY THE AGENT OF THE INSURER OR CERTIFICATE WILL BE RETURNED.

IT IS NECESSARY TO SUBMIT YOUR CLIENTS COVERAGE THIRTY (30) DAYS PRIOR TO THE EXPIRATION OF THE EXISTING COVERAGE ON OUR CERTIFICATE ONLY; ALL OTHERS WILL BE RETURNED TO THE SUPPLIER AND SERVE TO DELAY FUTURE BUSINESS DEALINGS BETWEEN THE OWNER AND YOUR CLIENT.

TABLE OF CONTENTS
GENERAL CONDITIONS

			PAGE NO.
1.0	GENERAL PROVISIONS		
	1.01	Definitions	GC-1
	1.02	Special Notice	GC-2
	1.03	Representation of Contractor	GC-2
	1.04	Subletting or Assigning of Contract	GC-2
	1.05	Construing the Specifications	GC-2
	1.06	Necessary to Complete	GC-2
	1.07	Drawings and Specifications	GC-2
	1.08	Right-Of-Way	GC-3
	1.09	Time Limits	GC-3
	1.10	Liquidated Damages	GC-3
	1.11	Owner's Right to Stop Work or Terminate Contract	GC-4
	1.12	Reference to the Standard Specifications	GC-5
2.0	INSURANCE		
	2.01	State Law and Regulations and Insurance	GC-5
	2.02	Contractor's Insurance	GC-5
	2.03	Suit or Claims	GC-6
	2.04	Damages to Persons and Property	GC-6
3.0	CONDUCT OF THE WORK		
	3.01	Role of the Engineer	GC-6
	3.02	Surveys	GC-6
	3.03	Preservation of Stakes	GC-7
	3.04	Uses of Premises and Removal of Debris	GC-7
	3.05	Injury to Existing Structures	GC-7
	3.06	Correction of Work	GC-7
	3.07	Public Utilities	GC-8
	3.08	Protection of Work and Property	GC-8
	3.09	Contractor to Act in an Emergency	GC-8

			PAGE NO.
	3.10	Extra Work	GC-8
	3.11	Dispute Resolution	GC-9
4.0	CONTRACTOR'S PERSONNEL		
	4.01	Personal Attention	GC-9
	4.02	Contractor's Superintendent	GC-9
	4.03	Labor Laws	GC-10
	4.04	Contractor's Employees	GC-10
	4.05	Eight Hour Day: Prevailing Wage Rate	GC-11
	4.06	Payment of Employees	GC-11
	4.07	Safety and Health Regulations	GC-11
	4.08	Accident Prevention	GC-11
5.0	MATERIALS		
	5.01	Contractor's Title to Materials	GC-11
	5.02	Royalties and Payments	GC-11
	5.03	Use of Domestic Material	GC-11
	5.04	Ordering Materials	GC-12
	5.05	Samples	GC-12
	5.06	Shop or Setting Drawings	GC-12
	5.07	Additional Instructions and Detail Drawings	GC-12
	5.08	Or Equal Clauses	GC-13
	5.09	Substitutions	GC-13
	5.10	Material Safety Data	GC-13
6.0	INSPECTION AND TESTING		
	6.01	Inspection	GC-14
	6.02	Daily Reports	GC-14
	6.03	Inspectors	GC-14
	6.04	Access to the Work	GC-15
	6.05	Covering Uninspected Work	GC-15
	6.06	Testing Materials	GC-15

			PAGE NO.
7.0	PAYMENTS		
	7.01	Construction Schedule and Periodic Estimates	GC-15
	7.02	Payments	GC-16
	7.03	Retainage	GC-17
	7.04	Acceptance of Final Payment as Release	GC-17
	7.05	Owner's Right to Withhold Payments	GC-18
	7.06	Costs of Engineering and Inspection	GC-18
	7.07	Liens	GC-18
	7.08	Prevailing Wage Payment Certificate	GC-18
	7.09	Certified Payroll Reports	GC-18
8.0	VALUE ENGINEERING CONSTRUCTION CHANGE ORDERS		
	8.01	Implementation of Value Engineering	GC-19
	8.02	Statutory Provisions	GC-19
	8.03	Procedures	GC-20
9.0	DIFFERING SITE CONDITIONS PROVISIONS		GC-23
	Prevailing Wage Payment Certification Form		GC-26
	Form GC-6.02S - Certificate of Site Safety Conditions		GC-27
	Full Release and Waiver of Liens		GC-28

GENERAL CONDITIONS

1.0 GENERAL

1.01 DEFINITIONS

The following words and expressions used in the contract documents shall be construed as follows:

Owner.....Ewing Lawrence Sewerage Authority
600 Whitehead Road
Lawrenceville, New Jersey, 08648

Engineer .....Remington & Vernick Engineers
2059 Springdale Road
Cherry Hill, New Jersey, 08003

Contractor.....Party, firm, corporation with whom or which the contract is made, or authorized agent thereof.

Day.....Calendar day.

Legal Holiday.....Days which the owner does not conduct regular business hours. The Contractor is responsible to contact the Owner for a listing of these days.

Substantial Completion ..... The work will not reach Substantial Completion until all project systems included in the work are operational as designed and scheduled, all designated or required inspections, certifications, permits, approvals, licenses and other documents from any governmental authority having jurisdiction thereof necessary for the beneficial use and occupancy of the work are received, designated instruction of Owner's personnel has been completed, and all final finishes within the Contract are in place. Any remaining work shall be minor in nature, so that the Owner can occupy the building on that date and the completion of the remaining work by the Contractor would not materially interfere or hamper the Owner's (or those claiming by, through or under the Owner) normal operations. Contractor recognizes that normal operations require the use and occupancy of the work area without interruption and that any punchlist or corrective work shall be done at times when the work area is not so occupied. As a further condition of reaching Substantial Completion, the Contractor shall certify that all remaining work will be completed within thirty (30) consecutive calendar days or as so agreed upon following the date of Substantial Completion. Site related projects and/or projects including facilities with site improvements shall not reach Substantial Completion until such time as all site amenities (i.e. lighting, top paving, striping, fencing, stormwater compliance, etc..) are placed into service leaving only minor improvements that will not hamper access or use to complete the project."

Final Completion .....All warranties and guarantees required pursuant to the Contract Documents shall be assembled and delivered by the Contractor to the Owner as part of the final application for payment. The final Certificate for Payment will not be issued by the Engineer until all warranties and guarantees have been received and accepted by the Owner.

1.02 SPECIAL NOTICE

The "Information for Bidders", the "General Conditions", the "Notice to Bidders", and "Proposal Section" shall be held equally binding with and are to be considered a part of the specifications and contract and the party of the second part, the Contractor, will be held responsible for neglect in attending to any part, paragraph or item therein.

1.03 REPRESENTATION OF CONTRACTOR

The Contractor represents and warrants:

(a) That he is financially solvent and that he is experienced in and competent to perform the type of work to furnish the labor, plant, materials and supplies or equipment to be so performed or furnished by him and

(b) That he is familiar with all Federal, State, County, Municipal and Department Laws, Ordinances and Regulations, which may in any way affect the work or those employed therein, including, but not limited to, any special Acts relating to the work or to the project of which it is a part, and

(c) That such temporary and permanent work required by the contract documents and is to be done by him can be satisfactorily constructed and used for the purpose for which it is intended, and that such construction will not injure any persons or damage any property, and

(d) That he has carefully examined the drawings, specifications, and the site of the work, and that from his own investigations he has satisfied himself as to the nature and location of the work, the character, quality and quantity of surface and subsurface materials likely to be encountered, the character of equipment and other facilities needed for the performance of the work, the general and local conditions and all other items which may in any way affect the work or its performance.

1.04 SUBLETTING OR ASSIGNING OF CONTRACT

The Contractor shall not assign, sell or transfer or otherwise dispose of the contract or any portion thereof or of the work provided therein or his right, title or interest therein, to any persons, firm or corporation, without prior written consent of the Owner.

1.05 CONSTRUING THE SPECIFICATIONS

To avoid disputes and litigation, it must be distinctly understood by the Bidder/Contractor that the Engineer shall construe or interpret the specifications and explain any ambiguity therein and shall have the right to decide as to their purpose and intent and his decision upon any such ambiguity shall be final, conclusive and binding.

1.06 NECESSARY TO COMPLETE

If any work or materials are required which are obviously necessary to carry out the full intent and meaning of the said specifications although the same may not be either directly or indirectly in the specifications, the Contractor is hereby bound to furnish the same without charge or claim.

1.07 DRAWINGS AND SPECIFICATIONS

The Contractor shall keep at the site of the work one copy of the drawings and specifications signed and identified by the Engineer and shall at all times give the Engineer and other representatives of the Owner access thereto. Anything shown on the drawings and not mentioned in the specifications, or mentioned in the

specifications and not shown on the drawings, shall have the same affect as if shown or mentioned respectively in both. In case of any conflict within the construction documents, the Engineer shall determine which of the requirements shall govern based upon the most stringent of the requirements, and the Contractor shall perform the work at no additional cost or time to the owner. Any ambiguity or discrepancy between drawings and specifications shall be submitted by the Contractor to the Engineer whose decision shall be conclusive.

The general arrangement and location of equipment, the various pipe, duct, and conduit runs, etc. are shown on the drawings. All dimensions or the scales of the drawings shall be considered as approximate and shall be checked by each bidder to his own satisfaction prior to bid. The exact location of all parts of the work shall be governed by existing conditions, and the Contractor shall coordinate and locate all work at the time of installation. Any changes in location, etc. from that shown on the drawings, necessary by existing conditions, shall be made by the Contractor at no increase of the contract sum.

1.08 RIGHT-OF-WAY

All right-of-ways through private property required shall be secured by the Owner. Contractor shall not start construction in right-of-ways until directed by the Engineer. No claim shall be made by the Contractor for damage due to delay in securing right-of-ways.

1.09 TIME LIMITS

The Contractor agrees to start the work herein contracted for within ten (10) days from the date of the Engineer's Notice To Proceed to the Contractor directing him to proceed with the work. The time to complete the work contracted for, from the date of the Proceed Order, shall be limited to the following:

Two Hundred Seventy (270) Calendar Days

No extension of time will be allowed for delay from any cause whatsoever, including normal weather conditions unless the Contractor shall have notified the Engineer in writing of such delay and his intention to claim an extension of time within two (2) days after the beginning of such delay. Such notice shall give complete information concerning the nature, extent and cause of the delay. If, in the opinion of the Owner, an extension of time is warranted the Owner or Owner's representative, will issue a written extension, setting a new time limit for the completion of the work. Additionally, should the Owner grant the Contractor an extension of Contract time, the Contractor shall not be due any compensation for the extended contract time unless specifically indicated in writing at the time of the extension. Failure of Owner or Owner's Representative to expressly respond to a reservation of rights letter from Contractor reserving a right to additional compensation shall in no way be deemed an admission that Contractor is entitled to additional fees. Any costs associated with increased contract time due to approved change order work must be specifically identified included in the change order at the time of submission.

1.10 LIQUIDATED DAMAGES

In case the Contractor fails to complete the work contracted for, satisfactory to and acceptable to the Owner within the stipulated time limit, or violates any terms or conditions of said contract or the terms and conditions of N.J.S.A. 40A:11-1 et seq. (Local Public Contracts Law), then the Contractor shall and will pay to the Owner for each and every calendar day determined to be in default, the following sums, which are agreed upon, fixed and determined by the parties hereto to be liquidated damages. Liquidated damages shall not be assessed beyond substantial completion.

One (1) to Fifteen (15) Days beyond Contract Time Limits
Five Hundred ($500.00) dollars per calendar day.

Sixteen (16) to Thirty (30) Days beyond Contract Time Limits

One Thousand ($1,000.00) dollars per calendar day.

Greater than Thirty (30) Days beyond Contract Time Limits
Two Thousand ($2,000.00) dollars per calendar day

The Owner shall recover said damages by deducting the amount thereof out of any money which may be due or become due the Contractor, or by an action of law against the Contractor, his surety or by either or both of these methods.

In case the Contractor shall be delayed due to the failure on the part of the Owner to furnish anything on its part to be furnished or for any other cause beyond the control of the Contractor, he shall be entitled to such an extension of time for the delivery of equipment, materials, work and supplies as in the judgement of the Owner or Owner's representative to be fair and just.

1.11 OWNER'S RIGHT TO STOP WORK OR TERMINATE CONTRACT

The Owner has the right to stop work or terminate the contract, if:

(a) The Contractor has violated the provisions of N.J.S.A. 40A:11-1 et seq. (Local Public Contracts Law), or any other Federal, State or Local law, or

(b) The Contractor shall be adjudged bankrupt or make an assignment for the benefit of creditors, or

(c) A receiver or liquidator shall be appointed for the Contractor or for any of his property and shall not be dismissed within 20 days after such appointment or the proceedings in connection therewith shall not be stayed on appeal within the said 20 days, or

(d) The Contractor shall refuse or fail, after notice or warning from the Engineer, to supply enough properly skilled workmen or proper materials, or

(e) The Contractor shall refuse or fail to prosecute to work or any part thereof with such diligence as will ensure its completion within the period herein specified (or any duly authorized extension thereof) or shall fail to complete the work within said period, or

(f) The Contractor shall fail to make prompt payment to persons supplying labor or materials for the work, or

(g) The Contractor shall fail or refuse to regard laws, ordinances or regulations or otherwise to be guilty of a violation of any provisions of the contract or the Scope of Work therein, then and in such event, the Owner, without prejudice or any rights or remedy it may have, may give seven (7) days notice to the Contractor to terminate the employment of the Contractor and his right to proceed, either as to the entire work or at the option of the Owner as to any portion thereof as to which delay shall have occurred, and may take possession of the work and complete the work by the Contractor or otherwise, as the Owner may deem expedient. In such case, the Contractor shall not be entitled to receive any further payment until the work is finished. If the unpaid balance of the compensation to be paid the Contractor hereunder shall exceed the expense of so completing the work, including compensation for additional managerial, administrative and inspection services and any damages for delay, such excess shall be paid to the Contractor. If such expense shall exceed such unpaid balance, the Contractor and his sureties shall be liable to the Owner for such expenses. If the right of the Contractor to proceed with the work is terminated, the Owner may take possession of and utilize in completing the work such materials, appliances, supplies, drawings, and equipment, as may be on the site of the work and necessary therefore. If the Owner does not terminate the right of the Contractor to proceed, the Contractor shall continue the work.

If the work shall be stopped by order of the Court or any other public authority, for a period of three (3) months without act or fault of the Contractor or of any of his agents, servants, employees, or Subcontractor, the Contractor may, upon ten (10) days notice to the Owner, discontinue his performance of the work and/or terminate the contract, in which event the liability of the Owner to the Contractor shall be determined as provided in the paragraphs immediately preceding, except that the Contractor shall not be obligated to pay to the Owner any excess of the expense of completing the work over the unpaid balance of the compensation to be paid by the Contractor hereunder.

1.12 REFERENCE TO THE STANDARD SPECIFICATIONS

(a) All applicable portions of the work performed under this contract shall comply with the requirements of the current New Jersey Department of Transportation Standard Specifications for Road and Bridge Construction, as amended or supplemented and whose specifications are made part of these specifications. The New Jersey Department of Transportation Standard Construction Details shall govern except insofar as same are expressly modified, amended or changed in detail drawings prepared specifically for this particular project.

(b) The Standard Specifications are made part of these specifications by this reference as if were set forth in full. It is the responsibility of the prospective bidder to be familiar with these Standard Specifications. The Contractor is required to follow only the electronic version, effective September 1, 2019, as referenced in Baseline Document Change announcement BDC19S-01 of the New Jersey Department of Transportation Standard Specifications for Road and Bridge Construction, 2019, unless modified in the technical specifications of this contract. Copies may be examined in the Engineer's office or may be obtained from the New Jersey Department of Transportation.

2.0 INSURANCE

2.01 STATE LAW AND REGULATIONS AND INSURANCE

The Contractor must assume all risks connected with his work. He shall comply with all State Laws and Regulations concerning Workmen's Compensation and shall maintain such insurance as will protect him against all claims for damages for personal injury, including death which may arise during prosecution of the contract, either by himself or by any Subcontractor or anyone directly or indirectly employed by either of them.

2.02 CONTRACTOR'S INSURANCE

The Contractor shall not commence work under this contract, until he has obtained all insurance required under this paragraph and such insurance has been approved by the Owner, nor shall the Contractor allow any Subcontractor to commence work, in his subcontract until all similar insurance required of the Subcontractor has been so obtained and approved.

Insurance coverage shall remain in effect until the project is accepted by the Owner, and at all times thereafter when the Contractor may be removing or replacing defective work.

The Contractor shall furnish the Owner with proof of insurance by execution of the Certificate of Insurance, of which a copy is included herein. The Owner, Remington & Vernick Engineers and the Solicitor shall be a named additional insured.

The Certificate of Insurance shall give the Owner and Engineer 30 days written notice of any material change in, cancellation of, or expiration of the policies.

The following types of insurance are required:

a. General Liability

b. Automobile Liability

c. Excess Liability

d. Worker's Compensation and Employer's Liability

The amounts for property damage and bodily injury for each type of insurance are as shown on the Certificate of Insurance herein.

The Contractor's insurance shall apply to and provide coverage for all Subcontractors and/or suppliers unless the Contractor forwards to the Owner and Engineer the Certificate of Insurance for the Subcontractor and/or supplier.

Any insurance company providing coverage must be licensed, admitted and authorized to do business in the State of New Jersey.

2.03 SUIT OR CLAIMS

The Contractor agrees to indemnify and save harmless the Owner and the Engineer and all their agents and employees from actions and suits of every kind and description brought against them, or on account of the use of patented rights, and from any damages or injuries received or sustained by any party, or parties, arising out of any act or omission of the Contractor, his workmen or agents in performance of the work under this agreement, including the furnishing of equipment, materials and supplies at the site of the proposed work.

2.04 DAMAGES TO PERSONS AND PROPERTY

Contractor shall fully and completely indemnify and same harmless the Owner from damages or injury to persons or property resulting from the performance of the work, or through negligence to the contract, or through the use of any improper or defective machinery implements or appliances or through any act of omission of the Contractor, or his agents, or his employees.

3.0 CONDUCT OF THE WORK

3.01 ROLE OF THE ENGINEER

The Engineer may verify, by observation and/or required tests, the amount, quality, acceptability and fitness of the materials, equipment and supplies furnished; and shall interpret any ambiguities in the drawings and specifications, contract documents, and any extra work order. Upon request, the Engineer shall confirm in writing any oral direction, requirement or determination.

All work of refilling sunken ditches, repaving over trenches and keeping the streets and sidewalks in passable condition shall be satisfactorily performed by the Contractor during the construction of the work as well as during the maintenance period. If any work is not done within 48 hours after written notice given by the Engineer, the work may be done by the Owner and charged to the Contractor.

3.02 SURVEYS

Unless otherwise expressly provided for in the specifications, the Contractor will furnish all surveys necessary for the execution of the work. The Owner will furnish a base line and datum bench marks as required. The Contractor shall measure and lay out his work and be responsible for the accuracy thereof from bench marks and base lines established by the Engineer which shall constitute the surveys hereinbefore referred to. The contractor shall submit cut sheets for curb, sidewalk and roadway construction projects unless specifically waived in writing by the Engineer.

3.03 PRESERVATION OF STAKES

The Contractor shall carefully preserve bench marks, reference points and stakes, and in case of willful or careless destruction, he will be charged with the resulting expense and shall be responsible, for any mistakes that may be caused by their unnecessary loss or disturbance.

3.04 USES OF PREMISES AND REMOVAL OF DEBRIS

The Contractor expressly undertakes at his own expense:

(a) To take every precaution against injuries to persons or damage to property.

(b) To store his apparatus, materials, supplies and equipment in such orderly fashion at the site of the work as will not unduly interfere with the progress of his work or the administration of Owner's affairs.

(c) To place upon the work any part thereof only such loads as are consistent with the safety of that portion of the work.

(d) To frequently clean up all refuse, scrap material and debris caused by his operations and at all times the site of the work shall present a neat, orderly condition.

(e) Before final payment to remove all surplus material, false work, temporary structures, including foundations thereof, plant of any description and debris of every nature resulting from his operations and to put the site in a neat orderly condition.

(f) To affect all cutting, fitting, or patching of his work required to make the same conform to the drawings and specifications, and except with the consent of the Engineer, not to cut or otherwise alter the work.

3.05 INJURY TO EXISTING STRUCTURES

The Contractor shall be responsible for all injury to existing structures met within the prosecution of the work, including the delivery to the site of the proposed improvements of materials and supplies. In case of accident to existing structures met within the prosecution of the work, the Contractor will be required to immediately notify the proper authorities and as soon as possible thereafter also notify the Engineer.

3.06 CORRECTION OF WORK

The Contractor expressly warrants that his work shall be free from any defects in materials or workmanship and agrees to correct any such defects which may appear in such materials or workmanship within two years or the term of the maintenance bond, which ever is longer, following the final acceptance of the work by the Owner, such final acceptance to be evidenced by an appropriate resolution of the governing body in the case of municipal corporation, quasi municipal corporation, municipal board, municipal commission or other municipal authority or by the issuance of final payment in the case of any Owner other than a municipal corporation, quasi municipal corporation, municipal board, municipal commission or other municipal authority.

Neither, the acceptance of the completed work, nor payment therefore shall operate to release the Contractor or his surety or sureties from any obligation or obligations under this contract or the bonds required under these Contract Documents.

3.07 PUBLIC UTILITIES

The contract drawings indicate the approximate location of known overhead and subsurface utilities in the vicinity of the work. The bidder is advised to investigate and ascertain for himself all the facts concerning the actual location of these utilities.

The Contractor shall cooperate with the utility Owners in the adjustment of their facilities and shall notify the utility Owners not less than ten (10) days in advance of the time he proposes to perform any work that will endanger or affect their facilities.

The Contractor shall permit the Owners of utilities, or their agents, access to the site of the work at all times in order to relocate, construct or protect their lines and he shall cooperate with them in performing this work.

Separate payments will not be made for the following:

1. Coordination and cooperation of the Contractor with the utility companies, nor for the protection or replacement of utilities as specified hereinbefore.

2. Damages for delay caused by conflicts with utilities outside the jurisdiction of the Owner (ex: gas mains, telephone or electric lines, county storm sewer, water mains, etc.).

The bidder shall include all such costs in the prices bid for the various scheduled items in the Bid form.

3.08 PROTECTION OF WORK AND PROPERTY

The Contractor shall continuously maintain adequate protection of his work and shall protect Owner's property from injury or loss arising in connection with his work. He shall also protect all adjacent property as provided by law, and shall be responsible for all injury to property and existing structures sustained during the prosecution of his work, including delivery to the site of the equipment, materials and supplies. He shall repair and replace any such damage, injury or loss equal or better than the condition of the item prior to the Contractor's action.

All passageways, guard fences, light and other facilities required for protection by local authorities or local conditions must be provided and maintained.

3.09 CONTRACTOR TO ACT IN AN EMERGENCY

In case of any emergency which threatens loss or injury of property, and/or safety of life, the Contractor is required to act as he sees fit. He shall notify the Engineer thereof immediately thereafter.

3.10 EXTRA WORK

The Contractor further agrees that the Engineer may make such alterations as he may see fit in the form, dimensions, plans for materials of the work, materials and supplies bid upon or any part thereof, either before or after work. If such alterations diminish the quantity of the equipment, materials and supplies to be furnished and delivered to the site or work to be executed, they shall not constitute a claim for damages for anticipated profits on the work that may be dispensed with. If the extra work, change or alteration increases the amount of work to be performed or equipment, they shall be paid for at the price bid. If prices for such extra work are not included in the lump sum prices or unit prices bid, the Contractor hereby agrees to furnish the necessary materials and perform such labor as extra work, and agrees to accept in full payment therefore a price which shall be fixed by the Engineer previous to its commencement. The basis of such price will be the estimated actual cost of materials, labor, equipment, and a maximum 10% overhead plus a maximum 10% profit. Contractor shall furnish a detailed cost breakdown for proposed extra work for

review by the Engineer. The Owner and/or Engineer has the sole authority to unilaterally direct extra work to be performed on a force account basis. The basis of payment for force account work shall be the actual cost of the materials, labor and equipment, and a maximum 10% overhead plus a maximum 10% profit. Contractor shall furnish a detailed cost estimate of the extra work to be paid by force account previous to its commencement. Contractor shall submit daily or shift reports for actual force account costs. Payment for markup on subcontracted work shall be at a maximum rate of 5% of the total amount for all costs on the subcontracted work, for both fixed price and force account extra work. Change Orders and Open End Contracts will be in accordance with N.J.A.C. 5:30-11 et seq.

The Contractor shall not be entitled to receive payment for any extra work unless the same is certified in writing by the Engineer.

3.11 CONSTRUCTION CONTRACT DISPUTE PROCEDURES

Pursuant to P.L. 1977, c.371 (N.J.S.A. 40A:11-50), with regard to any dispute arising under this contract and prior to being submitted to a court for adjudication, the parties agree to try in good faith to settle the dispute by alternative dispute resolution practices, such a mediation binding arbitration or non-binding arbitration pursuant to industry standards. Mediation shall be administered by the American Arbitration Association under its Commercial Mediation Rules. The expense of the mediation shall be shared equally by the parties. The mediation shall be conducted at ELSA's offices or at any other mutually agreeable location in Mercer County, New Jersey. Unless extended by agreement of both parties, mediation shall be deemed to have concluded unsuccessfully unless the dispute is resolved within thirty days of referral to the mediator, or at such earlier date as may be necessary to insure that the contractor is continuing to perform required services under this contract. If necessary, to fully resolve the issues in dispute, either party may demand the joinder of other interested parties to the dispute unless the mediator determines that such a joinder is inappropriate. Nothing in the section shall prevent ELSA from seeking injunction or declaratory relief in court at any time.

4.0 CONTRACTOR'S PERSONNEL

4.01 PERSONAL ATTENTION

The Contractor shall give his personal supervision to the prosecution of the work, or have a competent representative on the work who shall have written authority to carry out the requirements of the Contract Documents. He shall also supply all manpower, materials and equipment as they may be required in the furnishing and delivery to the site of the proposed work, the equipment, materials and supplies bid upon.

4.02 CONTRACTOR'S SUPERINTENDENT

The Contractor shall attend to the work personally or through a competent, English-speaking superintendent, who shall be continually present on the project site whenever work is in progress. Such a superintendent shall be satisfactory to the Owner and Engineer and shall not be removed or replaced without due notice being given the Owner and Engineer. The Superintendent shall have full authority to act for the Contractor without the need to consult any higher level of authority.

4.03 LABOR LAWS

The Contractor and any Subcontractors shall comply with all the requirements of the Labor Laws of the State of New Jersey applicable to contracts on behalf of this Owner for construction, alteration or repair of any building or public work, including particularly, but without limitation of the foregoing, the provisions of New Jersey Administrative Codes and related statues including N.J.S.A. 10:2-1 to 10:2-4, inclusive and N.J.S.A. 34:11-56.*25* et seq., New Jersey Prevailing Wage Act

The Contractor hereby agrees to comply in all respect with the New Jersey Prevailing Wage Act, N.J.S.A. 34:11-56.25 et seq. as amended. A copy of the prevailing wage rates pertaining to the work and issued by the

New Jersey Department of Labor entitled, "Prevailing Wage Rate Determination" is on file in the Engineer's office and is included herein. Pursuant to N.J.S.A. 34:11-56.25 et seq. – New Jersey Prevailing Wage Act, no public works contract may be awarded to any contractor and subcontractor or to any firm, corporation or partnership in which they have an interest on the attached disbarred bidders list located at the end of this specification, until expiration date given. Workmen shall be paid not less than such prevailing wage rate.

In accordance with N.J.A.C. 12:60-9.1, if the Contractor who makes the lowest bid for the contract is 10% or more under the amount of the next lowest bid, they must, prior to the award, certify to the Owner via the "Lowest Bidder Prevailing Wage Certification" that the prevailing wage rates required by the Prevailing Wage Act shall be paid in performing the work under the contract. If the Contractor does not provide the Certification required prior to the award of the contract, the Owner shall award the contract to the next lowest responsible and responsive bidder.

Before final payment is made by or on behalf of the Owner of any sum or sums due to the work, the Contractor or Subcontractor shall file with the treasurer of the Owner, written statements in form satisfactory to the Commissioner of Labor certifying to the amounts then due and owing from such contractor or subcontractor filing such statement to any and all workmen for wages due on account of the work, setting forth therein the names of the persons whose wages are unpaid and the amount due to each respectively which statement shall be certified by the oath of the Contractor or Subcontractor as the case may be in accordance with the said New Jersey Prevailing Wage Act.

The prevailing wage rate shall be determined by the Commissioner of Labor or his duly authorized representative.

Contractors or Subcontractors performing public work of a public body subject to the provisions of this act shall post the prevailing wage rates for each craft and classification involved as determined by the Commissioners of Labor including the effective date of any changes thereof, in prominent and easily accessible places at the site of the work or at such place or places as are used by them to pay workmen their wages.

In the event it is found that any workmen, employed by the Contractor or any Subcontractor, on this project, has been paid a rate of wages less than the prevailing wage required, the Department of Labor along with the Owner may terminate the Contractor's or Subcontractor's right to proceed with the work or such part of the work as to which there has been a failure to pay required wages and to prosecute the work to completion or otherwise, the Contractor and his surety(ies) shall be liable to the Department of Labor along with the Owner for any excess costs occasioned thereby.

Prior to final payment, the Contractor shall be required to execute and deliver an Affidavit of Compliance in a form provided by the Engineer, as required by the Act.

4.04 CONTRACTOR'S EMPLOYEES

All workmen must be competent and fully qualified in the type of work to be performed. Any employee of the Contractor, who is found by the Engineer to be incompetent, or who is performing his work in an unsightly manner or contrary to the specifications or the Engineer's instructions, or who is disorderly, shall be removed from the project and shall not again be employed on the project without the Engineer's consent.

4.05 EIGHT HOUR DAY: PREVAILING WAGE RATE

All mechanics, workers, laborers, employed or engaged in the work hereunder shall work no more than eight (8) hours in any one day. In case of necessity for the protection of property or human life, mechanics, workmen and laborers may be employed for longer periods than eight hours per calendar day, if paid extra compensation on the basis of eight hours, constituting a days work, in accordance with the Prevailing Wage Act, N.J.S.A. 34:11-56-25 et seq., and all State and Federal laws.

4.06 PAYMENT OF EMPLOYEES

The Contractor and each of his Subcontractors shall pay each of his employees engaged in work on the project under this contract in full (less deductions made mandatory by law) in legal tender and not less often than once each month.

4.07 SAFETY AND HEALTH REGULATIONS

The Contractor shall comply with the Department of Labor, Safety and Health Regulations for construction promulgated under the Occupational Safety and Health Act of 1970 (P.L.91-596) and under Section 107 of the Contract Work Hours and Safety Standards for Construction (P.L.91-54).

4.08 ACCIDENT PREVENTION

Precautions shall be exercised at all times for the protection of persons (incl. employees) and property. The safety provisions of applicable laws, buildings and construction codes shall be observed. Machinery, equipment, and all hazards shall be guarded or eliminated in accordance with the safety provisions of the Manual of Accident Prevention in Construction published by the Association General Contractors in America and Part VI "Temporary Traffic Control" of the U.S. Dept. of Transportation. Federal Highway Administration "Manual on Uniform Traffic Control Devices", latest edition, whichever is more stringent to the extent that such provisions are not in contravention of applicable law. Contractor alone shall be responsible for the safety, efficiency, and adequacy of his plant, appliances and methods and for any damage which may result from their failure for their improper construction, maintenance or operation. The cost of "Accident Prevention" shall be included in the lump sum or unit price bid whichever is applicable.

5.0 MATERIALS

5.01 CONTRACTOR'S TITLE TO MATERIALS

No materials or supplies for the work shall be purchased by the Contractor or by Subcontractor that are subject to any chattel mortgage or under a conditional sale or other agreement by which an interest is retained by the seller. The Contractor warrants that he has good title to all materials and supplies used by him in the work.

5.02 ROYALTIES AND PAYMENTS

The Contractor shall pay all royalties and license fees. He shall defend all suits or claims for infringements of any patent rights and shall save the Owner harmless from loss or account thereof.

5.03 USE OF DOMESTIC MATERIAL

In the performance of the work, the Contractor and all Subcontractors shall use only manufactured materials and farm products of the United States of America, wherever available.

All Contractors and Subcontractors shall comply with the provisions of N.J.S.A. 40A:11-18, which relate to the use of domestic materials.

5.04 ORDERING MATERIALS

Before ordering materials, the Contractor shall obtain the Engineer's approval of their conformity to the specifications. In the case of concrete aggregate, and similar materials, samples must accompany the request for approval. The Contractor must forward to the Engineer copies of all shipping lists, invoices or delivery slips accompanying such deliveries.

5.05 SAMPLES

The Contractor shall submit to the Engineer any samples of materials before or during the progress of the work that may be required by the Contract Documents and all materials and workmanship must be equal in every respect to the samples submitted and approved.

5.06 SHOP OR SETTING DRAWINGS

(a) The Contractor shall submit promptly eight copies, of which two will be returned to the contractor, of each shop or setting drawings prepared in accordance with the schedule predetermined under the provisions of the preceding paragraph hereof with the Contractor's approval stamp and date thereon. After examination of such drawings by the Engineer, and the return thereof, the Contractor shall make such corrections to the drawings as have been indicated and shall furnish the Engineer with eight corrected copies. If requested by the Engineer, the Contractor must furnish additional copies, regardless of corrections made in or approval given to such drawings by the Engineer. The Contractor will nevertheless be responsible for the accuracy of such drawings and for their conformity to the drawings and specifications unless he notified the Engineer in writing of any deviations, at the time he furnished such drawings. Shop drawing requirements as detailed within the technical specifications and scope of work shall govern should they be in conflict with the General Conditions.

(b) The Contractor shall likewise submit, in writing, the type, kind and name of the manufacturer of all materials to be used in the work for the written approval of the Engineer prior to the installation of same.

(c) Any equipment or materials installed without this written approval of the Engineer will be required to be removed by the Contractor at his own expense and replaced with equipment and materials as approved.

5.07 ADDITIONAL INSTRUCTIONS AND DETAIL DRAWINGS

The Contractor will be furnished additional instructions and detail drawings to carry out the work included in the contract as required. The additional drawings and instructions thus supplied, to the Contractor, will coordinate with the contract documents and will be so prepared that they can be reasonably interpreted as a part thereof. The Contractor shall carry out the work in accordance with the additional detail drawings and instructions.

The Contractor and the Engineer will prepare, jointly (a) a schedule fixing the date at which special drawings will be required and by whom they will be made, such drawings, if any, to be furnished by the Engineer in accordance with said schedule, and (b) a schedule fixing the respective dates for the submission of shop or setting drawings; the beginning of manufacture, testing and installation of materials, supplies and equipment and the completion of the various parts of the work, each such schedule to be subject to change from time to time in accordance with the progress of the work.

5.08 OR EQUAL CLAUSES

Wherever in these contract documents a particular brand, make of materials, device or equipment is shown or specified, such brand, make of material, device or equipment should be regarded merely as a standard.

When a bidder submits an equivalent, it shall be the responsibility of the bidder to document the equivalence claim.

Failure to submit such documentation shall be grounds for rejection of the claim of equivalence.

If two or more brands, makes of material, devices or equipment are shown or specified, each should be regarded as the equal of the other. Any other brand, make of material, devices or equipment, which in the opinion of the Engineer is the recognized equal of that specified, considering quality, workmanship and economy of operation, and is suitable for the purpose intended, will be accepted. All material and workmanship shall, in every respect be in accordance with what, in the opinion of the Engineer is in conformity with approved modern practice.

Whenever the drawings, specifications or other contract documents or the direction of the Owner or its authorized agent admit of doubt as to what is permissible, and/or fail to note the quality of any work, that interpretation will be made by the Engineer which is in accordance with approved modern practice to meet the particular requirement of the contract.

In all cases, new materials shall be used unless this provision is waived by notice from the Engineer.

5.09 SUBSTITUTIONS

After the execution of the contract, substitution of equipment or materials of makes other than those named in the contract will be considered for one reason only. That the equipment proposed for substitution is superior or equal in construction and/or efficiency to that named in the contract.

Complete data, to include: shop drawings, specifications, performance curves, test results, list of similar installation with years of service, operating and maintenance instruction, a statement that the Contractor agrees to pay all costs that will result directly or indirectly from acceptance of the substitute, and all other necessary information; shall be submitted in triplicate to enable the Engineer to evaluate the proposed substitution equipment or material. The determination as to whether or not such changes will be permitted rests solely with the Engineer.

The Contractor shall take and assume full responsibility and bear any extra expense or cost incurred by changes advocated by him. Those costs include, but are not limited to, review time by the Engineer or the Engineer's Consultants, costs of redesign, and claims of other contractors affected by the resulting change. It will be assumed that the cost to the Contractor of the equipment or materials proposed to be substituted is less than the equipment or materials named in the contract, and if the substitution is approved, the contract price shall be reduced by an amount equal to the savings.

5.10 MATERIAL SAFETY DATA

In accordance with the requirements of N.J.S.A. 34:5A-1 et seq., "Workers and Community Right to Know Act", the State Department of Health has adopted a Workplace Hazardous Substance List (N.J.A.C. 8:59-9) which includes substances that pose a threat to the health and safety of employees. Therefore, under the provisions of N.J.A.C. 8:59-7, the contractor must furnish the Owner a "Material Safety Data Sheet" for each product which is supplied to the Owner which contains a substance listed on the Hazardous Substance List (N.J.A.C. 8:59-9). The Owner reserves the right to request a copy of the applicable Material Safety Data Sheet be forwarded with the delivery of each product. Furthermore, under the provisions of N.J.A.C. 8:59-5, each product shall have a label affixed or stenciled onto any container that contains any substance listed on the Hazardous Substance List (N.J.A.C. 8:59-9).

6.0 INSPECTION AND TESTING

6.01 INSPECTION

The Contractor shall afford every facility for inspection of the equipment, materials and supplies at all times by the Engineer prior to the delivery of same to the site of the work. All equipment, supplies and materials shall be tested in the presence of the Engineer, if so desired.

Any equipment, materials, supplies or workmanship deemed of inferior quality, or not in accordance with the finally approved specifications, brought to or incorporated in the work may be rejected by the Engineer. The equipment, materials and supplies and workmanship may be re-inspected at any time, prior to delivery to the site of the proposed improvements. The Contractor shall bear all the expense of testing materials.

When construction is not continuous through the normal work week, (Monday through Friday), Contractor must notify the Engineer at least 24 hours in advance of any stopping or starting of the work. Notification may be by writing, telephone, facsimile, telegraph or personal visit to the Engineer's listed office.

Contractor shall notify Engineer at least forty-eight (48) hours in advance to any work on Saturdays. There will be no work permitted on Sundays or holidays. If the project receives inspection by the Engineer, the normal working hours for the Engineers inspector are from 7:30 a.m. to 4:00 p.m., Monday through Friday. Any overtime inspection costs for the Engineers inspector which are avoidable shall be reimbursed by the Contractor.

Should the contractor have an emergency or need to cancel scheduled work, notification of the cancelled work must be received by the Engineer's inspector no later than 6:00 am the morning of the cancellation. Failure of the contractor to provide the required notification will require the contractor to pay for eight (8) hours of inspection at the rate of the Engineer's local inspector. The costs for cancellation of inspection without the required notification will be deducted from the contractor's payment application.

As the Owner is only paying for the contract time in the Contract Documents, the Contractor shall be responsible for all costs of inspection and contract management beyond the contract time limits, unless a written extension of time has been granted by the Owner. These costs are in addition to any liquidated damages that may be charged to the Contractor.

6.02 DAILY REPORTS

On a daily basis, the Contractor shall have his Authorized Representative complete, sign and present the Engineer with a Certificate of Site Safety Conditions, attached hereto as Form GC-6.02S.

At the Engineers discretion, the Contractor may be directed to furnish a daily report, on a form, which will include the date, the weather, a general description of the work performed, line item quantities involved, number and skill type of workers, equipment utilized, location of work, and any pertinent remarks affecting the work.

6.03 INSPECTORS

The work shall be conducted under the general observation of the Engineer through such Inspectors as the Engineer employs. Inspectors are stationed on the site of the work to represent the Engineer and to report to him concerning the observation of progress of the work and the workmanship and materials being furnished. Such Inspectors shall inform the Engineer and the Contractor when they observe that work being performed and/or the materials being furnished do not conform to the requirements of the Contract Documents. Such observation, if and when provided, shall not relieve the Contractor of any responsibility to furnish materials and perform work in complete accordance with the requirements of the Contract Documents, nor does such observation create any duty or obligation to any employee or invitee of Contractor, any Subcontractor, or to any third party. The Contractor is prohibited from relying upon the Engineer's site inspections or raising the engineer's observations as a defense to claims of defective work.

The Inspector is not authorized to revoke, alter, enlarge, relax or release any requirements of the Contract Documents or to issue instructions contrary to the Contract Documents.

6.04 ACCESS TO THE WORK

The Contractor shall furnish the Engineer with every reasonable facility for observing the work as performed.

The Engineer shall have the right to inspect all work done and all materials furnished either in the field or at the point of manufacture. The Contractor shall furnish or cause to be furnished safe access at all times to the places where preparation, fabrication or manufacture of materials and/or construction of the work is in progress.

When the Engineer or his representative are in or about the premises mentioned above in the course of their duties, they shall be deemed conclusively to be an invitee of the Contractor. If the Contractor is not the Owner of the premises mentioned above, the Owner thereof shall be deemed an agent of the Contractor with respect to the obligation assumed hereby. The Contractor or his agent, as described above, shall be liable for the payment of claims for injuries, damages, etc, for death of the Owner or his representative due to the negligence on the part of the Contractor or his agent.

6.05 COVERING UNINSPECTED WORK

If any work be buried, covered or otherwise concealed prior to observation by Engineer or contrary to the orders and direction of the Engineer and such work is not subject to testing and approval by any acceptable alternate method it must, if required by the Engineer, be uncovered for examination. Such uncovering and all necessary restoration regardless of the final acceptability of the work, uncovered, shall be at the expense of the Contractor.

6.06 TESTING MATERIALS

Except as may be provided elsewhere, tests or analysis of materials which are usually tested after delivery to the site, such as concrete aggregate, mixed-in-place concrete, and similar materials; will be performed by the Engineer or testing laboratories which will be approved by the Engineer and selected and paid for by the Contractor. The preliminary testing of concrete mixtures and tests or analysis of other materials, samples of which are to be submitted prior to delivery, will also be performed by the laboratory and paid for by the Contractor at the Engineer's request.

If the Engineer orders sampling and analysis or tests of materials which are usually accepted on certification of the manufacturer but which appear defective or not conforming to the requirements of the Specifications, the Contractor will bear the reasonable costs of sampling, transportation, tests and analysis.

7.0 PAYMENTS

7.01 CONSTRUCTION SCHEDULE AND PERIODIC ESTIMATES

Immediately after execution and delivery of the contract, and before the first partial payment is made, the Contractor shall deliver to the Engineer an estimated construction progress schedule in form satisfactory to the Engineer, showing proposed dates of commencement and completion of each of the various subdivisions of work required under the Contract Documents and the anticipated amount of each monthly payment that will become due to the Contractor in accordance with the progress schedule. The Contractor shall update the schedule each time a change is approved, but at a minimum every 30 days. An updated schedule shall be submitted with the Contractor's payment application. Should a payment application be submitted without an updated schedule, payment processing may be delayed. The Contractor shall also furnish the Engineer (a) a detailed estimate giving a complete breakdown of the contract price on Lump Sum Contracts and (b) periodic itemized estimates of work done for the purpose of making partial payments thereon. The costs employed in making up any of these schedules are to be used in determining the basis of partial payments.

Approval of the progress schedule by the Engineer does not modify the Contract or constitute Acceptance of the feasibility of the Contractor's logic, activity durations, or assumptions used in creating the schedule. If the schedule reflects a completion date different than that defined by the date of Notice to Proceed and Contract Time, this does not change the specified completion date. If the Engineer approves a schedule that reflects a completion date earlier than that specified as the Contract Time, the Owner will not accept claims for additional Contract Time or compensation as the result of failure to complete the Work by the earlier date shown on the progress schedule. Float is the amount of time that an activity may be delayed from its early start without delaying Completion. Float belongs to the Project and is not for the exclusive use of the Contractor or the Owner.

7.02 PAYMENTS

Unless otherwise specified, on the first day of each month or within thirty (30) days thereafter, the Engineer will estimate approximately the value of the work performed, and equipment, materials and supplies delivered on the ground inspected and accepted during the preceding month, according to these specifications, less any retainage, and shall be certified by the Engineer for payment to the Contractor. The value of the work, as estimated, will be determined by the lump sum and/or unit price bid. Requests for payment for materials on hand shall be accompanied with receipted invoice from supplier. Prior to such payment being made, the Contractor shall execute an agreement, provided by the Engineer and Solicitor on behalf of the Owner, which details the conditions of payment.

If, in the opinion of the Engineer, it is undesirable to replace any defective or damaged materials or to reconstruct or correct any portion of the work injured or not performed in accordance with the contract documents, the compensation to be paid to the Contractor hereunder shall be reduced by such amount as in the judgment of the Engineer shall be equitable.

No request for payment shall be approved until a Certification of Site Safety Conditions showing no unsafe conditions for each day worked in the payment request period has been furnished by the Contractor. When the work performed under this contract has been completed by the Contractor and accepted by the Owner, the Engineer shall make a final estimate of the work and certify the same to the Owner which shall for causes herein specified, pay to the Contractor the balance due, excepting therefrom such sum as may be lawfully retained under any provisions of this contract. All prior estimates and payments including those relating to extra work shall be subjected to corrections by this payment.

The Owner shall pay the amount due to the prime contractor for each periodic payment, final payment or retainage monies not more than 30 calendar days after the billing date, except as provided herein, which for periodic billing shall be established at the pre-construction meeting and memorialized in the minutes of the pre-construction meeting. The billing shall be deemed approved and certified 20 days after the Owner or Owner's Representative receives it, as indicated by the date stamped received on the billing by the Owner or Owner's Representative, except as provided herein, unless the Owner or Owner's Representative provides, before the end of the 20 day period, a written statement of the amount withheld and the reason for withholding payment. The Owner is a public or governmental agency that requires the governing body to vote on authorizations for each periodic payment, final payment or retainage monies, the amount due may be approved and certified at the next scheduled public meeting of the Owner's governing body, and paid during the Owner's subsequent payment cycle.

7.03 RETAINAGE

The Contractor is advised that for contracts $100,000.00 and under for improvement to real property, the sum of 10% of the amount due shall be held on each partial payment pending completion of the project.

The Contractor is advised that the Local Public Contracts Law, N.J.S.A. 40A:11-1 et seq., are applicable if the total amount of the contract awarded for this project exceeds $100,000.00. The provisions of N.J.S.A. 40A:11-1 et seq., provide that the Contractor may:

1. Agree to the withholding of payments in the manner prescribed in the contract, or may deposit with the contracting unit registered book bonds, entry municipal bonds, State bonds or other appropriate bonds of the State of New Jersey, or negotiable bearer bonds or notes of any political subdivision of the State, the value of which is equal to the amount necessary to satisfy the amount that otherwise would be withheld pursuant to the terms of the contract. The nature and amount of the bonds or notes to be deposited shall be subject to approval by the contracting unit. For the purposes of this section, "value" shall mean par value or current market value, whichever is lower.

2. Such agreement will be indicated by signing of estimate or payment certificates unless written communication to the contrary is made to the Owner and Engineer, or

If the Contractor agrees to the withholding of payments, the amount withheld shall be deposited, with a banking institution or savings and loan association insured by an agency of the Federal Government, in an account bearing interest at the rate currently paid by such institutions or associations on time or savings deposits. The amount withheld, or the bonds or notes deposited, and any interest accruing on such bonds or notes, shall be returned to the contractor upon fulfillment of the terms of the contract relating to such withholding, Any interest accruing on such cash withholdings shall be credited to the Owner.

Furthermore, N.J.S.A. 40A:11-1 et seq. provides that for contracts over $100,000.00 for improvement to real property:

1. From the total amounts due as ascertained through a current Engineer's estimate will be deducted an amount equivalent to two percent (2%) of the amount due on each partial payment shall be withheld by the Owner pending completion of the contract.

2. Upon acceptance of the work performed pursuant to the contract for which the contractor has agreed to the withholding of payments pursuant to this section, all amounts being withheld by the Owner shall be released and paid in full to the contractor as required by law after final acceptance by the Owner, without further withholding of any amounts for any purpose whatsoever, provided that the contract has been completed as indicated.

7.04 ACCEPTANCE OF FINAL PAYMENT AS RELEASE

The acceptance by the Contractor of final payment shall be and shall operate as the Contractor's release of the Owner from all claims and all liability to the Contractor, other than claims in stated amounts as may be specifically excepted by the Contractor, for all things done or furnished in connection with the work and for every act and neglect of the Owner, or Owners designee and others relating to or arising out of this work. Any payment, however, final or otherwise, shall not release the Contractor or its sureties from any obligations under the contract documents, and/or arising out of performance of the work, and/or arising out of the obligations undertaken by the surety under performance, payment and/or maintenance bonds.

7.05 OWNER'S RIGHT TO WITHHOLD PAYMENTS

Owner may withhold from the Contractor as much of any approved payments due him, as may, in the judgment of the Owner, be necessary, to

(a) Secure the payment of just claims then due and unpaid by any persons supplying labor or materials for the work.

(b) Protect the Owner from loss due to defective work not remedied, or

(c) Protect the Owner from loss due to injury to persons or damage to the work or property of other Contractors, Subcontractors or others caused by the act or neglect of the Contractor or any of his Subcontractors that the Owner may deem proper to satisfy such claims or to secure such protection. Such application of such money shall be deemed payment for the amount of the Contractor.

(d) Protect the Owner from enforcement action by others or from being in non-compliance with laws or regulations due to the failure of the Contractor to supply the Engineer and or Owner with Monthly Manning Reports, Certified Payroll Reports or other submittals required by the Engineer or Owner.

7.06 COSTS OF ENGINEERING AND INSPECTION

There will be deducted from the contract and retained by the Owner an amount to defray the cost of wages and overhead paid by the Owner to the Resident Engineer, Inspector or Inspectors employed on the work for any avoidable time in excess of eight (8) hours per day or on Saturdays, Sundays or legal holidays. This amount shall be determined at the rate of the hourly rate contract with the Owner per man hour for each Inspector or Resident Engineer for, in excess of 8 hours per day and at the rate of the hourly rate contract with the Owner per man hour for Saturday, Sunday and Holidays for each Inspector or Resident Engineer.

In addition, there will be deducted from the contract and retained by the Owner an amount equal to the cost paid by the Owner to the Engineer, for all inspection and contract administration performed in excess of the completion time stipulated for the contract, or as amended by approved change orders.

7.07 LIENS

Final payment of retained percentage shall not become due until the Contractor, shall furnish the Owner a complete release of liens arising out of his contract, or receipts in full, in lieu thereof covering claims of any kind or character for work or labor done, or labor or materials furnished by the Subcontractor, materialmen, persons or corporations whatsoever. The form attached entitled "Full Release and Waiver of Liens" shall be submitted with the final voucher prior to final payment.

7.08 PREVAILING WAGE PAYMENT CERTIFICATE

The form attached hereto, entitled "Prevailing Wage Payment Certification" shall be executed by the Contractor and submitted with the final voucher prior to final payment.

7.09 CERTIFIED PAYROLL REPORTS

The Contractor shall submit original certified payroll reports within 10 days of the payment of wages to the Owner with a copy to the Owners designee, in compliance with N.J.A.C. 12:60.

8.0 VALUE ENGINEERING CONSTRUCTION CHANGE ORDERS

8.01 IMPLEMENTATION OF VALUE ENGINEERING

In accordance with N.J.S.A. 40A:11-16.6 a contractor may submit a Value Engineering Construction Proposal (VECP) after the award of a contract for a project for structures or other improvements to real property, other than work affecting a public building, that exceed $5,000,000. This includes most public works projects, such as utility and environmental systems, road construction and repair, etc., but not building construction, improvements, or renovation. A VECP is a cost reduction proposal based on analysis by a contractor of the functions, systems, equipment, facilities, services, supplies, means and methods of construction, and any other

item needed for the completion of the contract consistent with the required performance, quality, reliability, and safety.

8.02 STATUTORY PROVISIONS

a. Value engineering construction change orders shall not be used to impair any of the essential functions, or characteristics of the project, or any portion of the work involved.

b. The contractor shall submit a value engineering construction proposal that completely describes the changes to the original specifications or proposal, impact on other project components, advantages and disadvantages of the proposed change, cost estimates and calculations on which they are based, any impact on the contract time schedule, and any other relevant information that the contracting unit may require in order to review the value engineering construction proposal. The contractor's cost for developing the value engineering construction proposal shall not be eligible for reimbursement by the contracting unit.

c. The contractor shall be liable for all reasonable costs incurred by the contracting unit for the technical evaluation and engineering review of a value engineering construction proposal presented by the contractor.

d. The contracting unit's engineer shall prepare a written report for the governing body that shall evaluate the value engineering construction proposal, make a recommendation on whether or not it should be accepted, rejected, or modified, and state to the contracting unit and contractor the amount of any projected cost savings.

e. The proposal shall not be approved unless the engineer reports to the governing body that the proposal appears consistent with the required performance, quality, reliability, and safety of the project and does not impair any of the essential functions, or characteristics of the project, or any portion of the work involved.

f. The contracting unit shall have the sole discretion to approve or disapprove a value engineering construction proposal.

g. The contractor and the contracting unit shall equally share in the cost savings generated on the contract as a result of an approved value engineering construction change order. Once the project is completed, the contracting unit's engineer shall verify the cost savings to reflect the actual cost of the work, and such verified cost saving shall be the basis for the savings shared equally with the contractor.

h. The contractor shall have no claim against the contracting unit as a result of the contracting unit's disapproval of a value engineering construction proposal.

8.03 PROCEDURES

An initial submission is required to use the Value Engineering process. The initial proposal shall outline the general technical concepts associated with the proposal and the estimated savings that will result.

The initial proposal will be reviewed by the Owner and, if found to be conceptually acceptable, approval to submit a final proposal will be granted by the Owner. A finding of conceptual acceptability of the initial proposal in no way obligates the Owner to approve the final proposal. The Contractor shall have no claim against the Owner as a result of the rejection of any such final proposal.

Final proposals will be considered only after Owner approval of the initial proposal.. Final proposals will not be considered if submitted after 50 percent completion of the Work has occurred, based on monthly estimates

amounting to more than 50 percent of the total Contract price (subject to any approved adjustments), unless the remaining Contract Time is one year or more.

Proposals will not be considered that change the following:

a. The type, thickness, or joint designs of a concrete, or HMA surface, intermediate, or base course.

b. The types and thicknesses of the unbound materials underlying a concrete, or HMA surface, intermediate, or base course.

c. The basic design of bridges, defined as the type of superstructure and substructure, span length type and thickness of deck, type of beam and arrangement, geometrics, width, and underclearance.

d. The basic design of retaining walls.

e. The basic design of overhead sign supports and breakaway sign supports.

f. The type of noise barriers.

g. Special architectural aesthetic treatments of structures.

All proposals for changes to bridges and structures shall conform to the current AASHTO Standard Specifications for Highway Bridges as modified by the NJDOT Design Manual for Bridges and Structures.

As a minimum, the following materials and information shall be submitted with each final proposal plus any additional information requested by the Owner:

a. A statement that the final proposal is submitted as a Value Engineering proposal.

b. A description of the difference between the existing Contract requirements and the proposed change, and the comparative advantages and disadvantages of each, including considerations of safety, service life, economy of operations, stage construction, ease of maintenance, and desired appearance.

c. Complete plans, specifications, and calculations showing the proposed revisions relative to the original Contract features and requirements. If the proposal is approved, the Contractor shall submit drawings, in ink, on polyester film such as Mylar or Herculene, 4 mils thick, matted on both sides except as follows:

   (1) Structural drawings may be submitted in pencil.

   (2) Electrical drawings may be matted on one side and may be submitted in pencil.

   (3) Cross-section sheets may be 3 mils thick and may be matted on one side.

   All plans and engineering calculations shall bear the signature of a Professional Engineer licensed to practice in the State.

d. A complete cost analysis indicating the final estimated costs and quantities to be replaced by the proposal, the new costs and quantities generated by the final proposal, and the cost effects of the proposed changes on operational, maintenance, and other considerations.

e. A specific date by which a Change Order adopting the final proposal must be executed so as to obtain the maximum cost reduction during the remainder of the Contract. This date must be selected to allow the Owner ample time, usually a minimum of 45 days, for review and processing a Change Order. Should the Owner find that insufficient time is available for review and processing, it may reject the final proposal solely on such basis.

f. A statement as to the effect the final proposal has on the Contract Time.

g. A description of any previous use or testing of the final proposal on another Owner project or elsewhere and the conditions and results therewith. If the final proposal was previously submitted on another Owner project, indicate the date, the project, and the action taken by the Owner.

h. The proposal shall not be experimental in nature but shall have been proven to the Owner's satisfaction under similar or acceptable conditions on another Owner project or at another location acceptable to the Owner.

Proposals will be considered only after Award of Contract and only when all of the following conditions are met:

a. The Contractor is cautioned not to base any bid prices on the anticipated approval of a proposal and to recognize that such proposal may be rejected. In the event of rejection, the Contractor is required to complete the Contract according to the original Plans and Specifications and the prices initially bid and accepted by the Governing Body.

b. All proposals, approved or not approved by the Owner for use in the Contract, apply only to the ongoing Contract or Contracts referenced in the proposal. The proposals shall become the property of the Owner and shall contain no restrictions imposed by the Contractor on their use or disclosure. The Owner will have the right to use, duplicate, and disclose in whole or in part any data necessary for the utilization of the proposal. The Owner retains the right to use any accepted proposal or part thereof on any other or subsequent project without any obligation to the Contractor. This provision is not intended to deny rights provided by law with respect to patented materials or processes.

c. If the Owner already has under consideration certain revisions to the Contract that are subsequently incorporated in a proposal, the Owner will reject the Contractor's proposal and may proceed with such revisions without any value engineering obligation to the Contractor.

d. The Contractor shall make no claim against the Owner or Owner's agents for any costs or delays due to the Owner's rejection of a proposal, including but not limited to development costs, anticipated profits, or increased materials or labor costs resulting from delays in the review of such proposal.

e. The Engineer will determine whether a proposal qualifies for consideration and evaluation. The Owner may reject any proposal which is not consistent with the basic design criteria for the Project.

f. The Engineer may reject all or any portion of Work performed pursuant to an approved proposal if the Engineer determines that unsatisfactory results are being obtained. The Engineer may direct the removal of such rejected Work and require the Contractor to proceed according to the original Contract requirements without reimbursement for any Work performed under the proposal, or for its removal. Where modifications to the proposal are approved to adjust to field or other conditions, reimbursement is limited to the total amount payable for the Work at the Contract prices as if it were constructed according to the original Contract requirements. Such rejection or limitation of reimbursement does not constitute the basis of any claim against the Owner for delay or for any other costs.

g. Proposals will be considered only if equivalent options are not already provided in the Contract Documents.

h. The proposal shall be made based on items of work scheduled to be done by the Contractor. Anticipated cost savings based on revisions of utility relocations or other similar items to be done by others will not be considered. Proposals that may increase the cost of Work done by others may be considered.

i. If additional information is needed to evaluate proposals, this information must be provided in a timely manner. Such additional information could include, where design changes are proposed, results of field investigations and surveys, design computations, and field change sheets.

The contracting unit's engineer shall prepare a written report for the governing body that shall evaluate the value engineering construction proposal, make a recommendation on whether or not it should be accepted, rejected, or modified, and state to the contracting unit and contractor the amount of any projected cost savings.

a. The proposal shall not be approved unless the Engineer reports to the Owner's governing body that the proposal appears consistent with the required performance, quality, reliability, and safety of the project and does not impair any of the essential functions, or characteristics of the project, or any portion of the work involved.

b. If the Owner fails to respond to the final proposal by the date specified, the Contractor shall consider the final proposal rejected and shall make no claim against the Owner as a result thereof.

c. The Owner shall have the sole discretion to approve or disapprove a value engineering construction proposal.

If the proposal is accepted, the changes will be authorized by Change Order. Payment will be made as follows:

a. The changes will be incorporated into the Contract by adjustments in the quantities of Pay Items, agreed upon Extra Work Items or by Force Account, as appropriate, according to the Specifications.

b. Once the project is completed, the contracting unit's engineer shall verify the cost savings to reflect the actual cost of the work, and such verified cost saving shall be the basis for the savings shared equally with the contractor. The costs of such verification shall be borne equally by both parties.

c. The Owner's costs for review and processing of the proposal will be deducted from the savings. The cost of the Engineer to verify the savings shall be apportioned equally between the parties.

d. A Contractor's costs for development, design, and implementation of the proposal are not eligible for reimbursement.

e. The Contractor may submit proposals for an approved Subcontractor, provided that reimbursement is made by the Owner to the Contractor and that the terms of the remuneration to the Subcontractor are satisfactorily negotiated and accepted before the proposal is submitted to the Owner. Subcontractors may not submit a proposal except through the Contractor.

9.0 DIFFERING SITE CONDITIONS PROVISIONS (N.J.S.A. 40A:11-16.7)

a. Differing Site Conditions Provisions:

(1) If the contractor encounters differing site conditions during the progress of the work of the contract, the contractor shall promptly notify the contracting unit in writing of the specific differing site conditions encountered before the site is further disturbed and before any additional work is performed in the impacted area.

(2) Upon receipt of a differing site conditions notice in accordance with Section 9.0(a)1 of this subsection, or upon the contracting unit otherwise learning of differing site conditions, the contracting unit shall promptly undertake an investigation to determine whether differing site conditions are present.

(3) If the contracting unit determines different site conditions that may result in additional costs or delays exist, the contracting unit shall provide prompt written notice to the contractor containing directions on how to proceed.

(4) (a) The contracting unit shall make a fair and equitable adjustment to the contract price and contract completion date for increased costs and delays resulting from the agreed upon differing site conditions encountered by the contractor.

(b) If both parties agree that the contracting unit's investigation and directions decrease the contractor's costs or time of performance, the contracting unit shall be entitled to a fair and equitable downward adjustment of the contract price or time of performance.

(c) If the contracting unit determines that there are no differing site conditions present that would result in additional costs or delays, the contracting unit shall so advise the contractor, in writing, and the contractor shall resume performance of the contract, and shall be entitled to pursue a differing site conditions claim against the contracting unit for additional compensation or time attributable to the alleged differing site conditions.

(5) Execution of the contract by the contractor shall constitute a representation that the contractor has visited the site and has become generally familiar with the local conditions under which the work is to be performed.

(6) As used in this subsection, "differing site conditions" mean physical conditions at the contract work site that are subsurface or otherwise concealed and which differ materially from those indicated in the contract documents or are of such an unusual nature that the conditions differ materially from those ordinarily encountered and generally recognized as inherent in the work of the character provided for in the contract.

b. Suspension of Work Provisions:

(1) The contracting unit shall provide written notice to the contractor in advance of any suspension of work lasting more than 10 calendar days of the performance of all or any portion of the work of the contract.

(2) If the performance of all or any portion of the work of the contract is suspended by the contracting unit for more than 10 calendar days due to no fault of the contractor or as a consequence of an occurrence beyond the contracting unit's control, the contractor shall be entitled to compensation for any resultant delay to the project completion or additional contractor expenses, and to an extension of time, provided that, to the extent feasible, the contractor, within 10 calendar days following the conclusion of the suspension, notifies the contracting unit, in writing, of the nature and extent of the suspension of work. The notice shall include available supporting information, which information may thereafter be supplemented by the contractor as needed and as may be reasonably requested by the contracting unit. Whenever a work suspension exceeds 60 days, upon seven days' written notice, either party shall have the option to terminate the contract for cause and to be fairly and equitably compensated therefore.

(3) Upon receipt of the contractor's suspension of work notice in accordance with Section 9.0(A)2 of this subsection, the contracting unit shall promptly evaluate the contractor's notice and promptly advise the contractor of its determination on how to proceed in writing.

(4) (a) If the contracting unit determines that the contractor is entitled to additional compensation or time, the contracting unit shall make a fair and equitable upward adjustment to the contract price and contract completion date.

(b) If the contracting unit determines that the contractor is not entitled to additional compensation or time, the contractor shall proceed with the performance of the contract work, and shall be entitled to pursue a suspension of work claim against the contracting unit for additional compensation or time attributable to the suspension.

(5) Failure of the contractor to provide timely notice of a suspension of work shall result in a waiver of a claim if the contracting unit can prove by clear and convincing evidence that the lack of notice or delayed notice by the contractor actually prejudiced the contracting unit's ability to adequately investigate and defend against the claim.

c. Change in Character of Work Provisions:

(1) If the contractor believes that a change directive by the contracting unit results in a material change to the contract work, the contractor shall so notify the contracting unit in writing. The contractor shall continue to perform all work on the project that is not the subject of the notice.

(2) Upon receipt of the contractor's change in character notice in accordance with paragraph (1) of this subsection, the contracting unit shall promptly evaluate the contractor's notice and promptly advise the contractor of its determination on how to proceed in writing.

(3) (a) If the contracting unit determines that a change to the contractor's work caused or directed by the contracting unit materially changes the character of any aspect of the contract work, the contracting unit shall make a fair and equitable upward adjustment to the contract price and contract completion date. The basis for any such price adjustment shall be the difference between the cost of performance of the work as planned at the time of contracting and the actual cost of such work as a result of its change in character, or as otherwise mutually agreed upon by the contractor and the contracting unit prior to the contractor performing the subject work.

(b) If the contracting unit determines that the contractor is not entitled to additional compensation or time, the contractor shall continue the performance of all contract work, and shall be entitled to pursue a claim against the contracting unit for additional compensation or time attributable to the alleged material change.

(4) As used in this subsection, "material change" means a character change which increases or decreases the contractor's cost of performing the work, increases or decreases the amount of time by which the contractor completes the work in relation to the contractually required completion date, or both.

d. Change in Quantity Provisions:

(1) The contracting unit may increase or decrease the quantity of work to be performed by the contractor.

(2) (a) If the quantity of a pay item is cumulatively increased or decreased by 20 percent or less from the bid proposal quantity, the quantity change shall be considered a minor change in quantity.

(b) If the quantity of a pay item is increased or decreased by more than 20 percent from the bid proposal quantity, the quantity change shall be considered a major change in quantity.

(3) For any minor change in quantity, the contracting unit shall make payment for the quantity of the pay item performed at the bid price for the pay item.

(4) (a) For a major increase in quantity, the contracting unit or contractor may request to renegotiate the price for the quantity in excess of 120 percent of the bid proposal quantity. If a mutual agreement cannot be reached on a negotiated price for a major quantity increase, the contracting unit shall pay the actual costs plus an additional 10 percent for overhead and an additional 10 percent for profit, unless otherwise specified in the original bid.

(b) For a major decrease in quantity, the contracting unit or contractor may request to renegotiate the price for the quantity of work performed. If a mutual agreement cannot be reached on a negotiated price for a major quantity decrease, the contracting unit shall pay the actual costs plus an additional 10 percent for overhead and an additional 10 percent for profit, unless otherwise specified in the original bid; provided, however, that the contracting unit shall not make a payment in an amount that exceeds 80 percent of the value of the bid price multiplied by the bid proposal quantity.

(5) As used in this subsection, the term "bid proposal quantity" means the quantity indicated in the bid proposal less the quantities designated in the project plans as "if and where directed."

PREVAILING WAGE PAYMENT CERTIFICATION

This form must be executed by Contractor and submitted with final voucher prior to final payment.

PROJECT _____

TO _____
(NAME OF OWNER AS IT APPEARS IN CONTRACT)

RE: Contract for Certification of Contractor of Payment of Prevailing Wages to Workmen Pursuant to New Jersey Prevailing Wage Act. Chapter 150 Laws of 1963 of New Jersey and all other claims.

The undersigned Contractor hereby certifies that any and all workmen employed by the undersigned Contractor and all Subcontractors have been paid in full and prevailing wages for their respective crafts or trades as determined and computed by the Commissioner of Labor and Industry, of the State of New Jersey, and that all suppliers and material men have been paid in full all amounts claimed by them, and there remains no outstanding claim, lien, or dispute; nor any contingent claim by any of the foregoing:

DATED: _____ _____
CONTRACTOR

STATE OF NEW JERSEY

COUNTY OF _____

_____, being duly sworn according to law, upon his oath disposes and says that he is the _____ (Owner-pres. or authorized agent) of _____ (name of corporation) that he has read the aforesaid statement of certification and knows the content thereof, and that the same is true of his own knowledge and this affidavit is being executed by him pursuant to the New Jersey Prevailing Wage Act (Chapter 150 of Laws of 1963).

_____
Signature

Sworn and subscribed to
before me this _____day of _____ 20____,

_____
Notary Public of New Jersey

CERTIFICATION OF SITE SAFETY CONDITIONS

Form GC-6.02S

TOWN: _____ PROJECT NAME: _____

COUNTY: _____ JOB #: _____

I hereby certify that site safety conditions and the means and methods of construction have been and are in accord with the provisions of the Contract Documents and all requirements contained and referenced therein since the last executed Certificate of Site Safety Conditions, except as noted:

- ☐ Unsafe Trench Condition
- ☐ Unsafe Entry to Live Manhole
- ☐ Unsafe Traffic Control
- ☐ Unsafe Equipment
- ☐ Inadequate Fall Protection
- ☐ Proximity to Electric
- ☐ Other _____

_____

- ☐ None _____

Comments/Resolutions _____

_____

Contractor: _____

by: _____
Authorized Representative

I executed this form at _____ on _____.
Time Date

FULL RELEASE AND WAIVER OF LIENS

WHEREAS, the undersigned is a subcontractor, supplier or other person furnishing work, services, materials or equipment upon real estate owned by (OWNER) in (MUNICIPALITY), State of New Jersey in furtherance of that certain (PROJECT NAME) sponsored by the (OWNER) (hereinafter referred to as "Owner").

Receipt is acknowledged of $ _____, which represents full payment, for work, services, materials and/or equipment furnished and installed by us at the above referenced project, the undersigned does hereby waive, release and relinquish the Owner and the Building/Land from any and all claims and/or construction liens pursuant to N.J.S.A. 2A:44A-1 *et seq.* relating to this Project, to the extent of $ _____.

We agree to hold the Owner and the Building/Land harmless against any claim made or lien filed by any of our material suppliers and subcontractors who performed work or supplied materials for the Project to-date.

In addition, the undersigned warrants: (a) that any claims for payment for work, services, materials and/or equipment furnished in the construction or repair of the aforesaid real estate and improvements have not been assigned; (b) that all laborers, subcontractors and suppliers of the undersigned who have furnished work, services, materials and/or equipment in the construction or repair of the aforesaid real estate and improvements have been fully paid and that none of such laborers, subcontractors or suppliers have or will have any claim, demand or lien against the aforesaid real estate and improvements; and (c) that no financing statement, chattel mortgage, security interest, conditional bill of sale or retention of title agreement has been given or executed or will be given or executed for or in connection with any materials, appliances, machinery, fixtures or furnishings placed upon or installed, or to be placed upon or installed, in the aforesaid real estate and improvements by the undersigned.

IN WITNESS WHEREOF, the undersigned has executed and sealed this Full Release and Waiver of Liens this

_____ day of _____, 20.

Paid to date: $ _____

NAME OF SUBCONTRACTOR/SUPPLIER: _____

By: _____

Title: _____

Sworn and subscribed to

before me this _____ day of _____ 20____,

_____
Notary Public of New Jersey

Table of Contents – ELSA Vehicle Storage Building - 1102M026

Division/Section	Section Title	# Pages
SOW	SCOPE OF WORK	6
DIVISION 1 - GENERAL REQUIREMENTS		
01000	GENERAL REQUIREMENTS	2
01010	AS-BUILTS	1
01300	SUBMITTALS	4
01740	CLEANING AND RESTORATIONS	3
DIVISION 2 - SITE CONSTRUCTION		
02627	HDPE SANITARY SEWER FORCE MAIN & FITTINGS	7
02655	WATER SERVICE LINE (COPPER)	3
DIVISION 3 – CONCRETE		
033000	CAST-IN-PLACE CONCRETE	27
DIVISION 4 – MASONRY		
048100	UNITED MASONRY ASSEMBLIES	16
DIVISION 5 – METALS		
050200	PRE-ENGINEERED RIGID FRAMES	3
050300	PRE-ENGINEERED METAL BUILDINGS	2
055000	METAL FABRICATIONS	20
DIVISION 7 – THERMAL & MOISTURE PROTECTION		
077100	GUTTERS AND DOWNSPOUTS	4
DIVISION 8 – OPENINGS		
081000	METAL DOORS AND FRAMES	5
081100	STEEL SECTIONAL OVERHEAD GARAGE DOORS	5
DIVISION 9 – FINISHES		
099123	INTERIOR PAINTING	15
DIVISION 11 – EQUIPMENT		
11520	FIRE EXTINGUISHERS	2
MECHANICAL, ELECTRICAL, & PLUMBING		
DIVISION 22 – PLUMBING		
220500	COMMON WORK REQUIREMENTS FOR PLUMBING	10
220517	SLEEVES AND SLEEVE SEALS FOR PLUMBING PIPING	5
220518	ESCUTCHEONS FOR PLUMBING PIPING	3
220523	GENERAL DUTY VALVES FOR PLUMBING PIPING	13
220529	HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT	14
220548	VIBRATION AND SEISMIC CONTROLS FOR PLUMBING PIPING AND EQUIPMENT	5
220553	IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT	6
220700	PLUMBING INSULATION	31
221113	FACILITY WATER DISTRIBUTION PIPING	10
221116	DOMESTIC WATER PIPING	19
221119	DOMESTIC WATER PIPING SPECIALTIES	21
221313	FACILITY SANITARY SEWERS	5
221316	SANITARY WASTE AND VENT PIPING	10
221319	SANITARY WASTE PIPING SPECIALTIES	12
221343	PACKAGED DUPLEX GRINDER PUMPS	8

Table of Contents – ELSA Vehicle Storage Building - 1102M026

Division/Section	Section Title	# Pages
224000	PLUMBING FIXTURES	5
DIVISION 23 – HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)		
230500	COMMON WORK REQUIREMENTS FOR HVAC	10
230513	COMMOM MOTOR REQUIREMENTS FOR HVAC EQUIPMENT	3
230529	HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT	13
230548	VIBRATION AND SEISMIC CONTROLS FOR HVAC PIPING AND EQUIPMENT	5
230553	IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT	6
230593	TESTING, ADJUSTING AND BALANCING FOR HVAC	16
230700	HVAC INSULATION	41
231123	FACILITY NATURAL GAS PIPING	28
233113	METAL DUCTS	21
233300	AIR DUCT ACCESSORIES	20
233423	HVAC POWER VENTILATORS	9
233713	DIFFUSERS, REGISTERS AND GRILLES	3
235533	NATURAL GAS UNIT HEATERS	4
238233	ELECTRIC BASEBOARD RADIATION	3
DIVISION 26 – ELECTRICAL		
260500	COMMON WORK RESULTS FOR ELECTRICAL – MATERIALS AND METHODS	10
260519	CONDUCTORS & CABLES	6
260526	GROUNDING AND BONDING	8
260529	HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS	5
260533	RACEWAYS AND BOXES	9
260543	UNDERGROUND DUCTS AND REACEWAYS FOR ELECTRICAL SYSTEMS	9
260553	ELECTRICAL IDENTIFICATION	6
260923	LIGHTING CONTROL DEVICES	8
262200	LOW VOLTAGE DRY TYPE ISTRIBUTIONTRANSFORMERS	5
262416	PANELBOARDS & SWITCHBOARDS	8
262726	WIRING DEVICES	8
262813	FUSES	2
262816	ENCLOSED SWITCHES AND CIRCUIT BREAKERS	8
264113	LIGHTNING PROTECTION FOR STRUCTURES	
265100	LED INTERIOR LIGHTING	7
DIVISION 28 – ELCTRONIC SAFETY AND SECURITY		
283111	ADDRESSABLE FIRE ALARM SYSTEM – NON-VOICE	31
DIVISION 31 – EARTHWORK		
311000	SITE CLEARING	4
312000	EARTH MOVING	10
DIVISION 32 – EXTERIOR IMPROVEMENTS		
321216	ASPHALT PAVING	5
321313	CONCRETE PAVING	6
329200	TURF AND GRASSES	5
329201	TEMPORARY SOIL EROSION & SEDIMENT CONTROL MEASURES	2
330500	COMMON WORK RESULTS FOR UTILITIES	10

Table of Contents – ELSA Vehicle Storage Building - 1102M026

APPENDICES		
A	GEOTECHNICAL REPORT	
B	ENVIRONMENTAL PERMITSW	

DEBARMENT LIST

The list of debarred firms and individuals can be reviewed at the following web address:

https://www.nj.gov/labor/wagehour/wagerate/prevailing_wage_debarment_list.html

PREVAILING COUNTY & STATE WAGE RATES

Prevailing wage rates are available online at the following web address:
https://www.nj.gov/labor/wagehour/wagerate/pwr_construction.html.

A copy will be included with each contract set provided to the awarded contractor.

ELSA – VEHICLE STORAGE BUILDING

SCOPE OF WORK

1.01 GENERAL

In general, this project consists of the construction of a Pre-Engineered Metal Building for the Ewing Lawrence Sewerage Authority at the Wastewater Treatment Plant; 600 Whitehead Road, Lawrenceville, NJ. This project will include site preparation and erection of a pre-engineered vehicle storage building.

1.02 BACKGROUND

RVE was contracted to provide engineering services for the design of the new Vehicle Storage Building. The engineering design effort included assessment of ELSA's vehicle storage needs; conducted site surveys and geotechnical investigations (refer to the geotechnical report in APPENDIX – D - GEOTECHNICAL REPORT; and designed (or collaborated with others) systems for each discipline – mechanical, plumbing, electrical, civil/site, architectural, and structural. This scope of work is an overview of elements of construction for the project.

1.03 DESCRIPTION OF WORK

The scope of work below outlines the general items and distribution of work and shall not be construed as being all inclusive.

The work of this project consists of the following:

1. MOBILIZATION – Mobilize to the project site for work and provide a complete demobilization upon completion of work. All costs for these efforts shall be as defined in the Contract Documents an included in the lump sum line item "Mobilization (Maximum 4% of Contract Amount per NJAC 7:14-2.9)" of the Bid Form. This bid item will be recommended for payment by the Engineer once 10% of the total project cost is recommended for payment. It shall only be paid where listed in the Bid Proposal and per the guidelines of NJAC 7:14-2.9.

2. SITE WORK - Perform development work consisting of site clearing, stripping, and storing topsoil, site regrading, storm water components and swale construction, and site improvements. Site improvements to include building entrance apron and on-property quarry fill pavement from service road to the building entrance apron. Excess soils, if any, shall be removed from site.

3. SITE PIPING – Furnish and install all piping and make all connections to utility sources and connection points, including – water, gas, electric, sanitary, and storm. The Contractor shall also provide and install a commercial pump station and force main.

4. CONCRETE WORK - Provide all plain and reinforced cast-in-place concrete, complete in place, as indicated on the drawings, and needed for a complete and proper installation. Concrete work to include concrete building access apron; concrete flooring and foundation for the vehicle storage building; bollards; and all other locations shown in project documents.

5. PRE-ENGINEERED METAL BUILDING – All costs associated with the provision, delivery and construction of the pre-engineered vehicle storage building shall be included in this bid line item. Contractor shall furnish and install motorized overhead doors as indicated in the drawings. Flood openings in the PEMB will be also required. Contractor shall furnish and install the flood openings in coordination with the OHD manufacturer and the PEMB supplier.

6. MECHANICAL SYSTEMS – Furnish and install all mechanical systems for the vehicle storage building as specified or detailed in the project documents for a complete and functional system. Provide required startup testing, manuals, and training. Complete and as specified or detailed in the project documents.

   The project drawings and spec sections reflect gas-fired unit heaters as the basis of design. The contractor may propose an infrared heating system as an approved equal. If an infrared heating system is proposed, the contractor's shop drawings shall provide detailed layouts complete with supports and appurtenances. A spec section is provided to address infrared heating systems, should that be the contractor's proposed method for heating.

7. ELECTRICAL SYSTEMS – Furnish and install all electrical systems for the vehicle storage building site including conduit to feed from the solids handling building and feed to site lighting. Furnish and install all electrical systems for the vehicle storage building as specified or detailed in the project documents for a complete and functional system. Provide required startup testing, manuals, and training.

   Please note that the bathroom, including the walls, ceiling, and appurtenances, is not to be constructed under this contract. Only floor stub-ups for plumbing, electrical outlets, and roughing (conduit, boxes, etc.) for the water heater, exhaust fan, and bathroom lighting, are to be provided.

8. PLUMBING SYSTEMS - Furnish and install all plumbing systems for the site including connections to water supply, gas supply, and sanitary sewer. Furnish and install all plumbing systems for the vehicle storage building as specified or detailed in the project documents for a complete and functional system. A trench drain system is to be included in the storage building bays. An area is shown for a future oil/water separator should this become a code requirement. Provide gas to mechanical systems. Provide required startup testing, manuals, and training.

Please note that the bathroom, including the walls, ceiling, and appurtenances, is not to be constructed under this contract. Only floor stub-ups for plumbing and electrical outlets are to be provided.

9. FIRE ALARM SYSTEM - Furnish and install a local fire alarm system with local enunciation for the vehicle storage building as specified or detailed in the project documents for a complete and functional system. Provide required startup testing, manuals, and training.

10. FIRE RATED WALL SYSTEM – A fire rated wall is needed between two groupings of bays to limit any exposed area to less than 5,000 SF. Adequate water supply is not available for fire suppression.

11. LIGHTNING PROTECTION SYSTEM – Provide and install a lightning protection system.

12. ALLOWANCES – GENERAL – A general allowance to cover additional expenses, such as outside agency service charges or additional work as directed by the Authority. Costs are to be approved in writing. General Contractor overhead expense limited to 5% markup for allowance items. See item 1.04 B for further clarity.

    Note: Prior to award ELSA reserves the right to reduce allowance amount equally for all bidders.

13. PROJECT CLOSEOUT – Costs shall include delivery of all O&M manuals, warranties, and other pertinent documents as required for project completion. This item also includes all work to obtain final Certificate of Occupancy. A minimum bid amount of $10,000.00 is required for this item. This is in addition to the 2% retainage.

1.04 BID ITEM NOTES

A. The **Bid Form** lists several lump sum items on which the Bidder will present his or her cost to perform the Work. The items shall be all inclusive of the Work that is required for a full and functioning system as shown and specified. For Work that is not specifically listed as part of a line item, but required to complete the scope, payment shall be made as part of the various items in the Contractor's bid.

B. **Allowance**: There are several specified allowances, plus an allowance provided for unforeseen conditions, or the replacement of any equipment found to be defective during the performance of the Contract work. It shall include work not in the contract that the Contractor is directed to perform in writing by the Owner, or the project engineer at an agreed upon price. The cost of the work shall be approved by the Owner prior to Contractor initiating the work. Any unused monies shall be retained by the Owner.

Work under the allowance is subject to the conditions set forward in Section 3.1 of the General Conditions. Special testing will also be reimbursed under the General Allowance.

1.05 COORDINATION

A. Contractor shall, at no additional cost:

1. Assume full responsibility for protection and safekeeping of products stored on and off premises.
2. Not store products in locations that interfere with the operations of Owner or other Contractors. If stored products are found to interfere, Contractor is to move immediately without additional payment.
3. Obtain and pay for all storage or work areas required for his or her operations other than what can be arranged on site. A Site Staging Storage Plan shall be submitted for review.
4. Coordinate onsite storage areas with Engineering.
5. Not unreasonably encumber the site with materials and equipment.
6. Properly store all equipment onsite and insure against damage, fire and/or explosion.
7. Assume full responsibility for site safety within the work area.
8. Provide all required potable water and temporary power required to complete all work required under this contract. Connection to existing onsite utilities is permissible on a temporary basis, once in place.

1.06 COMPLETION SCHEDULE

A. The contractor shall provide a construction schedule which shows project closeout within the contract specified time following the notice to proceed. A temporary occupancy and final certificate of occupancy shall be procured in advance of the project closeout. The project has obtained Lawrence Township Planning Board approval including Soil Erosion permit approval. Conditions of permit applies.

1.07 PROJECT DOCUMENTS

A. General Contractors intending to bid this project shall purchase a set of official documents from RVE. Contact shall be made by phone or by email to make bid package purchase arrangements, at 856-795-9595 or by submitting your request to

RVEbidinterest@rve.com. RVE will make a digital link available to download project documents to the plan holders.

B. Refer to APPENDIX – E – PROJECT DRAWING SET INDEX for a listing of all the drawings comprising the project set of drawings.

1.08 MISCELLANEOUS

C. While there will be no Pre-Bid meeting, site visits can be scheduled and are recommended. Contact Chris Gianotto at 609-587-4061.

D. The above Scope of Work outlines the general items and distribution of work and shall not be construed as being all inclusive.

E. The general contractor will be responsible for scheduling testing services in coordination with RVE's construction manager. The costs for special testing services will be paid via an allowance. ELSA will select the service to be utilized and test will be coordinated with the Engineer.

F. Contractor shall verify all dimensions and existing conditions in the field prior to the start of the construction. Any errors or discrepancies shall be brought to the attention of the engineer immediately.

G. Location of existing utilities are approximate and must be verified in the field prior to the start of construction.

H. It is recommended that all bidders make arrangements to visit the site to verify the existing conditions and determine potential difficulties in staging of work for site conditions to be encountered prior to bid. The project site is accessible to the Contractor to perform a site visit to verify the existing conditions. No extra monies will be paid for site and equipment contingencies. Contractor may visit the site between 9 A.M. and 2 P.M. and shall coordinate the site visit with the ELSA Maintenance Supervisor, as noted.

I. Contractor shall be responsible for coordinating his/her work and that of all other contractors on the project. Any costs related to his coordinating shall be included in his proposal.

J. Materials on site: Payment shall be made for materials delivered on-site per N.J.S.A 40A:11-16.4.

K. A Mercer County Soil Erosion Permit is being processed and all conditions will be the responsibility of the Contractor.

L. Any asphalt price adjustment costs will be addressed under the General Allowance.

M. The Contractor shall provide and maintain a project schedule and shall update the schedule for review at monthly project meetings.

N. Geotechnical Data is included in Appendix 'A' for informational purposes.

O. The Wetlands and Land Use Permits are in-place and attached in Appendix B. All conditions of the Permit shall be adhered to during the project. A D&R Canal Permit is pending. No site work can commence until this approval is in place. We are advertising in advance of expected permit approval to expedite the process. Upon receipt of D&R Canal permit, we will confirm changes or review impacts with the successful bidder. We do not anticipate any changes.

END OF SCOPE

SECTION 01000

GENERAL REQUIREMENTS

1.01 GENERAL

A. Only major items of work are given in the Bid Form, but it is the intent of the specifications to secure a completely interconnected and functioning system, and if any workmanship or materials be required which are obviously necessary to carry out the full intent and meaning of the plans and specifications or to be reasonably inferred therefrom, the cost of such workmanship or materials shall be included in the unit price bid for the major items of work.

B. Reproducible As-built drawings must be furnished by the Contractor to the Engineer prior to final payment in accordance with Section 01010.

C. Contractor shall notify all utility companies prior to construction of utilities by contacting 1-800-272-1000.

D. Prior to any excavation, the Contractor shall have all utilities marked and shall excavate or otherwise determine the exact location and elevations of said utilities. The Contractor shall notify the Engineer of any conflicts. The Contractor shall arrange for any necessary utility relocations or plan changes and shall reschedule his operations appropriately.

E. The Contractor, in the construction of any project, shall not stockpile materials or his equipment on any private property; except areas designated by the drawings as directed by the Engineer. If so required, the Engineer may direct the Contractor to have his equipment removed from any project during weekend hours.

F. All work of refilling sunken ditches, repaving over trenches and keeping streets and sidewalks in passable condition shall be done to the satisfaction of the Engineer during the construction of the above work as well as during the maintenance period. If any work is not done within twenty-four (24) hours after written notice is given by the Engineer, the work may be done by the Owner and charged to the Contractor.

G. Special care shall be taken to prevent contamination, siltation, or interfering in any way with the stream flows or ponds along the line of work. No waste matter of any kind will be allowed to discharge into the stream flows or impounded water of any ponds or other bodies of water.

H. The Contractor shall apply and pay for all local permits that may be required for any of the work involved with this project.

I. All notes on drawings shall be made a part of the specifications.

J. Contractor shall notify Engineer at least seventy-two (72) hours in advance of any work on Saturdays. There will be no work permitted on Sundays or holidays. This project will receive inspection and the normal working hours for the Inspector are from 7:00 AM to 3:30 PM, Monday through Friday. Any overtime inspection costs which are not specifically mentioned in the drawings and specifications will be reimbursed by the Contractor. Holidays are New Years Day, Memorial Day, Fourth of July, Labor Day, Thanksgiving and Christmas.

K. It shall be the Contractor's responsibility to keep the concrete curb clean of asphaltic tack coat.

1.02 PUBLIC UTILITIES

A. The contract drawings indicate the approximate location of existing overhead and subsurface utilities in the vicinity of the work. The bidder is advised to ascertain for himself all the facts concerning the location of these utilities.

B. The Contractor shall cooperate with the utility owners in the adjustment of their facilities and shall notify the utility owners not less than five (5) days in advance of the time he proposes to perform any work that will endanger or affect their facilities.

C. The Contractor shall permit the owners of utilities, or their agents, access to the site of the work at all times in order to relocate, construct or protect their lines and he shall cooperate with them in performing this work.

D. Separate payments will not be made for the coordination and cooperation of the Contractor with the utility companies, nor for the protection or replacement of utilities for the resequencing or delay of work due to a utility company and the bidder shall include all such costs in the prices bid for the various related items of work in the Bid Form.

E. The Contractor is responsible for repairing all located utilities (water, sewer, storm sewer, gas lines, etc.) which are broken or damaged during construction.

1.03 PHOTOGRAPHS & VIDEO TAPES

The Contractor shall video tape in digital format the construction site prior to the commencement of construction. Two copies of the digital recording shall be forwarded and kept by Remington and Vernick Engineers to resolve any disputes arising over the restoration of all curbs, sidewalks, driveways, fences, lawns, landscaped areas, or any other items that may be disturbed during construction.

1.04 TESTING MATERIALS

A. Except as may be provided elsewhere, test or analysis of materials which are usually tested after delivery to the site, such as concrete aggregate, mixed and placed concrete, and similar materials; will be performed by the Engineer or test laboratories which will be approved by the Engineer and selected and paid for by the Contractor. The preliminary testing of concrete mixtures and test or analysis of other materials, samples of which are to be submitted prior to delivery, will also be performed by the laboratory and paid for by the Contractor at the Engineer's request.

B. If the Engineer orders sampling and analysis or tests of materials which are usually accepted on Certification of the manufacturer but which appear defective or not conforming to the requirements of the Specifications, the Contractor will bear the reasonable costs of sampling, transportation, test and analysis.

END OF SECTION

SECTION 01010

AS-BUILT DRAWINGS

1.01 GENERAL

The Contractor shall provide three (3) sets of reproducible as-built drawings prior to final payment.

2.01 MATERIALS

A. As-builts shall be a reproducible of the original contract drawings including any additional sheets required. All deviations from the original contract drawings shall be on the as-builts. The drawings shall be legible, neat, and of a quality acceptable to the Engineer.

B. The Engineer shall provide a set of reproducibles at the beginning of the project.

3.01 EXECUTION

A. The Contractor shall be responsible for keeping the as-built up-to-date as the project progresses.

B. Building Construction: Actual installation with all items clearly identified shall be indicated. Location of installed items and any deviations from contract documents shall be so shown with boxes around the as-built numbers or labels.

C. This section is intended to provide a minimum level of acceptance. Any section with more stringent requirements shall have precedence over this section.

D. The foundation design should detail any encounter with rock excavation.

4.01 PAYMENT

No separate payment will be made for work performed under this section.

END OF SECTION

SECTION 01300

SUBMITTALS

PART 1 – GENERAL

1.01 Summary: This section specifies requirements for handling submittals.

1.02 General Procedures: Coordinate submittal preparation with performance of construction activities, and with purchasing or fabrication, delivery, other submittals, and related activities. Transmit in advance of performance of related activities to avoid delays.

Coordinate transmittal of different submittals for related elements so processing will not be delayed for coordination with other submittals. The Engineer reserves the right to withhold action on a submittal requiring coordination until related submittals are received.

Processing: Allow two weeks for review. Allow more time if processing must be delayed for coordination with other submittals. The Engineer will advise the Contractor when a submittal must be delayed for coordination. Allow two weeks for reprocessing each submittal.

No extension of time will be authorized because of failure to transmit submittals sufficiently in advance of the Work to Permit processing.

Submittal Preparation: Place a label or title block on each submittal for identification. Provide a 4" x 5" space on the label or beside the title block on shop drawings to record Contractor's review and approval markings and action taken. Include the following information on the label for processing and recording action taken:

Project Name
Date
Name and address of Engineer
Name and address of Subcontractor
Name and address of Supplier
Name of Manufacturer
Bid Item Number

1.03 Submittal Transmittal: Package submittals appropriately for transmittal and handling. Transmit with a transmittal form. Submittals received from other than the Contractor will be returned without action.

1.04 Contractor's Construction Schedule: Submit a fully developed, bar-chart type construction schedule at the pre-construction conference. Provide a separate bar for each construction activity and a vertical line to identify the first working day of each week.

Coordinate the construction schedule with the list of subcontracts, submittal schedule, progress reports, payment requests and other schedules.

Indicate completion in advance of the date established for substantial completion. Indicate substantial completion on the schedule to allow time for the Engineer's procedures necessary for certification of substantial completion.

1.05 Distribution of Schedules: Distribute approved copies of the construction schedules to the Engineer, Owner, Subcontractors, and other parties required to comply with scheduled dates. Post copies in the temporary field office. When revisions are made, distribute to the same parties and post in the same locations.

Updating: Revise each schedule after each meeting or activity, where revisions have been made. Issue the updated schedules concurrently with report of each meeting. The revised schedule must be approved by the engineer. Activity delays shall not automatically mean that an extension of the contract time is warranted or due to the Contractor. It is possible that a change order or delay will not affect critical activities or cause non-critical activities to become critical. A change order or delay may result in only absorbing a part of the available total float that may exist within an activity chain, thereby not having any effect on the Contract Time. Provide updated schedules with applications for payment. Owner may delay issuance of payment when required schedule updates are not provided.

1.06 Daily Construction Reports: Prepare a daily construction report, recording information concerning events at the site. Submit duplicate copies to the Engineer at weekly intervals. Include the following information:

List of subcontractors at the site.
High and low temperatures, general weather conditions.
Accidents, stoppages, delays, shortages, losses.
Emergency procedures.
Change orders received, implemented.
Partial completions, occupancies.
Substantial completions authorized.

1.07 Shop Drawing: Submit new information, drawn to accurate scale. Indicate deviations from contract documents. Do not reproduce contract documents or copy standard information as the basis of shop drawings. Include the following information:

Dimensions
Identification of products and materials included.
Notation of coordination requirements.
Notation of dimensions established by field measurement.
Date of Field Visit

Sheet Size: Except for templates, patterns, and similar full-size drawings, submit shop drawings on sheets at least 8 1/2“ x 11” but no larger than 30” x 42”.

Do not use shop drawings without a final stamp indicating action taken indicating action taken in connection with construction.

1.08 Product Data: Collect product data into a single submittal for each element or system. Mark each copy to show applicable choices and options. Where product data includes information on several products, some of which are not required, mark copies to indicate the applicable information. Include the following information:

Manufacturer’s printed recommendations.
Compliance with recognized trade association standards.
Compliance with recognized testing agency standards.

Application of testing agency labels and seals.
Notation of dimensions verified by filed measurement.
Notation of coordination requirements.

Submittals: Submit five (5) copies of each required submittal. The Engineer will retain three (3) copies and return the others marked with action taken and corrections or modifications required.

Unless noncompliance with contract document provisions is observed, the submittal may serve as the final submittal.

Distribution: Furnish copies of final submittal to installers, and other required for performance of construction activities. Show distribution on transmittal forms. Do not proceed with installation until an applicable copy of product data is in the installer's possession. Do not permit use of unmarked copies of product and data in connection with construction.

1.09 Samples: Submit full-size samples cured and finished as specified and identical to the product proposed. Mount display or package samples to facilitate review. Prepare samples to match the Engineer's sample. Include the following:

1. Generic Description
2. Compliance with Recognized Standards
3. Source Availability and Delivery Time
4. Product name or name of manufacturer
5. Logic diagrams and drawings, prepared by the system integrator, for the I&C system.

Submit samples for review of kind, color, pattern, and texture for a final check of these characteristics and a comparison of these characteristics between the final submittal and the component as delivered and installed. Where variations are inherent in the product, submit multiple units that show limits of the variations.

Refer to other sections for samples that illustrate details of assembly, fabrication techniques, workmanship, connections, operation, and similar characteristics.

Refer to other sections for samples to be returned for incorporation in the work. Such samples must be undamaged at the time of use. On the transmittal indicate special requests regarding disposition of sample submittals.

Submittals: Except for samples illustrating assembly details, workmanship, fabrication techniques, connections, operation, and similar characteristics, submit six (6) sets; one will be returned marked with the action taken. Maintain sample sets at the project site for quality comparisons.

Unless noncompliance with contract document provisions is observed, the submittal may serve as the final submittal.

Sample sets must be used to obtain final acceptance of the construction associated with each set.

1.10 Distribution: Prepare additional sets for subcontractors, manufacturers, fabricators, installers, and others as required for performance. Show distribution on transmittal forms.

1.11 Engineer's Action: Except for submittals for record, information, or similar purposes, where action and return are required, the Engineer will review each submittal, mark to indicate action taken and return. Compliance with specified characteristics is the contractor's responsibility.

Action Stamp: The Engineer will stamp each submittal with a self-explanatory action stamp. The stamp will be appropriately marked to indicate action taken.

PART 2 – MATERIALS

A. Not Applicable

PART 3 – EXECUTION

A. Not Applicable

PART 4 – QUANTITY AND PAYMENT

A. No specific payment shall be made for work under this section and all costs for said work shall be incorporated in various items in the bid proposal associated with this work.

END OF SECTION

SECTION 01740

DAILY CLEANING AND RESTORATIONS

1.01 DESCRIPTION

A. Contractor shall provide all equipment, labor & materials required to clear the site of all debris to match the natural grade conditions. Backfill shall be provided as required to provide positive drainage from any disturbed areas so that there is no ponding water on the site. All disturbed areas shall be seeded to establish vegetation and prevent erosion.

B. Maintain premises and public properties free from accumulations of waste, debris and rubbish caused by work operations.

C. At completion of work, remove waste materials, rubbish, tools, equipment, machinery and surplus materials; clean all sight exposed surfaces; leave project clean and ready for occupancy.

D. At completion of work, restore or replace, when and as directed by the Engineer, any public or private property disturbed or damaged by Contractor's work operations to a condition at least equal to that existing prior to beginning work, or as otherwise specified. Materials, equipment and methods shall be approved by the Engineer.

2.01 MATERIALS

A. For restorations all materials shall comply with the following Articles of the New Jersey Department of Transportation Standard Specifications latest revision and these specifications.

B. Pavement restorations: See Section 903 "Bituminous Concrete".

C. Restoration of curbs and other concrete structures:

1. Concrete:
   a. Shall conform to Section 605 for Curbs, Section 607 for sidewalks and driveways, and Section 405 for concrete surface course.

   b. Compressive Strength: 4,000 psi at 28 days.

   c. Air-entrained.

2. Joint Fillers: Section 908, bituminous cellular type.

3. Curing Compound: Section 905.03, white-pigmented liquid.

D. Driveway Restoration: Driveway Aprons shall be replaced in kind with Portland Cement Concrete, Bituminous Concrete or 3/4 inch stone. Dirt driveway aprons are to be upgraded to stone.

E. All other Materials: As approved by the Engineer or authorities having jurisdiction.

3.01 METHODS OF CONDUCTING WORK – CLEANING

A. Requirements of regulatory agencies:

The Contractor shall comply with all Federal, State, and local anti-pollution laws, ordinances, codes and regulations when disposing of waste materials, debris and rubbish. All excess material shall be removed from the site and disposed of by the Contractor. Cost to be included in the unit price bid for all items.

The disposal site shall be in permanently established licensed OSWA (Office of Solid Waste Administration, New Jersey Department of Environmental Protection) landfills or a NJDEP certified recycling center if applicable.

B. Cleaning during construction:

Provide daily cleaning to keep the work, the site, and adjacent properties free from accumulations of waste materials, rubbish and windblown debris resulting from construction operations.

The Contractor is responsible for street sweeping as directed by the Engineer or Owner. The Contractor shall keep all public roadways free of dirt and debris from any trucks entering or leaving the demolition site.

Provide on-site containers for the collection of waste materials, debris and rubbish. Maintain containers as required.

C. Dust Control:

The Contractor will be required to maintain all excavations, embankments, stockpiles, haul roads, permanent access roads, plant sites, waste areas, borrow areas, and all other work areas within or without the project boundaries free from dust which would cause a hazard or nuisance to others. Approved temporary methods of stabilization consisting of sprinkling, chemical treatment, light bituminous treatment or similar methods will be permitted to control dust. Sprinkling, to be approved, must be repeated at such intervals as to keep all parts of the disturbed area at least damp at all times, and the Contractor must have sufficient competent equipment on the job to accomplish this if sprinkling is used. Dust control shall be performed as the work proceeds and whenever a dust nuisance or hazard occurs. If any dust control is not done within twenty-four (24) hours after written notice is given by the Engineer, the work may be done by Owner and charged to the Contractor.

3.02 METHODS OF CONDUCTING WORK - RESTORATIONS

A. General: All existing structures, unpaved areas and paved areas disturbed or damaged during the work under this contract shall be restored or replaced to a condition at least equal to that existing prior to beginning work, or as otherwise specified. The methods of conducting this work shall, as a minimum, conform to the New Jersey Department of Transportation Standard Specifications, latest revision.

B. Pavement Restorations:

The methods of construction employed shall conform to the requirements set forth in Section 208, 304, 305 & 404 of the Standard Specifications as applicable to the type of material being utilized.

Restoration type and thickness shall be as shown on the contract drawings.

C. Restorations of Curbs and Other Concrete Structures:

1. Curbs: Section 605

2. Other concrete structures: Restore in accordance with applicable Sections of the Standard Specifications.

D. Fence Restorations:

Contractor shall remove all concrete from existing fence posts and appurtenances before reinstalling fence in kind.

E. All Other Restorations:

Restore in accordance with applicable Sections of the Standard Specifications, or as approved by the Engineer or authorities having jurisdiction.

END OF SECTION

SECTION 02627

HDPE SANITARY SEWER FORCE MAIN & FITTINGS

1.00 GENERAL

1.01 DESCRIPTION

A. Furnish and install HDPE (High Density Polyethylene) Sewer Force Main and Fittings for proposed sanitary sewer force main complete as shown on the drawings and specified herein. Installation method shall be by Guided Boring Method.

1.02 SUBMITTALS

A. Certifications: Submit copies of manufacturer's certified letter stating that pipe or joint materials ordered meets requirements of this specification. Letter shall indicate compliance with appropriate reference standards listed.

B. Qualifications of the Guided Boring Subcontractor shall have been engaged in the installation of guided boring pipes for at least three years during which time the contractor shall have installed a minimum of 500,000 linear feet of pipe. A list of projects shall be submitted to substantiate this requirement.

2.00 MATERIALS

A. The pipe materials shall meet the following requirements.

1. Polyethylene Compound: Class 345434C conforming to ASTM D 3350, and shall meet the following physical property requirements:

Property	**Unit**	**Test Procedure**	**Typical Value**
Material Designation		PPI/ASTM	PE 3408
PPL Material Listing		PPI TR-4	Plexco P34CH
Material Classification		ASTM D-1248	III C 5 P34
Cell Classification		ASTM D-3350	345434C
Density (3)	g/cm^3	ASTM D-1505	0.955
Melt Index (4)	g/10 minutes	ASTM D-1238	0.1
Flexural Modulus (5)	psi	ASTM D-790	133,000
Tensile Strength (4)	psi	ASTM D-638	3500

ESCR (3)	fail % hours	ASTM D-1693	f0>5000
HDB (4)	psi	ASTM D-2837	1600
UV Stabilizer (C)	% Carbon Black	ASTM D-1603	2 to 3
Elastic Modulus	psi	ASTM D-638	110,000
Brittleness Temperature	□F	ASTM D-746	<-180
Vicat Softening Temperature	□°F	ASTM D-1525	255
Thermal Expansion	inches/inches/□F	ASTM D-696	$8x10^{-5}$
Hardness	Shore DASTM D-2240		64
Molecular Weight Category	Extra High		
HDB @ 73.4□F	psi	ASTM D-2837	1600
HDB @ 140□F	psi	ASTM D-2837	800

2. Pipe: ASTM D 1248 "Standard Specification for Plastic Pipe". Pipe shall be suitable for conveying water under pressure. Pipe shall be black HDPE PE 3408 pipe as manufactured by Chevron Plexco, Phillips Driscopipe or equal. Pressure rating shall be 160 p.s.i. with Standard Dimension Ration (DR) of 11 and meet AWWA C-906 standards, and manufactured per ASTM F-714 and D-3035 and tested per ASTM D2837.

   Printline markings shall include a production code from which the location and date of manufacture can be identified. Upon request, the manufacturer shall provide an explanation of his production code.

   The pipe shall have a metallic locating wire or tape buried with the pipe.

3. Fittings: Fittings shall be fittings compatible with the piping system and manufacturer per ASTM D-3261.

   Fittings shall be produced by the same manufacturer as the pipe from identical materials meeting the requirements of this specification.

   Fittings shall be pressure rated to meet the service pressure requirements specified. Whether molded or fabricated, fittings shall be fully pressure rated to at least the same service pressure rating as the pipe to which joining is intended.

   Molded fittings shall meet the requirements of ASTM D-3261 and this specification. At the point of fusion, the outside diameter and minimum wall thickness of fitting butt fusion outlets shall meet the outside diameter and minimum

wall thickness specifications of ASTM F-714 for the same size of pipe. Fitting markings shall include a production code from which the location and date of manufacture can be determined. Upon request, the manufacturer shall provide an explanation of his production code.

Fittings shall be manufactured in production facilities designed for that purpose. Field fabricated fittings are not allowed.

4. Joints:

Except where flange connections or other mechanical connections are specified, pipe and fittings shall be butt fusion joined in accordance with the manufacturer's recommended procedure. Upon request, the pipe and fitting manufacturer shall provide fusion training services for field construction and inspection personnel. Training shall be conducted by the pipe and fitting manufacturer or his authorized representative.

Heat Fusion Joining Systems: Pipes shall be joined to one another and to polyethylene fittings by thermal butt fusion, saddle fusion, or socket fusion, excepting directional outlets, in accordance with procedures recommended by the pipe manufacturer.

Butt fusion joining of unlike SDR's shall not be permitted. Transition from one SDR to another may be accomplished by the use of mechanical couplings, or a transition nipple, which is a short length off the heavier SDR pipe with one end machined to the lighter SDR.

Joining, Terminating, or Adapting by Mechanical Means: Mechanical connections of polyethylene pipe to systems or fittings of other materials, or to unlike SDR's shall be by means of flanged connections (flange adapters and back-up rings rated for the same pressure service as the system piping), or mechanical compression couplings designed for joining polyethylene pipe to polyethylene pipe or to another piping material.

Flanged joints shall use bolts of compatible material (insulated from the fittings where necessary). Gaskets of reinforced black rubber, asbestos-rubber compound or other material specified by the engineer, shall be required when joining to non-polyethylene materials. Flanged polyethylene joints shall be gasketed. In all cases, the bolts shall be evenly torqued using a crossing pattern like that used to tighten lug nuts on a car wheel. Flanged joints are to be re-torqued after one hour or more has passed.

Polyethylene pipe adjacent to flanged joints and the joints themselves must be rigidly supported for a distance of one pipe diameter or 1 foot, whichever is the greater, beyond the flange assembly.

When mechanical compression couplings are used, polyethylene pipes shall be reinforced by a stiffener in the pipe bore. Stiffeners shall be properly sized for the size and SDR of polyethylene pipe being joined.

Mechanical couplings shall be installed in accordance with the manufacturer's recommended procedure.

4. Drilling Fluid - Drilling fluid shall be a mixture of water and bentonite clay. The fluid will be inert. The fluid shall remain in the tunnel to ensure the stability of the tunnel, reduce drag on pulled pipe and provide backfill within the annulus of the pipe and tunnel.

Disposal of excess drilling fluid and spoils will be the responsibility of the Contractor who must comply with all relevant regulations, right of way, work space and permit agreements. Excess drilling fluid and spoils will be disposed of at an approved location. The Contractor is responsible for transporting all excess drilling fluid and spoils to the disposal site and paying any disposal costs. Excess drilling fluids and spoils will be transported in a manner that prevents accidental spillage onto roadways. Excess drilling fluid and spoils will not be discharged into sanitary sewer or storm drain systems, ditches or roadways.

B. Concrete for Thrust Blocks:

1. Compressive Strength: Minimum of 4,000 p.s.i. at twenty-eight days.

2. Concrete shall be Class C conforming to Section 914 of the New Jersey Department of Transportation Standard Specifications.

3.00 EXECUTION

3.01 METHOD OF CONSTRUCTION

A. General - All pipe shall be installed in accordance with the details shown on the drawings unless otherwise hereinafter specified and all excavation and backfill shall conform to the requirements hereinbefore specified.

B. Handling Pipe & Accessories - All pipe and accessories shall be new material which has at no time previously been used for any purpose whatsoever. Pipe and accessories shall be handled in such a manner to insure delivery on the work in sound, undamaged condition and conforming in all respects to these specifications.

The pipe and fitting manufacturer shall package products for shipment in a manner suitable for safe transport on commercial carriers. When delivered, a receiving inspection shall be performed, and any shipping damage reported to the pipe and fitting manufacturer within 7 days. Pipe and fittings shall be handled, installed, and tested in accordance with manufacturer's recommendations, and the requirements of this specification.

C. Placing Pipe in Trench - The interior of all pipe shall be thoroughly cleaned of all foreign matter before being lowered into the trench and shall be kept clean during laying operations by means of plugs or other approved methods. No trench water shall be allowed to enter the pipe or fittings. At all times when work is not in progress, all open ends of pipes and fittings shall be securely closed to the satisfaction of the Engineer. The method of directional moling of pipe is acceptable.

D. Laying Pipe - Under no circumstances will pipe be laid in water and no pipe shall be laid when trench conditions or the weather is unsuitable for such work, except by permission of the Engineer.

E. Cutting Pipe - Cutting the pipe for closure pieces or for other reasons shall be done in a neat and workmanlike manner by a method which will not damage the pipe lining. Unless otherwise authorized by the Engineer, all cutting of pipes shall be done by means of mechanical cutters of an approved type or types. Wheel cutters shall be used wherever practicable.

F. Test - All joints in pipe lines shall remain uncovered until the pipe has been subject to pressure tests of 125 lbs. per square inch. When all joints being subjected to the test are found to be tight at this pressure, in the presence of the Engineer, the test may be stopped and backfiring commenced, as hereinbefore specified. The cost of testing of the pipe lines shall be borne by the contractor who must furnish all necessary equipment, labor and materials for the tests. Pressure shall remain on the pipe at least 60 minutes and shall not drop more than 2 pounds in 60 minutes. Defective joints, pipe and fittings shall be removed and replaced by the contractor.

G. Bracing the Pipe at Bends - All fittings at bends in the pipe lines shall be firmly wedged between the fittings and the vertical face of the trench consisting of undisturbed earth in order to prevent the fittings from being blown off the line when under pressure by means of a 1-2-4 concrete mix except at plugs where wood block shall be used.

H. Guided Boring Operations -

1. Equipment -
   a. The drilling equipment must be capable of placing the pipe within the limits indicated on the contract plans.

   b. Guided boring equipment shall be the FlowMole guided boring system as manufactured be UTILX Corporation or its equal. The system shall consist of a surface launched steerable drilling tool controlled from a mobile drilling frame, and include a field power unit, mud mixing system and a mobile spoils extraction system.

   c. The number of access pits shall be kept to a minimum and the equipment must be capable of boring a six inch pipe for a distance of 400 feet in a single bore.

d. The guidance system shall have the capability of measuring vertical position, horizontal position and roll. The guidance system must meet the following specifications in homogenous soils:

	Accuracy
Vertical position	+/- 1 inch at 18-96 inches of depth
Horizontal position	+/- 2 inch at 18-96 inches of depth

2. Pilot Hole Boring

a. The entry angle of the pilot hole and the boring process will maintain a curvature that does not exceed the allowable bending radii of the product pipe.

b. Alignment Adjustments and Restarts - The Contractor will follow the pipeline alignment as shown on the Drawings and within the specifications. In the event of difficulties at any time during boring operations requiring the complete withdrawal from the tunnel, the Contractor will be allowed to withdraw and abandon the tunnel and begin a second tunnel. The first tunnel must be backfilled with drilling fluid or concrete grout without leaving any voids.

3. Installing Product Pipe

a. After the pilot hole is completed, the Contractor will install a swivel to the reamer and commence pullback operations. Prereaming of the tunnel may be necessary and is at the option of the Contractor.

b. Reaming diameter will not exceed 1.5 times the diameter of the product pipe being installed.

c. The product pipe being pulled into the tunnel will be protected and supported so that it moves freely and is not damaged by stones and debris on the ground during installation.

d. Pullback forces will not exceed the allowable pulling forces for the product pipe.

e. The contractor will allow sufficient lengths of product pipe to extend pass the termination point to allow connections to adjacent pipe sections or manholes. Pulled pipe will be allowed 24 hours of stabilization prior to making tie-ins.

3.02 WARRANTY AND ACCEPTANCE: The contractor shall warrant all work to be free of defects in workmanship or materials for a period of one year from the date of completion of all construction. In the event deficiencies are discovered during the warranty period, they shall be corrected by the contractor before final acceptance.

During the warranty period, the Engineer shall determine if warranty repairs or replacement work shall be performed by the contractor. The decision of the Engineer shall be binding upon the contractor.

3.03 QUALIFICATION OF MANUFACTURERS: Manufacturer's production facilities shall be open for inspection by the owner or his designated agents. During inspection, the manufacturer shall demonstrate that he has facilities capable of manufacturing the pipe and fittings required by this specification, that a quality control program meeting the minimum requirements specified in ASTM F-714 is in place, and that facilities for performing the tests required by this specification are available.

The manufacturer shall certify that the material supplied meets the specifications and that samples of his production pipe have undergone stress regression testing, evaluation, and validation in accordance with ASTM D-2837 and PPI TR-3.

4.00 QUANTITY AND PAYMENT

A. PIPE

Payment for HDPE force main of the type and sizes specified will be included in the various lump sum prices bid which price shall include the cost of excavating, laying, assembling, and jointing of the pipe complete, shoring, dewatering, pumping, backfiring, cutting, testing, stone bedding, imported or on-site select fill, fittings, all labor, equipment, materials and all else necessary therefore and all other work in connection therewith and incidental thereto.

END OF SECTION

SECTION 02655

WATER SERVICE LINE (COPPER)

1.01 DESCRIPTION

Remove and replace existing water service lines where shown on the plans or as directed by the Engineer.

2.01 MATERIALS

A. Acceptable manufacturers:

1. The products of Mueller Company, Decatur, Ill, as specified in the following paragraphs, are used to establish standards of quality. Other manufacturers' materials may be used provided they are approved as an equivalent product.

B. Curb valve: Mueller, Catalog No. H-15201 or approved equal.

C. Curb box: Cast iron, Buffalo type, arch pattern:

1. Sizes - 3/4" to 1-1/4" Service

a. Tyler Series 6500 Curb box - 93D (36" to 4 8")

b. Mueller Type H10350 Curb box - 93D (36" to 48")

2. Sizes - 1-1/4" up to 2" Service

a. Tyler Series 6500 Enlarged base

b. Mueller Type H10349 Enlarged base

3. All boxes shall be provided complete with the lid marked "WATER" and with the Stationary Rod and Guide Ring.

4. Furnish each curb box with foot piece, if necessary.

5. Box Length: Order to meet project conditions.

D. Pentagon keys: Steel; Catalog No. H-10325.

E. Corporation Stops: Mueller Corporation Stop Model H15000.

F. Seamless Copper water tube: ASTM B88-77 Type K annealed, furnished straight or in coils.

G. Fittings: Cast Bronze fittings for flared copper tubes: ANSI-B16.26, latest edition.

3.01 METHODS OF CONSTRUCTION

A. Installation

1. Workmanship:

a. Examine pipe, fittings, curb boxes and valves before installation to assure no defective materials are incorporated.

2. Placement:

a. Lay piping on firm bed for entire length of trench except where supports are otherwise provided.

b. Employ partial backfilling and cradling to hold pipe in secure position during backfilling operations.

c. Backfill evenly on both sides of pipe to maintain equipment.

d. Anchor piping laid on grade prior to embedment in concrete.

e. Install pipe at 90 degrees to the water main.

3. Bending pipe:

a. Bend pipe by any method to any radius within manufacturer's recommendations.

b. Only bend surface free of cracks and buckles.

B. Curb valves and boxes:

1. Install curb valves and boxes in accordance with the manufacturer's printed instructions and in a manner to allow proper operation of the valve. Assure that valves are installed in the proper direction and that boxes are installed plumb.

2. Install valves and boxes in the locations shown on the plans.

C. Testing:

1. Disconnect all equipment and devices which may be damaged by test pressures.

2. Plug or cap lines.

3. Test and disinfect each piping system.

4. Repair all leaks.

4.01 QUANTITY AND PAYMENT

A. Payment to be under Site Piping or related items.

END OF SECTION

SECTION 033000 - CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Cast-in-place concrete, including concrete materials, mixture design, placement procedures, and finishes.

1.2 DEFINITIONS

A. Cementitious Materials: Portland cement alone or in combination with one or more of the following: blended hydraulic cement, fly ash, slag cement, other pozzolans, and silica fume; materials subject to compliance with requirements.

B. Water/Cement Ratio (w/cm): The ratio by weight of water to cementitious materials.

1.3 ACTION SUBMITTALS

A. Product Data: For each of the following.

1. Portland cement.
2. Fly ash.
3. Slag cement.
4. Blended hydraulic cement.
5. Silica fume.
6. Performance-based hydraulic cement
7. Aggregates.
8. Admixtures:

a. Include limitations of use, including restrictions on cementitious materials, supplementary cementitious materials, air entrainment, aggregates, temperature at time of concrete placement, relative humidity at time of concrete placement, curing conditions, and use of other admixtures.

b. Include limitations of use. Admixtures that do not comply with reference ASTM International requirements must be submitted with test data for approval.

9. Color pigments.
10. Fiber reinforcement.
11. Vapor retarders.
12. Floor and slab treatments.
13. Liquid floor treatments.
14. Curing materials.

a. Include documentation from color pigment manufacturer, indicating that proposed methods of curing are recommended by color pigment manufacturer.

15. Joint fillers.
16. Repair materials.

B. Design Mixtures: For each concrete mixture, include the following:

1. Mixture identification.
2. Minimum 28-day compressive strength.
3. Durability exposure class.
4. Maximum w/cm.
5. Calculated equilibrium unit weight, for lightweight concrete.
6. Slump limit.
7. Air content.
8. Nominal maximum aggregate size.
9. Steel-fiber reinforcement content.
10. Synthetic micro-fiber content.
11. Indicate amounts of mixing water to be withheld for later addition at Project site if permitted.
12. Include manufacturer's certification that permeability-reducing admixture is compatible with mix design.
13. Include certification that dosage rate for permeability-reducing admixture matches dosage rate used in performance compliance test.
14. Intended placement method.
15. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.

C. Shop Drawings:

1. Construction Joint Layout: Indicate proposed construction joints required to construct the structure.

a. Location of construction joints is subject to approval of the Engineer.

D. Concrete Schedule: For each location of each Class of concrete indicated in "Concrete Mixtures" Article, including the following:

1. Concrete Class designation.
2. Location within Project.
3. Exposure Class designation.
4. Formed Surface Finish designation and final finish.
5. Final finish for floors.
6. Curing process.
7. Floor treatment if any.

1.4 INFORMATIONAL SUBMITTALS

A. Qualification Data: For the following:

1. Installer: Include copies of applicable ACI certificates.
2. Ready-mixed concrete manufacturer.
3. Testing agency: Include copies of applicable ACI certificates.

B. Material Certificates: For each of the following, signed by manufacturers:

1. Cementitious materials.
2. Admixtures.
3. Fiber reinforcement.
4. Curing compounds.
5. Floor and slab treatments.
6. Bonding agents.
7. Adhesives.
8. Vapor retarders.
9. Semirigid joint filler.
10. Joint-filler strips.
11. Repair materials.

C. Material Test Reports: For the following, from a qualified testing agency:

1. Portland cement.
2. Fly ash.
3. Slag cement.
4. Blended hydraulic cement.
5. Silica fume.
6. Performance-based hydraulic cement.
7. Aggregates.
8. Admixtures:

    a. Permeability-Reducing Admixture: Include independent test reports, indicating compliance with specified requirements, including dosage rate used in test.

D. Floor surface flatness and levelness measurements report, indicating compliance with specified tolerances.

E. Research Reports:

1. For concrete admixtures in accordance with ICC's Acceptance Criteria AC198.
2. For sheet vapor retarder/termite barrier, showing compliance with ICC AC380.

F. Preconstruction Test Reports: For each mix design.

G. Field quality-control reports.

1.5 QUALITY ASSURANCE

A. Installer Qualifications: A qualified installer who employs Project personnel qualified as an ACI-certified Flatwork Technician and Finisher and a supervisor who is a certified ACI Flatwork Concrete Finisher/Technician or an ACI Concrete Flatwork Technician with experience installing and finishing concrete, incorporating permeability-reducing admixtures.

1. Post-Installed Concrete Anchors Installers: ACI-certified Adhesive Anchor Installer.

B. Ready-Mixed Concrete Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C94/C94M requirements for production facilities and equipment.

1. Manufacturer certified in accordance with NRMCA's "Certification of Ready Mixed Concrete Production Facilities."

C. Laboratory Testing Agency Qualifications: A testing agency qualified in accordance with ASTM C1077 and ASTM E329 for testing indicated and employing an ACI-certified Concrete Quality Control Technical Manager.

1. Personnel performing laboratory tests to be an ACI-certified Concrete Strength Testing Technician and Concrete Laboratory Testing Technician, Grade I. Testing agency laboratory supervisor to be an ACI-certified Concrete Laboratory Testing Technician, Grade II.

D. Field Quality-Control Testing Agency Qualifications: An independent agency, qualified in accordance with ASTM C1077 and ASTM E329 for testing indicated.

1. Personnel conducting field tests to be qualified as an ACI Concrete Field Testing Technician, Grade 1, in accordance with ACI CPP 610.1 or an equivalent certification program.

1.6 PRECONSTRUCTION TESTING

A. Preconstruction Testing Service: Engage a qualified testing agency to perform preconstruction testing on each concrete mixture.

1. Include the following information in each test report:

a. Admixture dosage rates.
b. Slump.
c. Air content.
d. Seven-day compressive strength.
e. 28-day compressive strength.
f. Permeability.

1.7 DELIVERY, STORAGE, AND HANDLING

A. Comply with ASTM C94/C94M and ACI 301.

1.8 FIELD CONDITIONS

A. Cold-Weather Placement: Comply with ACI 301 and ACI 306.1 and as follows.

1. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.

2. When average high and low temperature is expected to fall below 40 deg F for three successive days, maintain delivered concrete mixture temperature within the temperature range required by ACI 301.
3. Do not use frozen materials or materials containing ice or snow.
4. Do not place concrete in contact with surfaces less than 35 deg F, other than reinforcing steel.
5. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in mixture designs.

B. Hot-Weather Placement: Comply with ACI 301 and ACI 305.1, and as follows:

1. Maintain concrete temperature at time of discharge to not exceed 95 deg F.
2. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade uniformly moist without standing water, soft spots, or dry areas.

1.9 WARRANTY

A. Manufacturer's Warranty: Manufacturer agrees to furnish replacement sheet vapor retarder/termite barrier material and accessories for sheet vapor retarder/ termite barrier and accessories that do not comply with requirements or that fail to resist penetration by termites within specified warranty period.

1. Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 CONCRETE, GENERAL

A. ACI Publications: Comply with ACI 301 unless modified by requirements in the Contract Documents.

2.2 CONCRETE MATERIALS

A. Source Limitations:

1. Obtain all concrete mixtures from a single ready-mixed concrete manufacturer for entire Project.
2. Obtain each type or class of cementitious material of the same brand from the same manufacturer's plant.
3. Obtain aggregate from single source.
4. Obtain each type of admixture from single source from single manufacturer.

B. Cementitious Materials:

1. Portland Cement: ASTM C150/C150M, Type I Type II,.
2. Fly Ash: ASTM C618, Class C or F.
3. Slag Cement: ASTM C989/C989M, Grade 100 or 120.

C. Normal-Weight Aggregates: ASTM C33/C33M, Class 3S coarse aggregate or better, graded. Provide aggregates from a single source.

1. Maximum Coarse-Aggregate Size: 3/4 inch nominal.
2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.

D. Air-Entraining Admixture: ASTM C260/C260M.

E. Chemical Admixtures: Certified by manufacturer to be compatible with other admixtures that do not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride in steel-reinforced concrete.

1. Water-Reducing Admixture: ASTM C494/C494M, Type A.
2. Retarding Admixture: ASTM C494/C494M, Type B.
3. Water-Reducing and -Retarding Admixture: ASTM C494/C494M, Type D.
4. High-Range, Water-Reducing Admixture: ASTM C494/C494M, Type F.
5. High-Range, Water-Reducing and -Retarding Admixture: ASTM C494/C494M, Type G.
6. Plasticizing and Retarding Admixture: ASTM C1017/C1017M, Type II.
7. Set-Accelerating Corrosion-Inhibiting Admixture: Commercially formulated, anodic inhibitor or mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete and complying with ASTM C494/C494M, Type C.

8. Non-Set-Accelerating Corrosion-Inhibiting Admixture: Commercially formulated, non-set-accelerating, anodic inhibitor or mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete.

2.3 VAPOR RETARDERS

A. Sheet Vapor Retarder, Class A: ASTM E1745, Class A; not less than 6 mils thick.

2.4 FLOOR AND SLAB TREATMENTS

A. Slip-Resistive Emery Aggregate Finish: Factory-graded, packaged, rustproof, nonglazing, abrasive, crushed emery aggregate containing not less than 50 percent aluminum oxide and not less than 20 percent ferric oxide; unaffected by freezing, moisture, and cleaning materials.

B. Slip-Resistive Aluminum Granule Finish: Factory-graded, packaged, rustproof, nonglazing, abrasive aggregate of not less than 95 percent fused aluminum-oxide granules.

2.5 LIQUID FLOOR TREATMENTS

A. Penetrating Liquid Floor Treatment: Clear, chemically reactive, waterborne solution of inorganic silicate or siliconate materials and proprietary components; odorless; that penetrates, hardens, and densifies concrete surfaces.

2.6 CURING MATERIALS

A. Clear, Solvent-Borne, Membrane-Forming, Curing and Sealing Compound: ASTM C1315, Type 1, Class A.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. ChemMasters, Inc.
b. Concrete Sealers USA.
c. Kaufman Products, Inc.

2.7 RELATED MATERIALS

A. Expansion- and Isolation-Joint-Filler Strips: ASTM D1751, asphalt-saturated cellulosic fiber.

B. Bonding Agent: ASTM C1059/C1059M, Type II, nonredispersible, acrylic emulsion or styrene butadiene.

C. Epoxy Bonding Adhesive: ASTM C881, two-component epoxy resin, capable of humid curing and bonding to damp surfaces, of class suitable for application temperature and of grade and class to suit requirements, and as follows:

1. Types I and II, nonload bearing Types IV and V, load bearing, for bonding hardened or freshly mixed concrete to hardened concrete.

2.8 REPAIR MATERIALS

A. Repair Underlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.

1. Cement Binder: ASTM C150/C150M portland cement or hydraulic or blended hydraulic cement, as defined in ASTM C219.
2. Primer: Product of underlayment manufacturer recommended for substrate, conditions, and application.
3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand, as recommended by underlayment manufacturer.
4. Compressive Strength: Not less than 4100 psi at 28 days when tested in accordance with ASTM C109/C109M.

B. Repair Overlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/4 inch and that can be filled in over a scarified surface to match adjacent floor elevations.

1. Cement Binder: ASTM C150/C150M portland cement or hydraulic or blended hydraulic cement, as defined in ASTM C219.
2. Primer: Product of topping manufacturer recommended for substrate, conditions, and application.

3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by topping manufacturer.
4. Compressive Strength: Not less than 5000 psi at 28 days when tested in accordance with ASTM C109/C109M.

2.9 CONCRETE MIXTURES, GENERAL

A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, in accordance with ACI 301.

1. Use a qualified testing agency for preparing and reporting proposed mixture designs, based on laboratory trial mixtures.

B. Cementitious Materials: Limit percentage, by weight, of cementitious materials other than portland cement in concrete as follows:

1. Fly Ash or Other Pozzolans: 25 percent by mass.
2. Slag Cement: 50 percent by mass.
3. Silica Fume: 10 percent by mass.
4. Total of Fly Ash or Other Pozzolans, Slag Cement, and Silica Fume: 50 percent by mass, with fly ash or pozzolans not exceeding 25 percent by mass and silica fume not exceeding 10 percent by mass.
5. Total of Fly Ash or Other Pozzolans and Silica Fume: 35 percent by mass with fly ash or pozzolans not exceeding 25 percent by mass and silica fume not exceeding 10 percent by mass.

C. Admixtures: Use admixtures in accordance with manufacturer's written instructions.

1. Use water-reducing high-range water-reducing or plasticizing admixture in concrete, as required, for placement and workability.
2. Use water-reducing and -retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
3. Use corrosion-inhibiting admixture in concrete mixtures where indicated.
4. Use permeability-reducing admixture in concrete mixtures where indicated.

D. Color Pigment: Add color pigment to concrete mixture in accordance with manufacturer's written instructions and to result in hardened concrete color consistent with approved mockup.

2.10 CONCRETE MIXTURES

A. Class A: Normal-weight concrete used for footings, grade beams, and tie beams.
1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum w/cm: .48
3. Slump Limit: 4 inches, plus or minus 1 inch.
4. Air Content:

a. Exposure Class F1: 5.0 percent, plus or minus 1.5 percent at point of delivery for concrete containing 3/4-inch nominal maximum aggregate size.

5. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.

B. Class B: Normal-weight concrete used for foundation walls.
1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum w/cm: 0.45.
3. Slump Limit: 4 inches, plus or minus 1 inch.
4. Air Content:

a. Exposure Class F1: 5.0 percent, plus or minus 1.5 percent at point of delivery for concrete containing 3/4-inch nominal maximum aggregate size.

5. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.

C. Class C: Normal-weight concrete used for interior slabs-on-ground.
1. Minimum Compressive Strength: 4000 psi at 28 days.
2. Maximum w/cm: 0.45.
3. Slump Limit: 4 inches, plus or minus 1 inch.
4. Air Content:

a. Do not use an air-entraining admixture or allow total air content to exceed 3 percent for concrete used in trowel-finished floors.

5. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.

2.11 CONCRETE MIXING

A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete in accordance with ASTM C94/C94M and ASTM C1116/C1116M, and furnish batch ticket information.

B. Project-Site Mixing: Measure, batch, and mix concrete materials and concrete in accordance with ASTM C94/C94M. Mix concrete materials in appropriate drum-type batch machine mixer.

1. For mixer capacity of 1 cu. yd. or smaller, continue mixing at least 1-1/2 minutes, but not more than five minutes after ingredients are in mixer, before any part of batch is released.
2. For mixer capacity larger than 1 cu. yd., increase mixing time by 15 seconds for each additional 1 cu. yd..
3. Provide batch ticket for each batch discharged and used in the Work, indicating Project identification name and number, date, mixture type, mixture time, quantity, and amount of water added. Record approximate location of final deposit in structure.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Verification of Conditions:

1. Before placing concrete, verify that installation of concrete forms, accessories, and reinforcement, and embedded items is complete and that required inspections have been performed.
2. Do not proceed until unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Provide reasonable auxiliary services to accommodate field testing and inspections, acceptable to testing agency, including the following:

1. Daily access to the Work.
2. Incidental labor and facilities necessary to facilitate tests and inspections.
3. Secure space for storage, initial curing, and field curing of test samples, including source of water and continuous electrical power at Project site during site curing period for test samples.
4. Security and protection for test samples and for testing and inspection equipment at Project site.

3.3 TOLERANCES

A. Comply with ACI 117.

3.4 INSTALLATION OF EMBEDDED ITEMS

A. Place and secure anchorage devices and other embedded items required for adjoining Work that is attached to or supported by cast-in-place concrete.

1. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
2. Install anchor rods, accurately located, to elevations required and complying with tolerances in Section 7.5 of ANSI/AISC 303.
3. Install reglets to receive waterproofing and to receive through-wall flashings in outer face of concrete frame at exterior walls, where flashing is shown at lintels, shelf angles, and other conditions.

3.5 INSTALLATION OF VAPOR RETARDER

A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder in accordance with ASTM E1643 and manufacturer's written instructions.

1. Install vapor retarder with longest dimension parallel with direction of concrete pour.
2. Face laps away from exposed direction of concrete pour.
3. Lap vapor retarder over footings and grade beams not less than 6 inches, sealing vapor retarder to concrete.
4. Lap joints 6 inches and seal with manufacturer's recommended tape.
5. Terminate vapor retarder at the top of floor slabs, grade beams, and pile caps, sealing entire perimeter to floor slabs, grade beams, foundation walls, or pile caps.

6. Seal penetrations in accordance with vapor retarder manufacturer's instructions.
7. Protect vapor retarder during placement of reinforcement and concrete.

    a. Repair damaged areas by patching with vapor retarder material, overlapping damages area by 6 inches on all sides, and sealing to vapor retarder.

B. Bituminous Vapor Retarders: Place, protect, and repair bituminous vapor retarder in accordance with manufacturer's written instructions.

3.6 INSTALLATION OF CAST-IN-PLACE CONCRETE

A. Before placing concrete, verify that installation of formwork, reinforcement, embedded items, and vapor retarder is complete and that required inspections are completed.

1. Immediately prior to concrete placement, inspect vapor retarder for damage and deficient installation, and repair defective areas.
2. Provide continuous inspection of vapor retarder during concrete placement and make necessary repairs to damaged areas as Work progresses.

B. Notify Engineer and testing and inspection agencies 24 hours prior to commencement of concrete placement.

C. Water addition in transit or at the Project site must be in accordance with ASTM C94/C94M and must not exceed the permitted amount indicated on the concrete delivery ticket.

D. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete is placed on concrete that has hardened enough to cause seams or planes of weakness.

1. If a section cannot be placed continuously, provide construction joints as indicated.
2. Deposit concrete to avoid segregation.
3. Deposit concrete in horizontal layers of depth not to exceed formwork design pressures and in a manner to avoid inclined construction joints.
4. Consolidate placed concrete with mechanical vibrating equipment in accordance with ACI 301.

    a. Do not use vibrators to transport concrete inside forms.
    b. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches (150 mm) into preceding layer.
    c. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity.
    d. At each insertion, limit duration of vibration to time necessary to consolidate concrete, and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.

E. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.

1. Do not place concrete floors and slabs in a checkerboard sequence.
2. Consolidate concrete during placement operations, so concrete is thoroughly worked around reinforcement and other embedded items and into corners.

3. Maintain reinforcement in position on chairs during concrete placement.
4. Screed slab surfaces with a straightedge and strike off to correct elevations.
5. Level concrete, cut high areas, and fill low areas.
6. Slope surfaces uniformly to drains where required.
7. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface.
8. Do not further disturb slab surfaces before starting finishing operations.

3.7 JOINTS

A. Construct joints true to line, with faces perpendicular to surface plane of concrete.

B. Construction Joints: Coordinate with floor slab pattern and concrete placement sequence.

1. Install so strength and appearance of concrete are not impaired, at locations indicated on Drawings or as approved by Engineer.
2. Place joints perpendicular to main reinforcement.

    a. Continue reinforcement across construction joints unless otherwise indicated.
    b. Do not continue reinforcement through sides of strip placements of floors and slabs.

3. Form keyed joints as indicated. Embed keys at least 1-1/2 inches into concrete.
4. Locate joints for beams, slabs, joists, and girders at third points of spans. Offset joints in girders a minimum distance of twice the beam width from a beam-girder intersection.
5. Locate horizontal joints in walls and columns at underside of floors, slabs, beams, and girders and at the top of footings or floor slabs.
6. Space vertical joints in walls as indicated on Drawings. Unless otherwise indicated on Drawings, locate vertical joints beside piers integral with walls, near corners, and in concealed locations where possible.
7. Use a bonding agent at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
8. Use epoxy-bonding adhesive at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.

C. Control Joints in Slabs-on-Ground: Form weakened-plane control joints, sectioning concrete into areas as indicated. Construct control joints for a depth equal to at least one-fourth of concrete thickness as follows:

1. Grooved Joints: Form control joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of control joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
2. Sawed Joints: Form control joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch-wide joints into concrete when cutting action does not tear, abrade, or otherwise damage surface and before concrete develops random cracks.

D. Isolation Joints in Slabs-on-Ground: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.

1. Extend joint-filler strips full width and depth of joint, terminating flush with finished concrete surface unless otherwise indicated on Drawings.
2. Terminate full-width joint-filler strips not less than 1/2 inch or more than 1 inch below finished concrete surface, where joint sealants, specified in Section 079200 "Joint Sealants," are indicated.
3. Install joint-filler strips in lengths as long as practicable. Where more than one length is required, lace or clip sections together.

E. Doweled Joints:

1. Install dowel bars and support assemblies at joints where indicated on Drawings.
2. Lubricate or asphalt coat one-half of dowel bar length to prevent concrete bonding to one side of joint.

F. Dowel Plates: Install dowel plates at joints where indicated on Drawings.

3.8 CONCRETE PLACEMENT

A. Before placing concrete, verify that installation of formwork, reinforcement, embedded items, and vapor retarder is complete and that required inspections are completed.

1. Immediately prior to concrete placement, inspect vapor retarder for damage and deficient installation, and repair defective areas.
2. Provide continuous inspection of vapor retarder during concrete placement and make necessary repairs to damaged areas as Work progresses.

B. Notify Engineer and testing and inspection agencies 24 hours prior to commencement of concrete placement.

C. Do not add water to concrete during delivery, at Project site, or during placement unless approved by Engineer in writing, but not to exceed the amount indicated on the concrete delivery ticket.

1. Do not add water to concrete after adding high-range water-reducing admixtures to mixture.

D. Before test sampling and placing concrete, water may be added at Project site, subject to limitations of ACI 301, but not to exceed the amount indicated on the concrete delivery ticket.

1. Do not add water to concrete after adding high-range water-reducing admixtures to mixture.

E. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete is placed on concrete that has hardened enough to cause seams or planes of weakness.

1. If a section cannot be placed continuously, provide construction joints as indicated.
2. Deposit concrete to avoid segregation.
3. Deposit concrete in horizontal layers of depth not to exceed formwork design pressures and in a manner to avoid inclined construction joints.

4. Consolidate placed concrete with mechanical vibrating equipment in accordance with ACI 301.

    a. Do not use vibrators to transport concrete inside forms.
    b. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches into preceding layer.
    c. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity.
    d. At each insertion, limit duration of vibration to time necessary to consolidate concrete, and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.

F. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.

1. Do not place concrete floors and slabs in a checkerboard sequence.
2. Consolidate concrete during placement operations, so concrete is thoroughly worked around reinforcement and other embedded items and into corners.
3. Maintain reinforcement in position on chairs during concrete placement.
4. Screed slab surfaces with a straightedge and strike off to correct elevations.
5. Level concrete, cut high areas, and fill low areas.
6. Slope surfaces uniformly to drains where required.
7. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface.
8. Do not further disturb slab surfaces before starting finishing operations.

3.9 FINISHING FORMED SURFACES

A. As-Cast Surface Finishes:

1. ACI 301 Surface Finish SF-1.0: As-cast concrete texture imparted by form-facing material.

    a. Patch voids larger than 1-1/2 inches wide or 1/2 inch deep.
    b. Remove projections larger than 1 inch.
    c. Tie holes do not require patching.
    d. Surface Tolerance: ACI 117 Class D.
    e. Apply to concrete surfaces not exposed to public view.

2. ACI 301 Surface Finish SF-2.0: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams.

    a. Patch voids larger than 3/4 inch wide or 1/2 inch deep.
    b. Remove projections larger than 1/4 inch.
    c. Patch tie holes.
    d. Surface Tolerance: ACI 117 Class B.
    e. Locations: Apply to concrete surfaces exposed to public view, to receive a rubbed finish.

3. ACI 301 Surface Finish SF-3.0:

a. Patch voids larger than 3/4 inch wide or 1/2 inch deep.
b. Remove projections larger than 1/8 inch.
c. Patch tie holes.
d. Surface Tolerance: ACI 117 Class A.
e. Locations: Apply to concrete surfaces exposed to public view, to receive a rubbed finish, or to be covered with a coating or covering material applied directly to concrete.

B. Rubbed Finish: Apply the following to as cast surface finishes wherever these type of surfaces are shown on the Drawings:

1. Smooth-Rubbed Finish:

a. Perform no later than one day after form removal.
b. Moisten concrete surfaces and rub with carborundum brick or another abrasive until producing a uniform color and texture.
c. If sufficient cement paste cannot be drawn from the concrete by the rubbing process, use a grout made from the same cementitious materials used in the in-place concrete.
d. Maintain required patterns or variances as shown on Drawings.

2. Grout-Cleaned Rubbed Finish:

a. Clean concrete surfaces after contiguous surfaces are completed and accessible.
b. Do not clean concrete surfaces as Work progresses.
c. Mix 1 part portland cement to 1-1/2 parts fine sand, complying with ASTM C144 or ASTM C404, by volume, with sufficient water to produce a mixture with the consistency of thick paint. Add white portland cement in amounts determined by trial patches, so color of dry grout matches adjacent surfaces.
d. Wet concrete surfaces.
e. Scrub grout into voids and remove excess grout. When grout whitens, rub surface with clean burlap, and keep surface damp by fog spray for at least 36 hours.
f. Maintain required patterns or variances as shown on Drawings.

C. Related Unformed Surfaces:

1. At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a color and texture matching adjacent formed surfaces.
2. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.

3.10 FINISHING FLOORS AND SLABS

A. Comply with ACI 302.1R recommendations for screeding, restraightening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.

B. Scratch Finish:

1. While still plastic, texture concrete surface that has been screeded and bull-floated or darbied.
2. Use stiff brushes, brooms, or rakes to produce a profile depth of 1/4 inch in one direction.
3. Apply scratch finish to surfaces to receive concrete floor toppings or to receive mortar setting beds for bonded cementitious floor finishes.

C. Float Finish:

1. When bleedwater sheen has disappeared and concrete surface has stiffened sufficiently to permit operation of specific float apparatus, consolidate concrete surface with power-driven floats or by hand floating if area is small or inaccessible to power-driven floats.
2. Repeat float passes and restraightening until surface is left with a uniform, smooth, granular texture and complies with ACI 117 tolerances for conventional concrete.
3. Apply float finish to surfaces to receive trowel finish and to be covered with fluid-applied or sheet waterproofing, built-up or membrane roofing, or sand-bed terrazzo.

D. Trowel Finish:

1. After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel.
2. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance.
3. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
4. Do not add water to concrete surface.
5. Do not apply hard-troweled finish to concrete, which has a total air content greater than 3 percent.
6. Apply a trowel finish to surfaces exposed to view or to be covered with resilient flooring, carpet, ceramic or quarry tile set over a cleavage membrane, paint, or another thin-film-finish coating system.
7. Finish surfaces to the following tolerances, in accordance with ASTM E1155, for a randomly trafficked floor surface:

    a. Slabs on Ground:

        1) Finish and measure surface so gap at any point between concrete surface and an unleveled, freestanding, 10-ft.- long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch and also no more than 1/16 inch in 2 feet.
        2) Specified overall values of flatness, F_F 25; and of levelness, F_L 20; with minimum local values of flatness, F_F 17; and of levelness, F_L 15.
        3) Specified overall values of flatness, F_F 35; and of levelness, F_L 25; with minimum local values of flatness, F_F 24; and of levelness, F_L 17.
        4) Specified overall values of flatness, F_F 45; and of levelness, F_L 35; with minimum local values of flatness, F_F 30; and of levelness, F_L 24.
        5) Specified overall values of flatness, F_F 50; and of levelness, F_L 25; with minimum local values of flatness, F_F 40; and of levelness, F_L 17.

    b. Suspended Slabs:

1) Finish and measure surface so gap at any point between concrete surface and an unleveled, freestanding, 10-ft.- long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch.
2) Specified overall values of flatness, F_F 25; and of levelness, F_L 20; with minimum local values of flatness, F_F 17; and of levelness, F_L 15.
3) Specified overall values of flatness, F_F 35; and of levelness, F_L 20; with minimum local values of flatness, F_F 24; and of levelness, F_L 15.
4) Specified overall values of flatness, F_F 45; and of levelness, F_L 35; with minimum local values of flatness, F_F 30; and of levelness, F_L 24.

E. Trowel and Fine-Broom Finish: Apply a first trowel finish to surfaces indicated on Drawings and/or where ceramic or quarry tile is to be installed by either thickset or thin set method. While concrete is still plastic, slightly scarify surface with a fine broom perpendicular to main traffic route.

1. Coordinate required final finish with Engineer before application.
2. Comply with flatness and levelness tolerances for trowel-finished floor surfaces.

F. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, ramps, and locations indicated on Drawings.

1. Immediately after float finishing, slightly roughen trafficked surface by brooming with fiber-bristle broom perpendicular to main traffic route.
2. Coordinate required final finish with Engineer before application.

G. Slip-Resistive Finish: Before final floating, apply slip-resistive aggregate finish to concrete stair treads, platforms, ramps as indicated on Drawings

1. Apply in accordance with manufacturer's written instructions and as follows:

a. Uniformly spread 25 lb/100 sq. ft. of dampened slip-resistive aggregate over surface in one or two applications.
b. Tamp aggregate flush with surface, but do not force below surface.
c. After broadcasting and tamping, apply float finish.
d. After curing, lightly work surface with a steel wire brush or an abrasive stone and water to expose slip-resistive aggregate.

H. Dry-Shake Floor Hardener Finish: After initial floating, apply dry-shake floor hardener to surfaces in accordance with manufacturer's written instructions and as follows:

1. Uniformly apply dry-shake floor hardener at a rate of 100 lb/100 sq. ft. unless greater amount is recommended by manufacturer.
2. Uniformly distribute approximately two-thirds of dry-shake floor hardener over surface by hand or with mechanical spreader, and embed by power floating.
3. Follow power floating with a second dry-shake floor hardener application, uniformly distributing remainder of material, and embed by power floating.
4. After final floating, apply a trowel finish.
5. Cure concrete with curing compound recommended by dry-shake floor hardener manufacturer and apply immediately after final finishing.

3.11 INSTALLATION OF MISCELLANEOUS CONCRETE ITEMS

A. Filling In:

1. Fill in holes and openings left in concrete structures after Work of other trades is in place unless otherwise indicated.
2. Mix, place, and cure concrete, as specified, to blend with in-place construction.
3. Provide other miscellaneous concrete filling indicated or required to complete the Work.

B. Curbs: Provide monolithic finish to interior curbs by stripping forms while concrete is still green and by steel-troweling surfaces to a hard, dense finish with corners, intersections, and terminations slightly rounded.

C. Equipment Bases and Foundations:

1. Coordinate sizes and locations of concrete bases with actual equipment provided.
2. Construct concrete bases 4 inches high unless otherwise indicated on Drawings, and extend base not less than 6 inches in each direction beyond the maximum dimensions of supported equipment unless otherwise indicated on Drawings, or unless required for seismic anchor support.
3. Minimum Compressive Strength: 4000 psi at 28 days.
4. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of concrete base.
5. For supported equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete substrate.
6. Prior to pouring concrete, place and secure anchorage devices.

    a. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
    b. Cast anchor-bolt insert into bases.
    c. Install anchor bolts to elevations required for proper attachment to supported equipment.

D. Steel Pan Stairs: Provide concrete fill for steel pan stair treads, landings, and associated items.

1. Cast-in inserts and accessories, as shown on Drawings.
2. Screed, tamp, and trowel finish concrete surfaces.

3.12 CONCRETE CURING

A. Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.

1. Comply with ACI 301 and ACI 306.1 for cold weather protection during curing.
2. Comply with ACI 301 and ACI 305.1 for hot-weather protection during curing.
3. Maintain moisture loss no more than 0.2 lb/sq. ft. x h, calculated in accordance with ACI 305.1, before and during finishing operations.

B. Curing Formed Surfaces: Comply with ACI 308.1 as follows:

1. Cure formed concrete surfaces, including underside of beams, supported slabs, and other similar surfaces.
2. Cure concrete containing color pigments in accordance with color pigment manufacturer's instructions.
3. If forms remain during curing period, moist cure after loosening forms.
4. If removing forms before end of curing period, continue curing for remainder of curing period, as follows:

    a. Continuous Fogging: Maintain standing water on concrete surface until final setting of concrete.
    b. Continuous Sprinkling: Maintain concrete surface continuously wet.
    c. Absorptive Cover: Pre-dampen absorptive material before application; apply additional water to absorptive material to maintain concrete surface continuously wet.
    d. Water-Retention Sheeting Materials: Cover exposed concrete surfaces with sheeting material, taping, or lapping seams.
    e. Membrane-Forming Curing Compound: Apply uniformly in continuous operation by power spray or roller in accordance with manufacturer's written instructions.

        1) Recoat areas subject to heavy rainfall within three hours after initial application.
        2) Maintain continuity of coating and repair damage during curing period.

C. Curing Unformed Surfaces: Comply with ACI 308.1 as follows:

1. Begin curing immediately after finishing concrete.
2. Interior Concrete Floors:

    a. Floors to Receive Floor Coverings Specified in Other Sections: Contractor has option of the following:

        1) Absorptive Cover: As soon as concrete has sufficient set to permit application without marring concrete surface, install prewetted absorptive cover over entire area of floor.

            a) Lap edges and ends of absorptive cover not less than 12 inches.
            b) Maintain absorptive cover water saturated, and in place, for duration of curing period, but not less than seven days.

        2) Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive.

            a) Immediately repair any holes or tears during curing period, using cover material and waterproof tape.
            b) Cure for not less than seven days.

        3) Ponding or Continuous Sprinkling of Water: Maintain concrete surfaces continuously wet for not less than seven days, utilizing one, or a combination of, the following:

a) Water.
b) Continuous water-fog spray.

b. Floors to Receive Penetrating Liquid Floor Treatments: Contractor has option of the following:

1) Absorptive Cover: As soon as concrete has sufficient set to permit application without marring concrete surface, install prewetted absorptive cover over entire area of floor.

a) Lap edges and ends of absorptive cover not less than 12 inches.
b) Maintain absorptive cover water saturated, and in place, for duration of curing period, but not less than seven days.

2) Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive.

a) Immediately repair any holes or tears during curing period, using cover material and waterproof tape.
b) Cure for not less than seven days.

3) Ponding or Continuous Sprinkling of Water: Maintain concrete surfaces continuously wet for not less than seven days, utilizing one, or a combination of, the following:

a) Water.
b) Continuous water-fog spray.

c. Floors to Receive Polished Finish: Contractor has option of the following:

1) Absorptive Cover: As soon as concrete has sufficient set to permit application without marring concrete surface, install prewetted absorptive cover over entire area of floor.

a) Lap edges and ends of absorptive cover not less than 12 inches.
b) Maintain absorptive cover water saturated, and in place, for duration of curing period, but not less than seven days.

2) Ponding or Continuous Sprinkling of Water: Maintain concrete surfaces continuously wet for not less than seven days, utilizing one, or a combination of, the following:

a) Water.
b) Continuous water-fog spray.

d. Floors to Receive Chemical Stain:

1) As soon as concrete has sufficient set to permit application without marring concrete surface, install curing paper over entire area of floor.

2) Install curing paper square to building lines, without wrinkles, and in a single length without end joints.
3) Butt sides of curing paper tight; do not overlap sides of curing paper.
4) Leave curing paper in place for duration of curing period, but not less than 28 days.

e. Floors to Receive Urethane Flooring:

1) As soon as concrete has sufficient set to permit application without marring concrete surface, install prewetted absorptive cover over entire area of floor.
2) Rewet absorptive cover, and cover immediately with polyethylene moisture-retaining cover with edges lapped 6 inches and sealed in place.
3) Secure polyethylene moisture-retaining cover in place to prohibit air from circulating under polyethylene moisture-retaining cover.
4) Leave absorptive cover and polyethylene moisture-retaining cover in place for duration of curing period, but not less than 28 days.

f. Floors to Receive Curing Compound:

1) Apply uniformly in continuous operation by power spray or roller in accordance with manufacturer's written instructions.
2) Recoat areas subjected to heavy rainfall within three hours after initial application.
3) Maintain continuity of coating, and repair damage during curing period.
4) Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer unless manufacturer certifies curing compound does not interfere with bonding of floor covering used on Project.

g. Floors to Receive Curing and Sealing Compound:

1) Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller in accordance with manufacturer's written instructions.
2) Recoat areas subjected to heavy rainfall within three hours after initial application.
3) Repeat process 24 hours later, and apply a second coat. Maintain continuity of coating, and repair damage during curing period.

3.13 APPLICATION OF LIQUID FLOOR TREATMENTS

A. Penetrating Liquid Floor Treatment: Prepare, apply, and finish penetrating liquid floor treatment in accordance with manufacturer's written instructions.

1. Remove curing compounds, sealers, oil, dirt, laitance, and other contaminants and complete surface repairs.
2. Apply liquid until surface is saturated, scrubbing into surface until a gel forms; rewet; and repeat brooming or scrubbing.
3. Rinse with water; remove excess material until surface is dry.
4. Apply a second coat in a similar manner if surface is rough or porous.

B. Sealing Coat: Uniformly apply a continuous sealing coat of curing and sealing compound to hardened concrete by power spray or roller in accordance with manufacturer's written instructions.

3.14 JOINT FILLING

A. Prepare, clean, and install joint filler in accordance with manufacturer's written instructions.
   1. Do not fill joints until construction traffic has permanently ceased.

B. Remove dirt, debris, saw cuttings, curing compounds, and sealers from joints; leave contact faces of joints clean and dry.

C. Install semirigid joint filler full depth in saw-cut joints and at least 2 inches deep in formed joints.

D. Overfill joint, and trim joint filler flush with top of joint after hardening.

3.15 CONCRETE SURFACE REPAIRS

A. Defective Concrete:

   1. Repair and patch defective areas when approved by Engineer.
   2. Remove and replace concrete that cannot be repaired and patched to Engineer's approval.

B. Patching Mortar: Mix dry-pack patching mortar, consisting of 1 part portland cement to 2-1/2 parts fine aggregate passing a No. 16 sieve, using only enough water for handling and placing.

C. Repairing Formed Surfaces: Surface defects include color and texture irregularities, cracks, spalls, air bubbles, honeycombs, rock pockets, fins and other projections on the surface, and stains and other discolorations that cannot be removed by cleaning.

   1. Immediately after form removal, cut out honeycombs, rock pockets, and voids more than 1/2 inch in any dimension to solid concrete.

      a. Limit cut depth to 3/4 inch.
      b. Make edges of cuts perpendicular to concrete surface.
      c. Clean, dampen with water, and brush-coat holes and voids with bonding agent.
      d. Fill and compact with patching mortar before bonding agent has dried.
      e. Fill form-tie voids with patching mortar or cone plugs secured in place with bonding agent.

   2. Repair defects on surfaces exposed to view by blending white portland cement and standard portland cement, so that, when dry, patching mortar matches surrounding color.

      a. Patch a test area at inconspicuous locations to verify mixture and color match before proceeding with patching.
      b. Compact mortar in place and strike off slightly higher than surrounding surface.

   3. Repair defects on concealed formed surfaces that will affect concrete's durability and structural performance as determined by Engineer.

D. Repairing Unformed Surfaces:

1. Test unformed surfaces, such as floors and slabs, for finish, and verify surface tolerances specified for each surface.

    a. Correct low and high areas.
    b. Test surfaces sloped to drain for trueness of slope and smoothness; use a sloped template.

2. Repair finished surfaces containing surface defects, including spalls, popouts, honeycombs, rock pockets, crazing, and cracks in excess of 0.01 inch wide or that penetrate to reinforcement or completely through unreinforced sections regardless of width, and other objectionable conditions.
3. After concrete has cured at least 14 days, correct high areas by grinding.
4. Correct localized low areas during, or immediately after, completing surface-finishing operations by cutting out low areas and replacing with patching mortar.

    a. Finish repaired areas to blend into adjacent concrete.

5. Correct other low areas scheduled to receive floor coverings with a repair underlayment.

    a. Prepare, mix, and apply repair underlayment and primer in accordance with manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.
    b. Feather edges to match adjacent floor elevations.

6. Correct other low areas scheduled to remain exposed with repair topping.

    a. Cut out low areas to ensure a minimum repair topping depth of 1/4 inch to match adjacent floor elevations.
    b. Prepare, mix, and apply repair topping and primer in accordance with manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.

7. Repair defective areas, except random cracks and single holes 1 inch or less in diameter, by cutting out and replacing with fresh concrete.

    a. Remove defective areas with clean, square cuts, and expose steel reinforcement with at least a 3/4-inch clearance all around.
    b. Dampen concrete surfaces in contact with patching concrete and apply bonding agent.
    c. Mix patching concrete of same materials and mixture as original concrete, except without coarse aggregate.
    d. Place, compact, and finish to blend with adjacent finished concrete.
    e. Cure in same manner as adjacent concrete.

8. Repair random cracks and single holes 1 inch or less in diameter with patching mortar.

    a. Groove top of cracks and cut out holes to sound concrete, and clean off dust, dirt, and loose particles.
    b. Dampen cleaned concrete surfaces and apply bonding agent.

c. Place patching mortar before bonding agent has dried.
d. Compact patching mortar and finish to match adjacent concrete.
e. Keep patched area continuously moist for at least 72 hours.

E. Perform structural repairs of concrete, subject to Engineer's approval, using epoxy adhesive and patching mortar.

F. Repair materials and installation not specified above may be used, subject to Engineer's approval.

3.16 FIELD QUALITY CONTROL

A. Testing Agency: Engage a qualified testing and inspecting agency to sample materials, perform tests, and submit test reports during concrete placement according to requirements specified in this Article. The scheduling and costs for all testing shall be the responsibility of the contractor.
1. Testing agency to be responsible for providing curing container for composite samples on Site and verifying that field-cured composite samples are cured in accordance with ASTM C31/C31M.
2. Testing agency to immediately report to Engineer, Contractor, and concrete manufacturer any failure of Work to comply with Contract Documents.
3. Testing agency to report results of tests and inspections, in writing, to Owner, Engineer, Contractor, and concrete manufacturer within 48 hours of inspections and tests.

a. Test reports to include reporting requirements of ASTM C31/C31M, ASTM C39/C39M, and ACI 301, including the following as applicable to each test and inspection:

1) Project name.
2) Name of testing agency.
3) Names and certification numbers of field and laboratory technicians performing inspections and testing.
4) Name of concrete manufacturer.
5) Date and time of inspection, sampling, and field testing.
6) Date and time of concrete placement.
7) Location in Work of concrete represented by samples.
8) Date and time sample was obtained.
9) Truck and batch ticket numbers.
10) Design compressive strength at 28 days.
11) Concrete mixture designation, proportions, and materials.
12) Field test results.
13) Information on storage and curing of samples before testing, including curing method and maximum and minimum temperatures during initial curing period.
14) Type of fracture and compressive break strengths at seven days and 28 days.

B. Batch Tickets: For each load delivered, submit three copies of batch delivery ticket to testing agency, indicating quantity, mix identification, admixtures, design strength, aggregate size, design air content, design slump at time of batching, and amount of water that can be added at Project site.

C. Inspections:

1. Headed bolts and studs.
2. Verification of use of required design mixture.
3. Concrete placement, including conveying and depositing.
4. Curing procedures and maintenance of curing temperature.
5. Verification of concrete strength before removal of shores and forms from beams and slabs.

D. Concrete Tests: Testing of composite samples of fresh concrete obtained in accordance with ASTM C 172/C 172M to be performed in accordance with the following requirements:

1. Testing Frequency: Obtain one composite sample for each day's pour of each concrete mixture exceeding 5 cu. yd., but less than 25 cu. yd., plus one set for each additional 50 cu. yd. or fraction thereof.

    a. When frequency of testing provides fewer than five compressive-strength tests for each concrete mixture, testing to be conducted from at least five randomly selected batches or from each batch if fewer than five are used.

2. Slump: ASTM C143/C143M:

    a. One test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture.
    b. Perform additional tests when concrete consistency appears to change.

3. Slump Flow: ASTM C1611/C1611M:

    a. One test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture.
    b. Perform additional tests when concrete consistency appears to change.

4. Air Content: ASTM C231/C231M pressure method, for normal-weight concrete;

    a. One test for each composite sample, but not less than one test for each day's pour of each concrete mixture.

5. Concrete Temperature: ASTM C1064/C1064M:

    a. One test hourly when air temperature is 40 deg F and below or 80 deg F and above, and one test for each composite sample.

6. Unit Weight: ASTM C567/C567M fresh unit weight of structural lightweight concrete.

    a. One test for each composite sample, but not less than one test for each day's pour of each concrete mixture.

7. Compression Test Specimens: ASTM C31/C31M:

    a. Cast and laboratory cure two sets of two 6-inch by 12-inch or 4-inch by 8-inch cylinder specimens for each composite sample.

b. Cast, initial cure, and field cure two sets of three standard cylinder specimens for each composite sample.

8. Compressive-Strength Tests: ASTM C39/C39M.

   a. Test one set of two laboratory-cured specimens at seven days and one set of two specimens at 28 days.
   b. Test one set of two field-cured specimens at seven days and one set of two specimens at 28 days.
   c. A compressive-strength test to be the average compressive strength from a set of two specimens obtained from same composite sample and tested at age indicated.

9. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured cylinders, Contractor to evaluate operations and provide corrective procedures for protecting and curing in-place concrete.
10. Strength of each concrete mixture will be satisfactory if every average of any three consecutive compressive-strength tests equals or exceeds specified compressive strength, and no compressive-strength test value falls below specified compressive strength by more than 500 psi if specified compressive strength is 5000 psi, or no compressive strength test value is less than 10 percent of specified compressive strength if specified compressive strength is greater than 5000 psi.
11. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Engineer but will not be used as sole basis for approval or rejection of concrete.
12. Additional Tests:

    a. Testing and inspecting agency to make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Engineer.
    b. Testing and inspecting agency may conduct tests to determine adequacy of concrete by cored cylinders complying with ASTM C42/C42M or by other methods as directed by Engineer.

       1) Acceptance criteria for concrete strength to be in accordance with ACI 301, Section 1.6.6.3.

13. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
14. Correct deficiencies in the Work that test reports and inspections indicate do not comply with the Contract Documents.

E. Measure floor and slab flatness and levelness in accordance with ASTM E1155 within 48 hours of completion of floor finishing and promptly report test results to Engineer.

3.17 PROTECTION

A. Protect concrete surfaces as follows:

1. Protect from petroleum stains.
2. Diaper hydraulic equipment used over concrete surfaces.

3. Prohibit vehicles from interior concrete slabs.
4. Prohibit use of pipe-cutting machinery over concrete surfaces.
5. Prohibit placement of steel items on concrete surfaces.
6. Prohibit use of acids or acidic detergents over concrete surfaces.
7. Protect liquid floor treatment from damage and wear during the remainder of construction period. Use protective methods and materials, including temporary covering, recommended in writing by liquid floor treatments installer.
8. Protect concrete surfaces scheduled to receive surface hardener or polished concrete finish using Floor Slab Protective Covering.

PART 4 - MEASUREMENT, QUANTITY & PAYMENT

Cost for work specified in this section shall be paid for under the bid form line items for which they are a part. Costs shall include all excavation, shoring, formwork, finishes, steel reinforcement, reinforcement accessories, concrete materials, admixtures, water stops, vapor barriers, treatments, curing materials, joint fillers, bonding agents, adhesives, repair materials, testing, and all related appurtenances as required per the contract documents.

END OF SECTION 033000

SECTION 048100

UNIT MASONRY ASSEMBLIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. General Conditions of the Contract, as applicable.

1.2 SUMMARY

A. This Section includes unit masonry assemblies consisting of the following:

1. Concrete masonry units.
2. Decorative concrete masonry units.
3. Mortar and grout.
4. Reinforcing steel.
5. Masonry joint reinforcement.
6. Ties and anchors.
7. Embedded flashing.
8. Miscellaneous masonry accessories.
9. Masonry-cell insulation.

B. Products installed, but not furnished, under this Section include the following:
1. Steel lintels for unit masonry, furnished under Misc. Metals
2. Hollow-metal frames in unit masonry openings, furnished under Steel Doors and Frames.

1.3 SUBMITTALS

A. Product Data: For each different masonry unit, accessory, and other manufactured product specified.

B. Shop Drawings: Show fabrication and installation details for the following:
1. Reinforcing Steel: Detail bending and placement of unit masonry reinforcing bars. Comply with ACI 315, "Details and Detailing of Concrete Reinforcement."
2. Fabricated Flashing: Detail corner units, end-dam units, and other special applications.

C. Samples for Initial Selection: For the following:

1. Unit masonry Samples in small-scale form showing the full range of colors and textures available for each different exposed masonry unit required.
2. Colored mortar Samples showing the full range of colors available.

D. Samples for Verification: For the following:

1. Full-size units for each different exposed masonry unit required, showing the full range of exposed colors, textures, and dimensions to be expected in the completed construction.
2. Colored mortar Samples for each color required, showing the full range of colors expected in the finished construction. Make samples using the same sand and mortar ingredients to be used on Project.
3. Weep holes/vents in color to match mortar color.
4. Accessories embedded in the masonry.

E. Material Certificates: Signed by manufacturers certifying that each of the following items complies with requirements:

1. Each type of masonry unit required.
   a. Include test data, measurements, and calculations establishing net-area compressive strength of masonry units.
2. Each cement product required for mortar and grout, including name of manufacturer, brand, type, and weight slips at time of delivery.
3. Each material and grade indicated for reinforcing bars.
4. Each type and size of joint reinforcement.
5. Each type and size of anchor, tie, and metal accessory.

1.4 QUALITY ASSURANCE

A. Testing Agency Qualifications: An independent testing agency, acceptable to authorities having jurisdiction, qualified according to ASTM C 1093 to conduct the testing indicated, as documented according to ASTM E 548.

B. Source Limitations for Masonry Units: Obtain exposed masonry units of a uniform texture and color, or a uniform blend within the ranges accepted for these characteristics, through one source from a single manufacturer for each product required.

C. Source Limitations for Mortar Materials: Obtain mortar ingredients of a uniform quality, including color for exposed masonry, from one manufacturer for each cementitious component and from one source or producer for each aggregate.

D. Sample Panels: Before installing unit masonry, build sample panels, using materials indicated for the completed Work, to verify selections made under sample Submittals and to demonstrate aesthetic effects. Build sample panels for each type of exposed unit masonry assembly in sizes approximately 48 inches (1200 mm) long by 48 inches (1200 mm) high by full thickness.

1. Locate panels in the locations indicated or, if not indicated, as directed by Architect.
2. Clean exposed faces of panels with masonry cleaner indicated.
3. Where masonry is to match existing, erect panels adjacent and parallel to existing surface.
4. Protect approved sample panels from the elements with weather-resistant membrane.
5. Maintain sample panels during construction in an undisturbed condition as a standard for judging the completed Work.
6. Approval of sample panels is for color, texture, and blending of masonry units; relationship of mortar and sealant colors to masonry unit colors; tooling of joints; aesthetic qualities of workmanship; and other material and construction qualities specifically approved by Architect in writing.
   a. Approval of sample panels does not constitute approval of deviations from the Contract Documents contained in sample panels, unless such deviations are specifically approved by Architect in writing.
7. Demolish and remove sample panels when directed.

1.5 DELIVERY, STORAGE, AND HANDLING

A. Store masonry units on elevated platforms in a dry location. If units are not stored in an enclosed location, cover tops and sides of stacks with waterproof sheeting, securely tied. If units become wet, do not install until they are dry.

B. Store cementitious materials on elevated platforms, under cover, and in a dry location. Do not use cementitious materials that have become damp.

C. Store aggregates where grading and other required characteristics can be maintained and contamination avoided.

D. Deliver preblended, dry mortar mix in moisture-resistant containers designed for lifting and emptying into dispensing silo. Store preblended, dry mortar mix in delivery containers on elevated platforms, under cover, and in a dry location or in a metal dispensing silo with weatherproof cover.

E. Store masonry accessories, including metal items, to prevent corrosion and accumulation of dirt and oil.

1.6 PROJECT CONDITIONS

A. Protection of Masonry: During construction, cover tops of walls, projections, and sills with waterproof sheeting at end of each day's work. Cover partially completed masonry when construction is not in progress.

1. Extend cover a minimum of 24 inches (600 mm) down both sides and hold cover securely in place.
2. Where one wythe of multiwythe masonry walls is completed in advance of other wythes, secure cover a minimum of 24 inches (600 mm) down face next to unconstructed wythe and hold cover in place.

B. Do not apply uniform floor or roof loads for at least 12 hours and concentrated loads for at least 3 days after building masonry walls or columns.

C. Stain Prevention: Prevent grout, mortar, and soil from staining the face of masonry to be left exposed or painted. Immediately remove grout, mortar, and soil that come in contact with such masonry.

1. Protect base of walls from rain-splashed mud and from mortar splatter by coverings spread on ground and over wall surface.
2. Protect sills, ledges, and projections from mortar droppings.
3. Protect surfaces of window and door frames, as well as similar products with painted and integral finishes, from mortar droppings.
4. Turn scaffold boards near the wall on edge at the end of each day to prevent rain from splashing mortar and dirt onto completed masonry.

D. Cold-Weather Requirements: Do not use frozen materials or materials mixed or coated with ice or frost. Do not build on frozen substrates. Remove and replace unit masonry damaged by frost or by freezing conditions. Comply with cold-weather construction requirements contained in ACI 530.1.

1. Cold-Weather Cleaning: Use liquid cleaning methods only when air temperature is 40 deg F (4 deg C) and above and will remain so until masonry has dried, but not less than 7 days after completing cleaning.

E. Hot-Weather Requirements: Protect unit masonry work when temperature and humidity conditions produce excessive evaporation of water from mortar and grout. Provide artificial shade and wind breaks and use cooled materials as required.

1. When ambient temperature exceeds 100 deg F (38 deg C), or 90 deg F (32 deg C) with a wind velocity greater than 8 mph (13 km/h), do not spread mortar beds more than 48 inches (1200 mm) ahead of masonry. Set masonry units within one minute of spreading mortar.

PART 2 - PRODUCTS

2.1 CONCRETE MASONRY UNITS

A. General: Provide shapes indicated and as follows:

1. Provide special shapes for lintels, corners, jambs, sash, control joints, headers, bonding, and other special conditions.
2. Provide square-edged units for outside corners, unless indicated as bullnose.

B. Concrete Masonry Units: ASTM C90 and as follows:

1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength of 1900 psi (13.1 MPa)
2. Weight Classification: Normal weight.
3. Provide Type I, moisture-controlled units.
4. Size (Width): Manufactured to the following dimensions as indicated on the plans:

   a. 4 inches (102 mm) nominal; 3-5/8 inches (92 mm) actual.
   b. 8 inches (203 mm) nominal; 7-5/8 inches (194 mm) actual.
   c. 12 inches (305 mm) nominal; 11-5/8 inches (295 mm) actual.

5. Exposed Faces: Manufacturer's standard color and texture, unless otherwise indicated.

C. Decorative Concrete Masonry Units: ASTM C90 and as follows:

1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength of 1900 psi (13.1 MPa.
2. Weight Classification: Normal weight.
3. Provide Type I, moisture-controlled units.
4. Size: Manufactured to dimensions indicated for nondecorative units.
5. Finish: Exposed faces of the following general description matching color, pattern, and texture of Architect's samples.
   a. Normal-weight aggregate, split-face finish.

6. Integral Water Repellent: Provide units made with liquid polymeric, integral water-repellent admixture that does not reduce flexural bond strength. Units made with integral water repellent, when tested as a wall assembly made with mortar containing integral water-repellent manufacturer's mortar additive according to ASTM E 514, with test period extended to 24 hours, show no visible water or leaks on the back of the test specimen.

   a. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
   b. Products: Subject to compliance with requirements, provide one of the following:

      1) Block Plus W-10; Addiment Inc.
      2) Dry-Block; W. R. Grace & Co., Construction Products Division.
      3) Rheopel; Master Builders.

2.2 MORTAR AND GROUT MATERIALS

A. Portland Cement-Lime Mix: Packaged blend of portland cement complying with ASTM C 150, Type I or Type III, and hydrated lime complying with ASTM C 207.

B. Aggregate for Mortar: ASTM C 144; except for joints less than 1/4 inch (6.5 mm) thick, use aggregate graded with 100 percent passing the No. 16 (1.18-mm) sieve.

1. White-Mortar Aggregates: Natural white sand or ground white stone.
2. Colored-Mortar Aggregates: Natural-colored sand or ground marble, granite, or other sound stone; of color necessary to produce required mortar color.

C. Aggregate for Grout: ASTM C 404.

D. Cold-Weather Admixture: Nonchloride, noncorrosive, accelerating admixture complying with ASTM C 494, Type C, and recommended by the manufacturer for use in masonry mortar of composition indicated.

E. Water-Repellent Admixture: Liquid water-repellent mortar admixture intended for use with concrete masonry units, containing integral water repellent by same manufacturer.

F. Water: Potable.

G. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:

1. Colored Portland Cement-Lime Mix:

a. Eaglebond; Blue Circle Cement.
b. Color Mortar Blend; Glen-Gery Corporation.
c. Rainbow Mortamix Custom Color Cement/Lime; Holnam, Inc.
d. Centurion Colorbond PL; Lafarge Corporation.
e. Lehigh Custom Color Portland/Lime; Lehigh Portland Cement Co.
f. Riverton Portland Cement Lime Custom Color; Riverton Corporation (The).

2. Cold-Weather Admixture:

a. Accelguard 80; Euclid Chemical Co.
b. Morseled; W. R. Grace & Co., Construction Products Division.
c. Trimix-NCA; Sonneborn, Div. of ChemRex, Inc.

3. Water-Repellent Admixture:

a. Mortar Tite; Addiment Inc.
b. Dry-Block Mortar Admixture; W. R. Grace & Co., Construction Products Division.
c. Rheopel; Master Builders.

2.3 REINFORCING STEEL

A. Uncoated Steel Reinforcing Bars: ASTM A 615/A 615M; Grade 60.

2.4 MASONRY JOINT REINFORCEMENT

A. General: ASTM A951 and as follows:
1. Hot-dip galvanized, carbon-steel wire for both interior and exterior walls.
2. Wire Size for Side Rods: W1.7 or 0.148 inch (3.8 mm).
3. Wire Size for Cross Rods: W1.7 or 0.148 inch (3.8 mm).

4. Provide in lengths of not less than 10 feet (3 m), with prefabricated corner and tee units where indicated.

B. For single-wythe masonry, provide either ladder or truss type with single pair of side rods and cross rods spaced not more than 16 inches (407 mm) o.c.

C. For multiwythe masonry, provide types as follows:

1. Ladder type with perpendicular cross rods spaced not more than 16 inches (407 mm) o.c. and 1 side rod for each face shell of hollow masonry units more than 4 inches (100 mm) in width, plus 1 side rod for each wythe of masonry 4 inches (100 mm) or less in width.
2. Tab type with single pair of side rods spaced for embedment within each face shell of backup wythe and rectangular box-type cross ties spaced not more than 16 inches (407 mm) o.c. Size ties to extend at least halfway through outer wythe but with at least 5/8-inch (16-mm) cover on outside face.

2.5 TIES AND ANCHORS, GENERAL

A. General: Provide ties and anchors, specified in subsequent articles, made from materials that comply with this Article, unless otherwise indicated.

B. Hot-Dip Galvanized Carbon-Steel Wire: ASTM A 82; with ASTM A 153, Class B-2 coating.

C. Steel Sheet, Galvanized after Fabrication: ASTM A 366/A 366M cold-rolled, carbon-steel sheet hot-dip galvanized after fabrication to comply with ASTM A 153.

D. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.

2.6 BENT WIRE TIES

A. General: Rectangular units with closed ends and not less than 4 inches (100 mm) wide. Z-shaped ties with ends bent 90 degrees to provide hooks not less than 2 inches (50 mm) long may be used for masonry constructed from solid units or hollow units laid with cells horizontal.

1. Where coursing between wythes does not align, use adjustable ties composed of 2 parts; 1 with pintles, the other with eyes; with maximum misalignment of 1-1/4 inches (32 mm).

B. Wire: Fabricate from 3/16 inch (4.8 mm) diameter, hot-dip galvanized steel wire.

2.7 ADJUSTABLE ANCHORS FOR CONNECTING TO STEEL FRAME

A. General: Provide two-piece assemblies that allow vertical or horizontal adjustment but resist tension and compression forces perpendicular to plane of wall.

1. Anchor Section: Crimped 1/4-inch- (6.4-mm-) diameter, hot-dip galvanized steel wire anchor section for welding to steel.
2. Tie Section: Triangular-shaped wire tie, sized to extend within 1 inch (25 mm) of masonry face, made from 0.1875 inch (4.8 mm) diameter, hot-dip galvanized steel wire.

2.8 ADJUSTABLE MASONRY-VENEER ANCHORS

A. General: Provide two-piece assemblies that allow vertical or horizontal adjustment but resist tension and compression forces perpendicular to plane of wall, for attachment over sheathing to wood or metal studs, and as follows:

1. Structural Performance Characteristics: Capable of withstanding a 100-lbf (445-N) load in both tension and compression without deforming or developing play in excess of 0.05 inch (1.3 mm).

B. Screw-Attached, Masonry-Veneer Anchors: Units consisting of a wire tie section and a metal anchor section complying with the following requirements:

1. Anchor Section: Rib-stiffened, sheet metal plate with screw holes top and bottom, 2-3/4 inches (70 mm) wide by 3 inches (75 mm) high; with projecting tabs having slotted holes for inserting vertical legs of wire tie specially formed to fit anchor section.
2. Anchor Section: Sheet metal plate with screw holes top and bottom and with raised rib-stiffened strap stamped into center to provide a slot between strap and plate for connection of wire tie.
    a. Plate 1-1/4 inches (32 mm) wide by 6 inches (150 mm) long with strap 5/8 inch (16 mm) wide by 3-5/8 inches (92 mm) long; slot clearance formed between face of plate and back of strap shall not exceed diameter of wire tie by more than 1/32 inch (0.8 mm).
3. Wire Tie Section: Triangular or Rectangular shaped wire tie sized to extend at least halfway through veneer but with at least 5/8-inch (16-mm) cover on outside face.
4. Fabricate sheet metal anchor sections and other sheet metal parts from 0.0966 inch (2.5 mm), thisck, steel sheet, galvanized after fabrication.
5. Fabricate wire tie sections from 0.1875 inch (4.8 mm) diameter, hot-dip galvanized steel wire.

C. Steel Drill Screws for Steel Studs: ASTM C 954 except manufactured with hex washer head and neoprene washer, No. 10 (4.8-mm) diameter by length required to penetrate steel stud flange by not less than 3 exposed threads, and with the following corrosion protective coating:

1. Organic polymer coating with salt-spray resistance to red rust of more than 800 hours per ASTM B 117.

D. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:

1. Screw-Attached, Masonry-Veneer Anchors:
    a. D/A 213; Dur-O-Wal, Inc.
    b. D/A 210 with D/A 700-708; Dur-O-Wal, Inc.
    c. 315-D with 316; Heckman Building Products, Inc.
    d. Pos-I-Tie; Heckman Building Products, Inc.
    e. DW-10; Hohmann & Barnard, Inc.
    f. DW-10HS; Hohmann & Barnard, Inc.
    g. DW-10-X; Hohmann & Barnard, Inc.
    h. 1004, Type III; Masonry Reinforcing Corporation of America.
    i. RJ-711; Masonry Reinforcing Corporation of America.
2. Organic-Polymer-Coated, Steel Drill Screws:
    a. Dril-Flex; Elco Industries, Inc.
    b. Traxx; ITW-Buildex.

2.9 MISCELLANEOUS ANCHORS

A. Anchor Bolts: Steel bolts complying with ASTM A 307, Grade A (ASTM F 568, Property Class 4.6); with ASTM A 563 (ASTM A 563M) hex nuts and, where indicated, flat washers; hot-dip galvanized to comply with ASTM A 153, Class C; of diameter and length indicated and in the following configurations:

1. Headed bolts.
2. Nonheaded bolts, bent in manner indicated.

B. Postinstalled Anchors: Anchors as described below, with capability to sustain, without failure, load imposed within factors of safety indicated, as determined by testing per ASTM E 488, conducted by a qualified independent testing agency.
1. Type: Expansion anchors.
2. Corrosion Protection: Carbon-steel components zinc plated to comply with ASTM B 633, Class Fe/Zn 5 (5 microns) for Class SC 1 service condition (mild).
3. For Postinstalled Anchors in Grouted Masonry Units: Capability to sustain, without failure, a load equal to six times the loads imposed.

2.10 EMBEDDED FLASHING MATERIALS

A. Metal Flashing: Fabricate from the following metal complying with requirements specified in Division 7 Section "Sheet Metal Flashing and Trim" and below:

B. Solder and Sealants for Sheet Metal Flashings: As specified in Division 7 Section "Sheet Metal Flashing and Trim."

2.11 MISCELLANEOUS MASONRY ACCESSORIES

A. Compressible Filler: Premolded filler strips complying with ASTM D 1056, Grade 2A1; compressible up to 35 percent; of width and thickness indicated; formulated from neoprene, urethane or PVC.

B. Preformed Control-Joint Gaskets: Material as indicated below, designed to fit standard sash block and to maintain lateral stability in masonry wall; size and configuration as indicated.

1. Styrene-Butadiene-Rubber Compound: ASTM D 2000, Designation M2AA-805.

C. Bond-Breaker Strips: Asphalt-saturated, organic roofing felt complying with ASTM D 226, Type I (No. 15 asphalt felt).

D. Round Plastic Weep/Vent Tubing: Medium-density polyethylene, 3/8-inch (9-mm) OD by 4 inches (100 mm) long.

E. Wicking Material: Cotton or polyester rope, 1/4 to 3/8 inch (6 to 10 mm) in diameter, in length required to produce 2-inch (50-mm) exposure on exterior and 18 inches (450 mm) in cavity between wythes.

F. Plastic Weep Hole/Vent: One-piece, flexible extrusion made from UV-resistant polypropylene copolymer, designed to fill head joint with outside face held back 1/8 inch (3 mm) from exterior face of masonry, in color selected from manufacturer's standard.

G. Cavity Drainage Material: ¾ inch (19 mm) thick, free-draining mesh; made from polyethylene strands and shaped to avoid being clogged by mortar droppings.

H. Reinforcing Bar Positioners: Wire units designed to fit into mortar bed joints spanning masonry unit cells with loops for holding reinforcing bars in center of cells. Units are formed from 0.142 inch (3.6 mm) steel wire, hot-dip galvanized after fabrication.

1. Provide units with either two loops or four loops as needed for number of bars indicated.

I. Available Products: Subject to compliance with requirements, cavity drainage materials that may be incorporated into the Work include, but are not limited to, the following:

1. Plastic Weep Hole/Vent:

a. Cell Vent; Dur-O-Wal, Inc.

2. Cavity Drainage Material:

a. Mortar Break; Advanced Building Products, Inc.
b. CavClear Masonry Mat; CavClear.
c. Mortar Net; Mortar Net USA, Ltd.
d. Mortar Stop; Polytite Manufacturing Corp.

3. Reinforcing Bar Positioners:

a. D/A 811; Dur-O-Wal, Inc.
b. No. 376 Rebar Positioner; Heckman Building Products, Inc.
c. #RB Rebar Positioner; Hohmann & Barnard, Inc.
d. O-Ring Rebar Positioner; Masonry Reinforcing Corporation of America.

2.12 MASONRY-CELL INSULATION

A. Molded-Polystyrene Insulation Units: Rigid, cellular thermal insulation formed by the expansion of polystyrene-resin beads or granules in a closed mold to comply with ASTM C 578, Type I. Provide specially shaped units designed for installing in cores of masonry units. Provide cell insulation in units as located in the architectural plans or specifications.

2.13 MASONRY CLEANERS

A. Job-Mixed Detergent Solution: Solution of 1/2-cup (0.14-L) dry measure tetrasodium polyphosphate and 1/2-cup (0.14-L) dry measure laundry detergent dissolved in 1 gal. (4 L) of water.

2.14 MORTAR AND GROUT MIXES

A. General: Do not use admixtures, including pigments, air-entraining agents, accelerators, retarders, water-repellent agents, antifreeze compounds, or other admixtures, unless otherwise indicated.

1. Do not use calcium chloride in mortar or grout.
2. Add cold-weather admixture (if used) at the same rate for all mortar, regardless of weather conditions, to ensure that mortar color is consistent.

B. Preblended, Dry Mortar Mix: Furnish dry mortar ingredients in the form of a preblended mix. Measure quantities by weight to ensure accurate proportions, and thoroughly blend ingredients before delivering to Project site.

C. Mortar for Unit Masonry: Comply with ASTM C270, Proportion Specification.
1. For masonry below grade, in contact with earth, and where indicated, use Type S.
2. For reinforced masonry and where indicated, use Type S.

D. Grout for Unit Masonry: Comply with ASTM C 476.

1. Use grout of type indicated or, if not otherwise indicated, of type (fine or coarse) that will comply with Table 5 of ACI 530.1/ASCE 6/TMS 602 for dimensions of grout spaces and pour height.
2. Provide grout with a slump of 8 to 11 inches (200 to 280 mm) as measured according to ASTM C 143.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance.

B. Before installation, examine rough-in and built-in construction to verify actual locations of piping connections.

3.2 INSTALLATION, GENERAL

A. Thickness: Build cavity and composite walls and other masonry construction to the full thickness shown. Build single-wythe walls to the actual widths of masonry units, using units of widths indicated.

B. Build chases and recesses to accommodate items specified in this Section and in other Sections of the Specifications.

C. Leave openings for equipment to be installed before completing masonry. After installing equipment, complete masonry to match the construction immediately adjacent to the opening.

D. Cut masonry units with motor-driven saws to provide clean, sharp, unchipped edges. Cut units as required to provide a continuous pattern and to fit adjoining construction. Where possible, use full-size units without cutting. Allow units cut with water-cooled saws to dry before placing, unless wetting of units is specified. Install cut units with cut surfaces and, where possible, cut edges concealed.

E. Select and arrange units for exposed unit masonry to produce a uniform blend of colors and textures.

1. Mix units from several pallets or cubes as they are placed.

F. Wetting of Brick: Wet brick before laying if the initial rate of absorption exceeds 30 g/30 sq. in. (30 g/194 sq. cm) per minute when tested per ASTM C 67. Allow units to absorb water so they are damp but not wet at the time of laying.

3.3 CONSTRUCTION TOLERANCES

A. Comply with tolerances in ACI 530.1/ASCE 6/TMS 602 and the following:

B. For conspicuous vertical lines, such as external corners, door jambs, reveals, and expansion and control joints, do not vary from plumb by more than 1/4 inch in 20 feet (6 mm in 6 m), nor 1/2 inch (12 mm) maximum.

C. For vertical alignment of exposed head joints, do not vary from plumb by more than 1/4 inch in 10 feet (6 mm in 3 m), nor 1/2 inch (12 mm) maximum.

D. For conspicuous horizontal lines, such as exposed lintels, sills, parapets, and reveals, do not vary from level by more than 1/4 inch in 20 feet (6 mm in 6 m), nor 1/2 inch (12 mm) maximum.

E. For exposed bed joints, do not vary from thickness indicated by more than plus or minus 1/8 inch (3 mm), with a maximum thickness limited to 1/2 inch (12 mm). Do not vary from bed-joint thickness of adjacent courses by more than 1/8 inch (3 mm).

F. For exposed head joints, do not vary from thickness indicated by more than plus or minus 1/8 inch (3 mm). Do not vary from adjacent bed-joint and head-joint thicknesses by more than 1/8 inch (3 mm).

3.4 LAYING MASONRY WALLS

A. Lay out walls in advance for accurate spacing of surface bond patterns with uniform joint thicknesses and for accurate location of openings, movement-type joints, returns, and offsets. Avoid using less-than-half-size units, particularly at corners, jambs, and, where possible, at other locations.

B. Bond Pattern for Exposed Masonry: Lay exposed masonry in the following bond pattern; do not use units with less than nominal 4-inch (100-mm) horizontal face dimensions at corners or jambs.

1. One-half running bond with vertical joint in each course centered on units in courses above and below.

C. Lay concealed masonry with all units in a wythe in running bond or bonded by lapping not less than 2 inches (50 mm). Bond and interlock each course of each wythe at corners. Do not use units with less than nominal 4-inch (100-mm) horizontal face dimensions at corners or jambs.

D. Stopping and Resuming Work: In each course, rack back one-half-unit length for one-half running bond. Clean exposed surfaces of set masonry and remove loose masonry units and mortar before laying fresh masonry.

E. Built-in Work: As construction progresses, build in items specified under this and other Sections of the Specifications. Fill in solidly with masonry around built-in items.

F. Fill space between hollow-metal frames and masonry solidly with mortar, unless otherwise indicated.

G. Where built-in items are to be embedded in cores of hollow masonry units, place a layer of metal lath in the joint below and rod mortar or grout into core.

H. Fill cores in hollow concrete masonry units with grout for full height of wall under bearing plates, beams, lintels, posts, and similar items, unless otherwise indicated.

I. Build non-load-bearing interior partitions full height of story to underside of solid floor or roof structure above, unless otherwise indicated.

1. Install compressible filler in joint between top of partition and underside of structure above.

3.5 MORTAR BEDDING AND JOINTING

A. Lay hollow masonry units as follows:

1. With full mortar coverage on horizontal and vertical face shells.
2. Bed webs in mortar in starting course on footings and in all courses of piers, columns, and pilasters, and where adjacent to cells or cavities to be filled with grout.

3. For starting course on footings where cells are not grouted, spread out full mortar bed, including areas under cells.

B. Lay solid brick-size masonry units with completely filled bed and head joints; butter ends with sufficient mortar to fill head joints and shove into place. Do not deeply furrow bed joints or slush head joints.

1. At cavity walls, bevel beds away from cavity, to minimize mortar protrusions into cavity. As work progresses, trowel mortar fins protruding into cavity flat against the cavity face of the brick.

C. Tool exposed joints slightly concave when thumbprint hard, using a jointer larger than the joint thickness, unless otherwise indicated.

D. Cut joints flush for masonry walls to receive plaster or other direct-applied finishes (other than paint), unless otherwise indicated.

3.6 BONDING OF MULTIWYTHE MASONRY

A. Use masonry joint reinforcement installed in horizontal mortar joints to bond wythes together.

B. Corners: Provide interlocking masonry unit bond in each wythe and course at corners, unless otherwise indicated.

1. Provide continuity with masonry joint reinforcement at corners by using prefabricated "L" units as well as masonry bonding.

C. Intersecting and Abutting Walls: Unless vertical expansion or control joints are shown at juncture, bond walls together as follows:
1. Provide continuity with masonry joint reinforcement by using prefabricated "T" units.

3.7 CAVITIES

A. Keep cavities clean of mortar droppings and other materials during construction. Strike joints facing cavities flush.

1. Use wood strips temporarily placed in cavity to collect mortar droppings. As work progresses, remove strips, clean off mortar droppings, and replace in cavity.

3.8 MASONRY-CELL INSULATION

A. Install molded-polystyrene insulation units into masonry unit cells before laying units.

3.9 MASONRY JOINT REINFORCEMENT

A. General: Provide continuous masonry joint reinforcement as indicated. Install entire length of longitudinal side rods in mortar with a minimum cover of 5/8 inch (16 mm) on exterior side of walls, 1/2 inch (13 mm) elsewhere. Lap reinforcement a minimum of 6 inches (150 mm).

1. Space reinforcement not more than 16 inches (406 mm) o.c.

B. Cut or interrupt joint reinforcement at control and expansion joints, unless otherwise indicated.

C. Provide continuity at corners and wall intersections by using prefabricated "L" and "T" sections. Cut and bend reinforcing units as directed by manufacturer for continuity at returns, offsets, column fireproofing, pipe enclosures, and other special conditions.

3.10 ANCHORING MASONRY TO STRUCTURAL MEMBERS

A. Anchor masonry to structural members where masonry abuts or faces structural members to comply with the following:

1. Provide an open space not less than 1 inch (25 mm) in width between masonry and structural member, unless otherwise indicated. Keep open space free of mortar or other rigid materials.
2. Anchor masonry to structural members with flexible anchors embedded in masonry joints and attached to structure.
3. Space anchors as indicated, but not more than 16 inches (610 mm) o.c. vertically and 32 inches (915 mm) o.c. horizontally.

3.11 ANCHORING MASONRY VENEERS

A. Anchor masonry veneers to wall framing with masonry-veneer anchors to comply with the following requirements:

1. Fasten each anchor section through sheathing to wall framing with two metal fasteners of type indicated.
2. Embed tie sections in masonry joints. Provide not less than 2 inches (50 mm) of air space between back of masonry veneer and face of sheathing.
3. Locate anchor sections to allow maximum vertical differential movement of ties up and down.
4. Space anchors as indicated, but not more than 16 inches (406 mm) o.c. vertically and 32 inches (813 mm) o.c. horizontally with not less than 1 anchor for each 3.5 sq. ft. (0.33 sq. m) of wall area. Install additional anchors within 12 inches (305 mm) of openings and at intervals, not exceeding 36 inches (914 mm), around perimeter.

3.12 CONTROL AND EXPANSION JOINTS

A. General: Install control and expansion joints in unit masonry as follows unless otherwise indicated on drawings. Build-in related items as masonry progresses. Do not form a continuous span through movement joints unless provisions are made to prevent in-plane restraint of wall or partition movement.
1. Vertical control joins shall be spaced at maximum 20'-0" o.c. in any continuous run of wall.

B. Form control joints in concrete masonry as follows:

1. Fit bond-breaker strips into hollow contour in ends of concrete masonry units on one side of control joint. Fill resultant core with grout and rake joints in exposed faces.
2. Install preformed control-joint gaskets designed to fit standard sash block.
3. Install interlocking units designed for control joints. Install bond-breaker strips at joint. Keep head joints free and clear of mortar or rake joint.
4. Install temporary foam-plastic filler in head joints and remove filler when unit masonry is complete.

3.13 LINTELS

A. Install steel lintels where indicated or as required to provide support above all openings as shown on the architectural, structural, mechanical, plumbing or electrical plans.

B. Provide masonry lintels where shown and where openings of more than 12 inches (305 mm) for brick-size units and 24 inches (610 mm) for block-size units are shown without structural steel or other supporting lintels.
   1. Provide prefabricated or built-in-place masonry lintels if required in the architectural plans. Use specially formed bond beam units with reinforcing bars placed as indicated and filled with coarse grout. Cure precast lintels before handling and installing. Temporarily support built-in-place lintels until cured.

C. Provide minimum bearing of 8 inches (200 mm) at each jamb, unless otherwise indicated.

D. Fill cores in hollow concrete masonry units with grout for full height of wall under all lintels.

3.14 FLASHING, WEEP HOLES, AND VENTS

A. General: Install embedded flashing and weep holes in masonry at shelf angles, lintels, ledges, other obstructions to downward flow of water in wall, and where indicated.

B. Prepare masonry surfaces so they are smooth and free from projections that could puncture flashing. Unless otherwise indicated, place through-wall flashing on sloping bed of mortar and cover with mortar. Before covering with mortar, seal penetrations in flashing with adhesive, sealant, or tape as recommended by flashing manufacturer.

C. Install flashing as follows:
   1. At masonry-veneer walls, extend flashing from exterior face of veneer, through veneer, up face of sheathing at least 8 inches (200 mm), and behind air-infiltration barrier or building paper.
   2. At lintels and shelf angles, extend flashing a minimum of 4 inches (100 mm) into masonry at each end. At heads and sills, extend flashing 4 inches (100 mm) at ends and turn flashing up not less than 2 inches (50 mm) to form a pan.

D. Install weep holes in the head joints in exterior wythes of the first course of masonry immediately above embedded flashing and as follows:

   1. Use round plastic tubing, wicking material or plastic weep hole/vents to form weep holes.
   2. Use wicking material to form weep holes above flashing in brick sills. Turn wicking down at lip of sill to be as inconspicuous as possible.
   3. Space weep holes formed from plastic tubing or wicking material 16 inches (400 mm) o.c.
   4. Place cavity drainage material immediately above flashing in cavities.

E. Trim wicking material used in weep holes flush with outside face of wall after mortar has set.

F. Install reglets and nailers for flashing and other related construction where they are shown to be built into masonry.

3.15 REINFORCED UNIT MASONRY INSTALLATION

A. Temporary Formwork and Shores: Construct formwork and shores to support reinforced masonry elements during construction.

1. Construct formwork to conform to shape, line, and dimensions shown. Make it sufficiently tight to prevent leakage of mortar and grout. Brace, tie, and support forms to maintain position and shape during construction and curing of reinforced masonry.
2. Do not remove forms and shores until reinforced masonry members have hardened sufficiently to carry their own weight and other temporary loads that may be placed on them during construction.

B. Placing Reinforcement: Comply with requirements of ACI 530.1/ASCE 6/TMS 602.

C. Grouting: Do not place grout until entire height of masonry to be grouted has attained sufficient strength to resist grout pressure.

1. Comply with requirements of ACI 530.1/ASCE 6/TMS 602 for cleanouts and for grout placement, including minimum grout space and maximum pour height.

3.16 PARGING

A. Parge predampened masonry walls, where indicated, with Type S or Type N mortar applied in 2 uniform coats to a total thickness of 3/4 inch (19 mm). Scarify first parge coat to ensure full bond to subsequent coat.

B. Use a steel-trowel finish to produce a smooth, flat, dense surface with a maximum surface variation of 1/8 inch per foot (3 mm per 300 mm). Form a wash at top of parging and a cove at bottom.

C. Damp-cure parging for at least 24 hours and protect the parging until cured.

3.17 REPAIRING, POINTING, AND CLEANING

A. Remove and replace masonry units that are loose, chipped, broken, stained, or otherwise damaged or that do not match adjoining units. Install new units to match adjoining units; install in fresh mortar, pointed to eliminate evidence of replacement.

B. Pointing: During the tooling of joints, enlarge voids and holes, except weep holes, and completely fill with mortar. Point up joints, including corners, openings, and adjacent construction, to provide a neat, uniform appearance. Prepare joints for sealant application.

C. In-Progress Cleaning: Clean unit masonry as work progresses by dry brushing to remove mortar fins and smears before tooling joints.

D. Final Cleaning: After mortar is thoroughly set and cured, clean exposed masonry as follows:

1. Remove large mortar particles by hand with wooden paddles and nonmetallic scrape hoes or chisels.
2. Test cleaning methods on sample wall panel; leave one-half of panel uncleaned for comparison purposes. Obtain Architect's approval of sample cleaning before proceeding with cleaning of masonry.
3. Protect adjacent stone and nonmasonry surfaces from contact with cleaner by covering them with liquid strippable masking agent, polyethylene film, or waterproof masking tape.
4. Wet wall surfaces with water before applying cleaners; remove cleaners promptly by rinsing the surfaces thoroughly with clear water.
5. Clean brick by the bucket-and-brush hand-cleaning method described in BIA Technical Notes No. 20, using job-mixed detergent solution.

3.18 MASONRY WASTE DISPOSAL

A. Recycling: Unless otherwise indicated, excess masonry materials are Contractor's property. At completion of unit masonry work, remove from Project site.

END OF SECTION 04810

SECTION 050200

PRE-ENGINEERED RIGID FRAMES

1.01 GENERAL

A. The Contractor shall furnish all clearspan frames consisting of rafters rigidly connected to exterior columns. Erect and set all rigid frames as necessary for the completion of this contract as indicated on the drawings and as herein specified. All such work shall be fabricated as detailed or approved and installed complete with all necessary anchors, bolts and other accessories.

1.02 SUBMITTALS

A. Samples, shop drawings and manufacturer's product literature.

B. Samples include all factory made items.

C. Shop drawings shall show thicknesses, sizes and construction of all clearspan rigid frames. Show true profiles and all other pertinent information. Submit eight (8) copies of all shop drawings.

D. Submit structural design calculations of the building signed and sealed by a Professional Engineer in the State of New Jersey.

1.04 WORKMANSHIP

A. Steel shall be well formed to shape and size with sharp lines and angles. Shearing and punching shall leave clean, true lines and surfaces. Permanent connections shall be welded or riveted, unless bolting is indicated on the drawings or specified. The design details and workmanship shall conform to the current AISC Specifications for the Design, Fabrication and Erection of Structural Steel for Buildings insofar as applicable.

B. Castings shall be sound and free from warp and defects that impair their strength or appearance. Exposed surfaces shall be smooth and shall have sharp, well-defined lines and arises. Joints shall be milled to a close fit.

1.05 DESIGN LOADS

A. All rigid frame members shall be sized to support the loads as noted on the drawings, and meet the minimum required loads and load combinations as specified in the International Building Code 2015, whichever is greater.

B. Tapered depth columns are acceptable as located on the plans. Tapered beams are acceptable. However, the contractor is responsible for any and all modifications to the foundation required for rigid frame reactions which are greater than those specified on the plans. The dimensions of the building shown on the Drawings may be revised only as required to suit the building manufacturers plans and details at no additional cost to the Owner. No changes to any structural concrete dimensions or steel reinforcement will be permitted without the Engineer's approval. Any changes will be done at no additional cost to the Owner or Engineer.

C. Endwall Framing: The endwall frames shall be designed and installed to carry the mezzanine/second floor loading as shown on the plans. All required floor and roof loads of the adjacent structure shall be incorporated into the design of all beams and columns.hk

D. Diagonal Bracing: Diagonal bracing in the roof shall be used to stabilize the structure and to resist longitudinal loads (wind, snow, etc.) of the structure. This bracing will be furnished to length and equipped with bevel washers and nuts at each end. It shall consist of rods threaded each end with suitable threaded end anchors. Diagonal bracing rods for the sidewalls shall not be used. The structure shall be designed using portal frames in order to resist longitudinal or lateral loads.

E. The rigid frame shall be designed with all required intermediate members required to support all mechanical unit loads at the locations shown on the plans.

2.01 MATERIALS

A. All structural steel members shall be designed in accordance with AISC "Specifications for the Design Fabrication and Erection of Structural Steel Buildings" Latest Edition.

B. All hot rolled steel sheet, plate and strip used in the fabrication of welded assemblies shall conform to ASTM A572-GR50 and/or ASTM A-36 modified, with a minimum yield strength of 50000 psi.

2.02 FABRICATION

A. Form metals to shape and size, with sharp lines and angles, and with smooth surfaces and faces. Shearing and punching shall leave clean true lines and surfaces, free from distortion. Weld permanent connections. Provide necessary rabetts, lugs and brackets, etc., so that work can be assembled neatly. Thickness of metals and details of assembly and supports shall provide ample strength and stiffness. Form joints exposed to the weather to exclude water. Countersink and recess to receive hardware. Provide with proper bevels and clearances.

B. Furnish in ample time all anchors, bolts, inserts, clips and other items furnished under this section, but built in with the work of other trades.

C. Use plug welds wherever practicable in work exposed to view. Use fillet welds only where plug welding is impractical. Where welds are exposed to view, bevel members prior to welding and weld full. Grind welds flush and smooth, level with the adjacent surfaces so that the resultant weld provides the appearance and strength of a continuous member of uniform thickness. Grind welds at intersecting member of uniform thickness. Grind welds at intersecting members to sharp lines.

D. The anchor bolts furnished with the building system shall be set in accordance with the anchor bolt setting template furnished by the building manufacturer.

2.03 PAINTING

A. All members shall be factory coated with an average of 1 mil. thickness of red oxide primer or equal.

B. Guarantee: A factory guarantee shall be issued to the Owner guaranteeing the factor-applied finish against failure resulting from normal exposure to weather for twenty (20) years from date of acceptance.

C. Hidden Steel: All steel which becomes inaccessible after assembly shall be shop coated with rust-inhibiting primer before assembly.

D. Exposed structural members inside the building shall be given two (2) coats of high grade enamel or epoxy base paint for better protection against the moisture content and final finish. Color shall be selected by Owner. This addition protection shall be applied in the field by the General contractor after the structure has be constructed.

PART 3 - EXECUTION

3.01 ERECTION

A. Erect rigid frames in proper position, securely fastened, plumb, in line, and level. The completed installation shall be free of sharp edges and rough spots. Touch up all abrasions and metal cuts with the material used for shop priming so that the entire assembly, as erected, presents a complete smooth prime coat of paint.

4.01 QUANTITY & PAYMENT

A. Include all costs for rigid frame in lump sum bid prices for structural or building systems as noted in the bid form.

END OF SECTION

SECTION 050300

PRE-ENGINEERED METAL BUILDINGS

1.01 GENERAL

A. The contractor shall furnish and install the metal building complete as shown on the plans and specified herein.

B. The metal building shall be as designed and manufactured by Butler Manufacturing Company or approved equal.

1.02 SUBMITTALS

A. Samples, shop drawings and manufacturer's product literature.

B. Samples include all factory made items.

C. Shop drawings shall show thicknesses, sizes and construction of all clearspan rigid frames. Show true profiles and all other pertinent information. Submit eight (8) copies of all shop drawings.

1.03 DESIGN LOADS

A. All standard building components shall be sized to support the loads as noted on the drawings and meet the minimum required loads and load combinations as specified in the IBC 2015 Code, whichever is greater.

1.04 PRIMARY FRAMING

A. The rigid frames shall be designed, fabricated and installed per Section 05020 of these specifications.

B. The rigid frames shall also be designed to provide the required clear span, roof slope and bay spacings as shown on the plans.

1.05 SECONDARY FRAMING

A. Purlins and Girts: Purlins and girts shall be cold-formed "Z" sections with stiffened flanges. They shall be pre-punched at the factory to provide for field bolting to the rigid frames. They shall be simple or continuous span as required by design.

B. Eave Struts: Eave struts shall be unequal flange cold-formed "C" sections.

C. Base Angle: A base member will be supplied by which the base of the wall covering may be attached to the perimeter of the slab. This member shall be secured to the concrete slab with ram-sets, expansion bolts, or equivalent anchors as shown on the drawings.

D. Steel used to form purlins, girts, eave struts and "C" sections shall meet the requirements of ASTM A607 Grade 55. Minimum yield shall be 55,000 psi.

1.06 BRACING

A. Diagonal Bracing: Diagonal bracing in the roof shall be used to stabilize the structure and to resist longitudinal loads (wind, crane, etc.) of the structure. This bracing will be furnished to length and equipped with bevel washers and nuts at each end. It shall consist of rods threaded each end with suitable threaded end anchors. Diagonal bracing rods for the sidewalls shall not be used. The structure shall be designed using portal frames in order to resist longitudinal or lateral loads.

B. Flange Braces: The compression flange of all primary framing shall be braced laterally with angles connecting to the webs of purlins or girts so that the flange compressive stress is within allowable limits for any combination of loadings.

1.07 ROOF AND WALL PANELS

A. Refer to the Architectural plans and specifications.

1.08 MISCELLANEOUS MATERIALS

A. Structural Bolts: All bolts used in frame splices and in connections of secondary framing to primary framing shall be ASTM A307 or ATTM A325 as required by design.

B. Fasteners: All roof and wall panels shall be attached to secondary framing members self-drilling screws as required to meet design loads. Fasteners shall be of weather resistant material and provide a weathertight seal.

C. Closure Strips: The corrugations of the roof and wall panels shall be filled with solid or closed-cell, preformed rubber, neoprene or polyethylene closures along the eave, ridge and rake when required for weather tightness.

D. Sealers: All panel end laps and side laps shall be sealed with a mastic sealer to provide weather tightness. The sealer shall have good adhesion to metal and be non-staining, non-corrosive, non-shrinking, non-toxic, non-oxidizing, non-volatile and meet the requirements of Federal Specification TT-C-1796A Type II, Class B.

E. Caulk: All gutter and downspout joints, rake flashing laps, ridge flashing laps, doors, windows, and louvers shall be sealed with color matched caulk, which shall meet or exceed the requirements of Federal Specification TT-S-00230C, Type 2, Class A.

1.09 ACCESSORIES

A. Eave Gutters & Downspouts: Refer to architectural plans and specifications for details.

1.10 ERECTION AND INSTALLATION

A. The erection of the metal building and the installation of accessories shall be performed in accordance with manufacturer's erection drawings by a qualified erector using proper tools and equipment.

END OF SECTION

SECTION 055000 - METAL FABRICATIONS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Miscellaneous framing and supports.
2. Prefabricated building columns.
3. Shelf angles.
4. Metal ladders.
5. Alternating tread devices.
6. Metal ships' ladders and pipe crossovers.
7. Metal floor plate.
8. Elevator pit sump covers.
9. Structural-steel door frames.
10. Miscellaneous steel trim.
11. Metal bollards.
12. Vehicular barrier cable systems.
13. Pipe and downspout guards.
14. Abrasive metal nosings, treads, and thresholds.
15. Cast-iron wheel guards.
16. Metal downspout boots.
17. Loose bearing and leveling plates.

B. Products furnished, but not installed, under this Section include the following:

1. Loose steel lintels.
2. Steel weld plates and angles for casting into concrete for applications where they are not specified in other Sections.
3. Anchor bolts, steel pipe sleeves, slotted-channel inserts, and wedge-type inserts indicated to be cast into concrete or built into unit masonry.

C. Related Requirements:

1. Section 042000 "Unit Masonry" for installing loose lintels, anchor bolts, and other items built into unit masonry.
2. Section 051200 "Structural Steel Framing" for steel framing, supports, elevator machine beams, hoist beams, divider beams, door frames, and other steel items attached to the structural-steel framing.

1.2 COORDINATION

A. Coordinate selection of shop primers with topcoats to be applied over them. Comply with paint and coating manufacturers' written instructions to ensure that shop primers and topcoats are compatible with one another.

B. Coordinate installation of metal fabrications that are anchored to or that receive other work. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in concrete or masonry. Deliver such items to Project site in time for installation.

1.3 ACTION SUBMITTALS

A. Product Data:

1. Nonslip aggregates and nonslip-aggregate surface finishes.
2. Fasteners.
3. Shop primers.
4. Shrinkage-resisting grout.
5. Prefabricated building columns.
6. Slotted channel framing.
7. Manufactured metal ladders.
8. Alternating tread devices.
9. Metal ships' ladders and pipe crossovers.
10. Metal bollards.
11. Vehicular barrier cable systems.
12. Pipe and downspout guards.
13. Abrasive metal nosings, treads, and thresholds.
14. Cast-iron wheel guards.
15. Metal downspout boots.

B. Shop Drawings: Show fabrication and installation details. Include plans, elevations, sections, and details of metal fabrications and their connections. Show anchorage and accessory items. Provide Shop Drawings for the following:

1. Miscellaneous framing and supports for applications where framing and supports are not specified in other Sections.
2. Elevator machine beams, hoist beams, and divider beams.
3. Steel shapes for supporting elevator door sills.
4. Steel girders for supporting wood frame construction.
5. Steel pipe columns for supporting wood frame construction.
6. Prefabricated building columns.
7. Shelf angles.
8. Metal ladders.
9. Alternating tread devices.
10. Metal ships' ladders and pipe crossovers.
11. Metal floor plate and supports.
12. Elevator pit sump covers.
13. Structural-steel door frames.
14. Miscellaneous steel trim including steel angle corner guards, steel edgings and loading-dock edge angles.
15. Metal bollards.
16. Loose steel lintels.
17. Vehicular barrier cable systems.

C. Delegated Design Submittals: For installed products indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1.4 INFORMATIONAL SUBMITTALS

A. Mill Certificates: Signed by stainless steel manufacturers, certifying that products furnished comply with requirements.

B. Welding certificates.

C. Paint Compatibility Certificates: From manufacturers of topcoats applied over shop primers, certifying that shop primers are compatible with topcoats.

D. Research Reports: For post-installed anchors.

E. Delegated design engineer qualifications.

1.5 QUALITY ASSURANCE

A. Welding Qualifications: Qualify procedures and personnel in accordance with the following welding codes:

1. AWS D1.1/D1.1M, "Structural Welding Code - Steel."
2. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum."
3. AWS D1.6/D1.6M, "Structural Welding Code - Stainless Steel."

1.6 FIELD CONDITIONS

A. Field Measurements: Verify actual locations of walls, floor slabs, decks, and other construction contiguous with metal fabrications by field measurements before fabrication.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

A. Structural Performance of Aluminum Ladders: Ladders, including landings, are to withstand the effects of loads and stresses within limits and under conditions specified in ANSI/ASC A14.3.

2.2 METALS

A. Metal Surfaces, General: Provide materials with smooth, flat surfaces unless otherwise indicated. For metal fabrications exposed to view in the completed Work, provide materials without seam marks, roller marks, rolled trade names, or blemishes.

B. Steel Plates, Shapes, and Bars: ASTM A36/A36M.

C. Stainless Steel Sheet, Strip, and Plate: ASTM A240/A240M or ASTM A666, Type 304.

D. Stainless Steel Bars and Shapes: ASTM A276/A276M, Type 304.

E. Rolled-Steel Floor Plate: ASTM A786/A786M, rolled from plate complying with ASTM A36/A36M or ASTM A283/A283M, Grade C or D.

F. Rolled-Stainless Steel Floor Plate: ASTM A793.

G. Abrasive-Surface Floor Plate: Steel plate with abrasive granules rolled into surface or with abrasive material metallically bonded to steel.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. IKG.
b. Ohio Gratings, Inc.
c. SlipNOT Metal Safety Flooring, division of Traction Technologies Holdings, LLC.
d. Approved Equivalent.

2. Source Limitations: Obtain floor plate from single source from single manufacturer.

H. Steel Tubing: ASTM A500/A500M, cold-formed steel tubing.

I. Steel Pipe: ASTM A53/A53M, Standard Weight (Schedule 40) unless otherwise indicated.

J. Zinc-Coated Steel Wire Rope: ASTM A741.

1. Wire Rope Fittings: Hot-dip galvanized-steel connectors with capability to sustain, without failure, a load equal to minimum breaking strength of wire rope with which they are used.

K. Stainless Steel Wire Rope: Wire rope manufactured from stainless steel wire complying with ASTM A492, Type 316.

1. Wire Rope Fittings: Stainless steel connectors, Type 316, with capability to sustain, without failure, a load equal to minimum breaking strength of wire rope with which they are used.

L. Slotted Channel Framing: Cold-formed metal box channels (struts) complying with MFMA-4.

1. Size of Channels: As indicated.
2. Galvanized Steel: ASTM A653/A653M, structural steel, Grade 33 (Grade 230), with G90 (Z275) coating; 0.064-inch (1.6-mm) nominal thickness.
3. Cold-Rolled Steel: ASTM A1008/A1008M, structural steel, Grade 33 (Grade 230); 0.0677-inch (1.7-mm) minimum thickness; hot-dip galvanized after fabrication.

M. Cast Iron: Either gray iron, ASTM A48/A48M, or malleable iron, ASTM A47/A47M, unless otherwise indicated.

N. Aluminum Plate and Sheet: ASTM B209 (ASTM B209M), Alloy 6061-T6.

O. Aluminum Extrusions: ASTM B221 (ASTM B221M), Alloy 6063-T6.

P. Aluminum-Alloy Rolled Tread Plate: ASTM B632/B632M, Alloy 6061-T6.

Q. Aluminum Castings: ASTM B26/B26M, Alloy 443.0-F.

R. Bronze Extrusions: ASTM B455, Alloy UNS No. C38500 (extruded architectural bronze).

S. Bronze Castings: ASTM B584, Alloy UNS No. C83600 (leaded red brass) or UNS No. C84400 (leaded semired brass).

T. Nickel Silver Extrusions: ASTM B151/B151M, Alloy UNS No. C74500.

U. Nickel Silver Castings: ASTM B584, Alloy UNS No. C97600 (20 percent leaded nickel bronze).

2.3 FASTENERS

A. General: Unless otherwise indicated, provide Type 304 stainless steel fasteners for exterior use and zinc-plated fasteners with coating complying with ASTM B633 or ASTM F1941/F1941M, Class Fe/Zn 5, at exterior walls. Select fasteners for type, grade, and class required.

1. Provide stainless steel fasteners for fastening aluminum, stainless steel or nickel silver.
2. Provide bronze fasteners for fastening bronze.

B. Steel Bolts and Nuts: Regular hexagon-head bolts, ASTM A307, Grade A (ISO 898-1, Property Class 4.6); with hex nuts, ASTM A563 (ASTM A563M); and, where indicated, flat washers.

C. High-Strength Bolts, Nuts, and Washers: ASTM F3125/F3125M, Grade A325 (Grade A325M), Type 3, heavy-hex steel structural bolts; ASTM A563, Grade DH3, (ASTM A563M, Class 10S3) heavy-hex carbon-steel nuts; and where indicated, flat washers.

D. Stainless Steel Bolts and Nuts: Regular hexagon-head annealed stainless steel bolts, ASTM F593 (ISO 3506-1); with hex nuts, ASTM F594 (ASTM F836M); and, where indicated, flat washers; Alloy Group 1 (A1).

E. Anchor Bolts: ASTM F1554, Grade 36, of dimensions indicated; with nuts, ASTM A563 (ASTM A563M); and, where indicated, flat washers.

1. Hot-dip galvanize or provide mechanically deposited, zinc coating where item being fastened is indicated to be galvanized.

F. Anchors, General: Capable of sustaining, without failure, a load equal to six times the load imposed when installed in unit masonry and four times the load imposed when installed in concrete, as determined by testing in accordance with ASTM E488/E488M, conducted by a qualified independent testing agency.

G. Cast-in-Place Anchors in Concrete: Either threaded or wedge type unless otherwise indicated; galvanized ferrous castings, either ASTM A47/A47M malleable iron or ASTM A27/A27M cast steel. Provide bolts, washers, and shims as needed, all hot-dip galvanized per ASTM F2329/F2329M.

H. Post-Installed Anchors: Torque-controlled expansion anchors or chemical anchors.

1. Material for Interior Locations: Carbon-steel components zinc plated to comply with ASTM B633 or ASTM F1941/F1941M, Class Fe/Zn 5, unless otherwise indicated.
2. Material for Exterior Locations and Where Stainless Steel Is Indicated: Alloy Group 1 (A1) stainless steel bolts, ASTM F593 (ISO 3506-1), and nuts, ASTM F594 (ASTM F836M).

I. Slotted-Channel Inserts: Cold-formed, hot-dip galvanized-steel box channels (struts) complying with MFMA-4, 1-5/8 by 7/8 inches (41 by 22 mm) by length indicated with anchor straps or studs not less than 3 inches (75 mm) long at not more than 8 inches (200 mm) o.c. Provide with temporary filler and tee-head bolts, complete with washers and nuts, all zinc-plated to comply with ASTM B633, Class Fe/Zn 5, as needed for fastening to inserts.

2.4 MISCELLANEOUS MATERIALS

A. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat.

1. Use primer that contains pigments that make it easily distinguishable from zinc-rich primer.

B. Shop Primer for Galvanized Steel: Primer formulated for exterior use over zinc-coated metal and compatible with finish paint systems indicated.

C. Galvanizing Repair Paint: High-zinc-dust-content paint complying with SSPC-Paint 20 and compatible with paints specified to be used over it.

D. Bituminous Paint: Cold-applied asphalt emulsion complying with ASTM D1187/D1187M.

E. Shrinkage-Resistant Grout: Factory-packaged, nonmetallic, nonstaining, noncorrosive, nongaseous grout complying with ASTM C1107/C1107M. Provide grout specifically recommended by manufacturer for interior and exterior applications.

F. Concrete: Comply with requirements in Section 033000 "Cast-in-Place Concrete" for normal-weight, air-entrained concrete with a minimum 28-day compressive strength of 4000 psi (27 MPa).

2.5 FABRICATION, GENERAL

A. Shop Assembly: Preassemble items in the shop to greatest extent possible. Disassemble units only as necessary for shipping and handling limitations. Use connections that maintain structural value of joined pieces. Clearly mark units for reassembly and coordinated installation.

B. Cut, drill, and punch metals cleanly and accurately. Remove burrs and ease edges to a radius of approximately 1/32 inch (1 mm) unless otherwise indicated. Remove sharp or rough areas on exposed surfaces.

C. Form bent-metal corners to smallest radius possible without causing grain separation or otherwise impairing work.

D. Form exposed work with accurate angles and surfaces and straight edges.

E. Weld corners and seams continuously to comply with the following:

1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
2. Obtain fusion without undercut or overlap.
3. Remove welding flux immediately.
4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing and contour of welded surface matches that of adjacent surface.

F. Form exposed connections with hairline joints, flush and smooth, using concealed fasteners or welds where possible. Where exposed fasteners are required, use Phillips flat-head (countersunk) fasteners unless otherwise indicated. Locate joints where least conspicuous.

G. Fabricate seams and other connections that are exposed to weather in a manner to exclude water. Provide weep holes where water may accumulate.

H. Cut, reinforce, drill, and tap metal fabrications as indicated to receive finish hardware, screws, and similar items.

I. Provide for anchorage of type indicated; coordinate with supporting structure. Space anchoring devices to secure metal fabrications rigidly in place and to support indicated loads.

J. Where units are indicated to be cast into concrete or built into masonry, equip with integrally welded steel strap anchors, 1/8 by 1-1/2 inches (3.2 by 38 mm), with a minimum 6-inch (150-mm) embedment and 2-inch (50-mm) hook, not less than 8 inches (200 mm) from ends and corners of units and 24 inches (600 mm) o.c., unless otherwise indicated.

2.6 MISCELLANEOUS FRAMING AND SUPPORTS

A. General: Provide steel framing and supports not specified in other Sections as needed to complete the Work.

B. Fabricate units from steel shapes, plates, and bars of welded construction unless otherwise indicated. Fabricate to sizes, shapes, and profiles indicated and as necessary to receive adjacent construction.

1. Fabricate units from slotted channel framing where indicated.
2. Furnish inserts for units installed after concrete is placed.

C. Fabricate supports for operable partitions from continuous steel beams of sizes recommended by partition manufacturer with attached bearing plates, anchors, and braces as recommended by partition manufacturer. Drill or punch bottom flanges of beams to receive partition track hanger rods; locate holes where indicated on operable partition Shop Drawings.

D. Fabricate steel girders for wood frame construction from continuous steel shapes of sizes indicated.

1. Provide bearing plates welded to beams where indicated.
2. Drill or punch girders and plates for field-bolted connections where indicated.
3. Where wood nailers are attached to girders with bolts or lag screws, drill or punch holes at 24 inches (600 mm) o.c.

E. Fabricate steel pipe columns for supporting wood frame construction from steel pipe with steel baseplates and top plates as indicated. Drill or punch baseplates and top plates for anchor and connection bolts and weld to pipe with fillet welds all around. Make welds the same size as pipe wall thickness unless otherwise indicated.

1. Unless otherwise indicated, fabricate from Schedule 40 steel pipe.
2. Unless otherwise indicated, provide 1/2-inch (12.7-mm) baseplates with four 5/8-inch (16-mm) anchor bolts and 1/4-inch (6.4-mm) top plates.

F. Galvanize miscellaneous framing and supports where indicated.

2.7 PREFABRICATED BUILDING COLUMNS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Black Rock Fireproof Column, a division of United Steel.
2. Dean Lally LLC / FireTrol Columns.
3. Approved Equivalent.

B. Source Limitations: Obtain prefabricated building column from single source from single manufacturer.

C. General: Provide prefabricated building columns consisting of load-bearing structural-steel members protected by concrete fireproofing encased in an outer non-load-bearing steel shell. Fabricate connections to comply with details shown or as needed to suit type of structure indicated.

D. Fire-Resistance Ratings: Provide prefabricated building columns listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction for ratings indicated, based on testing in accordance with ASTM E119.

1. Fire-Resistance Rating: As indicated.

2.8 SHELF ANGLES

A. Fabricate shelf angles from steel angles of sizes indicated and for attachment to concrete framing. Provide horizontally slotted holes to receive 3/4-inch (19-mm) bolts, spaced not more than 6 inches (150 mm) from ends and 24 inches (600 mm) o.c., unless otherwise indicated.

1. Provide mitered and welded units at corners.
2. Provide open joints in shelf angles at expansion and control joints. Make open joint approximately 2 inches (50 mm) larger than expansion or control joint.

B. For cavity walls, provide vertical channel brackets to support angles from backup masonry and concrete.

C. Galvanize shelf angles located in exterior walls.

D. Furnish wedge-type concrete inserts, complete with fasteners, to attach shelf angles to cast-in-place concrete.

2.9 METAL LADDERS

A. General:

1. Comply with ANSI A14.3, except for elevator pit ladders.
2. For elevator pit ladders, comply with ASME A17.1/CSA B44.

B. Steel Ladders:

1. Space siderails 18 inches (457 mm) apart unless otherwise indicated.
2. Siderails: Continuous, 3/8-by-2-1/2-inch (9.5-by-64-mm) steel flat bars, with eased edges.
3. Rungs: 3/4-inch- (19-mm-) diameter or 3/4-inch- (19-mm-) square, steel bars.
4. Fit rungs in centerline of siderails; plug-weld and grind smooth on outer rail faces.
5. Provide nonslip surfaces on top of each rung, either by coating rung with aluminum-oxide granules set in epoxy-resin adhesive or by using a type of manufactured rung filled with aluminum-oxide grout.
6. Nonslip Surfaces for Steel Ladders: Provide nonslip surfaces on top of each rung by coating with abrasive material metallically bonded to rung.

    a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

        1) IKG.
        2) SlipNOT Metal Safety Flooring, division of Traction Technologies Holdings, LLC.
        3) Approved Equivalent.

7. Source Limitations: Obtain nonslip surfaces from single source from single manufacturer.
8. Provide platforms as indicated fabricated from welded or pressure-locked steel bar grating, supported by steel angles. Limit openings in gratings to no more than 3/4 inch (19 mm) in least dimension.
9. Support each ladder at top and bottom and not more than 60 inches (1500 mm) o.c. with welded or bolted steel brackets.
10. Galvanize exterior ladders, including brackets.

C. Aluminum Ladders:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Fixfast USA.

b. Halliday Products.
c. O'Keeffe's Inc.
d. Precision Ladders, LLC.
e. Royalite Manufacturing, Inc.
f. Thompson Fabricating, LLC.
g. UPNOVR, Inc.
h. Approved Equivalent.

2. Source Limitations: Obtain aluminum ladders from single source from single manufacturer.
3. Space siderails 18 inches (457 mm) apart unless otherwise indicated.
4. Siderails: Continuous extruded-aluminum channels or tubes, not less than 2-1/2 inches (64 mm) deep, 3/4 inch (19 mm) wide, and 1/8 inch (3.2 mm) thick.
5. Rungs: Extruded-aluminum tubes, not less than 3/4 inch (19 mm) deep and not less than 1/8 inch (3.2 mm) thick, with ribbed tread surfaces.
6. Fit rungs in centerline of siderails; fasten by welding or with stainless steel fasteners or brackets and aluminum rivets.
7. Provide platforms as indicated fabricated from pressure-locked aluminum bar grating or extruded-aluminum plank grating, supported by extruded-aluminum framing. Limit openings in gratings to no more than 3/4 inch (19 mm) in least dimension.
8. Support each ladder at top and bottom and not more than 60 inches (1500 mm) o.c.]with welded or bolted aluminum brackets.
9. Provide minimum 72-inch- (1830-mm-) high, hinged security door with padlock hasp at foot of ladder to prevent unauthorized ladder use.

2.10 METAL SHIPS' LADDERS AND PIPE CROSSOVERS

A. Provide metal ships' ladders and pipe crossovers where indicated. Fabricate of open-type construction with channel or plate stringers and pipe and tube railings unless otherwise indicated. Provide brackets and fittings for installation.

1. Treads are not to be less than 5 inches (127 mm) exclusive of nosing or less than 8-1/2 inches (216 mm) including the nosing, and riser height is not to be more than 9-1/2 inches (241 mm).
2. Fabricate ships' ladders and pipe crossovers, including railings from steel, stainless steel or aluminum, as indicated on the Contract Drawings.
3. Fabricate treads and platforms from welded or pressure-locked steel bar, pressure-locked stainless steel bar, pressure-locked aluminum bar or extruded-aluminum plank grating, as indicated on the Contract Drawings. Limit openings in gratings to no more than 3/4 inch (19 mm) in least dimension.
4. Fabricate treads and platforms from rolled-steel floor, rolled-stainless steel floor, rolled-aluminum-alloy tread or abrasive-surface floor plate, as indicated on the Contract Drawings.

B. Galvanize exterior steel ships' ladders and pipe crossovers, including treads, railings, brackets, and fasteners.

2.11 METAL FLOOR PLATE

A. Fabricate from rolled-steel floor, rolled-stainless steel floor, rolled-aluminum-alloy tread or abrasive-surface floor plate of thickness indicated below:

1. Thickness: As indicated.

B. Provide grating sections where indicated, fabricated from welded or pressure-locked steel bar, pressure-locked stainless steel bar, pressure-locked aluminum bar or extruded-aluminum plank grating. Limit openings in gratings to no more than 3/4 inch (19 mm) in least dimension.

C. Provide steel, stainless steel or aluminum angle supports as indicated.

D. Include steel, stainless steel or aluminum angle stiffeners, and fixed and removable sections as indicated.

E. Provide flush steel, stainless steel or aluminum bar drop handles for lifting removable sections, one at each end of each section.

2.12 ELEVATOR PIT SUMP COVERS

A. Fabricate from 3/16-inch (4.8-mm) rolled-steel floor plate with four 1-inch- (25-mm-) diameter holes for water drainage and for lifting.

B. Provide steel angle supports unless otherwise indicated.

2.13 STRUCTURAL-STEEL DOOR FRAMES

A. Fabricate structural-steel door frames from steel shapes, plates, and bars of size and to dimensions indicated, fully welded together, with 5/8-by-1-1/2-inch (16-by-38-mm) steel channel stops, unless otherwise indicated. Plug-weld built-up members and continuously weld exposed joints. Secure removable stops to frame with countersunk machine screws, uniformly spaced at not more than 10 inches (250 mm) o.c. Reinforce frames and drill and tap as necessary to accept finish hardware.

1. Provide with integrally welded steel strap anchors for securing door frames into adjoining concrete or masonry.

B. Extend bottom of frames to floor elevation indicated with steel angle clips welded to frames for anchoring frame to floor with expansion shields and bolts.

C. Galvanize exterior steel frames.

2.14 MISCELLANEOUS STEEL TRIM

A. Unless otherwise indicated, fabricate units from steel shapes, plates, and bars of profiles shown with continuously welded joints and smooth exposed edges. Miter corners and use concealed field splices where possible.

B. Provide cutouts, fittings, and anchorages as needed to coordinate assembly and installation with other work.

1. Provide with integrally welded steel strap anchors for embedding in concrete or masonry construction.

C. Galvanize exterior miscellaneous steel trim.

2.15 METAL BOLLARDS

A. Fabricate metal bollards from Schedule 80 steel pipe or steel shapes, as indicated.

1. Cap bollards with 1/4-inch-(6.4-mm-) thick, steel plate with flat top.
2. Where bollards are indicated to receive controls for door operators, provide cutouts for controls and holes for wire.
3. Where bollards are indicated to receive light fixtures, provide cutouts for fixtures and holes for wire.

B. Fabricate bollards with 3/8-inch-(9.5-mm-) thick, steel baseplates for bolting to concrete slab. Drill baseplates at all four corners for 3/4-inch (19-mm) anchor bolts.

1. Where bollards are to be anchored to sloping concrete slabs, angle baseplates for plumb alignment of bollards.

C. Fabricate sleeves for bollard anchorage from steel or stainless steel pipe or tubing with 1/4-inch-(6.4-mm-) thick, steel or stainless steel plate welded to bottom of sleeve. Make sleeves not less than 8 inches (200 mm) deep and 3/4 inch (19 mm) larger than OD of bollard.

D. Fabricate internal sleeves for removable bollards from Schedule 80 **steel** pipe or 1/4-inch (6.4-mm) wall-thickness steel tubing with an OD approximately 1/16 inch (1.5 mm) less than ID of bollards. Match drill sleeve and bollard for 3/4-inch (19-mm) steel] machine bolt.

E. Prime steel bollards with zinc-rich primer.

2.16 PIPE AND DOWNSPOUT GUARDS

A. Fabricate pipe and downspout guards from 3/8-inch- (9.5-mm-) thick by 12-inch- (300-mm-) wide, steel plate, bent to fit flat against the wall or column at both ends and to fit around pipe with 2-inch (50-mm) clearance between pipe and pipe guard. Drill each end for two 3/4-inch (19-mm) anchor bolts.

B. Galvanize steel pipe and downspout guards.

2.17 ABRASIVE METAL NOSINGS, TREADS, AND THRESHOLDS

A. Cast-Metal Units: Cast iron or aluminum, with an integral-abrasive, as-cast finish consisting of aluminum oxide, silicon carbide, or a combination of both. Fabricate units in lengths necessary to accurately fit openings or conditions.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. American Safety Tread Co., Inc.
    b. Balco; a CSW Industrials Company.
    c. Barry Pattern & Foundry Co., Inc.
    d. Safe-T-Metal Company, Inc.
    e. Wooster Products Inc.
    f. Approved Equivalent.

2. Source Limitations: Obtain units from single source from single manufacturer.
3. Cross-hatched nosings, 4 inches (100 mm) wide, with 1/4-inch- (6-mm-) thick 1-inch (25-mm) lip, for casting into concrete.
4. Cross-hatched nosings, 1-1/2 inches (38-mm) wide, 3/8-inch- (9.5-mm-) thick 1-1/2 inch (38-mm) lip, for casting into concrete.
5. Cross-hatched Treads: Full depth of tread with 3/4-by-3/4-inch (19-by-19-mm) nosing, for application over bent plate treads or existing stairs.
6. Fluted-Saddle-Type Thresholds: 5 inches (125 mm) wide by 1/2 inch (12 mm) high, with tapered edges.
7. Fluted-Interlocking or -Hook-Strip Thresholds: 5 inches (125 mm) wide by 5/8 inch (16 mm) high, with tapered edge.
8. Thresholds: Plain-stepped- (stop-) type units, 5 inches (125 mm) wide by 1/2 inch (12 mm) high, with 1/2-inch (12-mm) step.

B. Extruded Units: Aluminum, with abrasive filler consisting of aluminum oxide, silicon carbide, or a combination of both, in an epoxy-resin binder. Fabricate units in lengths necessary to accurately fit openings or conditions.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. American Safety Tread Co., Inc.
    b. Amstep Products.
    c. Armstrong Products, Inc.
    d. Balco; a CSW Industrials Company.
    e. Nystrom, Inc.
    f. Wooster Products Inc.
    g. Approved Equivalent.

2. Source Limitations: Obtain units from single source from single manufacturer.
3. Provide ribbed units, with abrasive filler strips projecting 1/16 inch (1.5 mm) above aluminum extrusion.
4. Nosings:

    a. Square-back units, 1-7/8 inches (48 mm) or 3 inches (75 mm) wide, for casting into concrete steps.
    b. Beveled-back units, 3 inches (75 mm) wide with 1-3/8-inch (35-mm) lip, for surface mounting on existing stairs.
    c. Two-piece units, 3 inches (75 mm) wide, with subchannel for casting into concrete steps.

5. Treads: Beveled-back units, full depth of tread with 1-3/8-inch (35-mm) lip, for application over existing stairs.

C. Provide anchors for embedding units in concrete, either integral or applied to units, as standard with manufacturer.

D. Apply bituminous paint to concealed surfaces of cast-metal units.

E. Apply clear lacquer to concealed surfaces of extruded units.

2.18 CAST-IRON WHEEL GUARDS

A. Provide wheel guards made from cast-iron, 3/4-inch- (19-mm-) thick, hollow-core construction, of size and shape indicated. Provide holes for countersunk anchor bolts and grouting.

2.19 METAL DOWNSPOUT BOOTS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. J.R. Hoe & Sons Inc.
2. Neenah Foundry Company.
3. Approved Equivalent.

B. Source Limitations: Obtain downspout boots from single source from single manufacturer.

C. Provide downspout boots made from cast aluminum in heights indicated with inlets of size and shape to suit downspouts. Provide units with flanges and holes for countersunk anchor bolts.

1. Outlet: Vertical, to discharge into pipe or at 35 degrees from horizontal, to discharge onto splash block or pavement.

2.20 LOOSE BEARING AND LEVELING PLATES

A. Provide loose bearing and leveling plates for steel items bearing on masonry or concrete construction. Drill plates to receive anchor bolts and for grouting.

B. Galvanize bearing and leveling plates.

2.21 LOOSE STEEL LINTELS

A. Fabricate loose steel lintels from steel angles and shapes of size indicated for openings and recesses in masonry walls and partitions at locations indicated. Fabricate in single lengths for each opening unless otherwise indicated. Weld adjoining members together to form a single unit where indicated.

B. Size loose lintels to provide bearing length at each side of openings equal to one-twelfth of clear span, but not less than 8 inches (200 mm) unless otherwise indicated.

C. Galvanize loose steel lintels located in exterior walls.

2.22 STEEL WELD PLATES AND ANGLES

A. Provide steel weld plates and angles not specified in other Sections, for items supported from concrete construction as needed to complete the Work. Provide each unit with no fewer than two integrally welded steel strap anchors for embedding in concrete.

2.23 GENERAL FINISH REQUIREMENTS

A. Finish metal fabrications after assembly.

B. Finish exposed surfaces to remove tool and die marks and stretch lines, and to blend into surrounding surface.

2.24 STEEL AND IRON FINISHES

A. Galvanizing: Hot-dip galvanize items as indicated to comply with ASTM A153/A153M for steel and iron hardware and with ASTM A123/A123M for other steel and iron products.

1. Do not quench or apply post galvanizing treatments that might interfere with paint adhesion.

B. Preparation for Shop Priming Galvanized Items: After galvanizing, thoroughly clean galvanized surfaces of grease, dirt, oil, flux, and other foreign matter, and treat with metallic phosphate process.

C. Shop prime iron and steel items not indicated to be galvanized unless they are to be embedded in concrete, sprayed-on fireproofing, or masonry, or unless otherwise indicated.

D. Preparation for Shop Priming: Prepare surfaces to comply with requirements indicated below:

1. Exterior Items: SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
2. Items Indicated to Receive Zinc-Rich Primer: SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
3. Items Indicated to Receive Primers Specified in Section 099600 "High-Performance Coatings": SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
4. Other Steel Items: SSPC-SP 3, "Power Tool Cleaning."
5. Galvanized-Steel Items: SSPC-SP 16, "Brush-off Blast Cleaning of Coated and Uncoated Galvanized Steel, Stainless Steels, and Non-Ferrous Metals."

E. Shop Priming: Apply shop primer to comply with SSPC-PA 1, "Paint Application Specification No. 1: Shop, Field, and Maintenance Painting of Steel," for shop painting.

1. Stripe paint corners, crevices, bolts, welds, and sharp edges.

2.25 ALUMINUM FINISHES

A. As-Fabricated Finish: AA-M12.

B. Clear Anodic Finish: AAMA 611, Class I, AA-M12C22A41.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

A. Cutting, Fitting, and Placement: Perform cutting, drilling, and fitting required for installing metal fabrications. Set metal fabrications accurately in location, alignment, and elevation; with edges and surfaces level, plumb, true, and free of rack; and measured from established lines and levels.

B. Fit exposed connections accurately together to form hairline joints. Weld connections that are not to be left as exposed joints but cannot be shop welded because of shipping size limitations. Do not weld, cut, or abrade surfaces of exterior units that have been hot-dip galvanized after fabrication and are for bolted or screwed field connections.

C. Field Welding: Comply with the following requirements:

1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
2. Obtain fusion without undercut or overlap.
3. Remove welding flux immediately.
4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing and contour of welded surface matches that of adjacent surface.

D. Fastening to In-Place Construction: Provide anchorage devices and fasteners where metal fabrications are required to be fastened to in-place construction. Provide threaded fasteners for use with concrete and masonry inserts, toggle bolts, through bolts, lag screws, wood screws, and other connectors.

E. Provide temporary bracing or anchors in formwork for items that are to be built into concrete, masonry, or similar construction.

F. Corrosion Protection: Coat concealed surfaces of aluminum that come into contact with grout, concrete, masonry, wood, or dissimilar metals with the following:

1. Cast Aluminum: Heavy coat of bituminous paint.
2. Extruded Aluminum: Two coats of clear lacquer.

3.2 INSTALLATION OF MISCELLANEOUS FRAMING AND SUPPORTS

A. General: Install framing and supports to comply with requirements of items being supported, including manufacturers' written instructions and requirements indicated on Shop Drawings.

B. Anchor supports for ceiling-hung toilet partitions, operable partitions and overhead doors securely to, and rigidly brace from, building structure.

C. Anchor shelf angles securely to existing construction with expansion anchors or anchor bolts through bolts.

D. Support steel girders on solid grouted masonry, concrete, or steel pipe columns. Secure girders with anchor bolts embedded in grouted masonry or concrete or with bolts through top plates of pipe columns.

1. Where grout space under bearing plates is indicated for girders supported on concrete or masonry, install as specified in "Installing Bearing and Leveling Plates" Article.

E. Install pipe columns on concrete footings with grouted baseplates. Position and grout column baseplates as specified in "Installation of Bearing and Leveling Plates" Article.

1. Grout baseplates of columns supporting steel girders after girders are installed and leveled.

3.3 INSTALLATION OF PREFABRICATED BUILDING COLUMNS

A. Install prefabricated building columns to comply with ANSI/AISC 360, "Specifications for Structural Steel Buildings," and with requirements applicable to listing and labeling for fire-resistance rating indicated.

3.4 INSTALLATION OF SHELF ANGLES

A. Install shelf angles as required to keep masonry level, at correct elevation, and flush with vertical plane.

3.5 INSTALLATION OF METAL LADDERS

A. Secure ladders to adjacent construction with the clip angles attached to the stringer.

B. Install brackets as required for securing of ladders welded or bolted to structural steel or built into masonry or concrete.

3.6 INSTALLATION OF ALTERNATING TREAD DEVICES

A. Secure top and bottom of alternating tread devices to construction to comply with manufacturer's written instructions.

3.7 INSTALLATION OF METAL SHIPS' LADDERS AND PIPE CROSSOVERS

A. Secure top and bottom of ships' ladders to construction to comply with manufacturer's written instructions.

B. Secure pipe crossovers to construction to comply with manufacturer's written instructions.

3.8 INSTALLATION OF METAL FLOOR PLATE

A. Install metal floor plates flush with finished surface. Adjust as required to avoid lippage that could present a tripping hazard.

3.9 INSTALLATION OF ELEVATOR PIT SUMP COVERS

A. Install tops of elevator sump pit cover plates and frames flush with finished surface. Adjust as required to avoid lippage that could present a tripping hazard.

3.10 INSTALLATION OF STRUCTURAL-STEEL DOOR FRAMES

A. Fasten structural steel door frames to the floor slab by means of angle clips and expansion bolts. Anchor door jambs to adjacent construction in accordance with shop drawing details.

3.11 INSTALLATION OF MISCELLANEOUS STEEL TRIM

A. Anchor to concrete construction to comply with manufacturer's written instructions.

3.12 INSTALLATION OF METAL BOLLARDS

A. Fill metal-capped bollards solidly with concrete and allow concrete to cure seven days before installing.

1. Do not fill removable bollards with concrete.

B. Anchor bollards to existing construction with expansion anchors or anchor bolts. Provide four 3/4-inch (19-mm) bolts at each bollard unless otherwise indicated.

1. Embed anchor bolts at least 4 inches (100 mm) in concrete.

C. Anchor bollards in concrete with pipe sleeves preset and anchored into concrete. Fill annular space around bollard solidly with shrinkage-resistant grout; mixed and placed to comply with grout manufacturer's written instructions. Slope grout up approximately 1/8 inch (3 mm) toward bollard.

D. Anchor bollards in place with concrete footings. Center and align bollards in holes 3 inches (75 mm) above bottom of excavation. Place concrete and vibrate or tamp for consolidation. Support and brace bollards in position until concrete has cured.

E. Anchor internal sleeves for removable bollards in concrete by inserting in pipe sleeves preset into concrete. Fill annular space around internal sleeves solidly with shrinkage-resistant grout; mixed and placed to comply with grout manufacturer's written instructions. Slope grout up approximately 1/8 inch (3 mm) toward internal sleeve.

F. Anchor internal sleeves for removable bollards in place with concrete footings. Center and align sleeves in holes 3 inches (75 mm) above bottom of excavation. Place concrete and vibrate or tamp for consolidation. Support and brace sleeves in position until concrete has cured.

G. Place removable bollards over internal sleeves and secure with 3/4-inch (19-mm) machine bolts and nuts. After tightening nuts, drill holes in bolts for inserting padlocks. Owner furnishes padlocks.

H. Fill bollards solidly with concrete, mounding top surface to shed water.

1. Do not fill removable bollards with concrete.

3.13 INSTALLATION OF PIPE AND DOWNSPOUT GUARDS

A. Provide pipe guards at exposed vertical pipes in parking garages where not protected by curbs or other barriers. Install by bolting to wall or column with expansion anchors. Provide four 3/4-inch (19-mm) bolts at each pipe guard. Mount pipe guards with top edge 26 inches (660 mm) above driving surface.

3.14 INSTALLATION OF ABRASIVE METAL NOSINGS, TREADS, AND THRESHOLDS

A. Center nosings on tread widths unless otherwise indicated.

B. For nosings embedded in concrete steps or curbs, align nosings flush with riser faces and level with tread surfaces.

C. Seal thresholds exposed to exterior with elastomeric sealant complying with Section 079200 "Joint Sealants" to provide a watertight installation.

3.15 INSTALLATION OF CAST-IRON WHEEL GUARDS

A. Anchor wheel guards to concrete or masonry construction to comply with manufacturer's written instructions. Fill cores solidly with concrete.

3.16 INSTALLATION OF METAL DOWNSPOUT BOOTS

A. Anchor metal downspout boots to concrete or masonry construction to comply with manufacturer's written instructions.

B. Secure downspouts terminations to downspouts and substrate per manufacturer's instructions.

3.17 INSTALLATION OF LOOSE BEARING AND LEVELING PLATES

A. Clean concrete and masonry bearing surfaces of bond-reducing materials and roughen to improve bond to surfaces. Clean bottom surface of plates.

B. Set bearing and leveling plates on wedges, shims, or leveling nuts. After bearing members have been positioned and plumbed, tighten anchor bolts. Do not remove wedges or shims but, if protruding, cut off flush with edge of bearing plate before packing with shrinkage-resistant grout. Pack grout solidly between bearing surfaces and plates to ensure that no voids remain.

3.18 REPAIRS

A. Touchup Painting:

1. Immediately after erection, clean field welds, bolted connections, and abraded areas. Paint uncoated and abraded areas with same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.

a. Apply by brush or spray to provide a minimum 2.0-mil (0.05-mm) dry film thickness.

B. Galvanized Surfaces: Clean field welds, bolted connections, and abraded areas and repair galvanizing to comply with ASTM A780/A780M.

PART 4 - MEASUREMENT, QUANITTY & PAYMENT

Cost for work specified in this section shall be paid for under the bid form line items for which they are a part. Costs shall include all furnishment and installation of miscellaneous metal fabrications as required per the contract documents. This includes but is not limited to all metal materials fasteners, miscellaneous framing/supports, prefabricated building columns, shelf angles, metal ladders, metal floor plates, elevator sump pit covers, structural steel door frames, metal trim, metal bollards, pipe/downspout guards, abrasive metal treads, metal downspout boots, loose steel lintels, and all metal finishes.

END OF SECTION 055000

SECTION 077100

GUTTERS AND DOWNSPOUTS

PART 1 GENERAL

1.1 SECTION INCLUDES

A. Gutters and Downspouts.

B. Related Accessories.

1.2 REFERENCES

A. ASTM B 209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate.

B. SMACNA - Architectural Sheet Metal Manual.

1.3 DESIGN / PERFORMANCE REQUIREMENTS

A. Conform to applicable code for size and method of rain water discharge.

B. American Architectural Manufacturers Association (AAMA) Specification 1405.1 "Specification for Aluminum Raincarrying Systems".

1.4 SUBMITTALS

A. Product Data: Manufacturer's catalog data, detail sheets, and specifications.

B. Shop Drawings: Prepared specifically for this project; showing dimensions of metal gutters and accessories, fastening details and connections and interface with other products.

C. Selection Samples: For each finish product specified, two complete sets of color chips representing manufacturer's full range of available colors and patterns.

D. Verification Samples: For each finish product specified, two samples, minimum size 6 inches (150 mm) square, representing actual product, color, and patterns.

E. Manufacturer's Certificates: Certify products meet or exceed specified requirements.

F. Manufacturers warranties.

1.5 QUALITY ASSURANCE

A. Manufacturer Qualifications:

B. Installer Qualifications: Certified and approved installer of the sheet metal roofing manufacturer.

C. Perform Work in accordance with SMACNA Manual

1.6 DELIVERY, STORAGE, AND HANDLING

A. Store products in manufacturer's unopened packaging until ready for installation.

B. Store products to prevent twisting, bending, and abrasion, and to provide ventilation. Slope stored materials to drain.

C. During storage prevent contact with materials capable of causing discoloration, staining, or other damage.

1.7 PROJECT CONDITIONS

A. Coordinate installation with installation of adjacent roofing, siding and related materials.

1.8 WARRANTY

A. Provide the Manufacturer's Limited 20-Year, pro-rated and non-transferable Warranty covering labor materials.

1.9 COORDINATION

A. Coordinate Work with other operations and installation of floor finish materials to avoid damage to installed underlayment and membrane materials.

PART 2 PRODUCTS

2.1 MANUFACTURERS

A. Basis of Design: Mazmet Metal Products, which is located at: 1050 Bristol Road; Mountainside, NJ 07092; Phone: 908.654.7686; Fax: Fax: 908.654.7898;

B. Substitutions: Approved equal.

2.2 COMPONENTS

A. Gutters: Aluminum sheet, ASTM B 209, Alloy 3105-H24. Minimum tensile strength 26,000 psi, minimum yield strength 25,000 psi or equivalent. Continuous and seamless sheet aluminum, roll formed.
   1. Thickness:
      a. 0.063 inch

B. Downspouts: Aluminum sheet, ASTM B 209, Alloy 3105-H24. Minimum tensile strength 26,000 psi, minimum yield strength 25,000 psi or equivalent.
   1. Thickness:
      a. 0.063 inch
   2. Size:
      a. Match Existing : 4 inches by 4 inches (min.).

C. Endcaps: Aluminum sheet, ASTM B 209, Alloy 3105-H24, thickness 0.063 inch

D. Inside and Outside Mitres: Aluminum sheet, ASTM B 209, Alloy 3105-H24, thickness 0.063inch

E. Gutter Hangers and Anchors: Aluminum sheet, ASTM B 209, Alloy 3105-H24, thickness 0.063 inch. Provide types required to suit project requirements.

F. Downspout Anchors: Aluminum. Provide types required to suit project requirements.

G. Elbows: Aluminum sheet, ASTM B 209, Alloy 3105-H24. Minimum tensile strength 26,000

psi, minimum yield strength 25,000 psi or equivalent.

1. Thickness:
   a. 0.063 inch
2. Size: To match downspouts.

H. Aluminum Finish: Kynar 500 system factory applied in a continuous process in a single operation.

1. Color:
   a. Approved by Owner from Manufacturer's Standard Colors.

I. Sealant: As recommended by manufacturer.

J. Fasteners: Same material and finish as gutters and downspouts.

2.3 FABRICATION

A. Continuously form seamless gutters to the profiles and sizes specified.

B. Form downspouts of profiles and sizes specified.

C. Hem exposed edges of metal.

PART 3 EXECUTION

3.1 EXAMINATION

A. Do not begin installation until substrates have been properly prepared.

B. Verify governing dimensions at building.

C. Verify surfaces are ready to receive gutters and downspouts.

3.2 PREPARATION

A. Clean surfaces thoroughly prior to installation.

B. Clean and repair if necessary any adjoining work on which this work is in any way dependent for its proper installation.

C. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

3.3 INSTALLATION

A. Install in accordance with manufacturer's instructions.

B. Install gutters using appropriate hangers to allow normal expansion and contraction.

C. Install gutter hangers using two 1-1/4 inch (32 mm) screw shank nails and fastened into solid lumber.

D. All gutters shall be in continuous length for each elevation (run). No end laps are allowed.

E. Exercise care in placing aluminum in contact with other dissimilar metals or materials that are not compatible with aluminum.

F. Providing adequate insulation/separation where ever necessary, such as by painting or otherwise protecting when they are in contact with aluminum or when drainage from them passes over aluminum surfaces.

G. Install sealants where indicated to clean dry surfaces only without skips or voids.

3.4 PROTECTION

A. Protect installed products until completion of project.

B. Touch-up, repair or replace damaged products before Substantial Completion.

END OF SECTION

SECTION 081000

METAL DOORS AND FRAMES

PART 1 - GENERAL

1.01 DESCRIPTION

The Contractor shall provide hollow metal flush doors and frames, complete in place as required for a complete and operable facility. The hollow metal door shall be 90 minute fire-rated, including self-closing and positive latching.

1.02 QUALITY ASSURANCE

A. Qualifications of Manufacturer: Products used in the work of this section shall be produced by manufacturers regularly engaged in manufacture of similar items and with a history of successful production acceptable to the Engineer.

B. Basis of Acceptance: The manufacturer's recommended installation procedures, when approved by the Engineer, will become the basis for inspecting and accepting or rejecting actual installation procedures used on this work.

1.03 SUBMITTALS

A. Product Data: Manufacturer's descriptive literature and installation instructions.

B. Shop Drawings: Illustrations and schedule of door and frame sizes, types, materials, construction, finishing, anchoring, accessories, and preparation for installing hardware (six copies required).

C. Certificates: Manufacturer's certification that materials meet specification requirements.

1.04 PRODUCT DELIVERY, STORAGE AND HANDLING

A. Shipment: For welded type frames, provide temporary steel spreaders fastened across bottom of frames; where construction will permit concealment, leave spreaders in place after installation, otherwise remove spreaders after frames are set and anchored. Before shipping, label each frame with metal or plastic tags to show their location, size, door swing and other pertinent information.

B. Deliver material in manufacturer's original packaging with all tags and labels intact and legible.

C. Store and handle material in such manner as to avoid damage; store at site under cover on wood blocking or on suitable floors.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS

A. Hollow metal flush doors and frames shall be products of the following manufacturers or equivalent, subject to compliance with specification requirements:

1. Thermatru Door
2. Overly Manufacturing Co.
3. Pioneer Fireproof Door Corp.

B. All work of this section shall be the products of a single manufacturer.

2.02 FABRICATION

Surfaces shall be smooth and free from warp or buckles. Arrises shall be straight, sharp and out of wind. Assemble joints so that the intersection will be imperceptible when finished.

2.03 HOLLOW METAL DOORS

A. Hollow metal doors shall be full flush, 1-3/4" thick, constructed of two (2) sheets of finest grade, cold rolled stretched leveled steel with not less than 18 ga. channel or "HI-HAT" stiffers placed vertically 6" o.c. Steel sheets for exterior doors shall be 16 ga. and for interior doors 18 ga. Top and bottom of door shall be reinforced horizontally with channels, full width. Both edges of door to be reinforced with channel to run full height of door. Edge joints shall be welded, ground smooth and filled with metallic filler. Welding at edges of door shall be continuous, or 1/2" long welds no more than 1-1/2" o.c. and filled. No mechanical seams such as "lock joint type" will be accepted even if spot welded and filled. Doors shall be completely sound and fire insulated with an approved filler such as fiberglass or mineral wool, completely filling all voids inside door. There shall be 1/8" in 2" bevel at lock edge or door.

B. Tops of all hollow metal doors shall have flush surfaces. In reinforcing channels of top rails are installed with legs pointed upwards, a closure channel shall be installed in an inverted position to close top. Top of door shall be watertight.

C. All doors shall be accurately mortised and reinforced for all hardware including surface mounted hardware. Reinforcement for mortise hardware shall be in accordance with the hereinafter listed "Table of Hardware Reinforced Gauges" (Section 2.04 H of this specification). Doors must be reinforced for hardware specified to be through bolted to eliminate any possibility of door compressing on tightening of through bolts. Where the door is extremely heavy, use one continuous structural channel inside hollow metal frame for hinge reinforcing. This is to be in addition to the reinforcing called for in the Table of Hardware Reinforcing Gauges.

D. Mortise hardware reinforcing shall be drilled and tapped at the shop from the hardware manufacturer's templates and surface applied hardware shall be drilled and tapped in the field. Clearance at head and jamb should be no more than 3/16". Clearance at bottom should be coordinated with threshold condition (where thresholds are required) so that stop strips are effective and that clearance above a threshold is no more than 3/16" or 3/8" above finish floor when no threshold is used.

E. After assembly, exposed surfaces of doors shall be thoroughly cleaned, all rough spots smoothed and given two (2) coats of a zinc chromate rust inhibitive primer, baked on.

F. Glazing stops on exterior doors are to be integral with the door. Removable channels for glazing shall be on the interior only and shall be fastened with stainless steel Phillips head sheet metal or machine screws. Glass and glazing furnished under that Section.

2.04 HOLLOW METAL FRAMES

A. All hollow metal door frames shall be combination buck, frame and integral trim type, formed of steel and constructed as full welded units. Frame profile jamb depth, trim and design shall be detailed job conditions as shown on the drawings. Frame, trim corners and door stops shall be mitered and continuously welded. Corner joints shall be well formed and in true alignment. All contacts between head and jambs shall be closed tight. Finished work shall be strong, rigid, neat in appearance and free from defects, warps, bulges or buckles. Steel for frames, including all components and reinforcements shall be first quality cold rolled or hot rolled pickled sheets with clean, smooth and level surfaces. All interior frames shall be a minimum of 16 gauge up to 4'0" wide. Frames over 4'0" wide for doors in pairs and multiple openings shall be 14 gauge. Exterior frames to be 14 gauge.

B. Frames shall be prepared at the factory to receive mortise type hardware where specified under "Finish Hardware" (Section 2.06 of this specification) and shall be reinforced in accordance with the hereinafter listed "Table of Hardware Reinforcing Gauges" (Section 2.04 H of these Specifications). Twenty-four (24) gauge galvanized steel plaster guards shall be spot welded over mortise hardware reinforcing plates.

C. Holes required for attachment of mortise hardware shall be drilled and tapped in the shop from templates furnished by the hardware manufacturer. Drilling and tapping for surface hardware shall be done in the field.

D. Anchors shall be furnished in sizes, shapes and designs suited to adjoining wall construction. Frames to 7'6" in height shall be provided with three (3) anchors per jamb, over 7'6" in height, four (4) anchors per jamb. Generally, for new work, anchors are to be of "T" type of Underwriters yoke, type as required. Floor clips shall be welded at the bottom of each jamb and punched for floor anchoring. Jamb anchors shall not be less than 14 gauge. Each frame shall be supplied with a temporary spreader. Hollow metal frames for openings over 3'0" wide shall have head sections reinforced with two (2) each 10 gauge 1/2" x 1" angles welded to head at 4" centers the full width of frame. Frames shall be cleaned of all scale, rust and rough spots and shall be given a hot-dip phosphate treatment followed with a baked on prime coat.

E. After assembly, all tool marks and surface imperfections shall be dressed smooth be grinding, filing and sanding as necessary. All exposed surfaces both inside and outside the frame shall be thoroughly cleaned of ruse, oil and other impurities and phosphate coated to condition the surface of the metal to resist and inhibit corrosion and promote paint adhesion in accordance with Federal Specification TT-C-490.

F. All doors and their frames shall be fabricated and hung in accordance with the requirements of Underwriter Laboratories Bulletin #200, ASTM-E152, latest edition, and shall have designated time rating and shall bear required labels. So called "Label Construction" doors conforming to UL Requirements are not acceptable.

G. Labeled fire doors shall have a maximum transmitted temperature end point of not more than 450° F. above ambient at the end of 30 minutes of standard fire test exposure, (for interior stairways only).

H. Hardware Reinforcing - Minimum Hardware Reinforcing Gauges listed below. All gauges to be U. S. Standard:

1. Hinges - 1-3/4" - Frame 7 gauge - Door 7 gauge
2. Mortise Locksets and Deadlocks - Door 14 gauge, frame 14 gauge
3. Bored or Cylindrical Locks - Door 14 gauge, frame 14 gauge
4. Flush Bolts and Chain and Foot Bolts - Door 14 gauge, frame 14 gauge
5. Surface Applied Closers - Door 12 gauge, frame 12 gauge
6. Hold-Open Arms - Door 12 gauge, frame 12 gauge
7. Push and Pull Plates & Bars - Door 16 gauge except when thru bolts are used
8. Surface Panic Devices - Door 14 gauge, frame 14 gauge
9. Floor Checking Hinges - Door 7 gauge, frame 7 gauge

2.05 FACTORY FINISH

A. Thoroughly clean all surfaces. Sand free of all imperfections.

B. Prime all hollow metal doors with rust inhibiting paint, baked on. Primer to be compatible with finish coating.

C. Give exposed surfaces of doors a sufficient number of filler coats baked-on and sanded to provide a flush even surface without voids, pits or construction marks.

2.06 HARDWARE SCHEDULE

A. All Doors - The following is the minimum hardware required per door.

1. 4 1/2" X 4 1/2" Stainless Steel Butt Hinges with non-removable pins and ball bearings (3 hinges per door).
2. Heavy Duty Cylindrical Locksets. Provide a minimum of five keys per lock. Contractor must use a construction lock set during construction.
3. Kickplates - brushed aluminum inside and out.
4. Door stops - brush aluminum.
5. Door closer with hold open arm.
6. Panic devices on all exit doors from building.
7. Wall bumpers.

8. Thresholds caulked with approved mastic.

B. Key Schedule: The keying schedule shall be coordinated with the owner.

END OF SECTION 081000

SECTION 081100
STEEL SECTIONAL OVERHEAD GARAGE DOOR

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions apply to this Section.

1.2 SUMMARY

A. This section includes sectional overhead doors, as follows:

1. Steel frame and steel panels.
2. Manual chain operated door openers.
3. Electric Operated door openers.

1.3 SUBMITTALS

A. General: Submit the following according to Conditions of the Contract.

B. Product data, roughing-in diagrams, and installation instructions for each type and size of overhead door. Include manufacturer's operating instructions and maintenance data.

C. Shop drawings for special components and installations which are not fully dimensioned or detailed in manufacturer's data.

1.4 QUALITY ASSURANCE

A. Manufacturer Qualifications: Provide each sectional overhead door as a complete unit produced by a single manufacturer, including frames, sections, brackets, guides, tracks, counterbalance mechanisms, hardware, operators, and installation accessories.

B. Inserts and Anchorages: Furnish inserts and anchoring devices that must be set in concrete or built into masonry for unit installation. Provide setting drawings, templates, and directions for installation of anchorage devices. Coordinate delivery with other work to avoid delay.

C. See concrete and masonry Sections for instruction on installing inserts and anchorage devices.

2.1 ACCEPTABLE MANUFACTURERS

A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated in the Work include, but are not limited to, the following:
1. C.H.I. Overhead Doors
2. Clopay Overhead Door Co.
3. Raynor Garage Door Co.
4. Wayne/Dalton Corp.

5. Overhead Door Corp.
6. Raynor Garage Door Co.
7. Atlas Roll-Lite Overhead Doors.
8. Or Equal

B. Overhead door shall be Model 3285 as manufactured by C.H.I. Overhead Doors, or equal.

2.2 STEEL SECTIONS

A. Construct door sections from galvanized, structural-quality carbon steel sheets complying with ASTM A 446 (ASTM A 446M), Grade A, or ASTM A 526 (ASTM A 526M), with a minimum yield strength of 33,000 psi (225 Mpa), and a minimum G40 (Z180) zinc coating complying with ASTM A 525 (ASTM A 525M).

1. Interior Steel Sheet Thickness: 27 gauge
2. Exterior Steel Sheet Thickness: 26 gauge
3. Exterior Section Face: Wood grain textured

B. Fabricate sections from a single sheet to provide units not more than 24 inches (600 mm) high, and nominally 2 inches (50 mm) deep. Roll horizontal meeting edges to a continuous shiplap, rabbeted, or keyed weather seal, with a reinforcing flange return.

C. Enclose open section with 0.06-inch (1.5-mm) galvanized steel channel, end stiles welded in place. Provide intermediate stiles, cut to door section profile, spaced at not more than 48 inches (1200 mm) o.c. and welded in place.

D. Reinforce bottom section with a continuous channel or angel conforming to bottom section profile.

E. Reinforce sections with continuous horizontal and diagonal reinforcing, as required by door width and design wind loading. Provide galvanized steel bars, struts, trusses or strip steel, formed to depth, and bolted or welded in place.

F. Insulate inner core of steel sections with manufacturer's standard glass-fiber, polystyrene, or polyurethane-foam type insulation. Average R-Value of 8.72.

1. Enclose insulation with manufacturer's standard steel sheet secured to door panel.

G. Finish door sections as follows:

1. Apply manufacturer's standard prime and finish coats, applied to interior and exterior door faces. The finish color shall be selected by the owner from standard color samples.

2.3 TRACKS, SUPPORTS, AND ACCESSORIES

A. Tracks: Provide manufacturer's standard, galvanized-steel track system, sized for door size and weight, and designed for clearances shown. Track size shall be 3 inches wide minimum. Provide complete track assembly including brackets, bracing and reinforcing for rigid support of ball-bearing roller guides for required door type and size. Slot vertical

sections of track at 2 inches (50 mm) o.c. for door-drop safety device. Slope tracks at proper angle from vertical, or otherwise design to ensure tight closure at jambs when door unit is closed. Weld or bolt to track supports.

B. Track Reinforcement and Supports: Provide galvanized-steel track reinforcement and support members. Secure, reinforce and support tracks as required for size and weight of door to provide strength and rigidity without sag, sway, and vibration during opening and closing of doors.

C. Support and attach tracks to opening jambs with continuous angle welded to tracks and attached to wall. Support horizontal (ceiling tracks) with continuous angle welded to track and supported by laterally braced attachments to overhead structural members at curve and end of tracks.

D. Weather Seals: Provide continuous rubber, neoprene, or flexible vinyl adjustable weather-strip gasket at tops and compressible astragal on bottoms of each overhead door.

1. In addition, provide continuous flexible seals at door jamb edges for a fully weathertight installation.

E. Vision Panels: Provide vision panels in arrangement shown. Set glass in rubber or neoprene channel glazing compound for wood doors, as required. Provide removable stops of same material at door section frames.

F. Exhaust Outlets: Provide exhaust pipe outlets through doors as shown on elevation plans.

2.4 HARDWARE

A. General: Provide heavy-duty, rust-resistant hardware, with galvanized or cadium-plated or stainless steel fasteners, to suit type of door.

B. Hinges: Provide heavy steel hinges at each end stile and at each intermediate stile, per manufacturer's recommendations for size of door. Attach hinges to door section through stiles and rails with bolts and lock nuts or lock washers and nuts. Use rivets or self-tapping fasteners where access to nuts is not possible. Provide double-end hinges, where required, for doors exceeding 16 feet (4.87 m) in width, unless otherwise recommended by door manufacturer.

C. Rollers: Provide heavy-duty rollers, with steel ball bearings in case-hardened steel races, mounted with varying projections to suit slope of track. Extend roller shaft through both hinges where double hinges are required. Provide roller tires to suit size of track [3-inch (75-mm) diameter for 3-inch (75-mm) track]; and as follows:

1. Case-hardened steel tires for normal installations.
2. Neoprene or bronze tires for hazardous atmospheres.

D. Pull Handles, Locks and Latches: For manually operated doors, furnish lifting handles, locks and locking device as follows:

1. Lifting Handles: Galvanized steel.
2. Locking Bars: Single side, operable from inside and outside.

E. Fabricate locking device assembly with mortise lock, spring-loaded dead bolt, chromium-plated operating handle, cam plate, and adjustable locking bar to engage through slots in tracks.

2.5 COUNTERBALANCING MECHANISM

A. Extension Spring: Operation by extension-spring counterbalance mechanism with aircraft-type steel cable over ball-bearing sheaves. Provide oil-tempered, wired springs with interal safety rods. Combine operation with a spring bumper in each horizontal track to cushion door at end of opening operation.

B. Torsion Spring: Operation by torsion-spring counterbalance mechanism, consisting of adjustable-tension, tempered-steel torsion springs mounted a cross header tube or steel shaft. Connect to door with galvanized aircraft-type lift cables. Provide springs calibrated for 10,000 cycles minimum.

C. Provide cast-aluminum or grey-iron casting cable drums, grooved to receive cable. Mount counterbalance mechanism with manufacturer's standard ball-bearing brackets at each end of shaft. Provide one additional midpoint bracket for shafts up to 16 feet (4.87 m) long and two additional (4.87 m) long, unless closer spacing recommended by door manufacturer.

D. Include a spring-loaded, steel or bronze cam mounted to bottom door roller assembly on each side, designed to automatically stop door if either cable breaks.

E. Provide a spring bumper at each horizontal track to cushion door at end of opening operation.

2.6 DOOR OPERATION

A. Provide electric operated door opening operators. Provide ZAP Model 8800 motor controller, or equal, for all garage doors. The system shall be provided with case mounted open, stop, & close buttons, full system safety control, adjustable auto-close timer, & sockets for optional remote control receiver. Electrical contractor shall provide all wiring in accordance with manufacturer's requirements.

PART 3 - EXECUTION

3.1 INSTALLATION

A. General: Install door, track, and operating equipment complete with necessary hardware, jamb and head mold stops, anchors, inserts, hangers, and equipment supports according to shop drawings, manufacturer's instructions, and as specified.

B. Fasten vertical track assembly to framing at not less than 24 inches (600 mm) o.c. Hang horizontal track from structural overhead framing with angle or channel hangers, welded and bolt-fastened in place. Provide sway bracing, diagonal bracing, and reinforcing as required for rigid installation of track and door-operating equipment.

C. After completing installation, including work by other trades, lubricate, test, and adjust doors to operate easily, free from warp, twist, or distortion and fitting weathertight for entire perimeter.

END OF SECTION

SECTION 099123 - INTERIOR PAINTING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section includes surface preparation and the application of paint systems on the following interior substrates:

1. Concrete.
2. Clay masonry.
3. Concrete masonry units (CMU).
4. Steel.
5. Cast iron.
6. Galvanized metal.
7. Aluminum (not anodized or otherwise coated).
8. Wood.
9. Gypsum board.
10. Plaster.
11. Spray-textured ceilings.
12. Cotton or canvas insulation covering.
13. ASJ insulation covering.

B. Related Requirements:

1. Section 051200 "Structural Steel Framing" for shop priming of metal substrates with primers specified in this section.

1.3 ACTION SUBMITTALS

A. Product Data: For each type of product. Include preparation requirements and application instructions.

1. Indicate VOC content.

B. Sustainable Design Submittals:

1. Product Data for LEED 2009 Credit EQ 4.2: For paints and coatings, showing printed statement of VOC content.
2. Laboratory Test Reports: For paints and coatings, indicating compliance with LEED 2009 Credit EQ 4.2 requirements for low-emitting materials.

C. Samples for Initial Selection: For each type of topcoat product.

D. Samples for Verification: For each type of paint system and in each color and gloss of topcoat.

1. Submit Samples on rigid backing, 8 inches (200 mm) square.
2. Label each coat of each Sample.
3. Label each Sample for location and application area.

E. Product List: For each product indicated, include the following:

1. Cross-reference to paint system and locations of application areas. Use same designations indicated on Drawings and in schedules.
2. Indicate VOC content.

1.4 CLOSEOUT SUBMITTALS

1. Coating Maintenance Manual: Provide coating maintenance manual including area summary with finish schedule, area detail designating location where each product/color/finish was used, product data pages, material safety data sheets, care and cleaning instructions, touch-up procedures, and color samples of each color and finish used.

1.5 MAINTENANCE MATERIAL SUBMITTALS

A. Furnish extra materials from the same manufacturer that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1.6 QUALITY ASSURANCE

A. Mockups: Apply mockups of each paint system indicated and each color and finish selected to verify preliminary selections made under Sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.

1. Owner's Representative will select one surface to represent surfaces and conditions for application of each paint system specified in Part 3.

a. Vertical and Horizontal Surfaces: Provide samples of at least 100 sq. ft. (9 sq. m).
b. Other Items: Owner's Representative will designate items or areas required.

2. Final approval of color selections will be based on mockups.

a. If preliminary color selections are not approved, apply additional mockups of additional colors selected by Owner's Representative at no added cost to Owner.

3. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless Owner's Representative specifically approves such deviations in writing.

4. Subject to compliance with requirements, approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

1.7 DELIVERY, STORAGE, AND HANDLING

A. Delivery and Handling: Deliver products to Project site in an undamaged condition in manufacturer's original sealed containers, complete with labels and instructions for handling, storing, unpacking, protecting, and installing. Packaging shall bear the manufacturer's label with the following information:

1. Product name and type (description).
2. Batch date.
3. Color number.
4. VOC content.
5. Environmental handling requirements.
6. Surface preparation requirements.
7. Application instructions.

B. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F.

1. Maintain containers in clean condition, free of foreign materials and residue.
2. Remove rags and waste from storage areas daily.

1.8 FIELD CONDITIONS

A. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F.

B. Do not apply paints when relative humidity exceeds 85 percent; at temperatures less than 5 deg F above the dew point; or to damp or wet surfaces.

C. Lead Paint: It is not expected that lead paint will be encountered in the Work.

1. If suspected lead paint is encountered, do not disturb; immediately notify Engineer and Owner.

D. Lead Paint: Lead paint may be present in buildings and structures to be painted. A report on the presence of lead paint is on file for review and use. Examine report to become aware of locations where lead paint is present.

1. Do not disturb lead paint or items suspected of containing hazardous materials except under procedures specified.
2. Perform preparation for painting of substrates known to include lead paint in accordance with EPA Renovation, Repair and Painting Rule and additional requirements of authorities having jurisdiction.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Basis-of-Design Product: Subject to compliance with requirements, provide products indicated or comparable product from one of the following:

1. Sherwin Williams Company

2. Benjamin Moore & Co.

3. Pratt & Lambert, Inc.

B. Comparable Products: Comparable products of approved manufacturers will be considered in accordance with Section 016000 "Product Requirements," and the following:

1. Products are approved by manufacturer in writing for application specified.
2. Products meet performance and physical characteristics of basis of design product including published ratio of solids by volume, plus or minus two percent.

C. Source Limitations: Obtain paint materials from single source from single listed manufacturer.

1. Manufacturer's designations listed on a separate color schedule are for color reference only and do not indicate prior approval.

2.2 PAINT, GENERAL

A. Material Compatibility:

1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.

B. VOC Content: For field applications that are inside the weatherproofing system, paints and coatings shall provide materials that comply with VOC limits of authorities having jurisdiction and for interior paints and coatings applied at Project site, the following VOC limits exclusive of colorants added to a tint base, when calculated according to 40 CFR 59, Subpart D (EPA Method 24):

1. Flat Paints and Coatings: 50 g/L.
2. Nonflat Paints and Coatings: 150 g/L.
3. Primers, Sealers, and Undercoaters: 200 g/L.
4. Anticorrosive and Antirust Paints Applied to Ferrous Metals: 250 g/L.
5. Floor Coatings: 100 g/L.
6. Shellacs, Clear: 730 g/L.
7. Shellacs, Pigmented: 550 g/L.

C. Low-Emitting Materials: Interior paints and coatings shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small Scale Environmental Chambers."

D. Colors: **As selected by Owner's Representative from manufacturer's full range**

2.3 SOURCE QUALITY CONTROL

A. Testing of Paint Materials: Owner reserves the right to invoke the following procedure:

1. Owner will engage the services of a qualified testing agency to sample paint materials. Contractor will be notified in advance and may be present when samples are taken. If paint materials have already been delivered to Project site, samples may be taken at Project site. Samples will be identified, sealed, and certified by testing agency.
2. Testing agency will perform tests for compliance with product requirements.
3. Owner may direct Contractor to stop applying coatings if test results show materials being used do not comply with product requirements. Contractor shall remove noncomplying paint materials from Project site, pay for testing, and repaint surfaces painted with rejected materials. Contractor will be required to remove rejected materials from previously painted surfaces if, on repainting with complying materials, the two paints are incompatible.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers. Where acceptability of substrate conditions is in question, apply samples and perform in-situ testing to verify compatibility, adhesion, and film integrity of new paint application.

1. Report, in writing, conditions that may affect application, appearance, or performance of paint.

B. Substrate Conditions:

1. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:

a. Concrete: 12 percent.
b. Masonry (Clay and CMU): 12 percent.
c. Wood: 15 percent.
d. Gypsum Board: 12 percent.
e. Plaster: 12 percent.

2. Gypsum Board Substrates: Verify that finishing compound is sanded smooth.
3. Plaster Substrates: Verify that plaster is fully cured.

4. Spray-Textured Ceiling Substrates: Verify that surfaces are dry.

C. Proceed with coating application only after unsatisfactory conditions have been corrected; application of coating indicates acceptance of surfaces and conditions.

3.2 PREPARATION

A. Comply with manufacturer's written instructions and recommendations in "MPI Manual" applicable to substrates indicated.

B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.

1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.

C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.

1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.

D. Concrete Substrates: Remove release agents, curing compounds, efflorescence, and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces to be painted exceeds that permitted in manufacturer's written instructions.

1. Concrete Floors: Remove oil, dust, grease, dirt, and other foreign materials. Comply with SSPC-SP-13/NACE 6 or ICRI 03732.

E. Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces or mortar joints exceed that permitted in manufacturer's written instructions.

F. Steel Substrates: Remove rust, loose mill scale, and shop primer, if any. Clean using methods recommended in writing by paint manufacturer but not less than the following:

1. SSPC-SP 2, "Hand Tool Cleaning."
2. SSPC-SP 3, "Power Tool Cleaning."
3. SSPC-SP 7/NACE No. 4, "Brush-off Blast Cleaning."
4. SSPC-SP 11, "Power Tool Cleaning to Bare Metal."

G. Shop-Primed Steel Substrates: Clean field welds, bolted connections, and abraded areas of shop paint, and paint exposed areas with the same material as used for shop priming to comply with SSPC-PA 1 for touching up shop-primed surfaces.

H. Galvanized-Metal Substrates: Remove grease and oil residue from galvanized sheet metal fabricated from coil stock by mechanical methods to produce clean, lightly etched surfaces that promote adhesion of subsequently applied paints.

I. Aluminum Substrates: Remove loose surface oxidation.

J. Wood Substrates:

1. Scrape and clean knots, and apply coat of knot sealer before applying primer.
2. Sand surfaces that will be exposed to view, and dust off.
3. Prime edges, ends, faces, undersides, and backsides of wood.
4. After priming, fill holes and imperfections in the finish surfaces with putty or plastic wood filler. Sand smooth when dried.

K. Cotton or Canvas Insulation Covering Substrates: Remove dust, dirt, and other foreign material that might impair bond of paints to substrates.

3.3 APPLICATION

A. Apply paints according to manufacturer's written instructions and to recommendations in "MPI Manual."

1. Use applicators and techniques suited for paint and substrate indicated.
2. Paint surfaces behind movable equipment and furniture same as similar exposed surfaces. Before final installation, paint surfaces behind permanently fixed equipment or furniture with prime coat only.
3. Paint front and backsides of access panels, removable or hinged covers, and similar hinged items to match exposed surfaces.
4. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
5. Primers specified in painting schedules may be omitted on items that are factory primed or factory finished if acceptable to topcoat manufacturers.

B. Tint each undercoat a lighter shade to facilitate identification of each coat if multiple coats of same material are to be applied. Tint undercoats to match color of topcoat, but provide sufficient difference in shade of undercoats to distinguish each separate coat.

C. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.

D. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.

3.4 FIELD QUALITY CONTROL

A. Dry Film Thickness Testing: Owner may engage the services of a qualified testing and inspecting agency to inspect and test paint for dry film thickness.

1. Contractor shall touch up and restore painted surfaces damaged by testing.
2. If test results show that dry film thickness of applied paint does not comply with paint manufacturer's written recommendations, Contractor shall pay for testing and apply additional coats as needed to provide dry film thickness that complies with paint manufacturer's written recommendations.

3.5 CLEANING AND PROTECTION

A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.

B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.

C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Owner's Representative, and leave in an undamaged condition.

D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.6 INTERIOR PAINTING SCHEDULE

A. Concrete Substrates, Nontraffic Surfaces and Clay Masonry:

1. Latex System:

a. Prime Coat: Primer, latex, interior.

1) S-W Loxon Concrete & Masonry Primer Sealer, A24W8300, or equal, at 8.0 mils (0.203 mm) wet, 3.2 mils (0.081 mm) dry.

b. Intermediate Coat: Latex, interior, matching topcoat.

c. Topcoat: Latex, interior, flat.

1) S-W ProMar 200 Zero VOC Latex Flat, B30-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

d. Topcoat: Latex, interior, low sheen.

1) S-W ProMar 200 Zero VOC Latex Low Sheen Eg-Shel, B24-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

e. Topcoat: Latex, interior, eggshell.

1) S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.7 mils (0.043 mm) dry, per coat .

f. Topcoat: Latex, interior, semi-gloss.

1) S-W ProMar 200 Zero VOC Latex Semi-Gloss, B31-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat .

g. Topcoat: Latex, interior, gloss.

1) S-W ProMar 200 Zero VOC Gloss, B21-12650 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry, per coat.

2. Water-Based Light Industrial Coating System:

a. Prime Coat: Primer sealer, latex, interior:

1) S-W Loxon Concrete & Masonry Primer Sealer, A24W8300, or equal, at 8.0 mils (0.203 mm) wet, 3.2 mils (0.081 mm) dry.

b. Intermediate Coat: Light industrial coating, interior, water based, matching topcoat.

c. Topcoat: Light industrial coating, interior, water based, eggshell:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K45-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

d. Topcoat: Light industrial coating, interior, water based, semi-gloss:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K46-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

B. Concrete Substrates, Pedestrian Traffic Surfaces:

1. Latex Floor Enamel System:

a. First Coat: Floor paint, latex, slip-resistant, matching topcoat.
b. Topcoat: Floor paint, latex, slip-resistant, low gloss: S-W ArmorSeal Tread-Plex, B90 Series, or equal, at 1.5 to 2.0 mils (0.038 to 0.051 mm) dry per coat.

2. Clear Acrylic System, Gloss Finish:

a. First Coat:

1) S-W H&C Clarishield Water-Based Wet-Look Concrete Sealer, or equal, at 100 to 200 sq. ft. per gal. (2.45 to 4.91 sq. m per liter).

b. Second Coat:

1) S-W H&C Clarishield Water-Based Wet-Look Concrete Sealer, or equal, at 100 to 200 sq. ft. per gal. (2.45 to 4.91 sq. m per liter).

3. Concrete Stain System (Water-based):

a. First Coat: Low-luster opaque finish:

1) S-W H&C Colortop Water-Based Solid Color Concrete Stain, or equal, at 50 to 300 sq. ft. per gal. (1.23 to 7.36 sq. m per liter).

b. Second Coat: Low-luster opaque finish:

1) S-W H&C Colortop Water-Based Solid Color Concrete Stain, or equal, at 50 to 300 sq. ft. per gal. (1.23 to 7.36 sq. m per liter).

C. CMU Substrates:

1. Latex System:

a. Block Filler: Block filler, latex, interior/exterior:

1) S-W PrepRite Block Filler, B25W25, or equal at 75-125 sq. ft. per gal. (1.84 to 3.07 sq. m per liter).

b. Intermediate Coat: Latex, interior, matching topcoat.

c. Topcoat: Latex, interior, flat:

1) S-W ProMar 200 Zero VOC Latex Flat, B30-2600 Series, or equal at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

d. Topcoat: Latex, interior, low sheen:

1) S-W ProMar 200 Zero VOC Latex Low Sheen Enamel, B24-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

e. Topcoat: Latex, interior, eggshell:

1) S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series, or equal at 4.0 mils (0.102 mm) wet, 1.7 mils (0.043 mm) dry, per coat.

f. Topcoat: Latex, interior, semi-gloss:

1) S-W ProMar 200 Zero VOC Latex Semi-Gloss, B31-2600 Series, or equal at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

g. Topcoat: Latex, interior, gloss:

1) S-W ProMar 200 Zero VOC Gloss, B21-12650 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

2. Water-Based Light Industrial Coating System:

a. Block Filler: Block filler, latex, interior/exterior:

1) S-W PrepRite Block Filler, B25W25, or equal at 75-125 sq. ft. per gal. (1.84 to 3.07 sq. m per liter).

b. Intermediate Coat: Light industrial coating, interior, water based, matching topcoat.

c. Topcoat: Light industrial coating, interior, water based, eggshell:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K45-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

d. Topcoat: Light industrial coating, interior, water based, semi-gloss:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K46-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

3. Concrete Stain System (Water-based):

a. First Coat:

1) S-W H&C Colortop Water-Based Solid Color Concrete Stain, or equal at 50 to 300 sq. ft. per gal. (1.23 to 7.36 sq. m per liter).

b. Second Coat:

1) S-W H&C Colortop Water-Based Solid Color Concrete Stain, or equal at 50 to 300 sq. ft. per gal. (1.23 to 7.36 sq. m per liter).

D. Metal Substrates (Aluminum, Steel, Galvanized Steel):

1. Latex System:

a. Prime Coat: Primer, rust-inhibitive, water based:

1) S-W Pro Industrial Pro-Cryl Universal Primer, B66-310 Series, or equal at 5.0 to 10 mils (0.127 to 0.254 mm) wet, 2.0 to 4.0 mils (0.051 to 0.102 mm) dry.

b. Intermediate Coat: Water-based acrylic, interior, matching topcoat.

c. Topcoat: Water-based acrylic, semi-gloss:

1) S-W Pro Industrial Acrylic Semi-Gloss Coating, B66-650 Series, or equal at 2.5 to 4.0 mils (0.064 to 0.102 mm) dry, per coat.

d. Topcoat: Water-based acrylic, gloss:

1) S-W Pro Industrial Acrylic Gloss Coating, B66-660 Series, or equal at 2.5 to 4.0 mils (0.064 to 0.102 mm) dry, per coat.

2. Water-Based Dry-Fall System:

a. Top Coat: Dry-fall latex, flat:

1) S-W Pro Industrial Waterborne Acrylic Dryfall Flat, B42-181 Series, or equal at 6.0 mils (0.152 mm) wet, 1.5 mils (0.038 mm) dry.

b. Top Coat: Dry-fall latex, eggshell:

1) S-W Pro Industrial Waterborne Acrylic DryFall Eg-Shel, B42-82, or equal at 6.0 mils (0.152 mm) wet, 1.9 mils (0.048 mm) dry.

c. Top Coat: Dry-fall latex, semi-gloss:

1) S-W Pro Industrial Waterborne Acrylic DryFall Semi-Gloss, B42-83, or equal at 5.8 mils (0.147 mm) wet, 2.3 mils (0.058 mm) dry.

3. Water-Based Light Industrial Coating System:

a. Prime Coat: Primer, rust-inhibitive, water based:

1) S-W Pro Industrial Pro-Cryl Universal Primer, B66-310 Series, or equal at 5.0 to 10 mils (0.127 to 0.254 mm) wet, 2.0 to 4.0 mils (0.051 to 0.102 mm) dry.

b. Intermediate Coat: Light industrial coating, interior, water based, matching topcoat.

c. Topcoat: Light industrial coating, interior, water based, eggshell:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K45-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

d. Topcoat: Light industrial coating, interior, water based, semi-gloss:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K46-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

4. Waterbased/Alkyd Urethane System:

a. Prime Coat:

1) S-W Pro Industrial Pro-Cryl Universal Primer, B66-310 Series, or equal at 5.0 to 10 mils (0.127 to 0.254 mm) wet, 2.0 to 4.0 mils (0.051 to 0.102 mm) dry.

b. Intermediate Coat: Water-based acrylic-alkyd, interior, matching topcoat.

c. Topcoat: Water-based alkyd-urethane, semi-gloss, interior:

1) S-W Pro Industrial Waterbased Alkyd Urethane Semi-Gloss, B53-1150 Series, or equal at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry, per coat.

d. Topcoat: Water-based alkyd-urethane, gloss, interior:

1) S-W Pro Industrial Waterbased Alkyd Urethane Gloss, B53-1050 Series, or equal at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry, per coat.

E. Wood Substrates: Including exposed wood items not indicated to receive shop-applied finish.

1. Latex System:

a. Prime Coat: Primer sealer, latex, interior:

1) S-W PrepRite ProBlock Primer Sealer, B51-620 Series, or equal at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry.

b. Intermediate Coat: Latex, interior, matching topcoat.

c. Topcoat: Latex, interior, eggshell:

1) S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series, or equal at 4.0 mils (0.102 mm) wet, 1.7 mils (0.043 mm) dry, per coat.

d. Topcoat: Latex, interior, semi-gloss:

1) S-W ProMar 200 Zero VOC Latex Semi-Gloss, B31-2600 Series, or equal at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

e. Topcoat: Latex, interior, gloss:

1) S-W ProMar 200 Zero VOC Gloss, B21-12650 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

2. Waterbased/Alkyd Urethane System:

a. Prime Coat: Primer sealer, latex, interior:

1) S-W Premium Wall & Wood Primer, B28W8111, or equal at 4.0 mils (0.102 mm) wet, 1.8 mils (0.046 mm) dry.

b. Intermediate Coat: Water-based alkyd-urethane, interior, matching topcoat.

c. Topcoat: Water-based alkyd-urethane, semi-gloss, interior:

1) S-W Pro Industrial Waterbased Alkyd Urethane Semi-Gloss, B53-1150 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry, per coat.

d. Topcoat: Water-based alkyd-urethane, gloss, interior:

1) S-W Pro Industrial Waterbased Alkyd Urethane Gloss, B53-1050 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry, per coat.

3. Water-Based Light Industrial Coating System:

a. Prime Coat: Primer sealer, latex, interior:

1) S-W PrepRite ProBlock Primer Sealer, B51-620 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.4 mils (0.036 mm) dry.

b. Intermediate Coat: Light industrial coating, interior, water based, matching topcoat.

c. Topcoat: Light industrial coating, interior, water based, eggshell:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K45-151 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

d. Topcoat: Light industrial coating, interior, water based, semi-gloss:

1) S-W Pro Industrial Pre-Catalyzed Water Based Epoxy, K46-151 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

F. Wood Substrates, Pedestrian Traffic Surfaces:

1. Latex Floor Enamel System:

a. First Coat: Floor paint, latex, slip-resistant, matching topcoat.

b. Topcoat: Floor paint, latex, slip-resistant, low gloss:

1) S-W ArmorSeal Tread-Plex, B90 Series, or equal at 1.5 to 2.0 mils (0.038 to 0.051 mm) dry per coat.

G. **Gypsum Board and Spray-Texture Ceiling** Substrates:

1. Latex System:

a. Prime Coat: Primer, latex, interior:

1) S-W ProMar 200 Zero VOC Latex Primer, B28W2600, or equal at 4.0 mils (0.102 mm) wet, 1.0 mils (0.025 mm) dry.

b. Intermediate Coat: Latex, interior, matching topcoat.

c. Topcoat: Latex, interior, flat:

1) S-W ProMar 200 Zero VOC Latex Flat, B30-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

d. Topcoat: Latex, interior, low sheen:

1) S-W ProMar 200 Zero VOC Latex Low Sheen Enamel, B24-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

e. Topcoat: Latex, interior, eggshell:

1) S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.7 mils (0.043 mm) dry, per coat.

f. Topcoat: Latex, interior, semi-gloss:

1) S-W ProMar 200 Zero VOC Latex Semi-Gloss, B31-2600 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.6 mils (0.041 mm) dry, per coat.

g. Topcoat: Latex, interior, gloss:

1) S-W ProMar 200 Zero VOC Gloss, B21-12650 Series, or equal, at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

2. Water-Based Light Industrial Coating System:

a. Prime Coat: Primer sealer, latex, interior:

1) S-W ProMar 200 Zero VOC Latex Primer, B28W2600, or equal, at 4.0 mils (0.102 mm) wet, 1.0 mils (0.025 mm) dry.

b. Intermediate Coat: Light industrial coating, interior, water based, matching topcoat.

c. Topcoat: Light industrial coating, interior, water based, eggshell:

1) S-W Pro Industrial Pre-Catalyzed Waterbased Epoxy, K45-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

d. Topcoat: Light industrial coating, interior, water based, semi-gloss:

1) S-W Pro Industrial Pre-Catalyzed Waterbased Epoxy, K46-151 Series, or equal at 4.0 mils (0.102 mm) wet, 1.5 mils (0.038 mm) dry, per coat.

END OF SECTION 099123

SECTION 11520

FIRE EXTINGUISHERS

PART 1 - GENERAL

1.02 WORK INCLUDED

A. Furnish and install as shown on the Drawings and as herein specified multi-purpose dry chemical fire extinguishers. Locate near all exterior egrees doors.

B. Fire extinguishers shall be located and mounted as required by OSHA and/or other local or state safety and/or fire codes and in coordination with ELSA's RCO.

1.03 SUBMITTALS

A. Product Data: As specified in Section 01300

B. Operation and Maintenance Manuals: As specified in Section 01300.

C. Obtain Engineers acceptance prior to commencing work of this section.

PART 2 - PRODUCTS

2.01 MATERIALS

A. Materials shall be commercially available products of reputable manufacturers acceptable to the Engineer.

B. Materials delivered to the job site shall bear the manufacturers name, brand, and as applicable shall be in the manufacturer's original unbroken packages.

C. Fire extinguishers shall be dry chemical, nitrogen generated, multi-purpose for class A-B-C fires, nominal ten (10) pound capacity. Supply with mounting bracket.

PART 3 - EXECUTION

3.01 WORKMANSHIP

A. Fire extinguisher brackets shall be securely mounted. Fire extinguisher shall be readily accessible and shall not block equipment or passageways.

PART 4 - QUANTITY AND PAYMENT

4.01 No specific payment shall be made for work under this section and all costs for said work shall be incorporated in various items in the bid proposal associated with this work.

END OF SECTION

SECTION 220500 - COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Piping materials and installation instructions common to most piping systems.
2. Dielectric fittings.
3. Mechanical sleeve seals.
4. Sleeves.
5. Escutcheons.
6. Grout.
7. Plumbing demolition.
8. Equipment installation requirements common to equipment sections.
9. Concrete bases.
10. Supports and anchorages.

1.2 DEFINITIONS

A. Finished Spaces: Spaces other than plumbing and electrical equipment rooms, furred spaces, pipe chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.

B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and plumbing equipment rooms.

C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.

D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and in chases.

E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.

1.3 SUBMITTALS

A. Welding certificates.

1.4 QUALITY ASSURANCE

A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."

B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."

1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.

C. Electrical Characteristics for Plumbing Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

PART 2 - PRODUCTS

2.1 PIPE, TUBE, AND FITTINGS

A. Refer to individual Division 22 piping Sections for pipe, tube, and fitting materials and joining methods.

B. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

2.2 JOINING MATERIALS

A. Refer to individual Division 22 piping Sections for special joining materials not listed below.

B. Pipe-Flange Gasket Materials: ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch (3.2-mm) maximum thickness unless thickness or specific material is indicated.

C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.

E. Brazing Filler Metals: AWS A5.8, BCuP Series or BAg1, unless otherwise indicated.

F. Welding Filler Metals: Comply with AWS D10.12.

G. Solvent Cements for Joining Plastic Piping:

1. ABS Piping: ASTM D 2235.
2. CPVC Piping: ASTM F 493.
3. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
4. PVC to ABS Piping Transition: ASTM D 3138.

2.3 DIELECTRIC FITTINGS

A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.

B. Insulating Material: Suitable for system fluid, pressure, and temperature.

C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig (1725-kPa) minimum working pressure at 180 deg F (82 deg C).

D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150- or 300-psig (1035- or 2070-kPa) minimum working pressure as required to suit system pressures.

E. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig (2070-kPa) minimum working pressure at 225 deg F (107 deg C).

F. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig (2070-kPa) minimum working pressure at 225 deg F (107 deg C).

2.4 MECHANICAL SLEEVE SEALS

A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.

B. Sealing Elements: EPDM interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.

C. Pressure Plates: Stainless steel. Include two for each sealing element.

D. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

2.5 SLEEVES

A. Galvanized-Steel Sheet: 0.0239-inch (0.6-mm) minimum thickness; round tube closed with welded longitudinal joint.

B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.

C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

D. Stack Sleeve Fittings: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring and bolts and nuts for membrane flashing.

1. Underdeck Clamp: Clamping ring with set screws.

E. Molded PVC: Permanent, with nailing flange for attaching to wooden forms.

F. PVC Pipe: ASTM D 1785, Schedule 40.

G. Molded PE: Reusable, PE, tapered-cup shaped, and smooth-outer surface with nailing flange for attaching to wooden forms.

2.6 ESCUTCHEONS

A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.

B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.

C. One-Piece, Cast-Brass Type: With set screw.

1. Finish: Polished chrome-plated

D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.

1. Finish: Polished chrome-plated

2.7 GROUT

A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.

1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
2. Design Mix: 5000-psi (34.5-MPa), 28-day compressive strength.
3. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 PLUMBING DEMOLITION

A. Refer to Division 01 Section "Cutting and Patching" and Division 02 Section "Selective Structure Demolition" for general demolition requirements and procedures.

B. Disconnect, demolish, and remove plumbing systems, equipment, and components indicated to be removed.

1. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
2. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material.
3. Equipment to Be Removed: Disconnect and cap services and remove equipment.
4. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
5. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.

C. If pipe, insulation, or equipment to remain is damaged in appearance or is unserviceable, remove damaged or unserviceable portions and replace with new products of equal capacity and quality.

3.2 PIPING SYSTEMS - COMMON REQUIREMENTS

A. Install piping according to the following requirements and Division 22 Sections specifying piping systems.

B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.

C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.

D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.

F. Install piping to permit valve servicing.

G. Install piping at indicated slopes.

H. Install piping free of sags and bends.

I. Install fittings for changes in direction and branch connections.

J. Install piping to allow application of insulation.

K. Select system components with pressure rating equal to or greater than system operating pressure.

L. Install escutcheons for penetrations of walls, ceilings, and floors.

M. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.

N. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.

1. Install steel pipe for sleeves smaller than 6 inches (150 mm) in diameter.
2. Install cast-iron "wall pipes" for sleeves 6 inches (150 mm) and larger in diameter.
3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

O. Underground, Exterior-Wall Pipe Penetrations: Install cast-iron "wall pipes" for sleeves. Seal pipe penetrations using mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.

1. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

P. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 07 Section "Penetration Firestopping" for materials.

Q. Verify final equipment locations for roughing-in.

R. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

3.3 PIPING JOINT CONSTRUCTION

A. Join pipe and fittings according to the following requirements and Division 22 Sections specifying piping systems.

B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.

D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.

E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.

F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.

G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.

H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

I. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:

1. Comply with ASTM F 402, for safe-handling practice of cleaners, primers, and solvent cements.
2. ABS Piping: Join according to ASTM D 2235 and ASTM D 2661 Appendixes.
3. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
4. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
5. PVC Nonpressure Piping: Join according to ASTM D 2855.
6. PVC to ABS Nonpressure Transition Fittings: Join according to ASTM D 3138 Appendix.

J. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.

K. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.

L. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D 2657.

1. Plain-End Pipe and Fittings: Use butt fusion.
2. Plain-End Pipe and Socket Fittings: Use socket fusion.

M. Fiberglass Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

3.4 PIPING CONNECTIONS

A. Make connections according to the following, unless otherwise indicated:

1. Install unions, in piping NPS 2 (DN 50) and smaller, adjacent to each valve and at final connection to each piece of equipment.
2. Install flanges, in piping NPS 2-1/2 (DN 65) and larger, adjacent to flanged valves and at final connection to each piece of equipment.
3. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.
4. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

3.5 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.

B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.

C. Install plumbing equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.

D. Install equipment to allow right of way for piping installed at required slope.

3.6 CONCRETE BASES

A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.

1. Construct concrete bases of dimensions indicated, but not less than 4 inches (100 mm) larger in both directions than supported unit.

2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch (450-mm) centers around the full perimeter of the base.
3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
5. Install anchor bolts to elevations required for proper attachment to supported equipment.
6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
7. Use 3000-psi (20.7-MPa) 28-day compressive-strength concrete and reinforcement as specified in Division 03 Sections.

3.7 ERECTION OF METAL SUPPORTS AND ANCHORAGES

A. Refer to Division 05 Section "Metal Fabrications" for structural steel.

B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor plumbing materials and equipment.

C. Field Welding: Comply with AWS D1.1.

3.8 ERECTION OF WOOD SUPPORTS AND ANCHORAGES

A. Cut, fit, and place wood grounds, nailers, blocking, and anchorages to support, and anchor plumbing materials and equipment.

B. Select fastener sizes that will not penetrate members if opposite side will be exposed to view or will receive finish materials. Tighten connections between members. Install fasteners without splitting wood members.

C. Attach to substrates as required to support applied loads.

3.9 GROUTING

A. Mix and install grout for plumbing equipment base bearing surfaces, pump and other equipment base plates, and anchors.

B. Clean surfaces that will come into contact with grout.

C. Provide forms as required for placement of grout.

D. Avoid air entrapment during placement of grout.

E. Place grout, completely filling equipment bases.

F. Place grout on concrete bases and provide smooth bearing surface for equipment.

G. Place grout around anchors.

H. Cure placed grout.

END OF SECTION 220500

SECTION 220517 - SLEEVES AND SLEEVE SEALS FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Sleeves.
2. Stack-sleeve fittings.
3. Sleeve-seal systems.
4. Sleeve-seal fittings.
5. Grout.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated.

PART 2 - PRODUCTS

2.1 SLEEVES

A. Cast-Iron Wall Pipes: Cast or fabricated of cast or ductile iron and equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop unless otherwise indicated.

B. Galvanized-Steel Wall Pipes: ASTM A 53/A 53M, Schedule 40, with plain ends and welded steel collar; zinc coated.

C. Galvanized-Steel-Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, zinc coated, with plain ends.

D. PVC-Pipe Sleeves: ASTM D 1785, Schedule 40.

E. Galvanized-Steel-Sheet Sleeves: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.

F. Molded-PE or -PP Sleeves: Removable, tapered-cup shaped, and smooth outer surface with nailing flange for attaching to wooden forms.

G. Molded-PVC Sleeves: With nailing flange for attaching to wooden forms.

2.2 STACK-SLEEVE FITTINGS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Smith, Jay R. Mfg. Co.
2. Zurn Specification Drainage Operation; Zurn Plumbing Products Group.

B. Description: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring, bolts, and nuts for membrane flashing.

1. Underdeck Clamp: Clamping ring with setscrews.

2.3 SLEEVE-SEAL SYSTEMS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Advance Products & Systems, Inc.
2. CALPICO, Inc.
3. Metraflex Company (The).
4. Pipeline Seal and Insulator, Inc.
5. Proco Products, Inc.

B. Description: Modular sealing-element unit, designed for field assembly, for filling annular space between piping and sleeve.

1. Sealing Elements: EPDM-rubber interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
2. Pressure Plates: Stainless steel.
3. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements.

2.4 SLEEVE-SEAL FITTINGS

A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Presealed Systems.

B. Description: Manufactured plastic, sleeve-type, waterstop assembly made for imbedding in concrete slab or wall. Unit has plastic or rubber waterstop collar with center opening to match piping OD.

2.5 GROUT

A. Standard: ASTM C 1107/C 1107M, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.

B. Characteristics: Nonshrink; recommended for interior and exterior applications.

C. Design Mix: 5000-psi, 28-day compressive strength.

D. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 SLEEVE INSTALLATION

A. Install sleeves for piping passing through penetrations in floors, partitions, roofs, and walls.

B. For sleeves that will have sleeve-seal system installed, select sleeves of size large enough to provide 1-inch annular clear space between piping and concrete slabs and walls.

1. Sleeves are not required for core-drilled holes.

C. Install sleeves in concrete floors, concrete roof slabs, and concrete walls as new slabs and walls are constructed.

1. Permanent sleeves are not required for holes in slabs formed by molded-PE or -PP sleeves.
2. Cut sleeves to length for mounting flush with both surfaces.

a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level.

3. Using grout, seal the space outside of sleeves in slabs and walls without sleeve-seal system.

D. Install sleeves for pipes passing through interior partitions.

1. Cut sleeves to length for mounting flush with both surfaces.
2. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation.

3. Seal annular space between sleeve and piping or piping insulation; use joint sealants appropriate for size, depth, and location of joint. Comply with requirements for sealants specified in Division 07 Section "Joint Sealants."

E. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Comply with requirements for firestopping specified in Division 07 Section "Penetration Firestopping."

3.2 STACK-SLEEVE-FITTING INSTALLATION

A. Install stack-sleeve fittings in new slabs as slabs are constructed.

1. Install fittings that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation.
2. Secure flashing between clamping flanges for pipes penetrating floors with membrane waterproofing. Comply with requirements for flashing specified in Division 07 Section "Sheet Metal Flashing and Trim."
3. Install section of cast-iron soil pipe to extend sleeve to 2 inches above finished floor level.
4. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
5. Using grout, seal the space around outside of stack-sleeve fittings.

B. Fire-Barrier Penetrations: Maintain indicated fire rating of floors at pipe penetrations. Seal pipe penetrations with firestop materials. Comply with requirements for firestopping specified in Division 07 Section "Penetration Firestopping."

3.3 SLEEVE-SEAL-SYSTEM INSTALLATION

A. Install sleeve-seal systems in sleeves in exterior concrete walls and slabs-on-grade at service piping entries into building.

B. Select type, size, and number of sealing elements required for piping material and size and for sleeve ID or hole size. Position piping in center of sleeve. Center piping in penetration, assemble sleeve-seal system components, and install in annular space between piping and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make a watertight seal.

3.4 SLEEVE-SEAL-FITTING INSTALLATION

A. Install sleeve-seal fittings in new walls and slabs as they are constructed.

B. Assemble fitting components of length to be flush with both surfaces of concrete slabs and walls. Position waterstop flange to be centered in concrete slab or wall.

C. Secure nailing flanges to concrete forms.

D. Using grout, seal the space around outside of sleeve-seal fittings.

3.5 SLEEVE AND SLEEVE-SEAL SCHEDULE

A. Use sleeves and sleeve seals for the following piping-penetration applications:

1. Exterior Concrete Walls above Grade:

   a. Piping Smaller Than NPS 6. Galvanized-steel wall sleeves.
   b. Piping NPS 6 and Larger: Galvanized-steel wall sleeves

2. Exterior Concrete Walls below Grade:

   a. Piping Smaller Than NPS 6: Galvanized-steel wall sleeves with sleeve seal.

      1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.

   b. Piping NPS 6 and Larger: Galvanized-steel wall sleeves with sleeve seal.

      1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.

3. Concrete Slabs-on-Grade:

   a. Piping Smaller Than NPS 6 : Galvanized-steel wall sleeves with sleeve seal.

      1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.

   b. Piping NPS 6 and Larger: Galvanized-steel wall sleeves with sleeve seal.

      1) Select sleeve size to allow for 1-inch annular clear space between piping and sleeve for installing sleeve-seal system.

4. Concrete Slabs above Grade:

   a. Piping Smaller Than NPS 6 : Galvanized-steel-pipe sleeves.
   b. Piping NPS 6 (DN 150) and Larger: Galvanized-steel-pipe sleeves.

5. Interior Partitions:

   a. Piping Smaller Than NPS 6: Galvanized-steel-pipe sleeves.
   b. Piping NPS 6 and Larger: Galvanized-steel-sheet sleeves.

END OF SECTION 220517

SECTION 220518 - ESCUTCHEONS FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Escutcheons.
2. Floor plates.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated.

PART 2 - PRODUCTS

2.1 ESCUTCHEONS

A. One-Piece, Cast-Brass Type: With polished, chrome-plated finish and setscrew fastener.

B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with chrome-plated finish and spring-clip fasteners.

C. One-Piece, Stamped-Steel Type: With chrome-plated finish and spring-clip fasteners.

D. Split-Casting Brass Type: With polished, chrome-plated finish and with concealed hinge and setscrew.

E. Split-Plate, Stamped-Steel Type: With chrome-plated finish, concealed hinge, and spring-clip fasteners.

2.2 FLOOR PLATES

A. One-Piece Floor Plates: Cast-iron flange with holes for fasteners.

B. Split-Casting Floor Plates: Cast brass with concealed hinge.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install escutcheons for piping penetrations of walls, ceilings, and finished floors.

B. Install escutcheons with ID to closely fit around pipe, tube, and insulation of insulated piping and with OD that completely covers opening.

1. Escutcheons for New Piping:

a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.
b. Chrome-Plated Piping: One-piece, cast-brass type with polished, chrome-plated finish.
c. Insulated Piping: One-piece, stamped-steel type.
d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished, chrome-plated finish.
e. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, stamped-steel type.
f. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece, cast-brass type with polished, chrome-plated finish.
g. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece, stamped-steel type.
h. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with polished, chrome-plated finish.
i. Bare Piping in Unfinished Service Spaces: One-piece, stamped-steel type.
j. Bare Piping in Equipment Rooms: One-piece, cast-brass type with polished, chrome-plated finish.
k. Bare Piping in Equipment Rooms: One-piece, stamped-steel type.

2. Escutcheons for Existing Piping:

a. Chrome-Plated Piping: Split-casting brass type with polished, chrome-plated finish.
b. Insulated Piping: Split-plate, stamped-steel type with concealed hinge.
c. Bare Piping at Wall and Floor Penetrations in Finished Spaces: Split-casting brass type with polished, chrome-plated finish.
d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: Split-plate, stamped-steel type with concealed hinge.
e. Bare Piping at Ceiling Penetrations in Finished Spaces: Split-casting brass type with polished, chrome-plated finish.
f. Bare Piping at Ceiling Penetrations in Finished Spaces: Split-plate, stamped-steel type with concealed hinge.
g. Bare Piping in Unfinished Service Spaces: Split-casting brass type with polished, chrome-plated finish.
h. Bare Piping in Unfinished Service Spaces: Split-plate, stamped-steel type with concealed hinge.

i. Bare Piping in Equipment Rooms: Split-casting brass type with polished, chrome-plated finish.
j. Bare Piping in Equipment Rooms: Split-plate, stamped-steel type with concealed hinge.

C. Install floor plates for piping penetrations of equipment-room floors.

D. Install floor plates with ID to closely fit around pipe, tube, and insulation of piping and with OD that completely covers opening.

1. New Piping: One-piece, floor-plate type.
2. Existing Piping: Split-casting, floor-plate type.

3.2 FIELD QUALITY CONTROL

A. Replace broken and damaged escutcheons and floor plates using new materials.

END OF SECTION 220518

SECTION 220523 - GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Bronze angle valves.
2. Brass ball valves.
3. Bronze ball valves.
4. Iron ball valves.
5. Iron, single-flange butterfly valves.
6. Iron, grooved-end butterfly valves.
7. Bronze lift check valves.
8. Bronze swing check valves.
9. Iron swing check valves.
10. Iron swing check valves with closure control.
11. Iron, grooved-end swing check valves.
12. Iron, center-guided check valves.
13. Iron, plate-type check valves.
14. Bronze gate valves.
15. Iron gate valves.
16. Bronze globe valves.
17. Iron globe valves.
18. Lubricated plug valves.
19. Chainwheels.

B. Related Sections:

1. Division 22 plumbing piping Sections for specialty valves applicable to those Sections only.
2. Division 22 Section "Identification for Plumbing Piping and Equipment" for valve tags and schedules.

1.3 DEFINITIONS

A. CWP: Cold working pressure.

B. EPDM: Ethylene propylene copolymer rubber.

C. NBR: Acrylonitrile-butadiene, Buna-N, or nitrile rubber.

D. NRS: Nonrising stem.

E. OS&Y: Outside screw and yoke.

F. RS: Rising stem.

G. SWP: Steam working pressure.

1.4 SUBMITTALS

A. Product Data: For each type of valve indicated.

1.5 QUALITY ASSURANCE

A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.

B. ASME Compliance:

1. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
2. ASME B31.1 for power piping valves.
3. ASME B31.9 for building services piping valves.

C. NSF Compliance: NSF 61 for valve materials for potable-water service.

1.6 DELIVERY, STORAGE, AND HANDLING

A. Prepare valves for shipping as follows:

1. Protect internal parts against rust and corrosion.
2. Protect threads, flange faces, grooves, and weld ends.
3. Set angle, gate, and globe valves closed to prevent rattling.
4. Set ball and plug valves open to minimize exposure of functional surfaces.
5. Set butterfly valves closed or slightly open.
6. Block check valves in either closed or open position.

B. Use the following precautions during storage:

1. Maintain valve end protection.

2. Store valves indoors and maintain at higher than ambient dew point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.

C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS FOR VALVES

A. Refer to valve schedule articles for applications of valves.

B. Valve Pressure and Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.

C. Valve Sizes: Same as upstream piping unless otherwise indicated.

D. Valve Actuator Types:

1. Gear Actuator: For quarter-turn valves NPS 8 and larger.
2. Handwheel: For valves other than quarter-turn types.
3. Handlever: For quarter-turn valves NPS 6 and smaller.
4. Chainwheel: Device for attachment to valve handwheel, stem, or other actuator; of size and with chain for mounting height, as indicated in the "Valve Installation" Article.

E. Valves in Insulated Piping: With 2-inch stem extensions and the following features:

1. Gate Valves: With rising stem.
2. Ball Valves: With extended operating handle of non-thermal-conductive material, and protective sleeve that allows operation of valve without breaking the vapor seal or disturbing insulation.
3. Butterfly Valves: With extended neck.

F. Valve-End Connections:

1. Flanged: With flanges according to ASME B16.1 for iron valves.
2. Grooved: With grooves according to AWWA C606.
3. Solder Joint: With sockets according to ASME B16.18.
4. Threaded: With threads according to ASME B1.20.1.

G. Valve Bypass and Drain Connections: MSS SP-45.

2.2 BRASS BALL VALVES

A. One-Piece, Full-Port, Brass Ball Valves with Brass Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. American Valve, Inc.
   b. Crane Co.; Crane Valve Group; Jenkins Valves.
   c. Crane Co.; Crane Valve Group; Stockham Div.
   d. Grinnell Corporation.
   e. Jamesbury, Inc.
   f. NIBCO INC.
   g. Watts Industries, Inc.; Water Products Div.
   h. Kitz Corporation.

2. Description:

   a. Standard: MSS SP-110.
   b. CWP Rating: 400 psig.
   c. Body Design: One piece.
   d. Body Material: Forged brass.
   e. Ends: Threaded.
   f. Seats: PTFE or TFE.
   g. Stem: Brass.
   h. Ball: Chrome-plated brass.
   i. Port: Full.

B. Three-Piece, Full-Port, Brass Ball Valves with Stainless-Steel Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Jomar International, LTD.
   b. Kitz Corporation.
   c. Marwin Valve; a division of Richards Industries.
   d. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
   e. Conbraco Industries, Inc.; Apollo Div.
   f. Grinnell Corporation.
   g. Jamesbury, Inc.
   h. NIBCO INC.
   i. PBM, Inc.

2. Controls Description:

   a. Standard: MSS SP-110.
   b. SWP Rating: 150 psig.
   c. CWP Rating: 600 psig.

d. Body Design: Three piece.
e. Body Material: Forged brass.
f. Ends: Threaded.
g. Seats: PTFE or TFE.
h. Stem: Stainless steel.
i. Ball: Stainless steel, vented.
j. Port: Full.

2.3 IRON, SINGLE-FLANGE BUTTERFLY VALVES

A. 200 CWP, Iron, Single-Flange Butterfly Valves with EPDM Seat and Stainless-Steel Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers

a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
b. American Valve, Inc.
c. Conbraco Industries, Inc.; Apollo Valves.
d. Cooper Cameron Valves; a division of Cooper Cameron Corp.
e. Crane Co.; Crane Valve Group; Jenkins Valves.
f. Crane Co.; Crane Valve Group; Stockham Division.
g. DeZurik Water Controls.
h. Dover Corp.; Dover Resources Company; Norriseal Div.
i. Flo Fab Inc.
j. Grinnell Corporation
k. Hammond Valve.
l. Kitz Corporation.
m. Legend Valve.
n. Milwaukee Valve Company.
o. Mueller Steam Specialty; a division of SPX Corporation.
p. NIBCO INC.
q. Norriseal; a Dover Corporation company.
r. Red-White Valve Corporation.
s. Spence Strainers International; a division of CIRCOR International.
t. Sure Flow Equipment Inc.
u. Tyco International, Ltd.; Tyco Valves & Controls.
v. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

a. Standard: MSS SP-67, Type I.
b. CWP Rating: 200 psig.
c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.

e. Seat: EPDM.
f. Stem: One- or two-piece stainless steel.
g. Disc: Stainless steel.

2.4 HIGH-PERFORMANCE BUTTERFLY VALVES

A. Class 150, Single-Flange, High-Performance Butterfly Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
b. Bray Controls; a division of Bray International.
c. Cooper Cameron Valves; a division of Cooper Cameron Corp.
d. Crane Co.; Crane Valve Group; Flowseal.
e. Crane Co.; Crane Valve Group; Stockham Division.
f. DeZurik Water Controls.
g. Hammond Valve.
h. Jamesbury; a subsidiary of Metso Automation.
i. Milwaukee Valve Company.
j. NIBCO INC.
k. Process Development & Control, Inc.
l. Tyco Valves & Controls; a unit of Tyco Flow Control.
m. Xomox Corporation.

2. Description:

a. Standard: MSS SP-68.
b. CWP Rating: 285 psig at 100 deg F.
c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
d. Body Material: Carbon steel, cast iron, ductile iron, or stainless steel.
e. Seat: Reinforced PTFE or metal.
f. Stem: Stainless steel; offset from seat plane.
g. Disc: Carbon steel.
h. Service: Bidirectional.

2.5 BRONZE LIFT CHECK VALVES

A. Class 125, Lift Check Valves with Bronze Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following] [available manufacturers:

a. Crane Co.; Crane Valve Group; Crane Valves.
b. Crane Co.; Crane Valve Group; Jenkins Valves.

c. Crane Co.; Crane Valve Group; Stockham Division.

2. Description:

a. Standard: MSS SP-80, Type 1.
b. CWP Rating: 200 psig.
c. Body Design: Vertical flow.
d. Body Material: ASTM B 61 or ASTM B 62, bronze.
e. Ends: Threaded.
f. Disc: Bronze.

2.6 BRONZE SWING CHECK VALVES

A. Class 150, Bronze Swing Check Valves with Bronze Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following vailable manufacturer:

a. American Valve, Inc.
b. Crane Co.; Crane Valve Group; Crane Valves.
c. Crane Co.; Crane Valve Group; Jenkins Valves.
d. Crane Co.; Crane Valve Group; Stockham Division.
e. Grinnell Corporation.
f. Kitz Corporation.
g. Milwaukee Valve Company.
h. NIBCO INC.
i. Red-White Valve Corporation.
j. Watts Industries, Inc.; Water Products Div.
k. Zy-Tech Global Industries, Inc.

2. Description:

a. Standard: MSS SP-80, Type 3.
b. CWP Rating: 300 psig.
c. Body Design: Horizontal flow.
d. Body Material: ASTM B 62, bronze.
e. Ends: Threaded.
f. Disc: Bronze.

2.7 IRON SWING CHECK VALVES

A. Class 250, Iron Swing Check Valves with Metal Seats:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following vailable manufacturers:

a. Crane Co.; Crane Valve Group; Crane Valves.
b. Crane Co.; Crane Valve Group; Jenkins Valves.
c. Crane Co.; Crane Valve Group; Stockham Division.
d. Cincinnati Valve Company
e. Flomatic Valves
f. Grinnell Corporation
g. Hammond Valve.
h. Milwaukee Valve Company.
i. NIBCO INC.
j. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

a. Standard: MSS SP-71, Type I.
b. NPS 2-1/2 to NPS 12, CWP Rating: 500 psig.
c. NPS 14 to NPS 24, CWP Rating: 300 psig.
d. Body Design: Clear or full waterway.
e. Body Material: ASTM A 126, gray iron with bolted bonnet.
f. Ends: Flanged.
g. Trim: Bronze.
h. Gasket: Asbestos free.

2.8 BRONZE GATE VALVES

A. Class 150, NRS Bronze Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

a. Hammond Valve.
b. Kitz Corporation.
c. Milwaukee Valve Company.
d. NIBCO INC.
e. Powell Valves.
f. Red-White Valve Corporation.
g. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
h. American Valve, Inc.
i. Grinnell Corporation.

2. Description:

a. Standard: MSS SP-80, Type 1.
b. CWP Rating: 300 psig.
c. Body Material: ASTM B 62, bronze with integral seat and union-ring bonnet.
d. Ends: Threaded.

e. Stem: Bronze.
f. Disc: Solid wedge; bronze.
g. Packing: Asbestos free.
h. Handwheel: Malleable iron bronze, or aluminum.

2.9 IRON GATE VALVES

A. Class 250, NRS, Iron Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

a. Crane Co.; Crane Valve Group; Crane Valves.
b. Crane Co.; Crane Valve Group; Stockham Division.
c. NIBCO INC.
d. Cincinnati Valve Company
e. Grinnell Corporation

2. Description:

a. Standard: MSS SP-70, Type I.
b. NPS 2-1/2 to NPS 12, CWP Rating: 500 psig.
c. NPS 14 to NPS 24, CWP Rating: 300 psig.
d. Body Material: ASTM A 126, gray iron with bolted bonnet.
e. Ends: Flanged.
f. Trim: Bronze.
g. Disc: Solid wedge.
h. Packing and Gasket: Asbestos free.

B. Class 250, OS&Y, Iron Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

a. Crane Co.; Crane Valve Group; Crane Valves.
b. Crane Co.; Crane Valve Group; Stockham Division.
c. Hammond Valve.
d. Milwaukee Valve Company.
e. NIBCO INC.
f. Powell Valves.
g. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
h. Grinnell Corporation

2. Description:

a. Standard: MSS SP-70, Type I.
b. NPS 2-1/2 to NPS 12, CWP Rating: 500 psig.

c. NPS 14 to NPS 24, CWP Rating: 300 psig.
d. Body Material: ASTM A 126, gray iron with bolted bonnet.
e. Ends: Flanged.
f. Trim: Bronze.
g. Disc: Solid wedge.
h. Packing and Gasket: Asbestos free.

2.10 CHAINWHEELS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Babbitt Steam Specialty Co.
2. Roto Hammer Industries.
3. Trumbull Industries.

B. Description: Valve actuation assembly with sprocket rim, brackets, and chain.

1. Brackets: Type, number, size, and fasteners required to mount actuator on valve.
2. Attachment: For connection to butterfly valve stems.
3. Sprocket Rim with Chain Guides: Ductile or cast iron, of type and size required for valve. Include zinc coating.
4. Chain: Hot-dip, galvanized steel, of size required to fit sprocket rim.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.

B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.

C. Examine threads on valve and mating pipe for form and cleanliness.

D. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.

E. Do not attempt to repair defective valves; replace with new valves.

F. True Unions required.

3.2 VALVE INSTALLATION

A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.

B. Locate valves for easy access and provide separate support where necessary.

C. Install valves in horizontal piping with stem at or above center of pipe.

D. Install valves in position to allow full stem movement.

E. Install chainwheels on operators for butterfly and gate valves NPS 4 and larger and more than 96 inches above floor. Extend chains to 60 inches above finished floor.

F. Install check valves for proper direction of flow and as follows:

1. Swing Check Valves: In horizontal position with hinge pin level.
2. Lift Check Valves: With stem upright and plumb.

G. Provide an additional six (6) valves of each type and size used in the project to accommodate interferences and/or as directed by Engineer.

3.3 ADJUSTING

A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves if persistent leaking occurs.

3.4 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

A. If valve applications are not indicated, use the following:

1. Shutoff Service: Ball, butterfly or gate valves.
2. Butterfly Valve Dead-End Service: Single-flange (lug) type.
3. Throttling Service: ball, or butterfly valves.
4. Pump-Discharge Check Valves:

    a. NPS 2 and Smaller: Bronze swing check valves with bronze disc.
    b. NPS 2-1/2 and Larger for Domestic Water: Iron swing check valves with lever and weight or with spring or iron, center-guided, metal-seat check valves.
    c. NPS 2-1/2 and Larger for Sanitary Waste and Storm Drainage: Iron swing check valves with lever and weight or spring.

B. If valves with specified SWP classes or CWP ratings are not available, the same types of valves with higher SWP classes or CWP ratings may be substituted.

C. Select valves, except wafer types, with the following end connections:

1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option is indicated in valve schedules below.
2. For Copper Tubing, NPS 2-1/2 to NPS 4 : Flanged ends except where threaded valve-end option is indicated in valve schedules below.
3. For Copper Tubing, NPS 5 and Larger: Flanged ends.
4. For Steel Piping, NPS 2 and Smaller: Threaded ends.
5. For Steel Piping, NPS 2-1/2 to NPS 4: Flanged ends except where threaded valve-end option is indicated in valve schedules below.
6. For Steel Piping, NPS 5 and Larger: Flanged ends.

3.5 DOMESTIC, HOT- AND COLD-WATER VALVE SCHEDULE

A. Pipe NPS 2 (DN 50) and Smaller:

1. Bronze and Brass Valves: may be provided with solder-joint ends instead of threaded ends.
2. Ball Valves: One or Three piece, full port, brass with stainless-steel trim.
3. Bronze Swing Check Valves: Class 150, bronze disc.
4. Bronze Gate Valves: Class 150, NRS.

B. Pipe NPS 2-1/2 and Larger:

1. Iron, Single-Flange Butterfly Valves, NPS 2-1/2 to NPS 12: 200 CWP, EPDM seat, stainless-steel disc.
2. Iron, Single-Flange Butterfly Valves, NPS 14 to NPS 24: 150 CWP, EPDM seat, stainless-steel disc.
3. High-Performance Butterfly Valves: Class 150, single flange.
4. Iron Swing Check Valves: Class 250, metal seats.
5. Iron Gate Valves: Class 250, NRS or OS&Y.

3.6 SANITARY-WASTE AND STORM-DRAINAGE VALVE SCHEDULE

A. Pipe NPS 2 and Smaller:

1. Brass and Bronze Valves: May be provided with solder-joint ends instead of threaded ends.
2. Ball Valves: One or Three piece, full port, brass with stainless-steel trim.
3. Bronze Swing Check Valves: Class 150, bronze disc.
4. Bronze Gate Valves: Class 150, [NRS, bronze.

B. Pipe NPS 2-1/2 and Larger:

1. Iron Valves, NPS 2-1/2 to NPS 4: May be provided with threaded ends instead of flanged ends.

2. Iron, Single-Flange Butterfly Valves, NPS 2-1/2 to NPS 12: 200 CWP, EPDM seat, stainless-steel disc.
3. Iron, Single-Flange Butterfly Valves, NPS 14 to NPS 24: 150 CWP, EPDM seat, stainless-steel disc.
4. High-Performance Butterfly Valves: Class 150, single flange.
5. Iron Swing Check Valves: Class 250, metal seats.
6. Iron Gate Valves: Class 250, NRS or OS&Y.

END OF SECTION 220523

SECTION 220529 - HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Metal pipe hangers and supports.
2. Trapeze pipe hangers.
3. Fiberglass pipe hangers.
4. Metal framing systems.
5. Fiberglass strut systems.
6. Thermal-hanger shield inserts.
7. Fastener systems.
8. Pipe stands.
9. Pipe positioning systems.
10. Equipment supports.

B. Related Sections:
1. Division 21 fire-suppression piping Sections for pipe hangers for fire-suppression piping.
2. Division 22 Section "Expansion Fittings and Loops for Plumbing Piping" for pipe guides and anchors.
3. Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment" for vibration isolation devices.

1.3 DEFINITIONS

A. MSS: Manufacturers Standardization Society of The Valve and Fittings Industry Inc.

1.4 PERFORMANCE REQUIREMENTS

A. Delegated Design: Design trapeze pipe hangers and equipment supports, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

B. Structural Performance: Hangers and supports for plumbing piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.

1. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.
2. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
3. Design seismic-restraint hangers and supports for piping and equipment and obtain approval from authorities having jurisdiction.

1.5 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings: Signed and sealed by a qualified professional engineer. Show fabrication and installation details and include calculations for the following; include Product Data for components:

1. Trapeze pipe hangers.
2. Metal framing systems.
3. Fiberglass strut systems.
4. Pipe stands.
5. Equipment supports.

C. Delegated-Design Submittal: For trapeze hangers indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1. Detail fabrication and assembly of trapeze hangers.
2. Design Calculations: Calculate requirements for designing trapeze hangers.

D. Welding certificates.

1.6 QUALITY ASSURANCE

A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

PART 2 - PRODUCTS

2.1 METAL PIPE HANGERS AND SUPPORTS

A. Carbon-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: Pregalvanized or hot dipped.
3. Nonmetallic Coatings: Plastic coating, jacket, or liner.
4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
5. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

B. Stainless-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel .

C. Copper Pipe Hangers:

1. Description: MSS SP-58, Types 1 through 58, copper-coated-steel, factory-fabricated components.
2. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel

2.2 TRAPEZE PIPE HANGERS

A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

2.3 FIBERGLASS PIPE HANGERS

A. Clevis-Type, Fiberglass Pipe Hangers:

1. Description: Similar to MSS SP-58, Type 1, steel pipe hanger except hanger is made of fiberglass or fiberglass-reinforced resin.
2. Hanger Rods: Continuous-thread rod, washer, and nuts made of stainless steel

B. Strap-Type, Fiberglass Pipe Hangers:

1. Description: Similar to MSS SP-58, Type 9 or Type 10, steel pipe hanger except hanger is made of fiberglass-reinforced resin.
2. Hanger Rod and Fittings: Continuous-thread rod, washer, and nuts made of stainless steel

2.4 METAL FRAMING SYSTEMS

A. MFMA Manufacturer Metal Framing Systems:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Allied Tube & Conduit.
    b. Cooper B-Line, Inc.
    c. Flex-Strut Inc.
    d. GS Metals Corp.
    e. Thomas & Betts Corporation.
    f. Unistrut Corporation; Tyco International, Ltd.
    g. Wesanco, Inc.

2. Description: Shop- or field-fabricated pipe-support assembly for supporting multiple parallel pipes.
3. Standard: MFMA-4.
4. Channels: Continuous slotted steel channel with inturned lips.
5. Channel Nuts: Formed or stamped steel nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
6. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel
7. Metallic Coating: Electroplated zinc

2.5 THERMAL-HANGER SHIELD INSERTS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Carpenter & Paterson, Inc.
2. Clement Support Services.
3. ERICO International Corporation.
4. National Pipe Hanger Corporation.
5. PHS Industries, Inc.
6. Pipe Shields, Inc.; a subsidiary of Piping Technology & Products, Inc.
7. Piping Technology & Products, Inc.
8. Rilco Manufacturing Co., Inc.
9. Value Engineered Products, Inc.

B. Insulation-Insert Material for Cold Piping: ASTM C 552, Type II cellular glass with 100-psig minimum compressive strength and vapor barrier.

C. Insulation-Insert Material for Hot Piping: Water-repellent treated, ASTM C 552, Type II cellular glass with 100-psig minimum compressive strength.

D. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.

E. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.

F. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

2.6 FASTENER SYSTEMS

A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

B. Mechanical-Expansion Anchors: Insert-wedge-type, stainless-steel anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

2.7 PIPE STANDS

A. General Requirements for Pipe Stands: Shop- or field-fabricated assemblies made of manufactured corrosion-resistant components to support roof-mounted piping.

B. Compact Pipe Stand: One-piece plastic unit with integral-rod roller, pipe clamps, or V-shaped cradle to support pipe, for roof installation without membrane penetration.

C. Low-Type, Single-Pipe Stand: One-piece stainless-steel base unit with plastic roller, for roof installation without membrane penetration.

D. High-Type, Single-Pipe Stand:

1. Description: Assembly of base, vertical and horizontal members, and pipe support, for roof installation without membrane penetration.
2. Base: Stainless steel.
3. Vertical Members: Two or more cadmium-plated-steel or stainless-steel, continuous-thread rods.
4. Horizontal Member: Cadmium-plated-steel or stainless-steel rod with plastic or stainless-steel, roller-type pipe support.

E. High-Type, Multiple-Pipe Stand:

1. Description: Assembly of bases, vertical and horizontal members, and pipe supports, for roof installation without membrane penetration.
2. Bases: One or more; plastic.
3. Vertical Members: Two or more protective-coated-steel channels.
4. Horizontal Member: Protective-coated-steel channel.
5. Pipe Supports: Galvanized-steel, clevis-type pipe hangers.

F. Curb-Mounting-Type Pipe Stands: Shop- or field-fabricated pipe supports made from structural-steel shapes, continuous-thread rods, and rollers, for mounting on permanent stationary roof curb.

2.8 PIPE POSITIONING SYSTEMS

A. Description: IAPMO PS 42, positioning system of metal brackets, clips, and straps for positioning piping in pipe spaces; for plumbing fixtures in commercial applications.

2.9 EQUIPMENT SUPPORTS

A. Description: Welded, shop- or field-fabricated equipment support made from structural carbon-steel shapes.

2.10 MISCELLANEOUS MATERIALS

A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.

B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.

1. Properties: Nonstaining, noncorrosive, and nongaseous.
2. Design Mix: 5000-psi , 28-day compressive strength.

PART 3 - EXECUTION

3.1 HANGER AND SUPPORT INSTALLATION

A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.

B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.

1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
2. Field fabricate from ASTM A 36/A 36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.

C. Fiberglass Pipe-Hanger Installation: Comply with applicable portions of MSS SP-69 and MSS SP-89. Install hangers and attachments as required to properly support piping from building structure.

D. Metal Framing System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled metal framing systems.

E. Fiberglass Strut System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled fiberglass struts.

F. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.

G. Fastener System Installation:

1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches (100 mm) thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.

H. Pipe Stand Installation:

1. Pipe Stand Types except Curb-Mounted Type: Assemble components and mount on smooth roof surface. Do not penetrate roof membrane.
2. Curb-Mounted-Type Pipe Stands: Assemble components or fabricate pipe stand and mount on permanent, stationary roof curb. See Division 07 Section "Roof Accessories" for curbs.

I. Pipe Positioning-System Installation: Install support devices to make rigid supply and waste piping connections to each plumbing fixture. See Division 22 plumbing fixture Sections for requirements for pipe positioning systems for plumbing fixtures.

J. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.

K. Equipment Support Installation: Fabricate from welded-structural-steel shapes.

L. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.

M. Install lateral bracing with pipe hangers and supports to prevent swaying.

N. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts

before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.

O. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.

P. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.

Q. Insulated Piping:

1. Attach clamps and spacers to piping.

    a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
    b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
    c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.

2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.

    a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.

3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.

    a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.

4. Shield Dimensions for Pipe: Not less than the following:

    a. NPS 1/4 to NPS 3-1/2 : 12 inches long and 0.048 inch thick.
    b. NPS 4 : 12 inches long and 0.06 inch thick.
    c. NPS 5 and NPS 6 : 18 inches long and 0.06 inch thick.
    d. NPS 8 to NPS 14 24 inches long and 0.075 inch thick.
    e. NPS 16 to NPS 24 24 inches long and 0.105 inch thick.

5. Pipes NPS 8 and Larger: Include wood or reinforced calcium-silicate-insulation inserts of length at least as long as protective shield.
6. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

3.2 EQUIPMENT SUPPORTS

A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.

B. Grouting: Place grout under supports for equipment and make bearing surface smooth.

C. Provide lateral bracing, to prevent swaying, for equipment supports.

3.3 METAL FABRICATIONS

A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.

B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.

C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:

1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
2. Obtain fusion without undercut or overlap.
3. Remove welding flux immediately.
4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

3.4 ADJUSTING

A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.

B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches .

3.5 PAINTING

A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.

1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils .

B. Touchup: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal are specified in Division 09 painting Sections.

C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

3.6 HANGER AND SUPPORT SCHEDULE

A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.

B. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.

C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.

D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.

E. Use carbon-steel metal trapeze pipe hangers and metal framing systems and attachments for general service applications.

F. Use stainless-steel pipe hangers and stainless-steel attachments for hostile environment applications.

G. Use copper-plated pipe hangers and copper or stainless-steel attachments for copper piping and tubing.

H. Use padded hangers for piping that is subject to scratching.

I. Use thermal-hanger shield inserts for insulated piping and tubing.

J. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30 .
2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of up to 1050 deg F pipes NPS 4 to NPS 24 requiring up to 4 inches of insulation.
3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes NPS 3/4 to NPS 36 requiring clamp flexibility and up to 4 inches of insulation.
4. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes NPS 1/2 to NPS 24 if little or no insulation is required.
5. Pipe Hangers (MSS Type 5): For suspension of pipes NPS 1/2 to NPS 4 to allow off-center closure for hanger installation before pipe erection.
6. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated, stationary pipes NPS 3/4 to NPS 8

7. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8
8. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8
9. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8
10. Split Pipe Ring with or without Turnbuckle Hangers (MSS Type 11): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 8 .
11. Extension Hinged or Two-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 3 .
12. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30
13. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
14. Pipe Saddle Supports (MSS Type 36): For support of pipes NPS 4 to NPS 36 with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate.
15. Pipe Stanchion Saddles (MSS Type 37): For support of pipes NPS 4 to NPS 36 with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate, and with U-bolt to retain pipe.
16. Adjustable Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes NPS 2-1/2 to NPS 36 if vertical adjustment is required, with steel-pipe base stanchion support and cast-iron floor flange.
17. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30 from two rods if longitudinal movement caused by expansion and contraction might occur.
18. Adjustable Roller Hangers (MSS Type 43): For suspension of pipes NPS 2-1/2 to NPS 24 from single rod if horizontal movement caused by expansion and contraction might occur.
19. Complete Pipe Rolls (MSS Type 44): For support of pipes NPS 2 to NPS 42 if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is not necessary.
20. Pipe Roll and Plate Units (MSS Type 45): For support of pipes NPS 2 to NPS 24 if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is not necessary.
21. Adjustable Pipe Roll and Base Units (MSS Type 46): For support of pipes NPS 2 to NPS 30 if vertical and lateral adjustment during installation might be required in addition to expansion and contraction.

K. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24
2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.

L. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.
4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.

M. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joist construction, to attach to top flange of structural shape.
3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
6. C-Clamps (MSS Type 23): For structural shapes.
7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
10. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
11. Malleable-Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
12. Welded-Steel Brackets: For support of pipes from below or for suspending from above by using clip and rod. Use one of the following for indicated loads:

    a. Light (MSS Type 31): 750 lb
    b. Medium (MSS Type 32): 1500 lb
    c. Heavy (MSS Type 33): 3000 lb

13. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
14. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.

15. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.

N. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.

O. Spring Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Restraint-Control Devices (MSS Type 47): Where indicated to control piping movement.
2. Spring Cushions (MSS Type 48): For light loads if vertical movement does not exceed 1-1/4 inches .
3. Spring-Cushion Roll Hangers (MSS Type 49): For equipping Type 41, roll hanger with springs.
4. Spring Sway Braces (MSS Type 50): To retard sway, shock, vibration, or thermal expansion in piping systems.
5. Variable-Spring Hangers (MSS Type 51): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from hanger.
6. Variable-Spring Base Supports (MSS Type 52): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from base support.
7. Variable-Spring Trapeze Hangers (MSS Type 53): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from trapeze support.
8. Constant Supports: For critical piping stress and if necessary to avoid transfer of stress from one support to another support, critical terminal, or connected equipment. Include auxiliary stops for erection, hydrostatic test, and load-adjustment capability. These supports include the following types:

    a. Horizontal (MSS Type 54): Mounted horizontally.
    b. Vertical (MSS Type 55): Mounted vertically.
    c. Trapeze (MSS Type 56): Two vertical-type supports and one trapeze member.

P. Comply with MSS SP-69 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.

Q. Comply with MFMA-103 for metal framing system selections and applications that are not specified in piping system Sections.

R. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.

S. Use pipe positioning systems in pipe spaces behind plumbing fixtures to support supply and waste piping for plumbing fixtures.

END OF SECTION 220529

SECTION 220548 - VIBRATION AND SEISMIC CONTROLS FOR PLUMBING PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Isolation pads.
2. Isolation mounts.
3. Restrained elastomeric isolation mounts.
4. Restraining braces.

1.2 DEFINITIONS

A. IBC: International Building Code.

B. ICC-ES: ICC-Evaluation Service.

C. OSHPD: Office of Statewide Health Planning and Development for the State of California.

1.3 PERFORMANCE REQUIREMENTS

A. Seismic-Restraint Loading:

1. Site Class as Defined in the IBC: 2021.
2. Assigned Seismic Use Group or Building Category as Defined in the IBC: 2021 NJ Edition.

a. Component Importance Factor: as required by IBC 2021 NJ Edition.
b. Component Response Modification Factor: as required by IBC 2021 NJ Edition.
c. Component Amplification Factor: as required by IBC 2021 NJ Edition.

3. Design Spectral Response Acceleration at Short Periods (0.2 Second): as required by IBC 2021 NJ Edition.
4. Design Spectral Response Acceleration at 1-Second Period: as required by IBC 2021 Edition.

1.4 SUBMITTALS

A. Product Data: For each product indicated.

B. Delegated-Design Submittal: For vibration isolation and seismic-restraint calculations and details indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation and licensed in the State of New Jersey.

C. Welding certificates.

D. Qualification Data: For professional engineer.

1.5 QUALITY ASSURANCE

A. Comply with seismic-restraint requirements in the IBC and NFPA 13 unless requirements in this Section are more stringent.

B. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

C. Seismic-restraint devices shall have horizontal and vertical load testing and analysis and shall bear anchorage preapproval OPA number from OSHPD, preapproval by ICC-ES, or preapproval by another agency acceptable to authorities having jurisdiction, showing maximum seismic-restraint ratings. Ratings based on independent testing are preferred to ratings based on calculations. If preapproved ratings are not available, submittals based on independent testing are preferred. Calculations (including combining shear and tensile loads) to support seismic-restraint designs must be signed and sealed by a qualified professional engineer.

PART 2 - PRODUCTS

2.1 VIBRATION ISOLATORS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Ace Mountings Co., Inc.
2. Amber/Booth Company, Inc.
3. California Dynamics Corporation.
4. Isolation Technology, Inc.
5. Kinetics Noise Control.
6. Mason Industries.

7. Vibration Eliminator Co., Inc.
8. Vibration Isolation.
9. Vibration Mountings & Controls, Inc.

B. Pads: Arranged in single or multiple layers of sufficient stiffness for uniform loading over pad area, molded with a nonslip pattern and galvanized-steel baseplates, and factory cut to sizes that match requirements of supported equipment.

1. Resilient Material: Oil- and water-resistant neoprene.

C. Mounts: Double-deflection type, with molded, oil-resistant rubber, hermetically sealed compressed fiberglass, or neoprene isolator elements with factory-drilled, encapsulated top plate for bolting to equipment and with baseplate for bolting to structure. Color-code or otherwise identify to indicate capacity range.

1. Materials: Cast-ductile-iron or welded steel housing containing two separate and opposing, oil-resistant rubber or neoprene elements that prevent central threaded element and attachment hardware from contacting the housing during normal operation.
2. Neoprene: Shock-absorbing materials compounded according to the standard for bridge-bearing neoprene as defined by AASHTO.

D. Restrained Mounts: All-directional mountings with seismic restraint.

1. Materials: Cast-ductile-iron or welded steel housing containing two separate and opposing, oil-resistant rubber or neoprene elements that prevent central threaded element and attachment hardware from contacting the housing during normal operation.
2. Neoprene: Shock-absorbing materials compounded according to the standard for bridge-bearing neoprene as defined by AASHTO.

2.2 SEISMIC-RESTRAINT DEVICES

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Amber/Booth Company, Inc.
2. California Dynamics Corporation.
3. Cooper B-Line, Inc.; a division of Cooper Industries.
4. Hilti, Inc.
5. Kinetics Noise Control.
6. Loos & Co.; Cableware Division.
7. Mason Industries.
8. TOLCO Incorporated; a brand of NIBCO INC.

9. Unistrut; Tyco International, Ltd.

B. General Requirements for Restraint Components: Rated strengths, features, and applications shall be as defined in reports by an agency acceptable to authorities having jurisdiction.

1. Structural Safety Factor: Allowable strength in tension, shear, and pullout force of components shall be at least four times the maximum seismic forces to which they will be subjected.

C. Channel Support System: MFMA-3, shop- or field-fabricated support assembly made of slotted steel channels with accessories for attachment to braced component at one end and to building structure at the other end and other matching components and with corrosion-resistant coating; and rated in tension, compression, and torsion forces.

D. Hanger Rod Stiffener: Steel tube or steel slotted-support-system sleeve with internally bolted connections to hanger rod.

E. Bushings for Floor-Mounted Equipment Anchor Bolts: Neoprene bushings designed for rigid equipment mountings, and matched to type and size of anchor bolts and studs.

F. Resilient Isolation Washers and Bushings: One-piece, molded, oil- and water-resistant neoprene, with a flat washer face.

G. Mechanical Anchor Bolts: Drilled-in and stud-wedge or female-wedge type in zinc-coated steel for interior applications and stainless steel for exterior applications. Select anchor bolts with strength required for anchor and as tested according to ASTM E 488. Minimum length of eight times diameter.

PART 3 - EXECUTION

3.1 VIBRATION-CONTROL AND SEISMIC-RESTRAINT DEVICE INSTALLATION

A. Equipment Restraints:

1. Install resilient bolt isolation washers on equipment anchor bolts where clearance between anchor and adjacent surface exceeds 0.125 inch.
2. Install seismic-restraint devices using methods approved by an agency acceptable to authorities having jurisdiction providing required submittals for component.

B. Piping Restraints:

1. Comply with requirements in MSS SP-127 and NFPA 13.

2. Space lateral supports a maximum of 40 feet o.c., and longitudinal supports a maximum of 80 feet o.c.
3. Brace a change of direction longer than 12 feet.

C. Install seismic-restraint devices using methods approved by an agency acceptable to authorities having jurisdiction providing required submittals for component.

D. Install bushing assemblies for anchor bolts for floor-mounted equipment, arranged to provide resilient media between anchor bolt and mounting hole in concrete base.

E. Attachment to Structure: If specific attachment is not indicated, anchor bracing to structure at flanges of beams, at upper truss chords of bar joists, or at concrete members.

F. Drilled-in Anchors:

1. Identify position of reinforcing steel and other embedded items prior to drilling holes for anchors. Do not damage existing reinforcing or embedded items during coring or drilling. Notify the structural engineer if reinforcing steel or other embedded items are encountered during drilling. Locate and avoid prestressed tendons, electrical and telecommunications conduit, and gas lines.
2. Do not drill holes in concrete or masonry until concrete, mortar, or grout has achieved full design strength.
3. Wedge Anchors: Protect threads from damage during anchor installation. Heavy-duty sleeve anchors shall be installed with sleeve fully engaged in the structural element to which anchor is to be fastened.
4. Set anchors to manufacturer's recommended torque, using a torque wrench.
5. Install zinc-coated steel anchors for interior and stainless-steel anchors for exterior applications.

3.2 ACCOMMODATION OF DIFFERENTIAL SEISMIC MOTION

A. Install flexible connections in piping where they cross seismic joints, where adjacent sections or branches are supported by different structural elements, and where the connections terminate with connection to equipment that is anchored to a different structural element from the one supporting the connections as they approach equipment. Comply with requirements in Division 22 Section "Domestic Water Piping" for piping flexible connections.

B. Submittals to be provided including isolators.

END OF SECTION 220548

SECTION 220553 - IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Equipment labels.
2. Warning signs and labels.
3. Pipe labels.
4. Duct labels.
5. Stencils.
6. Valve tags.
7. Warning tags.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Samples: For color, letter style, and graphic representation required for each identification material and device.

C. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.

D. Valve numbering scheme.

E. Valve Schedules: For each piping system to include in maintenance manuals.

1.4 COORDINATION

A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.

B. Coordinate installation of identifying devices with locations of access panels and doors.

C. Install identifying devices before installing acoustical ceilings and similar concealment.

PART 2 - PRODUCTS

2.1 EQUIPMENT LABELS

A. Metal Labels for Equipment:

1. Material and Thickness: Stainless steel, 0.025-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
2. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
3. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
4. Fasteners: Stainless-steel self-tapping screws.
5. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

B. Label Content: Include equipment's Drawing designation or unique equipment number, Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified.

C. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch bond paper. Tabulate equipment identification number and identify Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

2.2 WARNING SIGNS AND LABELS

A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/8 inch thick, and having predrilled holes for attachment hardware.

B. Letter Color: White

C. Background Color: Red

D. Maximum Temperature: Able to withstand temperatures up to 160 deg F.

E. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.

F. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

G. Fasteners: Stainless-steel self-tapping screws.

H. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

I. Label Content: Include caution and warning information, plus emergency notification instructions.

2.3 PIPE LABELS

A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.

B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to cover full circumference of pipe and to attach to pipe without fasteners or adhesive.

C. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.

D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings, pipe size, and an arrow indicating flow direction.

1. Flow-Direction Arrows: Integral with piping system service lettering to accommodate both directions, or as separate unit on each pipe label to indicate flow direction.
2. Lettering Size: At least 1-1/2 inches high.

2.4 VALVE TAGS

A. Valve Tags: Stamped or engraved with 1/4-inch letters for piping system abbreviation and 1/2-inch numbers.

1. Tag Material: Stainless steel, 0.025-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
2. Fasteners: Brass beaded chain.

B. Valve Schedules: For each piping system, on 8-1/2-by-11-inch bond paper. Tabulate valve number, piping system, system abbreviation (as shown on valve tag), location of valve (room or space), normal-operating position (open, closed, or modulating), and variations for identification. Mark valves for emergency shutoff and similar special uses.

1. Valve-tag schedule shall be included in operation and maintenance data.

2.5 WARNING TAGS

A. Warning Tags: Preprinted or partially preprinted, accident-prevention tags, of plasticized card stock with matte finish suitable for writing.

1. Size: Approximately 4 by 7 inches
2. Fasteners: Brass grommet and wire
3. Nomenclature: Large-size primary caption such as "DANGER," "CAUTION," or "DO NOT OPERATE."
4. Color: Yellow background with black lettering.

PART 3 - EXECUTION

3.1 PREPARATION

A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

3.2 EQUIPMENT LABEL INSTALLATION

A. Install or permanently fasten labels on each major item of mechanical equipment.

B. Locate equipment labels where accessible and visible.

3.3 PIPE LABEL INSTALLATION

A. Piping Color-Coding: Painting of piping is specified in Division 09 Section "Interior Painting".

B. Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:

1. Near each valve and control device.
2. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
3. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
4. At access doors, manholes, and similar access points that permit view of concealed piping.
5. Near major equipment items and other points of origination and termination.
6. Spaced at maximum intervals of 50 feet along each run. Reduce intervals to 25 feet in areas of congested piping and equipment.
7. On piping above removable acoustical ceilings. Omit intermediately spaced labels.

C. Pipe Label Color Schedule:

1. Domestic Water Piping(Label piping as CWS, HWS, HWR):

   a. Background Color: White
   b. Letter Color: Blue

2. Sanitary Waste and Storm Drainage Piping:

   a. Background Color: Black
   b. Letter Color: White

3. Compressed Air Piping:

   a. Background Color: White
   b. Letter Color: Green

3.4 VALVE-TAG INSTALLATION

A. Install tags on valves and control devices in piping systems, except check valves; valves within factory-fabricated equipment units; shutoff valves; faucets; convenience and lawn-watering hose connections; and similar roughing-in connections of end-use fixtures and units. List tagged valves in a valve schedule.

B. Valve-Tag Application Schedule: Tag valves according to size, shape, and color scheme and with captions similar to those indicated in the following subparagraphs:

1. Valve-Tag Size and Shape:

   a. Cold Water: 2 inches , round
   b. Hot Water: 2 inches , round

2. Valve-Tag Color:

   a. Cold Water: Green
   b. Hot Water: Green

3. Letter Color:

   a. Cold Water: White
   b. Hot Water: White

3.5 WARNING-TAG INSTALLATION

A. Write required message on, and attach warning tags to, equipment and other items where required.

END OF SECTION 220553

SECTION 220700 - PLUMBING INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Insulation Materials:

a. Calcium silicate.
b. Cellular glass.
c. Flexible elastomeric.
d. Mineral fiber.
e. Phenolic.
f. Polyisocyanurate.
g. Polyolefin.
h. Polystyrene.

2. Insulating cements.
3. Adhesives.
4. Mastics.
5. Lagging adhesives.
6. Sealants.
7. Factory-applied jackets.
8. Field-applied fabric-reinforcing mesh.
9. Field-applied cloths.
10. Field-applied jackets.
11. Tapes.
12. Securements.
13. Corner angles.

B. Related Sections include the following:
1. Division 23 Section "HVAC Insulation."

1.3 SUBMITTALS

A. Product Data: For each type of product indicated. Include thermal conductivity, thickness, and jackets (both factory and field applied, if any).

1. Product Data for Credit EQ 4.1: For adhesives and sealants, including printed statement of VOC content.

B. Shop Drawings:

1. Detail application of protective shields, saddles, and inserts at hangers for each type of insulation and hanger.
2. Detail attachment and covering of heat tracing inside insulation.
3. Detail insulation application at pipe expansion joints for each type of insulation.
4. Detail insulation application at elbows, fittings, flanges, valves, and specialties for each type of insulation.
5. Detail removable insulation at piping specialties, equipment connections, and access panels.
6. Detail application of field-applied jackets.
7. Detail application at linkages of control devices.
8. Detail field application for each equipment type.

C. Samples: For each type of insulation and jacket indicated. Identify each Sample, describing product and intended use. Sample sizes are as follows:

1. Sample Sizes:

a. Preformed Pipe Insulation Materials: 12 inches long by NPS 2 .
b. Sheet Form Insulation Materials: 12 inches square.
c. Jacket Materials for Pipe: 12 inches long by NPS 2 .
d. Sheet Jacket Materials: 12 inches square.
e. Manufacturer's Color Charts: For products where color is specified, show the full range of colors available for each type of finish material.

D. Qualification Data: For qualified Installer.

E. Material Test Reports: From a qualified testing agency acceptable to authorities having jurisdiction indicating, interpreting, and certifying test results for compliance of insulation materials, sealers, attachments, cements, and jackets, with requirements indicated. Include dates of tests and test methods employed.

F. Field quality-control reports.

1.4 QUALITY ASSURANCE

A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.

B. Fire-Test-Response Characteristics: Insulation and related materials shall have fire-test-response characteristics indicated, as determined by testing identical products per ASTM E 84, by a testing and inspecting agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes,

and cement material containers, with appropriate markings of applicable testing and inspecting agency.

1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

C. Mockups: Before installing insulation, build mockups for each type of insulation and finish listed below to demonstrate quality of insulation application and finishes. Build mockups in the location indicated or, if not indicated, as directed by Architect. Use materials indicated for the completed Work.

1. Piping Mockups:

   a. One 10-foot section of NPS 2 straight pipe.
   b. One each of a 90-degree threaded, welded, and flanged elbow.
   c. One each of a threaded, welded, and flanged tee fitting.
   d. One NPS 2or smaller valve, and one NPS 2-1/2 or larger valve.
   e. Four support hangers including hanger shield and insert.
   f. One threaded strainer and one flanged strainer with removable portion of insulation.
   g. One threaded reducer and one welded reducer.
   h. One pressure temperature tap.
   i. One mechanical coupling.

2. Equipment Mockups: One tank or vessel.
3. For each mockup, fabricate cutaway sections to allow observation of application details for insulation materials, adhesives, mastics, attachments, and jackets.
4. Notify Architect seven days in advance of dates and times when mockups will be constructed.
5. Obtain Architect's approval of mockups before starting insulation application.
6. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless Architect specifically approves such deviations in writing.
7. Maintain mockups during construction in an undisturbed condition as a standard for judging the completed Work.
8. Demolish and remove mockups when directed.

1.5 DELIVERY, STORAGE, AND HANDLING

A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.6 COORDINATION

A. Coordinate size and location of supports, hangers, and insulation shields specified in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment."

B. Coordinate clearance requirements with piping Installer for piping insulation application and equipment Installer for equipment insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

C. Coordinate installation and testing of heat tracing.

1.7 SCHEDULING

A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.

B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

A. Comply with requirements in Part 3 schedule articles for where insulating materials shall be applied.

B. Products shall not contain asbestos, lead, mercury, or mercury compounds.

C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.

D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.

E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.

F. Cellular Glass: Inorganic, incombustible, foamed or cellulated glass with annealed, rigid, hermetically sealed cells. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

1. Products: Subject to compliance with requirements, provide one of the following

a. Cell-U-Foam Corporation; Ultra-CUF.

b. Pittsburgh Corning Corporation; Foamglas Super K.

2. Block Insulation: ASTM C 552, Type I.
3. Special-Shaped Insulation: ASTM C 552, Type III.
4. Board Insulation: ASTM C 552, Type IV.
5. Preformed Pipe Insulation without Jacket: Comply with ASTM C 552, Type II, Class 1.
6. Preformed Pipe Insulation with Factory-Applied ASJ: Comply with ASTM C 552, Type II, Class 2.
7. Factory fabricate shapes according to ASTM C 450 and ASTM C 585.

G. Flexible Elastomeric: Closed-cell, sponge- or expanded-rubber materials. Comply with ASTM C 534, Type I for tubular materials and Type II for sheet materials.

1. Products: Subject to compliance with requirements, provide one of the following

a. Aeroflex USA Inc.; Aerocel.
b. Armacell LLC; AP Armaflex.
c. RBX Corporation; Insul-Sheet 1800 and Insul-Tube 180.

H. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 553, Type II and ASTM C 1290, Type I. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

1. Products: Subject to compliance with requirements, provide one of the following:

a. CertainTeed Corp.; Duct Wrap.
b. Johns Manville; Microlite.
c. Knauf Insulation; Duct Wrap.
d. Manson Insulation Inc.; Alley Wrap.
e. Owens Corning; All-Service Duct Wrap.

I. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IA or Type IB. For equipment applications, provide insulation with factory-applied ASJ. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

1. Products: Subject to compliance with requirements, provide one of the following:

a. CertainTeed Corp.; Commercial Board.
b. Fibrex Insulations Inc.; FBX.
c. Johns Manville; 800 Series Spin-Glas.
d. Knauf Insulation; Insulation Board.
e. Manson Insulation Inc.; AK Board.
f. Owens Corning; Fiberglas 700 Series.

J. Mineral-Fiber, Preformed Pipe Insulation:

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Fibrex Insulations Inc.; Coreplus 1200.
    b. Johns Manville; Micro-Lok.
    c. Knauf Insulation; 1000(Pipe Insulation.
    d. Manson Insulation Inc.; Alley-K.
    e. Owens Corning; Fiberglas Pipe Insulation.

2. Type I, 850 deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with factory-applied ASJ. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

K. Mineral-Fiber, Pipe and Tank Insulation: Mineral or glass fibers bonded with a thermosetting resin. Semirigid board material with factory-applied ASJ complying with ASTM C 1393, Type II or Type IIIA Category 2, or with properties similar to ASTM C 612, Type IB. Nominal density is 3 lb/cu. ft. or more. Thermal conductivity (k-value) at 100 deg F is 0.29 Btu x in./h x sq. ft. x deg F or less. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. CertainTeed Corp.; CrimpWrap.
    b. Johns Manville; MicroFlex.
    c. Knauf Insulation; Pipe and Tank Insulation.
    d. Manson Insulation Inc.; AK Flex.
    e. Owens Corning; Fiberglas Pipe and Tank Insulation.

2.2 INSULATING CEMENTS

A. Mineral-Fiber Insulating Cement: Comply with ASTM C 195.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Insulco, Division of MFS, Inc.; Triple I.
    b. P. K. Insulation Mfg. Co., Inc.; Super-Stik.

B. Mineral-Fiber, Hydraulic-Setting Insulating and Finishing Cement: Comply with ASTM C 449/C 449M.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Insulco, Division of MFS, Inc.; SmoothKote.
    b. P. K. Insulation Mfg. Co., Inc.; PK No. 127, and Quik-Cote.
    c. Rock Wool Manufacturing Company; Delta One Shot.

2.3 ADHESIVES

A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.

B. Cellular-Glass, Phenolic, Polyisocyanurate, and Polystyrene Adhesive: Solvent-based resin adhesive, with a service temperature range of minus 75 to plus 300 deg F.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-96.
b. Foster Products Corporation, H. B. Fuller Company; 81-33.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

C. Flexible Elastomeric and Polyolefin Adhesive: Comply with MIL-A-24179A, Type II, Class I.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Aeroflex USA Inc.; Aeroseal.
b. Armacell LCC; 520 Adhesive.
c. Foster Products Corporation, H. B. Fuller Company; 85-75.
d. RBX Corporation; Rubatex Contact Adhesive.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

D. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-82.
b. Foster Products Corporation, H. B. Fuller Company; 85-20.
c. ITW TACC, Division of Illinois Tool Works; S-90/80.
d. Marathon Industries, Inc.; 225.
e. Mon-Eco Industries, Inc.; 22-25.

2. For indoor applications, use adhesive that has a VOC content of 80 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

E. ASJ Adhesive, and FSK and PVDC Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-82.
b. Foster Products Corporation, H. B. Fuller Company; 85-20.
c. ITW TACC, Division of Illinois Tool Works; S-90/80.

d. Marathon Industries, Inc.; 225.
e. Mon-Eco Industries, Inc.; 22-25.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

F. PVC Jacket Adhesive: Compatible with PVC jacket.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Dow Chemical Company (The); 739, Dow Silicone.
b. Johns-Manville; Zeston Perma-Weld, CEEL-TITE Solvent Welding Adhesive.
c. P.I.C. Plastics, Inc.; Welding Adhesive.
d. Speedline Corporation; Speedline Vinyl Adhesive.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.4 MASTICS

A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-C-19565C, Type II.

1. For indoor applications, use mastics that have a VOC content in compliance with 40 CFR 59, Subpart D (EPA Method 24).

B. Vapor-Barrier Mastic: Water based; suitable for indoor and outdoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-35.
b. Foster Products Corporation, H. B. Fuller Company; 30-90.
c. ITW TACC, Division of Illinois Tool Works; CB-50.
d. Marathon Industries, Inc.; 590.
e. Mon-Eco Industries, Inc.; 55-40.
f. Vimasco Corporation; 749.

2. Water-Vapor Permeance: ASTM E 96, Procedure B, 0.013 perm at 43-mil dry film thickness.
3. Service Temperature Range: Minus 20 to plus 180 deg F.
4. Solids Content: ASTM D 1644, 59 percent by volume and 71 percent by weight.
5. Color: White.

C. Vapor-Barrier Mastic: Solvent based; suitable for indoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Childers Products, Division of ITW; CP-30.
    b. Foster Products Corporation, H. B. Fuller Company; 30-35.
    c. ITW TACC, Division of Illinois Tool Works; CB-25.
    d. Marathon Industries, Inc.; 501.
    e. Mon-Eco Industries, Inc.; 55-10.

2. Water-Vapor Permeance: ASTM F 1249, 0.05 perm at 35-mil dry film thickness.
3. Service Temperature Range: 0 to 180 deg F.
4. Solids Content: ASTM D 1644, 44 percent by volume and 62 percent by weight.
5. Color: White.

D. Vapor-Barrier Mastic: Solvent based; suitable for outdoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Childers Products, Division of ITW; Encacel.
    b. Foster Products Corporation, H. B. Fuller Company; 60-95/60-96.
    c. Marathon Industries, Inc.; 570.
    d. Mon-Eco Industries, Inc.; 55-70.

2. Water-Vapor Permeance: ASTM F 1249, 0.05 perm at 30-mil dry film thickness.
3. Service Temperature Range: Minus 50 to plus 220 deg F.
4. Solids Content: ASTM D 1644, 33 percent by volume and 46 percent by weight.
5. Color: White.

E. Breather Mastic: Water based; suitable for indoor and outdoor use on above ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Childers Products, Division of ITW; CP-10.
    b. Foster Products Corporation, H. B. Fuller Company; 35-00.
    c. ITW TACC, Division of Illinois Tool Works; CB-05/15.
    d. Marathon Industries, Inc.; 550.
    e. Mon-Eco Industries, Inc.; 55-50.
    f. Vimasco Corporation; WC-1/WC-5.

2. Water-Vapor Permeance: ASTM F 1249, 3 perms at 0.0625-inch dry film thickness.
3. Service Temperature Range: Minus 20 to plus 200 deg F
4. Solids Content: 63 percent by volume and 73 percent by weight.
5. Color: White.

2.5 SEALANTS

A. Joint Sealants:

1. Joint Sealants for Cellular-Glass, Phenolic, and Polyisocyanurate Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-76.
   b. Foster Products Corporation, H. B. Fuller Company; 30-45.
   c. Marathon Industries, Inc.; 405.
   d. Mon-Eco Industries, Inc.; 44-05.
   e. Pittsburgh Corning Corporation; Pittseal 444.
   f. Vimasco Corporation; 750.

B. FSK and Metal Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-76-8.
   b. Foster Products Corporation, H. B. Fuller Company; 95-44.
   c. Marathon Industries, Inc.; 405.
   d. Mon-Eco Industries, Inc.; 44-05.
   e. Vimasco Corporation; 750.

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F
5. Color: Aluminum.
6. For indoor applications, use sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

C. ASJ Flashing Sealants, and Vinyl, PVDC, and PVC Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-76.

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F
5. Color: White.
6. For indoor applications, use sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.6 FACTORY-APPLIED JACKETS

A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:

1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.
3. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C 1136, Type II.
4. PVDC Jacket for Indoor Applications: 4-mil- thick, white PVDC biaxially oriented barrier film with a permeance at 0.02 perms when tested according to ASTM E 96 and with a flame-spread index of 5 and a smoke-developed index of 20 when tested according to ASTM E 84.

    a. Products: Subject to compliance with requirements, provide one of the following:

        1) Dow Chemical Company (The); Saran 540 Vapor Retarder Film and Saran 560 Vapor Retarder Film.

5. PVDC Jacket for Outdoor Applications: 6-mil- thick, white PVDC biaxially oriented barrier film with a permeance at 0.01 perms when tested according to ASTM E 96 and with a flame-spread index of 5 and a smoke-developed index of 25 when tested according to ASTM E 84.

    a. Products: Subject to compliance with requirements, provide one of the following:

        1) Dow Chemical Company (The); Saran 540 Vapor Retarder Film and Saran 560 Vapor Retarder Film.

6. PVDC-SSL Jacket: PVDC jacket with a self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip.

    a. Products: Subject to compliance with requirements, provide one of the following:

        1) Dow Chemical Company (The); Saran 540 Vapor Retarder Film and Saran 560 Vapor Retarder Film.

2.7 FIELD-APPLIED JACKETS

A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.

B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Johns Manville; Zeston.
b. P.I.C. Plastics, Inc.; FG Series.
c. Proto PVC Corporation; LoSmoke.
d. Speedline Corporation; SmokeSafe.

2. Adhesive: As recommended by jacket material manufacturer.
3. Color: White Factory-fabricated fitting covers to match jacket if available; otherwise, field fabricate.

a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, mechanical joints, and P-trap and supply covers for lavatories.

4. Factory-fabricated tank heads and tank side panels.

C. Metal Jacket:

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; Metal Jacketing Systems.
b. PABCO Metals Corporation; Surefit.
c. RPR Products, Inc.; Insul-Mate.

2. Aluminum Jacket: Comply with ASTM B 209 Alloy 3003, 3005, 3105 or 5005, Temper H-14.

a. Factory cut and rolled to size.
b. Finish and thickness are indicated in field-applied jacket schedules.
c. Moisture Barrier for Indoor Applications: 3-mil- thick, heat-bonded polyethylene and kraft paper.
d. Moisture Barrier for Outdoor Applications: 3-mil- thick, heat-bonded polyethylene and kraft paper.
e. Factory-Fabricated Fitting Covers:

1) Same material, finish, and thickness as jacket.
2) Preformed 2-piece or gore, 45- and 90-degree, short- and long-radius elbows.
3) Tee covers.
4) Flange and union covers.
5) End caps.
6) Beveled collars.
7) Valve covers.
8) Field fabricate fitting covers only if factory-fabricated fitting covers are not available.

D. Underground Direct-Buried Jacket: 125-mil- thick vapor barrier and waterproofing membrane consisting of a rubberized bituminous resin reinforced with a woven-glass fiber or polyester scrim and laminated aluminum foil.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Pittsburgh Corning Corporation; Pittwrap.
   b. Polyguard; Insulrap No Torch 125.

2.8 TAPES

A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0835.
   b. Compac Corp.; 104 and 105.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 428 AWF ASJ.
   d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.

2. Width: 3 inches .
3. Thickness: 11.5 mils.
4. Adhesion: 90 ounces force/inch in width.
5. Elongation: 2 percent.
6. Tensile Strength: 40 lbf/inch in width.
7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.

B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0827.
   b. Compac Corp.; 110 and 111.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 491 AWF FSK.
   d. Venture Tape; 1525 CW, 1528 CW, and 1528 CW/SQ.

2. Width: 3 inches .
3. Thickness: 6.5 mils .
4. Adhesion: 90 ounces force/inch in width.
5. Elongation: 2 percent.
6. Tensile Strength: 40 lbf/inch in width.
7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.

C. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive. Suitable for indoor and outdoor applications.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0555.

b. Compac Corp.; 130.
c. Ideal Tape Co., Inc., an American Biltrite Company; 370 White PVC tape.
d. Venture Tape; 1506 CW NS.

2. Width: 2 inches .
3. Thickness: 6 mils .
4. Adhesion: 64 ounces force/inch in width.
5. Elongation: 500 percent.
6. Tensile Strength: 18 lbf/inch in width.

D. Aluminum-Foil Tape: Vapor-retarder tape with acrylic adhesive.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0800.
b. Compac Corp.; 120.
c. Ideal Tape Co., Inc., an American Biltrite Company; 488 AWF.
d. Venture Tape; 3520 CW.

2. Width: 2 inches .
3. Thickness: 3.7 mils .
4. Adhesion: 100 ounces force/inch in width.
5. Elongation: 5 percent.
6. Tensile Strength: 34 lbf/inch in width.

E. PVDC Tape: White vapor-retarder PVDC tape with acrylic adhesive.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Dow Chemical Company (The); Saran 540 Vapor Retarder Tape.

2. Width: 3 inches
3. Film Thickness: 6 mils
4. Adhesive Thickness: 1.5 mils
5. Elongation at Break: 145 percent.
6. Tensile Strength: 55 lbf/inch in width.

2.9 SECUREMENTS

A. Bands:

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products; Bands.
b. PABCO Metals Corporation; Bands.
c. RPR Products, Inc.; Bands.

2. Stainless Steel: ASTM A 167 or ASTM A 240/A 240M, Type 304 0.015 inch thick, 3/4 inch wide with wing or closed seal.

3. Aluminum: ASTM B 209 , Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with wing or closed seal.
4. Springs: Twin spring set constructed of stainless steel with ends flat and slotted to accept metal bands. Spring size determined by manufacturer for application.

B. Insulation Pins and Hangers:

1. Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch- diameter shank, length to suit depth of insulation indicated.

2. Products: Subject to compliance with requirements, provide one of the following:

    1) AGM Industries, Inc.; CWP-1.
    2) GEMCO; CD.
    3) Midwest Fasteners, Inc.; CD.
    4) Nelson Stud Welding; TPA, TPC, and TPS.

3. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch- diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.

    a. Products: Subject to compliance with requirements, provide one of the following:

        1) AGM Industries, Inc.; CWP-1.
        2) GEMCO; Cupped Head Weld Pin.
        3) Midwest Fasteners, Inc.; Cupped Head.
        4) Nelson Stud Welding; CHP.

4. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick, galvanized-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.

    a. Products: Subject to compliance with requirements, provide one of the following:

        1) AGM Industries, Inc.; RC-150.
        2) GEMCO; R-150.
        3) Midwest Fasteners, Inc.; WA-150.
        4) Nelson Stud Welding; Speed Clips.

    b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.

C. Staples: Outward-clinching insulation staples, nominal 3/4-inch- wide, stainless steel or Monel.

D. Wire: 0.080-inch nickel-copper alloy, 0.062-inch soft-annealed, stainless steel or 0.062-inch soft-annealed, galvanized steel.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. C & F Wire.
b. Childers Products.
c. PABCO Metals Corporation.
d. RPR Products, Inc.

2.10 CORNER ANGLES

A. PVC Corner Angles: 30 mils thick, minimum 1 by 1 inch, PVC according to ASTM D 1784, Class 16354-C. White or color-coded to match adjacent surface.

B. Aluminum Corner Angles: 0.040 inch thick, minimum 1 by 1 inch , aluminum according to ASTM B 209 , Alloy 3003, 3005, 3105 or 5005; Temper H-14.

C. Stainless-Steel Corner Angles: 0.024 inch thick, minimum 1 by 1 inch , stainless steel according to ASTM A 167 or ASTM A 240/A 240M, Type 304.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine substrates and conditions for compliance with requirements for installation and other conditions affecting performance of insulation application.

1. Verify that systems and equipment to be insulated have been tested and are free of defects.
2. Verify that surfaces to be insulated are clean and dry.
3. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

B. Surface Preparation: Clean and prepare surfaces to be insulated. Before insulating, apply a corrosion coating to insulated surfaces as follows:

1. Stainless Steel: Coat 300 series stainless steel with an epoxy primer 5 mils thick and an epoxy finish 5 mils thick if operating in a temperature range between 140 and 300 deg F Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
2. Carbon Steel: Coat carbon steel operating at a service temperature between 32 and 300 deg F with an epoxy coating. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.

C. Coordinate insulation installation with the trade installing heat tracing. Comply with requirements for heat tracing that apply to insulation.

D. Mix insulating cements with clean potable water; if insulating cements are to be in contact with stainless-steel surfaces, use demineralized water.

3.3 GENERAL INSTALLATION REQUIREMENTS

A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of equipment and piping including fittings, valves, and specialties.

B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of equipment and pipe system as specified in insulation system schedules.

C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.

D. Install insulation with longitudinal seams at top and bottom of horizontal runs.

E. Install multiple layers of insulation with longitudinal and end seams staggered.

F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.

G. Keep insulation materials dry during application and finishing.

H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.

I. Provide an additional one hundred feet of preformed insulation and fifty square feet of blanket and board type insulation as well as accessories and labor for each size, thickness and type used on the project to accommodate any changes required to resolve interferences or as directed by the Engineer.

J. Install insulation with least number of joints practical.

K. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.

1. Install insulation continuously through hangers and around anchor attachments.
2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.

L. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.

M. Install insulation with factory-applied jackets as follows:

1. Draw jacket tight and smooth.
2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
3. Overlap jacket longitudinal seams at least 1-1/2 inches Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 4 inches o.c.

    a. For below ambient services, apply vapor-barrier mastic over staples.

4. Cover joints and seams with tape as recommended by insulation material manufacturer to maintain vapor seal.
5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.

N. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.

O. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.

P. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.

Q. For above ambient services, do not install insulation to the following:

1. Vibration-control devices.
2. Testing agency labels and stamps.

3. Nameplates and data plates.
4. Manholes.
5. Handholes.
6. Cleanouts.

3.4 PENETRATIONS

A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.

1. Seal penetrations with flashing sealant.
2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
4. Seal jacket to roof flashing with flashing sealant.

B. Insulation Installation at Underground Exterior Wall Penetrations: Terminate insulation flush with sleeve seal. Seal terminations with flashing sealant.

C. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.

1. Seal penetrations with flashing sealant.
2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches .
4. Seal jacket to wall flashing with flashing sealant.

D. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.

E. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.

1. Comply with requirements in Division 07 Section "Penetration Firestopping"irestopping and fire-resistive joint sealers.

F. Insulation Installation at Floor Penetrations:

1. Pipe: Install insulation continuously through floor penetrations.
2. Seal penetrations through fire-rated assemblies. Comply with requirements in Division 07 Section "Penetration Firestopping."

3.5 EQUIPMENT, TANK, AND VESSEL INSULATION INSTALLATION

A. Mineral Fiber, Pipe and Tank Insulation Installation for Tanks and Vessels: Secure insulation with adhesive and anchor pins and speed washers.

1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of tank and vessel surfaces.
2. Groove and score insulation materials to fit as closely as possible to equipment, including contours. Bevel insulation edges for cylindrical surfaces for tight joints. Stagger end joints.
3. Protect exposed corners with secured corner angles.
4. Install adhesively attached or self-sticking insulation hangers and speed washers on sides of tanks and vessels as follows:

    a. Do not weld anchor pins to ASME-labeled pressure vessels.
    b. Select insulation hangers and adhesive that are compatible with service temperature and with substrate.
    c. On tanks and vessels, maximum anchor-pin spacing is 3 inches from insulation end joints, and 16 inches o.c. in both directions.
    d. Do not overcompress insulation during installation.
    e. Cut and miter insulation segments to fit curved sides and domed heads of tanks and vessels.
    f. Impale insulation over anchor pins and attach speed washers.
    g. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.

5. Secure each layer of insulation with stainless-steel or aluminum bands. Select band material compatible with insulation materials.
6. Where insulation hangers on equipment and vessels are not permitted or practical and where insulation support rings are not provided, install a girdle network for securing insulation. Stretch prestressed aircraft cable around the diameter of vessel and make taut with clamps, turnbuckles, or breather springs. Place one circumferential girdle around equipment approximately 6 inches from each end. Install wire or cable between two circumferential girdles 12 inches o.c. Install a wire ring around each end and around outer periphery of center openings, and stretch prestressed aircraft cable radially from the wire ring to nearest circumferential girdle. Install additional circumferential girdles along the body of equipment or tank at a minimum spacing of 48 inches o.c. Use this network for securing insulation with tie wire or bands.
7. Stagger joints between insulation layers at least 3 inches
8. Install insulation in removable segments on equipment access doors, manholes, handholes, and other elements that require frequent removal for service and inspection.
9. Bevel and seal insulation ends around manholes, handholes, ASME stamps, and nameplates.
10. For equipment with surface temperatures below ambient, apply mastic to open ends, joints, seams, breaks, and punctures in insulation.

B. Flexible Elastomeric Thermal Insulation Installation for Tanks and Vessels: Install insulation over entire surface of tanks and vessels.

1. Apply 100 percent coverage of adhesive to surface with manufacturer's recommended adhesive.
2. Seal longitudinal seams and end joints.

C. Insulation Installation on Pumps:

1. Fabricate metal boxes lined with insulation. Fit boxes around pumps and coincide box joints with splits in pump casings. Fabricate joints with outward bolted flanges. Bolt flanges on 6-inch centers, starting at corners. Install 3/8-inch-diameter fasteners with wing nuts. Alternatively, secure the box sections together using a latching mechanism.
2. Fabricate boxes from aluminum, at least 0.060 inch thick.
3. For below ambient services, install a vapor barrier at seams, joints, and penetrations. Seal between flanges with replaceable gasket material to form a vapor barrier.

3.6 GENERAL PIPE INSULATION INSTALLATION

A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.

B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:

1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity, unless otherwise indicated.
2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe

insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below ambient services, provide a design that maintains vapor barrier.

6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.
7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below ambient services and a breather mastic for above ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
8. For services not specified to receive a field-applied jacket except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
9. Stencil or label the outside insulation jacket of each union with the word "UNION." Match size and color of pipe labels.

C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes, vessels, and equipment. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.

D. Install removable insulation covers at locations indicated. Installation shall conform to the following:

1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
3. Construct removable valve insulation covers in same manner as for flanges except divide the two-part section on the vertical center line of valve body.
4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches (50 mm) over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.
5. Unless a PVC jacket is indicated in field-applied jacket schedules, finish exposed surfaces with a metal jacket.

3.7 CELLULAR-GLASS INSULATION INSTALLATION

A. Insulation Installation on Straight Pipes and Tubes:

1. Secure each layer of insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above ambient services, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below ambient services, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

B. Insulation Installation on Pipe Flanges:

1. Install preformed pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of cellular-glass block insulation of same thickness as pipe insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch , and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available. Secure according to manufacturer's written instructions.
2. When preformed sections of insulation are not available, install mitered sections of cellular-glass insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of cellular-glass insulation to valve body.
2. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
3. Install insulation to flanges as specified for flange insulation application.

3.8 FLEXIBLE ELASTOMERIC INSULATION INSTALLATION

A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

B. Insulation Installation on Pipe Flanges:

1. Install pipe insulation to outer diameter of pipe flange.

2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as pipe insulation.
4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install mitered sections of pipe insulation.
2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed valve covers manufactured of same material as pipe insulation when available.
2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
3. Install insulation to flanges as specified for flange insulation application.
4. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

3.9 MINERAL-FIBER INSULATION INSTALLATION

A. Insulation Installation on Straight Pipes and Tubes:

1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below ambient surfaces, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

B. Insulation Installation on Pipe Flanges:

1. Install preformed pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.

3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

3.10 FIELD-APPLIED JACKET INSTALLATION

A. Where glass-cloth jackets are indicated, install directly over bare insulation or insulation with factory-applied jackets.

1. Draw jacket smooth and tight to surface with 2-inch overlap at seams and joints.
2. Embed glass cloth between two 0.062-inch- thick coats of lagging adhesive.
3. Completely encapsulate insulation with coating, leaving no exposed insulation.

B. Where FSK jackets are indicated, install as follows:

1. Draw jacket material smooth and tight.
2. Install lap or joint strips with same material as jacket.
3. Secure jacket to insulation with manufacturer's recommended adhesive.
4. Install jacket with 1-1/2-inch laps at longitudinal seams and 3-inch- wide joint strips at end joints.
5. Seal openings, punctures, and breaks in vapor-retarder jackets and exposed insulation with vapor-barrier mastic.

C. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications, install with longitudinal seams along top and bottom of tanks and vessels. Seal with manufacturer's recommended adhesive.

1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.

D. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless-steel bands 12 inches o.c. and at end joints.

E. Where PVDC jackets are indicated, install as follows:

1. Apply three separate wraps of filament tape per insulation section to secure pipe insulation to pipe prior to installation of PVDC jacket.
2. Wrap factory-presized jackets around individual pipe insulation sections with one end overlapping the previously installed sheet. Install presized jacket with an approximate overlap at butt joint of 2 inches over the previous section. Adhere lap seal using adhesive or SSL, and then apply 1-1/4 circumferences of appropriate PVDC tape around overlapped butt joint.
3. Continuous jacket can be spiral wrapped around a length of pipe insulation. Apply adhesive or PVDC tape at overlapped spiral edge. When electing to use adhesives, refer to manufacturer's written instructions for application of adhesives along this spiral edge to maintain a permanent bond.
4. Jacket can be wrapped in cigarette fashion along length of roll for insulation systems with an outer circumference of 33-1/2 inches or less. The 33-1/2-inch-circumference limit allows for 2-inch- overlap seal. Using the length of roll allows for longer sections of jacket to be installed at one time. Use adhesive on the lap seal. Visually inspect lap seal for "fishmouthing," and use PVDC tape along lap seal to secure joint.
5. Repair holes or tears in PVDC jacket by placing PVDC tape over the hole or tear and wrapping a minimum of 1-1/4 circumferences to avoid damage to tape edges.

3.11 FINISHES

A. Equipment and Pipe Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Division 09 painting Sections.

1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.

a. Finish Coat Material: Interior, flat, latex-emulsion size.

B. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.

C. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.

D. Do not field paint aluminum or stainless-steel jackets.

3.12 FIELD QUALITY CONTROL

A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.

B. Perform tests and inspections.

C. Tests and Inspections:

1. Inspect field-insulated equipment, randomly selected by the Engineer, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to ten location(s) for each type of equipment defined in the "Equipment Insulation Schedule" Article. For large equipment, remove only a portion adequate to determine compliance.
2. Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to ten locations of straight pipe, ten locations of threaded fittings, ten locations of welded fittings, five locations of threaded strainers, five locations of welded strainers, five locations of threaded valves, and five locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.

D. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

3.13 EQUIPMENT INSULATION SCHEDULE

A. Insulation materials and thicknesses are identified below. If more than one material is listed for a type of equipment, selection from materials listed is Contractor's option.

B. Insulate indoor and outdoor equipment in paragraphs below that is not factory insulated.

C. Domestic water pump insulation shall be the following:
1. Mineral-Fiber Board: 2 inches thick and 3-lb/cu. ft. nominal density.

D. Domestic chilled-water (potable) pump insulation shall be the following:
1. Mineral-Fiber Board: 2 inches thick and 3-lb/cu. ft. nominal density.

E. Domestic hot-water pump insulation shall be the following:
1. Mineral-Fiber Board: 2 inches thick and 3-lb/cu. ft. nominal density.

F. Domestic water, domestic chilled-water (potable), and domestic hot-water hydropneumatic tank insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

G. Domestic hot-water storage tank insulation shall be the following, of thickness to provide an R-value of 12.5:

1. Mineral-fiber pipe and tank.

H. Domestic water storage tank insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

I. Domestic chilled-water (potable) storage tank insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

J. Piping system filter-housing insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

3.14 PIPING INSULATION SCHEDULE, GENERAL

A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.

B. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:

1. Drainage piping located in crawl spaces.
2. Underground piping.
3. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

3.15 INDOOR PIPING INSULATION SCHEDULE

A. Domestic Cold Water:

1. NPS 1 and Smaller: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

2. NPS 1-1/4 and Larger: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

B. Domestic Hot and Recirculated Hot Water:

1. NPS 1-1/4 and Smaller: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

2. NPS 1-1/2 and Larger: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

C. Domestic Chilled Water (Potable):

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

D. Stormwater and Overflow:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

E. Roof Drain and Overflow Drain Bodies:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

F. Exposed Sanitary Drains, Domestic Water, Domestic Hot Water, and Stops for Plumbing Fixtures for People with Disabilities:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

G. Sanitary Waste Piping Where Heat Tracing Is Installed:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

H. Condensate and Equipment Drain Water below 60 Deg F:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1- inch thick.

I. Floor Drains, Traps, and Sanitary Drain Piping within 10 Feet of Drain Receiving Condensate and Equipment Drain Water below 60 Deg F:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.

J. Hot Service Drains:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe, Type I or II: 1-1/2 inches thick.

3.16 OUTDOOR, ABOVEGROUND PIPING INSULATION SCHEDULE

A. Domestic Water Piping:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 2 inches thick.

B. Domestic Hot and Recirculated Hot Water:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 2 inches thick.

C. Sanitary Waste Piping Where Heat Tracing Is Installed:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 2 inches thick.

D. Hot Service Drains:

1. All Pipe Sizes: Insulation shall be the following:
   a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 2 inches thick.

3.17 OUTDOOR, UNDERGROUND PIPING INSULATION SCHEDULE

A. Loose-fill insulation, for belowground piping, is specified in Division 33 piping distribution Sections.

B. Sanitary Waste Piping, All Sizes, Where Heat Tracing Is Installed: Cellular glass, 2 inches thick.

C. Chilled Domestic Water, All Sizes: Cellular glass, 2 inches thick.

3.18 INDOOR, FIELD-APPLIED JACKET SCHEDULE

A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.

B. If more than one material is listed, selection from materials listed is Contractor's option.

C. Equipment, Concealed:
1. Paper & Foil with Vapor Retarder

D. Equipment, Exposed, up to 48 Inches in Diameter or with Flat Surfaces up to 72 Inches :
1. PVC 30 mils thick.

E. Equipment, Exposed, Larger Than 48 Inches in Diameter or with Flat Surfaces Larger Than 72 Inches :
1. Painted Aluminum Smooth 0.032 inch thick.

F. Piping, Concealed:
1. Paper & Foil with Vapor Retarder

G. Piping, Exposed:
1. PVC 30 mils thick

3.19 OUTDOOR, FIELD-APPLIED JACKET SCHEDULE

A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.

B. If more than one material is listed, selection from materials listed is Contractor's option.

C. Equipment, Concealed:
   1. Aluminum, Smooth 0.040 inch thick.

D. Equipment, Exposed, up to 48 Inches in Diameter or with Flat Surfaces up to 72 Inches :
   1. Aluminum, Smooth 0.040 inch thick.

E. Equipment, Exposed, Larger Than 48 Inches in Diameter or with Flat Surfaces Larger Than 72 Inches
   1. Aluminum, Smooth 0.040 inch thick.

F. Piping, Concealed:
   1. Aluminum, Smooth 0.040 inch thick.

G. Piping, Exposed:
   1. Aluminum, Smooth 0.040 inch thick.

3.20 UNDERGROUND, FIELD-INSTALLED INSULATION JACKET

A. For underground direct-buried piping applications, install underground direct-buried jacket over insulation material.

END OF SECTION 220700

SECTION 221113

FACILITY WATER DISTRIBUTION PIPING

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes water-distribution piping and related components outside the building for water service mains.

B. Utility-furnished products include water meters that will be furnished to the site, ready for installation.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings: Detail precast concrete vault assemblies and indicate dimensions, method of field assembly, and components.

1.3 INFORMATIONAL SUBMITTALS

A. Field quality-control test reports.

1.4 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

1.5 QUALITY ASSURANCE

A. Regulatory Requirements:

1. Comply with requirements of utility company supplying water. Include tapping of water mains and backflow prevention.
2. Comply with standards of authorities having jurisdiction for potable-water-service piping, including materials, installation, testing, and disinfection.
3. Comply with standards of authorities having jurisdiction for fire-suppression water-service piping, including materials, hose threads, installation, and testing.

B. Piping materials shall bear label, stamp, or other markings of specified testing agency.

C. Comply with ASTM F 645 for selection, design, and installation of thermoplastic water piping.

D. Comply with FMG's "Approval Guide" or UL's "Fire Protection Equipment Directory" for fire-service-main products.

E. NFPA Compliance: Comply with NFPA 24 for materials, installations, tests, flushing, and valve and hydrant supervision for fire-service-main piping for fire suppression.

F. NSF Compliance:

1. Comply with NSF 14 for plastic potable-water-service piping. Include marking "NSF-pw" on piping.
2. Comply with NSF 61 Annex G for materials for water-service piping and specialties for domestic water.

1.6 PROJECT CONDITIONS

A. Interruption of Existing Water-Distribution Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water-distribution service according to requirements indicated:

1. Notify Architect no fewer than two days in advance of proposed interruption of service.
2. Do not proceed with interruption of water-distribution service without Architect's written permission.

1.7 COORDINATION

A. Coordinate connection to water main with utility company.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS

A. Soft Copper Tube: ASTM B 88, Type K, water tube, annealed temper.

1. Copper, Solder-Joint Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint pressure type. Furnish only wrought-copper fittings if indicated.

B. Hard Copper Tube: ASTM B 88, Type K, water tube, drawn temper.

1. Copper, Solder-Joint Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint pressure type. Furnish only wrought-copper fittings if indicated.

C. Mechanical-Joint, Ductile-Iron Pipe: AWWA C151, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated.

1. Mechanical-Joint, Ductile-Iron Fittings: AWWA C110, ductile- or gray-iron standard pattern or AWWA C153, ductile-iron compact pattern.
2. Glands, Gaskets, and Bolts: AWWA C111, ductile- or gray-iron glands, rubber gaskets, and steel bolts.

2.2 JOINING MATERIALS

A. Refer to Section 330500 "Common Work Results for Utilities" for commonly used joining materials.

B. Brazing Filler Metals: AWS A5.8, BCuP Series.

C. Bonding Adhesive for Fiberglass Piping: As recommended by fiberglass piping manufacturer.

D. Plastic Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

2.3 PIPING SPECIALTIES

A. Transition Fittings: Manufactured fitting or coupling same size as, with pressure rating at least equal to and ends compatible with, piping to be joined.

B. Tubular-Sleeve Pipe Couplings:

1. Description: Metal, bolted, sleeve-type, reducing or transition coupling, with center sleeve, gaskets, end rings, and bolt fasteners and with ends of same sizes as piping to be joined.

    a. Standard: AWWA C219.

2.4 GATE VALVES

A. AWWA, Cast-Iron Gate Valves:

1. Nonrising-Stem, Resilient-Seated Gate Valves:

    a. Description: Gray- or ductile-iron body and bonnet; with bronze or gray- or ductile-iron gate, resilient seats, bronze stem, and stem nut.

        1) Standard: AWWA C509.
        2) Minimum Pressure Rating: 200 psig (1380 kPa).
        3) End Connections: Mechanical joint.
        4) Interior Coating: Complying with AWWA C550.

2.5 GATE VALVE ACCESSORIES AND SPECIALTIES

A. Tapping-Sleeve Assemblies:

1. Description: Sleeve and valve compatible with drilling machine.

    a. Standard: MSS SP-60.
    b. Tapping Sleeve: Cast- or ductile-iron or stainless-steel, two-piece bolted sleeve with flanged outlet for new branch connection. Include sleeve matching size and type of pipe material being tapped and with recessed flange for branch valve.
    c. Valve: AWWA, cast-iron, nonrising-stem, resilient-seated gate valve with one raised face flange mating tapping-sleeve flange.

B. Valve Boxes: Comply with AWWA M44 for cast-iron valve boxes. Include top section, adjustable extension of length required for depth of burial of valve, plug with lettering "WATER," and bottom section with base that fits over valve and with a barrel approximately 5 inches (125 mm) in diameter.

1. Operating Wrenches: Steel, tee-handle with one pointed end, stem of length to operate deepest buried valve, and socket matching valve operating nut.

C. Indicator Posts: UL 789, FMG-approved, vertical-type, cast-iron body with operating wrench, extension rod, and adjustable cast-iron barrel of length required for depth of burial of valve.

2.6 CORPORATION VALVES AND CURB VALVES

A. Service-Saddle Assemblies: Comply with AWWA C800. Include saddle and valve compatible with tapping machine.

1. Service Saddle: Copper alloy with seal and AWWA C800, threaded outlet for corporation valve.
2. Corporation Valve: Bronze body and ground-key plug, with AWWA C800, threaded inlet and outlet matching service piping material.
3. Manifold: Copper fitting with two to four inlets as required, with ends matching corporation valves and outlet matching service piping material.

B. Curb Valves: Comply with AWWA C800. Include bronze body, ground-key plug or ball, and wide tee head, with inlet and outlet matching service piping material.

C. Service Boxes for Curb Valves: Similar to AWWA M44 requirements for cast-iron valve boxes. Include cast-iron telescoping top section of length required for depth of burial of valve, plug with lettering "WATER," and bottom section with base that fits over curb valve and with a barrel approximately 3 inches (75 mm) in diameter.

1. Shutoff Rods: Steel, tee-handle with one pointed end, stem of length to operate deepest buried valve, and slotted end matching curb valve.

2.7 WATER METERS

A. Water meters will be furnished by utility company.

2.8 CONCRETE VAULTS

A. Description: Precast, reinforced-concrete vault, designed for A-16 load designation according to ASTM C 857 and made according to ASTM C 858. See plans for typical detail. All work shall be coordinated with water company.

2.9 FIRE HYDRANTS

A. Wet-Barrel Fire Hydrants:

1. Description: Freestanding, with one NPS 4-1/2 (DN 115) and two NPS 2-1/2 (DN 65) outlets, NPS 6 (DN 150) threaded or flanged inlet, and base section with NPS 6 (DN 150) mechanical-joint inlet. Include interior coating according to AWWA C550.

    a. Standard: AWWA C503.
    b. Pressure Rating: 150 psig (1035 kPa) minimum.

PART 3 - EXECUTION

3.1 EARTHWORK

A. Refer to Section 312000 "Earth Moving" for excavating, trenching, and backfilling.

3.2 PIPING APPLICATIONS

A. General: Use pipe, fittings, and joining methods for piping systems according to the following applications.

B. Transition couplings and special fittings with pressure ratings at least equal to piping pressure rating may be used, unless otherwise indicated.

C. Do not use flanges or unions for underground piping.

D. Flanges, unions, and special fittings may be used, instead of joints indicated, on aboveground piping and piping in vaults.

E. Underground water-service piping NPS 3/4 to NPS 3 (DN 20 to DN 80) shall be soft copper tube, ASTM B 88, Type K (ASTM B 88M, Type A); wrought-copper, solder-joint fittings; and brazed joints.

F. Water Meter Box Water-Service Piping NPS 3/4 to NPS 2 (DN 20 to DN 50) shall be same as underground water-service piping.

G. Aboveground and Vault Water-Service Piping NPS 3/4 to NPS 3 (DN 20 to DN 80) shall be hard copper tube, ASTM B 88, Type K (ASTM B 88M, Type A); wrought-copper, solder-joint fittings; and brazed joints.

H. Aboveground and vault water-service piping NPS 4 and NPS 6 (DN 100 and DN 150) shall be the following:

1. Ductile-iron, grooved-end pipe; ductile-iron, grooved-end appurtenances; and grooved joints.

I. Underground Fire-Service-Main Piping NPS 4 to NPS 8 (DN 100 to DN 200) shall be the following:

1. Ductile-iron, mechanical-joint pipe; ductile-iron, mechanical-joint fittings; and mechanical joints.

J. Aboveground and Vault Fire-Service-Main Piping NPS 4 to NPS 8 (DN 100 to DN 200) shall be ductile-iron, grooved-end pipe; ductile-iron-pipe appurtenances; and grooved joints.

3.3 VALVE APPLICATIONS

A. General Application: Use mechanical-joint-end valves for NPS 3 (DN 80) and larger underground installation. Use threaded- or flanged-end valves for installation in vaults. Use UL/FMG, nonrising-stem gate valves for installation with indicator posts. Use corporation valves and curb valves with ends compatible with piping, for NPS 2 (DN 50) and smaller installation.

3.4 PIPING SYSTEMS - COMMON REQUIREMENTS

A. See Section 330500 "Common Work Results for Utilities" for piping-system common requirements.

3.5 PIPING INSTALLATION

A. Water-Main Connection: To be performed by utility company.

B. Comply with NFPA 24 for fire-service-main piping materials and installation.

1. Install copper tube and fittings according to CDA's "Copper Tube Handbook."

C. Install ductile-iron, water-service piping according to AWWA C600 and AWWA M41.

D. Bury piping with depth of cover over top at least 30 inches, with top at least 12 inches below level of maximum frost penetration.

E. Extend water-service piping and connect to water-supply source and building-water-piping systems at outside face of building wall in locations and pipe sizes indicated.

1. Terminate water-service piping at building wall until building-water-piping systems are installed. Terminate piping with caps, plugs, or flanges as required for piping material. Make connections to building-water-piping systems when those systems are installed.

F. Sleeves are specified in Section 220517 "Sleeves and Sleeve Seals for Plumbing Piping."

G. Install underground piping with restrained joints at horizontal and vertical changes in direction. Use restrained-joint piping, thrust blocks, anchors, tie-rods and clamps, and other supports.

3.6 JOINT CONSTRUCTION

A. Make pipe joints according to the following:

1. Ductile-Iron Piping, Gasketed Joints for Fire-Service-Main Piping: UL 194.
2. Dissimilar Materials Piping Joints: Use adapters compatible with both piping materials, with OD, and with system working pressure.

3.7 ANCHORAGE INSTALLATION

A. Anchorage, General: Install water-distribution piping with restrained joints. Anchorages and restrained-joint types that may be used include the following:

1. Concrete thrust blocks.
2. Locking mechanical joints.
3. Set-screw mechanical retainer glands.
4. Bolted flanged joints.
5. Heat-fused joints.
6. Pipe clamps and tie rods.

B. Install anchorages for tees, plugs and caps, bends, crosses, valves, and hydrant branches. Include anchorages for the following piping systems:

1. Gasketed-Joint, Ductile-Iron, Water-Service Piping: According to AWWA C600.
2. Fire-Service-Main Piping: According to NFPA 24.

C. Apply full coat of asphalt or other acceptable corrosion-resistant material to surfaces of installed ferrous anchorage devices.

3.8 VALVE INSTALLATION

A. AWWA Gate Valves: Comply with AWWA C600 and AWWA M44. Install each underground valve with stem pointing up and with valve box.

B. UL/FMG, Gate Valves: Comply with NFPA 24. Install each underground valve and valves in vaults with stem pointing up and with vertical cast-iron indicator post.

C. MSS Valves: Install as component of connected piping system.

D. Corporation Valves and Curb Valves: Install each underground curb valve with head pointed up and with service box.

3.9 WATER METER INSTALLATION

A. Install water meters, piping, and specialties according to utility company's written instructions.

3.10 CONCRETE VAULT INSTALLATION

A. Install precast concrete vaults according to ASTM C 891.

3.11 FIRE HYDRANT INSTALLATION

A. General: Install each fire hydrant with separate gate valve in supply pipe, anchor with restrained joints or thrust blocks, and support in upright position.

B. Wet-Barrel Fire Hydrants: Install with valve below frost line. Provide for drainage.

C. AWWA Fire Hydrants: Comply with AWWA M17.

D. UL/FMG Fire Hydrants: Comply with NFPA 24.

3.12 CONNECTIONS

A. See Section 330500 "Common Work Results for Utilities" for piping connections to valves and equipment.

B. Connect water-distribution piping to existing water service piping as shown on the plans. All work shall be coordinated with utility company.

C. Connect water-distribution piping to interior domestic water and fire-suppression piping.

3.13 FIELD QUALITY CONTROL

A. Piping Tests: Conduct piping tests before joints are covered and after concrete thrust blocks have hardened sufficiently. Fill pipeline 24 hours before testing and apply test pressure to stabilize system. Use only potable water.

B. Hydrostatic Tests: Test at not less than one-and-one-half times working pressure for two hours.

1. Increase pressure in 50-psig (350-kPa) increments and inspect each joint between increments. Hold at test pressure for 1 hour; decrease to 0 psig (0 kPa). Slowly increase again to test pressure and hold for 1 more hour. Maximum allowable leakage is 2 quarts (1.89 L) per hour per 100 joints. Remake leaking joints with new materials and repeat test until leakage is within allowed limits.

C. Prepare reports of testing activities.

3.14 IDENTIFICATION

A. Install continuous underground detectable warning tape during backfilling of trench for underground water-distribution piping. Locate below finished grade, directly over piping. Underground warning tapes are specified in Section 312000 "Earth Moving."

B. Permanently attach equipment nameplate or marker indicating plastic water-service piping, on main electrical meter panel. See Section 330500 "Common Work Results for Utilities" for identifying devices.

3.15 CLEANING

A. Clean and disinfect water-distribution piping as follows:

1. Purge new water-distribution piping systems and parts of existing systems that have been altered, extended, or repaired before use.
2. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in NFPA 24 for flushing of piping. Flush piping system with clean, potable water until dirty water does not appear at points of outlet.
3. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in AWWA C651 or do as follows:

a. Fill system or part of system with water/chlorine solution containing at least 50 ppm of chlorine; isolate and allow to stand for 24 hours.
b. Drain system or part of system of previous solution and refill with water/chlorine solution containing at least 200 ppm of chlorine; isolate and allow to stand for 3 hours.

c. After standing time, flush system with clean, potable water until no chlorine remains in water coming from system.
d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedure if biological examination shows evidence of contamination.

B. Prepare reports of purging and disinfecting activities.

END OF SECTION 221113

SECTION 221116 - DOMESTIC WATER PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Under-building slab and aboveground domestic water pipes, tubes, fittings, and specialties inside the building.
2. Encasement for piping.
3. Specialty valves.
4. Flexible connectors.
5. Water meters furnished by utility company for installation by Contractor.
6. Water meters.

1.3 PERFORMANCE REQUIREMENTS

A. Seismic Performance: Domestic water piping and support and installation shall withstand effects of earthquake motions determined according to ASCE/SEI 7.

B. Performance Requirements: Provide components and installation capable of producing domestic water piping systems with the following minimum working-pressure ratings, unless otherwise indicated:

1. Domestic Water Service Piping: 160 psig.
2. Domestic Water Distribution Piping: 125 psig.

1.4 SUBMITTALS

A. Product Data: For the following products:

1. Specialty valves.
2. Transition fittings.
3. Dielectric fittings.
4. Flexible connectors.
5. Water meters.
6. Backflow preventers and vacuum breakers.
7. Water penetration systems.

B. Water Samples: Specified in "Cleaning" Article.

C. Coordination Drawings: For piping in equipment rooms and other congested areas, drawn to scale, on which the following items are shown and coordinated with each other, using input from Installers of the items involved:

1. Fire-suppression-water piping.
2. Domestic water piping.
3. Compressed air piping.
4. HVAC equipment.

D. Field quality-control reports.

1.5 QUALITY ASSURANCE

A. Piping materials shall bear label, stamp, or other markings of specified testing agency.

B. Comply with NSF 61 for potable domestic water piping and components.

1.6 PROJECT CONDITIONS

A. Interruption of Existing Water Service: Do not interrupt water service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water service according to requirements indicated:

1. Do not proceed with interruption of water service without Architect's, Construction Manager's, Engineers and Owner's written permission.

1.7 COORDINATION

A. Coordinate sizes and locations of concrete bases with actual equipment provided.

PART 2 - PRODUCTS

2.1 PIPING MATERIALS

A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

2.2 COPPER TUBE AND FITTINGS

A. Hard Copper Tube: ASTM B 88, Type L water tube, drawn temper.

1. Cast-Copper Solder-Joint Fittings: ASME B16.18, pressure fittings.
2. Wrought-Copper Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.
3. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
4. Copper Unions: MSS SP-123, cast-copper-alloy, hexagonal-stock body, with ball-and-socket, metal-to-metal seating surfaces, and solder-joint or threaded ends.

B. Soft Copper Tube: ASTM B 88, Type L water tube, annealed temper.

1. Copper Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.

2.3 PIPING JOINING MATERIALS

A. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.

2.4 ENCASEMENT FOR PIPING

A. Standard: ASTM A 674 or AWWA C105.

B. Form: Tube.

C. Material: High-density, cross-laminated PE film of 0.004-inch minimum thickness.

D. Color: Black.

2.5 SPECIALTY VALVES

A. Comply with requirements in Division 22 Section "General-Duty Valves for Plumbing Piping" for general-duty metal valves.

B. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for balancing valves, drain valves, backflow preventers, and vacuum breakers.

2.6 TRANSITION FITTINGS

A. General Requirements:

1. Same size as pipes to be joined.
2. Pressure rating at least equal to pipes to be joined.
3. End connections compatible with pipes to be joined.

B. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.

C. Sleeve-Type Transition Coupling: AWWA C219.

1. Manufacturers: Subject to compliance with requirements, [provide products by one of the following.

   a. Cascade Waterworks Manufacturing.
   b. Dresser, Inc.; Dresser Piping Specialties.
   c. Ford Meter Box Company, Inc. (The).
   d. JCM Industries.
   e. Romac Industries, Inc.
   f. Smith-Blair, Inc; a Sensus company.
   g. Viking Johnson; c/o Mueller Co.

D. Plastic-to-Metal Transition Fittings:

1. Manufacturers: Subject to compliance with requirements, [provide products by one of the following] [available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following]:

   a. Charlotte Pipe and Foundry Company.
   b. Harvel Plastics, Inc.
   c. Spears Manufacturing Company.

2. Description: CPVC one-piece fitting with manufacturer's Schedule 80 equivalent dimensions; one end with threaded brass insert and one solvent-cement-socket[or threaded] end.

E. Plastic-to-Metal Transition Unions:

1. Manufacturers: Subject to compliance with requirements, [provide products by one of the following] [available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following]:

   a. Colonial Engineering, Inc.
   b. NIBCO INC.
   c. Spears Manufacturing Company.

2. Description: CPVC or PVC four-part union. Include brass[or stainless-steel] threaded end, solvent-cement-joint or threaded plastic end, rubber O-ring, and union nut.

2.7 DIELECTRIC FITTINGS

A. General Requirements: Assembly of copper alloy and ferrous materials or ferrous material body with separating nonconductive insulating material suitable for system fluid, pressure, and temperature.

B. Dielectric Unions:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Capitol Manufacturing Company.
    b. Central Plastics Company.
    c. EPCO Sales, Inc.
    d. Hart Industries International, Inc.
    e. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
    f. Zurn Plumbing Products Group; Wilkins Water Control Products.

2. Description:

    a. Pressure Rating: 150 psig at 180 deg F.
    b. End Connections: Solder-joint copper alloy and threaded ferrous.

C. Dielectric Flanges:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Capitol Manufacturing Company.
    b. Central Plastics Company.
    c. EPCO Sales, Inc.
    d. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

    a. Factory-fabricated, bolted, companion-flange assembly.
    b. Pressure Rating: 150 psig minimum.
    c. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

D. Dielectric-Flange Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Advance Products & Systems, Inc.
    b. Calpico, Inc.
    c. Central Plastics Company.
    d. Pipeline Seal and Insulator, Inc.

2. Description:

    a. Nonconducting materials for field assembly of companion flanges.
    b. Pressure Rating: 150 psig.
    c. Gasket: Neoprene or phenolic.
    d. Bolt Sleeves: Phenolic or polyethylene.
    e. Washers: Phenolic with steel backing washers.

E. Dielectric Couplings:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Calpico, Inc.
   b. Lochinvar Corporation.

2. Description:

   a. Galvanized-steel coupling.
   b. Pressure Rating: 300 psig at 225 deg F.
   c. End Connections: Female threaded.
   d. Lining: Inert and noncorrosive, thermoplastic.

F. Dielectric Nipples:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Perfection Corporation; a subsidiary of American Meter Company.
   b. Precision Plumbing Products, Inc.
   c. Victaulic Company.

2. Description:

   a. Electroplated steel nipple complying with ASTM F 1545.
   b. Pressure Rating: 300 psig at 225 deg F.
   c. End Connections: Male threaded or grooved.
   d. Lining: Inert and noncorrosive, propylene.

2.8 FLEXIBLE CONNECTORS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Flex-Hose Co., Inc.
2. Flexicraft Industries.
3. Flex Pression, Ltd.
4. Flex-Weld, Inc.
5. Hyspan Precision Products, Inc.
6. Mercer Rubber Co.
7. Metraflex, Inc.
8. Proco Products, Inc.
9. Tozen Corporation.
10. Unaflex, Inc.
11. Universal Metal Hose; a Hyspan company

B. Bronze-Hose Flexible Connectors: Corrugated-bronze tubing with bronze wire-braid covering and ends brazed to inner tubing.

1. Working-Pressure Rating: Minimum 200 psig.
2. End Connections NPS 2 and Smaller: Threaded copper pipe or plain-end copper tube.
3. End Connections NPS 2-1/2 and Larger: Flanged copper alloy.

C. Stainless-Steel-Hose Flexible Connectors: Corrugated-stainless-steel tubing with stainless-steel wire-braid covering and ends welded to inner tubing.

1. Working-Pressure Rating: Minimum 200 psig.
2. End Connections NPS 2 and Smaller: Threaded steel-pipe nipple.
3. End Connections NPS 2-1/2 and Larger: Flanged steel nipple.

2.9 WATER METERS

A. Displacement-Type Water Meters:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. AALIANT; a Venture Measurement Product Line.
b. ABB.
c. Badger Meter, Inc.
d. Carlon Meter.
e. Mueller Company; Water Products Division.
f. Schlumberger Limited; Water Division.
g. Sensus Metering Systems.

2. Description:

a. Standard: AWWA C700.
b. Pressure Rating: 150-psig working pressure.
c. Body Design: Nutating disc; totalization meter.
d. Registration: In gallons or cubic feet as required by utility.
e. Case: Bronze.
f. End Connections: Threaded.

B. Turbine-Type Water Meters:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. AALIANT; a Venture Measurement Product Line.
b. ABB.
c. Badger Meter, Inc.
d. Hays Fluid Controls.
e. Master Meter, Inc.

f. McCrometer.
g. Mueller Company; Water Products Division.
h. Schlumberger Limited; Water Division.
i. SeaMetrics Inc.
j. Sensus Metering Systems.

2. Description:

a. Standard: AWWA C701.
b. Pressure Rating: 150-psig working pressure.
c. Body Design: Turbine; totalization meter.
d. Registration: In gallons or cubic feet as required by utility company .
e. Case: Bronze.
f. End Connections for Meters NPS 2 and Smaller: Threaded.
g. End Connections for Meters NPS 2-1/2 and Larger: Flanged.

C. Compound-Type Water Meters:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. ABB.
b. Badger Meter, Inc.
c. Master Meter, Inc.
d. Mueller Company; Water Products Division.
e. Schlumberger Limited; Water Division.
f. Sensus Metering Systems.

2. Description:

a. Standard: AWWA C702.
b. Pressure Rating: 150-psig working pressure.
c. Body Design: With integral mainline and bypass meters; totalization meter.
d. Registration: In gallons or cubic feet as required by utility company.
e. Case: Bronze.
f. Pipe Connections: Flanged.

D. Fire-Service-Type Water Meters:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Badger Meter, Inc.
b. Mueller Company; Water Products Division.
c. Schlumberger Limited; Water Division.
d. Sensus Metering Systems.

2. Description:

a. Standard: AWWA C703 and UL listing.
b. Pressure Rating: 175-psig working pressure.
c. Body Design:

1) Proportional, Detector-Type Water Meters: With meter on bypass.

a) Bypass Meter: AWWA C701, turbine or AWWA C702, compound type with bronze case; size not less than one-half nominal size of main-line meter.

2) Turbine-Type Water Meters: With strainer, and with meter on bypass.

a) Strainer: Full size, matching water meter.
b) Bypass Meter: AWWA C701, turbine type with bronze case; not less than NPS 2.

d. Registration: In gallons or cubic feet as required by utility company.
e. Case: Bronze.
f. Pipe Connections for Meters NPS 2 and Smaller: Threaded.
g. Pipe Connections for Meters NPS 2-1/2 and Larger: Flanged.

E. Remote Registration System: Direct-reading type complying with AWWA C706; modified with signal transmitting assembly, low-voltage connecting wiring, and remote register assembly as required by utility company.

F. Remote Registration System: Encoder type complying with AWWA C707; modified with signal transmitting assembly, low-voltage connecting wiring, and remote register assembly as required by utility company.

PART 3 - EXECUTION

3.1 EARTHWORK

A. Comply with requirements in Division 31 Section "Earth Moving" for excavating, trenching, and backfilling.

3.2 PIPING INSTALLATION

A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.

B. Install copper tubing under building slab according to CDA's "Copper Tube Handbook."

C. Install underground copper tube in PE encasement according to ASTM A 674 or AWWA C105.

D. Install shutoff valve, hose-end drain valve, strainer, pressure gage, and test tee with valve, inside the building at each domestic water service entrance. Comply with requirements in Division 22 Section "Meters and Gages for Plumbing Piping" for pressure gages and Division 22 Section "Domestic Water Piping Specialties" for drain valves and strainers.

E. Install shutoff valve immediately upstream of each dielectric fitting.

F. Install water-pressure-reducing valves downstream from shutoff valves. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for pressure-reducing valves.

G. Install domestic water piping level with 0.25 percent slope downward toward drain and plumb.

H. Rough-in domestic water piping for water-meter installation according to utility company's requirements.

I. Install seismic restraints on piping. Comply with requirements in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment" for seismic-restraint devices.

J. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.

K. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

L. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal, and coordinate with other services occupying that space.

M. Install piping adjacent to equipment and specialties to allow service and maintenance.

N. Install piping to permit valve servicing.

O. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than system pressure rating used in applications below unless otherwise indicated.

P. Install piping free of sags and bends.

Q. Provide an additional one hundred feet of piping and accessories and labor for each size of pipe used on the project to accommodate any changes required to resolve interferences or as directed by the Engineer.

R. Install fittings for changes in direction and branch connections.

S. Install PEX piping with loop at each change of direction of more than 90 degrees.

T. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.

U. Install pressure gages on suction and discharge piping from each plumbing pump and packaged booster pump. Comply with requirements in Division 22 Section "Meters and Gages for Plumbing Piping" for pressure gages.

V. Install thermostats in hot-water circulation piping. Comply with requirements in Division 22 Section "Domestic Water Pumps" for thermostats.

W. Install thermometers on inlet and outlet piping from each water heater. Comply with requirements in Division 22 Section "Meters and Gages for Plumbing Piping" for thermometers.

X. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."

Y. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."

Z. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Division 22 Section "Escutcheons for Plumbing Piping."

3.3 JOINT CONSTRUCTION

A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.

C. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:

1. Apply appropriate tape or thread compound to external pipe threads.
2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.

D. Brazed Joints: Join copper tube and fittings according to CDA's "Copper Tube Handbook," "Brazed Joints" Chapter.

E. Soldered Joints: Apply ASTM B 813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B 828 or CDA's "Copper Tube Handbook."

F. Flanged Joints: Select appropriate asbestos-free, nonmetallic gasket material in size, type, and thickness suitable for domestic water service. Join flanges with gasket and bolts according to ASME B31.9.

3.4 VALVE INSTALLATION

A. General-Duty Valves: Comply with requirements in Division 22 Section "General-Duty Valves for Plumbing Piping" for valve installations.

B. Install shutoff valve close to water main on each branch and riser serving plumbing fixtures or equipment, on each water supply to equipment, and on each water supply to plumbing fixtures that do not have supply stops. Use ball or gate valves for piping NPS 2 and smaller. Use butterfly or gate valves for piping NPS 2-1/2 and larger.

C. Install drain valves for equipment at base of each water riser, at low points in horizontal piping, and where required to drain water piping. Drain valves are specified in Division 22 Section "Domestic Water Piping Specialties."

1. Hose-End Drain Valves: At low points in water mains, risers, and branches.
2. Stop-and-Waste Drain Valves: Instead of hose-end drain valves where indicated.

D. Install balancing valve in each hot-water circulation return branch and discharge side of each pump and circulator. Set balancing valves partly open to restrict but not stop flow. Use ball valves for piping NPS 2 and smaller and butterfly valves for piping NPS 2-1/2 and larger. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for balancing valves.

E. Install calibrated balancing valves in each hot-water circulation return branch and discharge side of each pump and circulator. Set calibrated balancing valves partly open to restrict but not stop flow. Comply with requirements in Division 22 Section "Domestic Water Piping Specialties" for calibrated balancing valves.

3.5 TRANSITION FITTING INSTALLATION

A. Install transition couplings at joints of dissimilar piping.

B. Transition Fittings in Underground Domestic Water Piping:

1. NPS 1-1/2 and Smaller: Fitting-type coupling.
2. NPS 2 and Larger: Sleeve-type coupling.

3.6 DIELECTRIC FITTING INSTALLATION

A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.

B. Dielectric Fittings for NPS 2 and Smaller: Use dielectric couplings or nipples.

C. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flanges.

D. Dielectric Fittings for NPS 5 and Larger: Use dielectric flange kits.

3.7 FLEXIBLE CONNECTOR INSTALLATION

A. Install flexible connectors in suction and discharge piping connections to each domestic water pump and in suction and discharge manifold connections to each domestic water booster pump.

B. Install bronze-hose flexible connectors in copper domestic water tubing.

C. Install stainless-steel-hose flexible connectors in steel domestic water piping.

3.8 WATER METER INSTALLATION

A. Rough-in domestic water piping for water meter installation and install water meters according to utility company's requirements.

B. Water meters will be furnished and installed by utility company.

C. Install water meters according to AWWA M6, utility company's requirements, and the following:

D. Install displacement-type water meters with shutoff valve on water-meter inlet. Install valve on water-meter outlet and valved bypass around meter unless prohibited by authorities having jurisdiction.

E. Install turbine-type water meters with shutoff valve on water-meter inlet. Install valve on water-meter outlet and valved bypass around meter unless prohibited by authorities having jurisdiction.

F. Install compound-type water meters with shutoff valves on water-meter inlet and outlet and on valved bypass around meter. Support meters, valves, and piping on brick or concrete piers.

G. Install fire-service water meters with shutoff valves on water-meter inlet and outlet and on full-size valved bypass around meter. Support meter, valves, and piping on brick or concrete piers.

H. Install remote registration system according to standards of utility company and of authorities having jurisdiction.

3.9 HANGER AND SUPPORT INSTALLATION

A. Comply with requirements in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment" for seismic-restraint devices.

B. Comply with requirements in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment" for pipe hanger and support products and installation.

1. Vertical Piping: MSS Type 8 or 42, clamps.
2. Individual, Straight, Horizontal Piping Runs:

    a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
    b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
    c. Longer Than 100 Feet If Indicated: MSS Type 49, spring cushion rolls.

3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
4. Base of Vertical Piping: MSS Type 52, spring hangers.

C. Support vertical piping and tubing at base and at each floor.

D. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch.

E. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 3/4 and Smaller: 60 inches with 3/8-inch rod.
2. NPS 1 and NPS 1-1/4: 72 inches with 3/8-inch rod.
3. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
4. NPS 2-1/2: 108 inches with 1/2-inch rod.
5. NPS 3 to NPS 5: 10 feet with 1/2-inch rod.
6. NPS 6: 10 feet with 5/8-inch rod.
7. NPS 8: 10 feet with 3/4-inch rod.

F. Install supports for vertical copper tubing every 10 feet.

G. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 1-1/4 and Smaller: 84 inches with 3/8-inch rod.
2. NPS 1-1/2: 108 inches with 3/8-inch rod.
3. NPS 2: 10 feet with 3/8-inch rod.
4. NPS 2-1/2: 11 feet with 1/2-inch rod.
5. NPS 3 and NPS 3-1/2: 12 feet with 1/2-inch rod.
6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
7. NPS 6: 12 feet with 3/4-inch rod.
8. NPS 8 to NPS 12: 12 feet with 7/8-inch rod.

H. Install supports for vertical steel piping every 15 feet.

I. Install vinyl-coated hangers for CPVC piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 1 and Smaller: 36 inches with 3/8-inch rod.

2. NPS 1-1/4 to NPS 2: 48 inches with 3/8-inch rod.
3. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
4. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
5. NPS 6: 48 inches with 3/4-inch rod.
6. NPS 8: 48 inches with 7/8-inch rod.

J. Install supports for vertical CPVC piping every 60 inches for NPS 1 and smaller, and every 72 inches for NPS 1-1/4 and larger.

K. Install vinyl-coated hangers for PEX piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 1 and Smaller: 32 inches with 3/8-inch rod.

L. Install hangers for vertical PEX piping every 48 inches.

M. Install vinyl-coated hangers for PVC piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 2 and Smaller: 48 inches with 3/8-inch rod.
2. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
3. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
4. NPS 6: 48 inches with 3/4-inch rod.
5. NPS 8: 48 inches with 7/8-inch rod.

N. Install supports for vertical PVC piping every 48 inches.

O. Support piping and tubing not listed in this article according to MSS SP-69 and manufacturer's written instructions.

3.10 CONNECTIONS

A. Drawings indicate general arrangement of piping, fittings, and specialties.

B. Install piping adjacent to equipment and machines to allow service and maintenance.

C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.

D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:

1. Domestic Water Booster Pumps: Cold-water suction and discharge piping.
2. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
3. Plumbing Fixtures: Cold- and hot-water supply piping in sizes indicated, but not smaller than required by plumbing code. Comply with requirements in Division 22 plumbing fixture Sections for connection sizes.

4. Equipment: Cold- and hot-water supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection. Use flanges instead of unions for NPS 2-1/2 and larger.

3.11 IDENTIFICATION

A. Identify system components. Comply with requirements in Division 22 Section "Identification for Plumbing Piping and Equipment" for identification materials and installation.

B. Label pressure piping with system operating pressure.

3.12 FIELD QUALITY CONTROL

A. Perform tests and inspections.

B. Piping Inspections:

1. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
2. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:

    a. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
    b. Final Inspection: Arrange final inspection for authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.

3. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.
4. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.

C. Piping Tests:

1. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
2. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
3. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
4. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate

test source and allow to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.

5. Repair leaks and defects with new materials and retest piping or portion thereof until satisfactory results are obtained.
6. Prepare reports for tests and for corrective action required.

D. Domestic water piping will be considered defective if it does not pass tests and inspections.

E. Prepare test and inspection reports.

3.13 ADJUSTING

A. Perform the following adjustments before operation:

1. Close drain valves, hydrants, and hose bibbs.
2. Open shutoff valves to fully open position.
3. Open throttling valves to proper setting.
4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.

    a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide flow of hot water in each branch.
    b. Adjust calibrated balancing valves to flows indicated.

5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
8. Check plumbing specialties and verify proper settings, adjustments, and operation.

3.14 CLEANING

A. Clean and disinfect potable and non-potable domestic water piping as follows:

1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:

    a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
    b. Fill and isolate system according to either of the following:

1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.

c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.

d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.

B. Clean non-potable domestic water piping as follows:

1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
2. Use purging procedures prescribed by authorities having jurisdiction or; if methods are not prescribed, follow procedures described below:

a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
b. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.

C. Prepare and submit reports of purging and disinfecting activities.

D. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

3.15 PIPING SCHEDULE

A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.

B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.

C. Fitting Option: Extruded-tee connections and brazed joints may be used on aboveground copper tubing.

1. Underground Domestic Water piping materials shall match those used for the underground site main to the building Soft copper tube, ASTM B 88, Type L; wrought-copper solder-joint fittings and brazed joints.

D. Aboveground domestic water piping, NPS 2 and smaller, shall be the following:

1. Hard copper tube, ASTM B 88, Type L; wrought-copper solder-joint fittings; and soldered joints.

E. Aboveground domestic water piping, NPS 2-1/2 to NPS 4, shall be the following:

1. Hard copper tube, ASTM B 88, Type L; wrought-copper solder-joint fittings; and soldered joints.

F. Aboveground domestic water piping, NPS 5 to NPS 8, shall be the following:

1. Hard copper tube, ASTM B 88, Type L; wrought-copper solder-joint fittings; and soldered joints.

G. Underground Domestic Water piping materials shall match those used for the underground site main to the building:

3.16 VALVE SCHEDULE

A. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:

1. Shutoff Duty: Use ball or gate valves for piping NPS 2 and smaller. Use butterfly, ball, or gate valves with flanged ends for piping NPS 2-1/2 and larger.
2. Throttling Duty: Use ball or globe valves for piping NPS 2 and smaller. Use butterfly or ball valves with flanged ends for piping NPS 2-1/2 and larger.
3. Hot-Water Circulation Piping, Balancing Duty: [Calibrated] [Memory-stop] balancing valves.
4. Drain Duty: Hose-end drain valves.

B. Use check valves to maintain correct direction of domestic water flow to and from equipment.

C. Iron grooved-end valves may be used with grooved-end piping.

END OF SECTION 221116

SECTION 221119 - DOMESTIC WATER PIPING SPECIALTIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes the following domestic water piping specialties:

1. Vacuum breakers.
2. Backflow preventers.
3. Water pressure-reducing valves.
4. Balancing valves.
5. Temperature-actuated water mixing valves.
6. Strainers.
7. Outlet boxes.
8. Hose stations.
9. Hose bibbs.
10. Wall hydrants.
11. Ground hydrants.
12. Post hydrants.
13. Drain valves.
14. Water hammer arresters.
15. Air vents.
16. Trap-seal primer valves.
17. Trap-seal primer systems.

B. Related Sections include the following:

1. Division 22 Section "Domestic Water Piping" for water meters.

1.3 PERFORMANCE REQUIREMENTS

A. Minimum Working Pressure for Domestic Water Piping Specialties: 125 psig, unless otherwise indicated.

1.4 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings: Diagram power, signal, and control wiring.

C. Field quality-control test reports.

D. Operation and Maintenance Data: For domestic water piping specialties to include in emergency, operation, and maintenance manuals.

1.5 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

B. NSF Compliance:

1. Comply with NSF 14, "Plastics Piping Components and Related Materials," for plastic domestic water piping components.
2. Comply with NSF 61, "Drinking Water System Components - Health Effects; Sections 1 through 9."

PART 2 - PRODUCTS

2.1 VACUUM BREAKERS

A. Pipe-Applied, Atmospheric-Type Vacuum Breakers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Ames Co.
    b. Cash Acme.
    c. Conbraco Industries, Inc.
    d. FEBCO; SPX Valves & Controls.
    e. Rain Bird Corporation.
    f. Toro Company (The); Irrigation Div.
    g. Watts Industries, Inc.; Water Products Div.
    h. Zurn Plumbing Products Group; Wilkins Div.

3. Standard: ASSE 1001.
4. Size: NPS 1/4 to NPS 3, as required to match connected piping.
5. Body: Bronze.
6. Inlet and Outlet Connections: Threaded.
7. Finish: Rough bronze or Chrome plated.

B. Hose-Connection Vacuum Breakers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Arrowhead Brass Products, Inc.
    b. Cash Acme.
    c. Conbraco Industries, Inc.
    d. Legend Valve.
    e. MIFAB, Inc.
    f. Prier Products, Inc.
    g. Watts Industries, Inc.; Water Products Div.
    h. Woodford Manufacturing Company.
    i. Zurn Plumbing Products Group; Light Commercial Operation.
    j. Zurn Plumbing Products Group; Wilkins Div.

3. Standard: ASSE 1011.
4. Body: Bronze, nonremovable, with manual drain.
5. Outlet Connection: Garden-hose threaded complying with ASME B1.20.7.
6. Finish: Chrome, nickel plated or rough bronze.

C. Pressure Vacuum Breakers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
3. Basis-of-Design Product: Subject to compliance with requirements, provide by one of the following:

    a. Ames Co.
    b. Conbraco Industries, Inc.
    c. FEBCO; SPX Valves & Controls.
    d. Flomatic Corporation.
    e. Toro Company (The); Irrigation Div.
    f. Watts Industries, Inc.; Water Products Div.
    g. Zurn Plumbing Products Group; Wilkins Div.

4. Standard: ASSE 1020.
5. Operation: Continuous-pressure applications.
6. Pressure Loss: 5 psig maximum, through middle 1/3 of flow range.
7. Accessories:

    a. Valves: Ball type, on inlet and outlet.

D. Laboratory-Faucet Vacuum Breakers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Conbraco Industries, Inc.
    b. Watts Industries, Inc.; Water Products Div.
    c. Woodford Manufacturing Company.
    d. Zurn Plumbing Products Group; Wilkins Div.

3. Standard: ASSE 1035.
4. Size: NPS 1/4 or NPS 3/8 matching faucet size.
5. Body: Bronze.
6. End Connections: Threaded.
7. Finish: Chrome plated.

E. Spill-Resistant Vacuum Breakers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Conbraco Industries, Inc.
    b. Watts Industries, Inc.; Water Products Div.

3. Standard: ASSE 1056.
4. Operation: Continuous-pressure applications.
5. Accessories:

    a. Valves: Ball type, on inlet and outlet.

2.2 BACKFLOW PREVENTERS

A. Reduced-Pressure-Principle Backflow Preventers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Ames Co.
    b. Conbraco Industries, Inc.
    c. FEBCO; SPX Valves & Controls.
    d. Flomatic Corporation.
    e. Watts Industries, Inc.; Water Products Div.
    f. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1013.
3. Operation: Continuous-pressure applications.
4. Pressure Loss: 12 psig maximum, through middle 1/3 of flow range.
5. Body: Bronze for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or that is FDA approved for NPS 2-1/2 and larger.
6. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
7. Configuration: Designed for horizontal, straight through flow.
8. Accessories:

    a. Valves: Ball type with threaded ends on inlet and outlet of NPS 2 and smaller; outside screw and yoke gate-type with flanged ends on inlet and outlet of NPS 2-1/2 and larger.
    b. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.

B. Double-Check Backflow-Prevention Assemblies:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Ames Co.
    b. Conbraco Industries, Inc.
    c. FEBCO; SPX Valves & Controls.
    d. Flomatic Corporation.
    e. Watts Industries, Inc.; Water Products Div.
    f. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1015.
3. Operation: Continuous-pressure applications, unless otherwise indicated.
4. Pressure Loss: 5 psig maximum, through middle 1/3 of flow range.
5. Body: Bronze for NPS 2 and smaller; [cast iron with interior lining complying with AWWA C550 or that is FDA approved] [steel with interior lining complying with AWWA C550 or that is FDA approved] [stainless steel] for NPS 2-1/2 and larger.
6. End Connections: Threaded for NPS 2 and smaller; [flanged] <Insert type> for NPS 2-1/2 and larger.
7. Configuration: Designed for horizontal, straight through flow.
8. Accessories:

    a. Valves: Ball type with threaded ends on inlet and outlet of NPS 2 and smaller; outside screw and yoke gate-type with flanged ends on inlet and outlet of NPS 2-1/2 and larger.

C. Reduced-Pressure-Detector, Fire-Protection Backflow-Preventer Assemblies:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Ames Co.
b. Conbraco Industries, Inc.
c. FEBCO; SPX Valves & Controls.
d. Watts Industries, Inc.; Water Products Div.
e. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1047 and FMG approved or UL listed.
3. Operation: Continuous-pressure applications.
4. Pressure Loss: 12 psig maximum, through middle 1/3 of flow range.
5. Body: Cast iron with interior lining complying with AWWA C550 or that is FDA approved].
6. End Connections: Flanged.
7. Configuration: Designed for horizontal, straight through flow.
8. Accessories:

a. Valves: Outside screw and yoke gate-type with flanged ends on inlet and outlet.
b. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.
c. Bypass: With displacement-type water meter, shutoff valves, and reduced-pressure backflow preventer.

D. Double-Check, Detector-Assembly Backflow Preventers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Ames Co.
b. Conbraco Industries, Inc.
c. FEBCO; SPX Valves & Controls.
d. Watts Industries, Inc.; Water Products Div.
e. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1048 and FMG approved or UL listed.
3. Operation: Continuous-pressure applications.
4. Pressure Loss: 5 psig maximum, through middle 1/3 of flow range.
5. Body: Cast iron with interior lining complying with AWWA C550 or that is FDA approved.
6. End Connections: Flanged.
7. Configuration: Designed for horizontal, straight through flow.
8. Accessories:

a. Valves: Outside screw and yoke gate-type with flanged ends on inlet and outlet.
b. Bypass: With displacement-type water meter, shutoff valves, and reduced-pressure backflow preventer.

E. Backflow-Preventer Test Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Conbraco Industries, Inc.
    b. FEBCO; SPX Valves & Controls.
    c. Flomatic Corporation.
    d. Watts Industries, Inc.; Water Products Div.
    e. Zurn Plumbing Products Group; Wilkins Div.

2. Description: Factory calibrated, with gages, fittings, hoses, and carrying case with test-procedure instructions.

2.3 WATER PRESSURE-REDUCING VALVES

A. Water Regulators:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Cash Acme.
    b. Conbraco Industries, Inc.
    c. Honeywell Water Controls.
    d. Watts Industries, Inc.; Water Products Div.
    e. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1003.
3. Pressure Rating: Initial working pressure of 150 psig.
4. Body: Bronze with chrome-plated finish for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or that is FDA approved for NPS 2-1/2 and NPS 3.
5. Valves for Booster Heater Water Supply: Include integral bypass.

6. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and NPS 3.

B. Water Control Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. CLA-VAL Automatic Control Valves.
    b. Flomatic Corporation.
    c. OCV Control Valves.
    d. Watts Industries, Inc.; Ames Fluid Control Systems.
    e. Watts Industries, Inc.; Watts ACV.
    f. Zurn Plumbing Products Group; Wilkins Div.

2. Description: Pilot-operation, diaphragm-type, single-seated main water control valve.
3. Pressure Rating: Initial working pressure of 150 psig minimum with AWWA C550 or FDA-approved, interior epoxy coating. Include small pilot-control valve, restrictor device, specialty fittings, and sensor piping.
4. Main Valve Body: Cast- or ductile-iron body with AWWA C550 or FDA-approved, interior epoxy coating; or stainless-steel body.

    a. Pattern: Angle or Globe-valve design
    b. Trim: Stainless steel.
5. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.

2.4 BALANCING VALVES

A. Copper-Alloy Calibrated Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Armstrong International, Inc.
    b. Flo Fab Inc.
    c. ITT Industries; Bell & Gossett Div.
    d. NIBCO INC.
    e. TAC Americas.
    f. Taco, Inc.
    g. Watts Industries, Inc.; Water Products Div.

2. Type: Ball or Y-pattern globe valve with two readout ports and memory setting indicator.
3. Body: Brass or bronze,

4. Size: Same as connected piping, but not larger than NPS 2.
5. Accessories: Meter hoses, fittings, valves, differential pressure meter, and carrying case.

B. Cast-Iron Calibrated Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Armstrong International, Inc.
    b. Flo Fab Inc.
    c. ITT Industries; Bell & Gossett Div.
    d. NIBCO INC.
    e. TAC Americas.
    f. Watts Industries, Inc.; Water Products Div.

2. Type: Adjustable with Y-pattern globe valve, two readout ports, and memory-setting indicator.
3. Size: Same as connected piping, but not smaller than NPS 2-1/2.

C. Accessories: Meter hoses, fittings, valves, differential pressure meter, and carrying case.

D. Memory-Stop Balancing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Conbraco Industries, Inc.
   b. Crane Co.; Crane Valve Group; Crane Valves.
   c. Crane Co.; Crane Valve Group; Jenkins Valves.
   d. Crane Co.; Crane Valve Group; Stockham Div.
   e. Hammond Valve.
   f. Milwaukee Valve Company.
   g. NIBCO INC.
   h. Red-White Valve Corp.

2. Standard: MSS SP-110 for two-piece, copper-alloy ball valves.
3. Pressure Rating: 400-psig minimum CWP.
4. Size: NPS 2 or smaller.
5. Body: Copper alloy.
6. Port: Standard or full port.
7. Ball: Chrome-plated brass.
8. Seats and Seals: Replaceable.
9. End Connections: Solder joint or threaded.
10. Handle: Vinyl-covered steel with memory-setting device.

2.5 TEMPERATURE-ACTUATED WATER MIXING VALVES

A. Water-Temperature Limiting Devices:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Armstrong International, Inc.
   b. Cash Acme.
   c. Conbraco Industries, Inc.
   d. Honeywell Water Controls.
   e. Legend Valve.
   f. Leonard Valve Company.
   g. Powers; a Watts Industries Co.
   h. Symmons Industries, Inc.
   i. Taco, Inc.
   j. Watts Industries, Inc.; Water Products Div.

k. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1017.
3. Pressure Rating: 125 psig.
4. Type: Thermostatically controlled water mixing valve.
5. Material: Bronze body with corrosion-resistant interior components.
6. Connections: Threaded inlets and outlet.
7. Accessories: Check stops on hot- and cold-water supplies, and adjustable, temperature-control handle.
8. Valve Finish: Chrome plated or Rough bronze.

B. Primary, Thermostatic, Water Mixing Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
2.

a. Armstrong International, Inc.
b. Lawler Manufacturing Company, Inc.
c. Leonard Valve Company.
d. Powers; a Watts Industries Co.
e. Symmons Industries, Inc.

3. Standard: ASSE 1017.
4. Pressure Rating: 125 psig.
5. Type: Exposed-mounting, thermostatically controlled water mixing valve.
6. Material: Bronze body with corrosion-resistant interior components.
7. Connections: Threaded inlets and outlet.
8. Accessories: Manual temperature control, check stops on hot- and cold-water supplies, and adjustable, temperature-control handle.
9. Valve Pressure Rating: 125 psig minimum, unless otherwise indicated.
10. Pressure Drop at Design Flow Rate: 15 psig.
11. Valve Finish: Chrome plated or Rough bronze.
12. Piping Finish: Copper.

C. Manifold, Thermostatic, Water-Mixing-Valve Assemblies:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Leonard Valve Company.
b. Powers; a Watts Industries Co.
c. Symmons Industries, Inc.

2. Description: Factory-fabricated, exposed-mounting, thermostatically controlled, water-mixing-valve assembly in three-valve parallel arrangement.
3. Large-Flow Parallel: Thermostatic water mixing valve and downstream pressure regulator with pressure gages on inlet and outlet.

4. Intermediate-Flow Parallel: Thermostatic water mixing valve and downstream pressure regulator with pressure gages on inlet and outlet.
5. Small-Flow Parallel: Thermostatic water mixing valve.
6. Thermostatic Mixing Valves: Comply with ASSE 1017. Include check stops on hot- and cold-water inlets and shutoff valve on outlet.
7. Water Regulator(s): Comply with ASSE 1003. Include pressure gage on inlet and outlet.
8. Component Pressure Ratings: 125 psig minimum, unless otherwise indicated.
9. Cabinet: Factory-fabricated, stainless steel, for surface mounting and with hinged, stainless-steel door.
10. Unit Pressure Drop at Design Flow Rate: 15 psig.
11. Thermostatic Mixing Valve and Water Regulator Finish: Chrome plated or rough bronze.
12. Piping Finish: Copper.

D. Individual-Fixture, Water Tempering Valve:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Cash Acme.
    b. Conbraco Industries, Inc.
    c. Honeywell Water Controls.
    d. Lawler Manufacturing Company, Inc.
    e. Leonard Valve Company.
    f. Powers; a Watts Industries Co.
    g. Watts Industries, Inc.; Water Products Div.
    h. Zurn Plumbing Products Group; Wilkins Div.

2. Standard: ASSE 1016, thermostatically controlled water tempering valve.
3. Pressure Rating: 125 psig minimum, unless otherwise indicated.
4. Body: Bronze body with corrosion-resistant interior components.
5. Temperature Control: Adjustable.
6. Inlets and Outlet: Threaded.
7. Finish: Rough or chrome-plated bronze.

E. Primary Water Tempering Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Heat-Timer Corporation.
    b. Holby Valve Co., Inc.

2. Standard: ASSE 1017, thermostatically controlled tempering valve, listed as tempering valve.
3. Pressure Rating: 125 psig minimum, unless otherwise indicated.
4. Body: Bronze.
5. Temperature Control: Manual.

6. Inlets and Outlet: Threaded.
7. Valve Finish: Rough bronze.

2.6 STRAINERS FOR DOMESTIC WATER PIPING

A. Y-Pattern Strainers:

1. Pressure Rating: 125 psig minimum, unless otherwise indicated.
2. Body: Bronze for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or FDA-approved, epoxy coating and for NPS 2-1/2 and larger.
3. End Connections: Threaded for NPS 2 and smaller;flanged for NPS 2-1/2 and larger.
4. Screen: Stainless steel with round perforations, unless otherwise indicated.
5. Perforation Size:

    a. StrainersNPS 2 and Smaller: 0.033 inch.
    b. Strainers NPS 2-1/2 to NPS 4: 0.045 inch.
    c. Strainers NPS 5 and Larger: 0.125 inch.

6. Drain: Factory-installed, hose-end drain valve.

2.7 OUTLET BOXES

A. Clothes Washer Outlet Boxes:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Acorn Engineering Company.
    b. Guy Gray Manufacturing Co., Inc.
    c. IPS Corporation.
    d. LSP Products Group, Inc.
    e. Oatey.
    f. Plastic Oddities; a division of Diverse Corporate Technologies.
    g. Symmons Industries, Inc.
    h. Watts Industries, Inc.; Water Products Div.
    i. Whitehall Manufacturing; a div. of Acorn Engineering Company.
    j. Zurn Plumbing Products Group; Light Commercial Operation.

2. Mounting: Recessed.
3. Material and Finish: Stainless-steel box and faceplate.
4. Faucet: Combination, valved fitting or separate hot- and cold-water, valved fittings complying with ASME A112.18.1. Include garden-hose thread complying with ASME B1.20.7 on outlets.
5. Supply Shutoff Fittings: NPS 1/2 gate, globe, or ball valves and NPS 1/2 copper, water tubing.

6. Drain: NPS 2 standpipe and P-trap for direct waste connection to drainage piping.
7. Inlet Hoses: Two 60-inch- long, rubber household clothes washer inlet hoses with female, garden-hose-thread couplings. Include rubber washers.
8. Drain Hose: One 48-inch- long, rubber household clothes washer drain hose with hooked end.

B. Icemaker Outlet Boxes:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Acorn Engineering Company.
   b. IPS Corporation.
   c. LSP Products Group, Inc.
   d. Oatey.
   e. Plastic Oddities; a division of Diverse Corporate Technologies.

2. Mounting: Recessed.
3. Material and Finish: Stainless-steel box and faceplate.
4. Faucet: Valved fitting complying with ASME A112.18.1. Include NPS 1/2 or smaller copper tube outlet.
5. Supply Shutoff Fitting: NPS 1/2 gate, globe, or ball valve and NPS 1/2 copper, water tubing.

2.8 HOSE STATIONS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. ARCHON Industries, Inc.
2. Armstrong International, Inc.
3. Cooney Brothers, Inc.
4. DynaFluid Ltd.
5. Leonard Valve Company.
6. Strahman Valves, Inc.
7. T & S Brass and Bronze Works, Inc.

B. Single-Temperature-Water Hose Stations:

1. Standard: ASME A112.18.1.
2. Cabinet: Stainless-steel enclosure with exposed valve handle, hose connection, and hose rack. Include thermometer in front.
3. Hose-Rack Material: Stainless steel.
4. Body Material: Bronze with stainless-steel wetted parts.
5. Body Finish: Rough bronze or chrome plated.
6. Mounting: Wall, with reinforcement.
7. Supply Fitting: NPS 3/4 gate, globe, or ball valve and check valve and NPS 3/4 copper, water tubing. Omit check valve if check stop is included with fitting.

8. Hose: Manufacturer's standard, for service fluid, temperature, and pressure; 50 feet long.
9. Nozzle: With hand squeeze on-off control.
10. Vacuum Breaker: Integral or factory-installed, nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052; and garden-hose thread complying with ASME B1.20.7 on outlet.

C. Hot- and Cold-Water Hose Stations:

1. Standard: ASME A112.18.1.
2. Type Faucet: Blending valve.
3. Cabinet: Stainless-steel enclosure with exposed valve handles, hose connection, and hose rack. Include thermometer in front.
4. Hose-Rack Material: Stainless steel.
5. Body Material: Bronze with stainless-steel wetted parts.
6. Body Finish: Rough bronze or chrome plate.
7. Mounting: Wall, with reinforcement.
8. Supply Fittings: TwoNPS 3/4 gate, globe, or ball valves and check valves and NPS 3/4 copper, water tubing. Omit check valves if check stops are included with fitting.
9. Hose: Manufacturer's standard, for service fluid, temperature, and pressure; 50 feet long.
10. Nozzle: With hand squeeze on-off control.
11. Vacuum Breaker: Integral or factory-installed, nonremovable, manual-drain-type, hose-connection vacuum breaker complying with ASSE 1011 or backflow preventer complying with ASSE 1052; and garden-hose thread complying with ASME B1.20.7 on outlet.

2.9 HOSE BIBBS

A. Hose Bibbs:

1. Standard: ASME A112.18.1 for sediment faucets.
2. Body Material: Bronze.
3. Seat: Bronze, replaceable.
4. Supply Connections: NPS 1/2 or NPS 3/4 threaded or solder-joint inlet.
5. Outlet Connection: Garden-hose thread complying with ASME B1.20.7.
6. Pressure Rating: 125 psig.
7. Vacuum Breaker: Integral nonremovable, drainable, hose-connection vacuum breaker complying with ASSE 1011.
8. Finish for Equipment Rooms: Rough bronze, or chrome or nickel plated.
9. Finish for Service Areas: Rough bronze, Chrome or nickel plated.
10. Finish for Finished Rooms: Chrome or nickel plated.
11. Operation for Equipment Rooms: Wheel handle or operating key.
12. Operation for Service Areas: Wheel handle.
13. Operation for Finished Rooms: Wheel handle.
14. Include operating key with each operating-key hose bibb.

15. Include integral wall flange with each chrome- or nickel-plated hose bibb.

2.10 WALL HYDRANTS

A. Nonfreeze Wall Hydrants:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Josam Company.
    b. MIFAB, Inc.
    c. Prier Products, Inc.
    d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
    e. Tyler Pipe; Wade Div.
    f. Watts Drainage Products Inc.
    g. Woodford Manufacturing Company.
    h. Zurn Plumbing Products Group; Light Commercial Operation.
    i. Zurn Plumbing Products Group; Specification Drainage Operation.

2. Standard: ASME A112.21.3M for concealed-outlet, self-draining wall hydrants.
3. Pressure Rating: 125 psig.
4. Operation: Loose key.
5. Casing and Operating Rod: Of length required to match wall thickness. Include wall clamp.
6. Inlet: NPS 3/4 or NPS 1.
7. Outlet: Concealed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
8. Box: Deep, flush mounting with cover.
9. Box and Cover Finish: Polished nickel bronze.
10. Outlet: Exposed, with integral vacuum breaker and garden-hose thread complying with ASME B1.20.7.
11. Nozzle and Wall-Plate Finish: Polished nickel bronze.
12. Operating Keys(s): Two with each wall hydrant.

2.11 DRAIN VALVES

A. Ball-Valve-Type, Hose-End Drain Valves:

1. Standard: MSS SP-110 for standard-port, two-piece ball valves.
2. Pressure Rating: 400-psig minimum CWP.
3. Size: NPS 3/4.
4. Body: Copper alloy.
5. Ball: Chrome-plated brass.
6. Seats and Seals: Replaceable.
7. Handle: Vinyl-covered steel.
8. Inlet: Threaded or solder joint.

9. Outlet: Threaded, short nipple with garden-hose thread complying with ASME B1.20.7 and cap with brass chain.

B. Gate-Valve-Type, Hose-End Drain Valve:

1. Standard: MSS SP-80 for gate valves.
2. Pressure Rating: Class 125.
3. Size: NPS 3/4.
4. Body: ASTM B 62 bronze.
5. Inlet: NPS 3/4 threaded or solder joint.
6. Outlet: Garden-hose thread complying with ASME B1.20.7 and cap with brass chain.

C. Stop-and-Waste Drain Valves:

1. Standard: MSS SP-110 for ball valves or MSS SP-80 for gate valves.
2. Pressure Rating: 200-psig minimum CWP or Class 125.
3. Size: NPS 3/4.
4. Body: Copper alloy or ASTM B 62 bronze.
5. Drain: NPS 1/8 side outlet with cap.

2.12 WATER HAMMER ARRESTERS

A. Water Hammer Arresters:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. AMTROL, Inc.
b. Josam Company.
c. MIFAB, Inc.
d. PPP Inc.
e. Sioux Chief Manufacturing Company, Inc.
f. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
g. Tyler Pipe; Wade Div.
h. Watts Drainage Products Inc.
i. Zurn Plumbing Products Group; Specification Drainage Operation.

3. Standard: ASSE 1010 or PDI-WH 201.
4. Type: Metal Bellows, see fixture schedule.
5. Size: ASSE 1010, Sizes AA and A through F or PDI-WH 201, Sizes A through F.

2.13 AIR VENTS

A. Bolted-Construction Automatic Air Vents:

1. Body: Bronze.
2. Pressure Rating: 125-psig minimum pressure rating at 140 deg F.
3. Float: Replaceable, corrosion-resistant metal.
4. Mechanism and Seat: Stainless steel.
5. Size: NPS 3/8 or NPS 1/2 minimum inlet.
6. Inlet and Vent Outlet End Connections: Threaded.

B. Welded-Construction Automatic Air Vents:

1. Body: Stainless steel.
2. Pressure Rating: 150-psig minimum pressure rating.
3. Float: Replaceable, corrosion-resistant metal.
4. Mechanism and Seat: Stainless steel.
5. Size: NPS 3/8 minimum inlet.
6. Inlet and Vent Outlet End Connections: Threaded.

2.14 TRAP-SEAL PRIMER VALVES

A. Supply-Type, Trap-Seal Primer Valves:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    a. MIFAB, Inc.
    b. PPP Inc.
    c. Sioux Chief Manufacturing Company, Inc.
    d. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
    e. Watts Industries, Inc.; Water Products Div.
3. Standard: ASSE 1018.
4. Pressure Rating: 125 psig minimum.
5. Body: Bronze.
6. Inlet and Outlet Connections: NPS 1/2 threaded, union, or solder joint.
7. Gravity Drain Outlet Connection: NPS 1/2 threaded or solder joint.
8. Finish: Chrome plated, or rough bronze for units used with pipe or tube that is not chrome finished.

B. Drainage-Type, Trap-Seal Primer Valves:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.

3. Standard: ASSE 1044, lavatory P-trap with NPS 3/8 minimum, trap makeup connection.
4. Size: NPS 1-1/4 minimum.
5. Material: Chrome-plated, cast brass.

2.15 TRAP-SEAL PRIMER SYSTEMS

A. Trap-Seal Primer Systems:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. PPP Inc.

2. Standard: ASSE 1044,
3. Piping: NPS 3/4, ASTM B 88, Type L; copper, water tubing.
4. Cabinet: Recessed-mounting steel box with stainless-steel cover.
5. Electric Controls: 24-hour timer, solenoid valve, and manual switch for 120-V ac power.
6. Vacuum Breaker: ASSE 1001.
7. Number Outlets: Six.
8. Size Outlets: NPS 1/2.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Refer to Division 22 Section "Common Work Results for Plumbing" for piping joining materials, joint construction, and basic installation requirements.

B. Install backflow preventers in each water supply to mechanical equipment and systems and to other equipment and water systems that may be sources of contamination. Comply with authorities having jurisdiction.

1. Locate backflow preventers in same room as connected equipment or system.
2. Install drain for backflow preventers with atmospheric-vent drain connection with air-gap fitting, fixed air-gap fitting, or equivalent positive pipe separation of at least two pipe diameters in drain piping and pipe to floor drain. Locate air-gap

device attached to or under backflow preventer. Simple air breaks are not acceptable for this application.

3. Do not install bypass piping around backflow preventers.

C. Install water regulators with inlet and outlet shutoff valves and bypass with memory-stop balancing valve. Install pressure gages on inlet and outlet.

D. Install water control valves with inlet and outlet shutoff valves and bypass with globe valve. Install pressure gages on inlet and outlet.

E. Install balancing valves in locations where they can easily be adjusted.

F. Install temperature-actuated water mixing valves with check stops or shutoff valves on inlets and with shutoff valve on outlet.

1. Install thermometers and water regulators if specified.
2. Install cabinet-type units recessed in or surface mounted on wall as specified.

G. Install Y-pattern strainers for water on supply side of each control valve,water pressure-reducing valve, solenoid valve and pump].

H. Install outlet boxes recessed in wall. Install 2-by-4-inch fire-retardant-treated-wood blocking wall reinforcement between studs. Fire-retardant-treated-wood blocking is specified in Division 06 Section "Rough Carpentry."

I. Install hose stations with check stops or shutoff valves on inlets and with thermometer on outlet.

1. Install shutoff valve on outlet if specified.
2. Install cabinet-type units recessed in or surface mounted on wall as specified. Install 2-by-4-inch fire-retardant-treated-wood blocking wall reinforcement between studs. Fire-retardant-treated-wood blocking is specified in Division 06 Section "Rough Carpentry."

J. Install ground hydrants with [1 cu. yd.] <Insert dimension> of crushed gravel around drain hole. Set ground hydrants with box flush with grade.

K. Install draining-type post hydrants with [1 cu. yd.] <Insert dimension> of crushed gravel around drain hole. Set post hydrants in concrete paving or in [1 cu. ft.] <Insert dimension> of concrete block at grade.

L. Install nonfreeze, nondraining-type post hydrants set in concrete or pavement.

M. Install freeze-resistant yard hydrants with riser pipe set in concrete or pavement. Do not encase canister in concrete.

N. Install water hammer arresters in water piping according to PDI-WH 201.

O. Install air vents at high points of water piping. Install drain piping and discharge onto floor drain.

P. Install supply-type, trap-seal primer valves with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting. Adjust valve for proper flow.

Q. Install drainage-type, trap-seal primer valves as lavatory trap with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting.

R. Install trap-seal primer systems with outlet piping pitched down toward drain trap a minimum of 1 percent, and connect to floor-drain body, trap, or inlet fitting. Adjust system for proper flow.

3.2 CONNECTIONS

A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping and specialties.

B. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."

C. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

3.3 LABELING AND IDENTIFYING

A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:

1. Pressure vacuum breakers.
2. Reduced-pressure-principle backflow preventers.
3. Double-check backflow-prevention assemblies.
4. Dual-check-valve backflow preventers.
5. Double-check, detector-assembly backflow preventers.
6. Water pressure-reducing valves.
7. Calibrated balancing valves.
8. Primary, thermostatic, water mixing valves.
9. Manifold, thermostatic, water-mixing-valve assemblies.
10. Primary water tempering valves.
11. Outlet boxes.
12. Hose stations.
13. Supply-type, trap-seal primer valves.
14. Trap-seal primer systems.

B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit. Nameplates and signs are specified in Division 22 Section "Identification for Plumbing Piping and Equipment."

3.4 FIELD QUALITY CONTROL

A. Perform the following tests and prepare test reports:

1. Test each pressure vacuum breaker, reduced-pressure-principle backflow preventer, double-check backflow-prevention assembly and double-check, detector-assembly backflow preventer according to authorities having jurisdiction and the device's reference standard.

B. Remove and replace malfunctioning domestic water piping specialties and retest as specified above.

3.5 ADJUSTING

A. Set field-adjustable pressure set points of water pressure-reducing valves.

B. Set field-adjustable flow set points of balancing valves.

C. Set field-adjustable temperature set points of temperature-actuated water mixing valves.

END OF SECTION 221119

SECTION 221313

FACILITY SANITARY SEWERS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Pipe and fittings.
2. Nonpressure couplings.
3. Cleanouts.

1.2 ACTION SUBMITTALS

A. Product Data: For expansion joints.

1.3 INFORMATIONAL SUBMITTALS

A. Coordination Drawings: Show pipe sizes, locations, and elevations. Show other piping in same trench and clearances from sewer system piping. Indicate interface and spatial relationship between manholes, piping, and proximate structures.

B. Field quality-control reports.

PART 2 - PRODUCTS

2.1 PVC PIPE AND FITTINGS

A. PVC Type PSM Sewer Piping:

1. Pipe: ASTM D 3034, SDR 35, PVC Type PSM sewer pipe with bell-and-spigot ends for gasketed joints.
2. Fittings: ASTM D 3034, PVC with bell ends.
3. Gaskets: ASTM F 477, elastomeric seals.

2.2 NONPRESSURE-TYPE TRANSITION COUPLINGS

A. Comply with ASTM C 1173, elastomeric, sleeve-type, reducing or transition coupling, for joining underground nonpressure piping. Include ends of same sizes as piping to be joined and corrosion-resistant-metal tension band and tightening mechanism on each end.

B. Sleeve Materials:
   1. For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
   2. For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.

2.3 CLEANOUTS

A. Cast-Iron Cleanouts: ASME A112.36.2M, round, gray-iron housing with clamping device and round, secured, scoriated, gray-iron cover. Include gray-iron ferrule with inside calk or spigot connection and countersunk, tapered-thread, brass closure plug.

   1. Top-Loading Classification(s): Heavy Duty.
   2. Sewer Pipe Fitting and Riser to Cleanout: ASTM A 74, Service class, cast-iron soil pipe and fittings.

2.4 CONCRETE

A. General: Cast-in-place concrete complying with ACI 318, ACI 350/350R (ACI 350M/350RM), and the following:

   1. Cement: ASTM C 150, Type II.
   2. Fine Aggregate: ASTM C 33, sand.
   3. Coarse Aggregate: ASTM C 33, crushed gravel.
   4. Water: Potable.

B. Ballast and Pipe Supports: Portland cement design mix, 3000 psi (20.7 MPa) minimum, with 0.58 maximum water/cementitious materials ratio.

   1. Reinforcing Fabric: ASTM A 185/A 185M, steel, welded wire fabric, plain.
   2. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (420 MPa) deformed steel.

PART 3 - EXECUTION

3.1 EARTHWORK

A. Excavating, trenching, and backfilling are specified in Section 312000 "Earth Moving."

3.2 PIPING INSTALLATION

A. General Locations and Arrangements: Drawing plans and details indicate general location and arrangement of underground sanitary sewer piping. Location and arrangement of piping layout take into account design considerations. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.

B. Install piping beginning at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for using lubricants, cements, and other installation requirements.

C. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.

D. When installing pipe under streets or other obstructions that cannot be disturbed, use pipe-jacking process of microtunneling.

E. Install gravity-flow, nonpressure, drainage piping according to the following:

1. Install PVC Type PSM sewer piping according to ASTM D 2321 and ASTM F 1668.

F. Clear interior of piping and manholes of dirt and superfluous material as work progresses. Maintain swab or drag in piping, and pull past each joint as it is completed. Place plug in end of incomplete piping at end of day and when work stops.

3.3 PIPE JOINT CONSTRUCTION

A. Join gravity-flow, nonpressure, drainage piping according to the following:

1. Join PVC Type PSM sewer piping according to ASTM D 2321 and ASTM D 3034 for elastomeric-seal joints or ASTM D 3034 for elastomeric-gasket joints.
2. Join dissimilar pipe materials with nonpressure-type, flexible couplings.

3.4 CONCRETE PLACEMENT

A. Place cast-in-place concrete according to ACI 318.

3.5 CLEANOUT INSTALLATION

A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade. Use cast-iron soil pipe fittings in sewer pipes at branches for cleanouts, and use cast-iron soil pipe for riser extensions to cleanouts. Install piping so cleanouts open in direction of flow in sewer pipe.

1. Use Heavy-Duty, top-loading classification cleanouts in vehicle-traffic service areas.

B. Set cleanout frames and covers in earth in cast-in-place-concrete block, 18 by 18 by 12 inches deep. Set with tops 1 inch above surrounding grade.

C. Set cleanout frames and covers in concrete pavement and roads with tops flush with pavement surface.

3.6 CONNECTIONS

A. Connect nonpressure, gravity-flow drainage piping to building's sanitary building drains specified in Section 221316 "Sanitary Waste and Vent Piping."

B. Make connections to existing piping and underground manholes.

1. Use commercially manufactured wye fittings for piping branch connections. Remove section of existing pipe, install wye fitting into existing piping, and encase entire wye fitting plus 6-inch (150-mm) overlap with not less than 6 inches (150 mm) of concrete with 28-day compressive strength of 3000 psi (20.7 MPa).
2. Make branch connections from side into existing piping, NPS 4 to NPS 20 (DN 100 to DN 500). Remove section of existing pipe, install wye fitting into existing piping, and encase entire wye with not less than 6 inches (150 mm) of concrete with 28-day compressive strength of 3000 psi (20.7 MPa).

3. Protect existing piping and manholes to prevent concrete or debris from entering while making tap connections. Remove debris or other extraneous material that may accumulate.

3.7 IDENTIFICATION

A. Materials and their installation are specified in Section 312000 "Earth Moving." Arrange for installation of green warning tapes directly over piping and at outside edges of underground manholes.
1. Use detectable warning tape over nonferrous piping and over edges of underground manholes.

3.8 FIELD QUALITY CONTROL

A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Inspect after approximately 24 inches (600 mm) of backfill is in place, and again at completion of Project.

1. Submit separate report for each system inspection.
2. Defects requiring correction include the following:

a. Alignment: Less than full diameter of inside of pipe is visible between structures.

b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
c. Damage: Crushed, broken, cracked, or otherwise damaged piping.
d. Infiltration: Water leakage into piping.
e. Exfiltration: Water leakage from or around piping.

3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
4. Reinspect and repeat procedure until results are satisfactory.

B. Test new piping systems, and parts of existing systems that have been altered, extended, or repaired, for leaks and defects.

1. Do not enclose, cover, or put into service before inspection and approval.
2. Test completed piping systems according to requirements of authorities having jurisdiction.
3. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours' advance notice.
4. Submit separate report for each test.
5. Hydrostatic Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction and the following:

a. Fill sewer piping with water. Test with pressure of at least 10-foot (3-m) head of water, and maintain such pressure without leakage for at least 15 minutes.
b. Close openings in system and fill with water.
c. Purge air and refill with water.
d. Disconnect water supply.
e. Test and inspect joints for leaks.

6. Air Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction, UNI-B-6, and the following:

a. Option: Test plastic gravity sewer piping according to ASTM F 1417.

C. Leaks and loss in test pressure constitute defects that must be repaired.

D. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.

3.9 CLEANING

A. Clean dirt and superfluous material from interior of piping. Flush with potable water.

END OF SECTION 221313

SECTION 221116 - DOMESTIC WATER PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Under-building slab and aboveground domestic water pipes, tubes, fittings, and specialties inside the building.
2. Encasement for piping.
3. Specialty valves.
4. Flexible connectors.
5. Water meters furnished by utility company for installation by Contractor.
6. Water meters.

1.3 PERFORMANCE REQUIREMENTS

A. Seismic Performance: Domestic water piping and support and installation shall withstand effects of earthquake motions determined according to ASCE/SEI 7.

B. Performance Requirements: Provide components and installation capable of producing domestic water piping systems with the following minimum working-pressure ratings, unless otherwise indicated:

1. Domestic Water Service Piping: 160 psig.
2. Domestic Water Distribution Piping: 125 psig.

1.4 SUBMITTALS

A. Product Data: For the following products:

1. Specialty valves.
2. Transition fittings.
3. Dielectric fittings.
4. Flexible connectors.
5. Water meters.
6. Backflow preventers and vacuum breakers.

SECTION 221316 - SANITARY WASTE AND VENT PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes the following for soil, waste, and vent piping inside the building:

1. Pipe, tube, and fittings.
2. Special pipe fittings.
3. Encasement for underground metal piping.

B. Any sanitary piping located above a drop ceiling or within a wall adjacent to an occupied space is to be insulated cast iron.

1.3 DEFINITIONS

A. ABS: Acrylonitrile-butadiene-styrene plastic.

B. EPDM: Ethylene-propylene-diene terpolymer rubber.

C. LLDPE: Linear, low-density polyethylene plastic.

D. NBR: Acrylonitrile-butadiene rubber.

E. PE: Polyethylene plastic.

F. PVC: Polyvinyl chloride plastic.

G. TPE: Thermoplastic elastomer.

1.4 PERFORMANCE REQUIREMENTS

A. Components and installation shall be capable of withstanding the following minimum working pressure, unless otherwise indicated:

1. Soil, Waste, and Vent Piping: 10-foot head of water.

B. Seismic Performance: Soil, waste, and vent piping and support and installation shall be capable of withstanding the effects of seismic events determined according to ASCE 7, "Minimum Design Loads for Buildings and Other Structures."

1.5 SUBMITTALS

A. Product Data: For pipe, tube, fittings, and couplings.

B. Shop Drawings:

1. Design Calculations: Signed and sealed by a qualified professional engineer for selecting seismic restraints.

C. Coordination Drawings: Plans and details, drawn to scale, on which above and below ground sanitary and vent piping is shown and coordinated with other installations, using input from installers of the items involved. Clearly indicate all inverts and coordinate with site contractors.

D. Field quality-control inspection and test reports.

1.6 QUALITY ASSURANCE

A. Piping materials shall bear label, stamp, or other markings of specified testing agency.

B. Comply with NSF 14, "Plastics Piping Systems Components and Related Materials," for plastic piping components. Include marking with "NSF-dwv" for plastic drain, waste, and vent piping; "NSF-drain" for plastic drain piping; "NSF-tubular" for plastic continuous waste piping; and "NSF-sewer" for plastic sewer piping.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, manufacturers specified.
2. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

2.2 PIPING MATERIALS

A. Refer to Part 3 "Piping Applications" Article for applications of pipe, tube, fitting, and joining materials.

2.3 HUB-AND-SPIGOT, CAST-IRON SOIL PIPE AND FITTINGS

A. Pipe and Fittings: ASTM A 74, Service class.

B. Gaskets: ASTM C 564, rubber.

2.4 HUBLESS CAST-IRON SOIL PIPE AND FITTINGS

A. Pipe and Fittings: ASTM A 888 or CISPI 301.

B. Sovent Stack Fittings: ASME B16.45 or ASSE 1043, hubless, cast-iron aerator and deaerator drainage fittings.

C. Shielded Couplings: ASTM C 1277 assembly of metal shield or housing, corrosion-resistant fasteners, and rubber sleeve with integral, center pipe stop.

1. Heavy-Duty, Shielded, Stainless-Steel Couplings: With stainless-steel shield, stainless-steel bands and tightening devices, and ASTM C 564, rubber sleeve.

a. Available Manufacturers:

1) ANACO.
2) Clamp-All Corp.
3) Ideal Div.; Stant Corp.
4) Mission Rubber Co.
5) Tyler Pipe; Soil Pipe Div.

2.5 STEEL PIPE AND FITTINGS

A. Steel Pipe: ASTM A 53/A 53M, Type E or S, Grade A or B, Standard Weight or Schedule 40, galvanized. Include ends matching joining method.

B. Drainage Fittings: ASME B16.12, threaded, cast-iron drainage pattern.

2.6 STAINLESS-STEEL PIPE AND FITTINGS

A. Pipe and Fittings: ASME A112.3.1, drainage pattern with socket and spigot ends.

B. Gaskets: Lip seals shaped to fit socket groove, with plastic backup ring.

1. Material: EPDM, unless NBR is indicated.

2.7 ENCASEMENT FOR UNDERGROUND METAL PIPING

A. Description: ASTM A 674 or AWWA C105, high-density, crosslaminated PE film of 0.004-inch minimum thickness.

B. Form: Sheet.

C. Color: Black.

PART 3 - EXECUTION

3.1 EXCAVATION

A. Refer to Division 31 Section "Earth Moving" for excavating, trenching, and backfilling.

3.2 PIPING APPLICATIONS

A. Flanges and unions may be used on aboveground pressure piping, unless otherwise indicated.

B. Aboveground, soil and waste piping NPS 4 and smaller shall be the following:

1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
2. Hubless cast-iron soil pipe and fittings heavy-duty shielded, couplings; and hubless-coupling joints.

C. Aboveground, soil and waste piping NPS 5 and larger shall be the following:

1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
2. Hubless cast-iron soil pipe and fittings and heavy-duty shielded, stainless-steel couplings; and hubless-coupling joints.

D. Aboveground, vent piping NPS 4 and smaller shall be the following:

1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
2. Hubless cast-iron soil pipe and fittings; heavy-duty shielded, stainless-steel couplings; and hubless-coupling joints.

E. Aboveground, vent piping NPS 5 and larger shall be the following:

1. Service class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
2. Hubless cast-iron soil pipe and fittings; heavy-duty shielded, stainless-steel couplings; and hubless-coupling joints.

F. Underground, soil, waste, and vent piping NPS 4 and smaller shall be the following:

1. Service class, cast-iron soil piping; gaskets; and gasketed joints.

G. Underground, soil and waste piping NPS 5 and larger shall be the following:

1. Service class, cast-iron soil piping; gaskets; and gasketed joints.

3.3 PIPING INSTALLATION

A. Sanitary sewer piping outside the building is specified in Division 22 Section "Facility Sanitary Sewers."

B. Basic piping installation requirements are specified in Division 22 Section "Common Work Results for Plumbing."

C. Install seismic restraints on piping. Seismic-restraint devices are specified in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment."

D. Install cleanouts at grade and extend to where building sanitary drains connect to building sanitary sewers.

E. Install cleanout fitting with closure plug inside the building in sanitary force-main piping.

F. Provide an additional one hundred feet of drainage and vent piping for each size used on the project to resolve interferences or as directed by the Engineer.

G. Install underground, steel, force-main piping. Install encasement on piping according to ASTM A 674 or AWWA C105.

H. Install underground, ductile-iron, force-main piping according to AWWA C600. Install buried piping inside the building between wall and floor penetrations and connection to sanitary sewer piping outside the building with restrained joints. Anchor pipe to wall or floor. Install thrust-block supports at vertical and horizontal offsets.

1. Install encasement on piping according to ASTM A 674 or AWWA C105.

I. Install underground, copper, force-main tubing according to CDA's "Copper Tube Handbook."

1. Install encasement on piping according to ASTM A 674 or AWWA C105.

J. Install underground, ductile-iron, special pipe fittings according to AWWA C600.

1. Install encasement on piping according to ASTM A 674 or AWWA C105.

K. Install cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings."

1. Install encasement on underground piping according to ASTM A 674 or AWWA C105.

L. Make changes in direction for soil and waste drainage and vent piping using appropriate branches, bends, and long-sweep bends. Sanitary tees and short-sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Use long-turn, double Y-branch and 1/8-bend fittings if 2 fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Use proper size of standard increasers and reducers if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

M. Lay buried building drainage piping beginning at low point of each system. Install true to grades and alignment indicated, with unbroken continuity of invert. Place hub ends of piping upstream. Install required gaskets according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements. Maintain swab in piping and pull past each joint as completed.

N. Install soil and waste drainage and vent piping at the following minimum slopes, unless otherwise indicated:

1. Building Sanitary Drain: 2 percent downward in direction of flow for piping NPS 3 and smaller; 1 percent downward in direction of flow for piping NPS 4 and larger.
2. Horizontal Sanitary Drainage Piping: 2 percent downward in direction of flow.
3. Vent Piping: 1 percent down toward vertical fixture vent or toward vent stack.

O. Install engineered soil and waste drainage and vent piping systems as follows:

1. Combination Waste and Vent: Comply with standards of authorities having jurisdiction.
2. Sovent Drainage System: Comply with ASSE 1043 and sovent fitting manufacturer's written installation instructions.
3. Reduced-Size Venting: Comply with standards of authorities having jurisdiction.

P. Sleeves are not required for cast-iron soil piping passing through concrete slabs-on-grade if slab is without membrane waterproofing.

Q. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.

R. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."

S. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Division 22 Section "Sleeves and Sleeve Seals for Plumbing Piping."

T. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Division 22 Section "Escutcheons for Plumbing Piping."

3.4 JOINT CONSTRUCTION

A. Basic piping joint construction requirements are specified in Division 22 Section "Common Work Results for Plumbing."

B. Join hub-and-spigot, cast-iron soil piping with gasket joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.

C. Join hubless cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-coupling joints.

3.5 VALVE INSTALLATION

A. General valve installation requirements are specified in Division 22 Section "General-Duty Valves for Plumbing Piping."

B. Backwater Valves: Install backwater valves in piping subject to sewage backflow.

1. Horizontal Piping: Horizontal backwater valves. Use normally closed type, unless otherwise indicated.
2. Floor Drains: Drain outlet backwater valves, unless drain has integral backwater valve.
3. Install backwater valves in accessible locations.
4. Backwater valve are specified in Division 22 Section "Sanitary Waste Piping Specialties."

3.6 HANGER AND SUPPORT INSTALLATION

A. Seismic-restraint devices are specified in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment."

B. Pipe hangers and supports are specified in Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment." Install the following:

1. Vertical Piping: MSS Type 8 or Type 42, clamps.
2. Install individual, straight, horizontal piping runs according to the following:

a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.

c. Longer Than 100 Feet, if Indicated: MSS Type 49, spring cushion rolls.

3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
4. Base of Vertical Piping: MSS Type 52, spring hangers.

C. Install supports according to Division 22 Section "Hangers and Supports for Plumbing Piping and Equipment."

D. Support vertical piping and tubing at base and at each floor.

E. Rod diameter may be reduced 1 size for double-rod hangers, with 3/8-inch minimum rods.

F. Install hangers for cast-iron soil piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 1-1/2 and NPS 2: 60 inches with 3/8-inch rod.
2. NPS 3: 60 inches with 1/2-inch rod.
3. NPS 4 and NPS 5: 60 inches with 5/8-inch rod.
4. NPS 6: 60 inches with 3/4-inch rod.
5. NPS 8 to NPS 12: 60 inches with 7/8-inch rod.

G. Install supports for vertical cast-iron soil piping every 15 feet.

H. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 1-1/4: 84 inches with 3/8-inch rod.
2. NPS 1-1/2: 108 inches with 3/8-inch rod.
3. NPS 2: 10 feet with 3/8-inch rod.
4. NPS 2-1/2: 11 feet with 1/2-inch rod.
5. NPS 3: 12 feet with 1/2-inch rod.
6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
7. NPS 6: 12 feet with 3/4-inch rod.
8. NPS 8 to NPS 12: 12 feet with 7/8-inch rod.

I. Install supports for vertical steel piping every 15 feet.

J. Install hangers for stainless-steel piping with the following maximum horizontal spacing and minimum rod diameters:

1. NPS 2: 84 inches with 3/8-inch rod.
2. NPS 3: 96 inches with 1/2-inch rod.
3. NPS 4: 108 inches with 1/2-inch rod.
4. NPS 6: 10 feet with 5/8-inch rod.

K. Install supports for vertical stainless-steel piping every 10 feet.

L. Support piping and tubing not listed above according to MSS SP-69 and manufacturer's written instructions.

3.7 CONNECTIONS

A. Drawings indicate general arrangement of piping, fittings, and specialties.

B. Connect soil and waste piping to exterior sanitary sewerage piping. Use transition fitting to join dissimilar piping materials.

C. Connect drainage and vent piping to the following:

1. Plumbing Fixtures: Connect drainage piping in sizes indicated, but not smaller than required by plumbing code.
2. Plumbing Fixtures and Equipment: Connect atmospheric vent piping in sizes indicated, but not smaller than required by authorities having jurisdiction.
3. Plumbing Specialties: Connect drainage and vent piping in sizes indicated, but not smaller than required by plumbing code.
4. Equipment: Connect drainage piping as indicated. Provide shutoff valve, if indicated, and union for each connection. Use flanges instead of unions for connections NPS 2-1/2 and larger.

3.8 FIELD QUALITY CONTROL

A. During installation, notify authorities having jurisdiction at least 24 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.

1. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
2. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.

B. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.

C. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.

D. Test sanitary drainage and vent piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:

1. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
2. Leave uncovered and unconcealed new, altered, extended, or replaced drainage and vent piping until it has been tested and approved. Expose work that was covered or concealed before it was tested.

3. Roughing-in Plumbing Test Procedure: Test drainage and vent piping, except outside leaders, on completion of roughing-in. Close openings in piping system and fill with water to point of overflow, but not less than 10-foot head of water. From 15 minutes before inspection starts to completion of inspection, water level must not drop. Inspect joints for leaks.
4. Finished Plumbing Test Procedure: After plumbing fixtures have been set and traps filled with water, test connections and prove they are gastight and watertight. Plug vent-stack openings on roof and building drains where they leave building. Introduce air into piping system equal to pressure of 1-inch wg. Use U-tube or manometer inserted in trap of water closet to measure this pressure. Air pressure must remain constant without introducing additional air throughout period of inspection. Inspect plumbing fixture connections for gas and water leaks.
5. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
6. Prepare reports for tests and required corrective action.

3.9 CLEANING

A. Clean interior of piping. Remove dirt and debris as work progresses.

B. Protect drains during remainder of construction period to avoid clogging with dirt and debris and to prevent damage from traffic and construction work.

C. Place plugs in ends of uncompleted piping at end of day and when work stops.

END OF SECTION 221316

SECTION 221319 - SANITARY WASTE PIPING SPECIALTIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes the following sanitary drainage piping specialties:
   1. Cleanouts.
   2. Floor drains.
   3. Trench drains.
   4. Air-admittance valves.
   5. Roof flashing assemblies.
   6. Through-penetration firestop assemblies.
   7. Miscellaneous sanitary drainage piping specialties.
   8. Flashing materials.
   9. Grease interceptors.
   10. Grease removal devices.
   11. Oil interceptors.
   12. Solids interceptors.

B. Related Sections include the following:

   1. Division 22 Section "Storm Drainage Piping Specialties" for trench drains for storm water, and catch basins.

1.3 DEFINITIONS

A. ABS: Acrylonitrile-butadiene-styrene plastic.

B. FOG: Fats, oils, and greases.

C. FRP: Fiberglass-reinforced plastic.

D. HDPE: High-density polyethylene plastic.

E. PE: Polyethylene plastic.

F. PP: Polypropylene plastic.

G. PVC: Polyvinyl chloride plastic.

1.4 SUBMITTALS

A. Product Data: For each type of product indicated. Include rated capacities, operating characteristics, and accessories for the following:
   1. Grease interceptors.
   2. Grease removal devices.
   3. Oil interceptors.

B. Shop Drawings: Show fabrication and installation details for frost-resistant vent terminals.

   1. Wiring Diagrams: Power, signal, and control wiring.

C. Manufacturer Seismic Qualification Certification: Submit certification that interceptors andaccessories, and components will withstand seismic forces defined in Division 22 Section "Vibration and Seismic Controls for Plumbing Piping and Equipment." Include the following:

   1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.

      a. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified."
      b. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."

   2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
   3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.

D. Field quality-control test reports.

E. Operation and Maintenance Data: For drainage piping specialties to include in emergency, operation, and maintenance manuals.

1.5 QUALITY ASSURANCE

A. Drainage piping specialties shall bear label, stamp, or other markings of specified testing agency.

B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

C. Comply with NSF 14, "Plastics Piping Components and Related Materials," for plastic sanitary piping specialty components.

1.6 COORDINATION

A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 03.

B. Coordinate size and location of roof penetrations.

1.7 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

PART 2 - PRODUCTS

2.1 CLEANOUTS

A. Exposed Metal Cleanouts:
   1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

      a. Josam Company; Josam Div.
      b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
      c. Tyler Pipe; Wade Div.
      d. Watts Drainage Products Inc.
      e. Zurn Plumbing Products Group; Specification Drainage Operation.
      f. Josam Company; Blucher-Josam Div.

   2. Standard: ASME A112.36.2M for cast iron & ASME A112.3.1 for stainless steel for cleanout test tee.
   3. Size: Same as connected drainage piping
   4. Body Material: Hub-and-spigot, cast-iron soil pipe T-branch as required to match connected piping.
   5. Closure: Countersun brass plug.
   6. Closure Plug Size: Same as or not more than one size smaller than cleanout size.
   7. Closure: Stainless-steel plug with seal.
   8. See plumbing fixture schedule for additional requirements

B. Metal Floor Cleanouts:
   1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

      a. Josam Company; Josam Div.
      b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
      c. Tyler Pipe; Wade Div.
      d. Watts Drainage Products Inc.
      e. Zurn Plumbing Products Group; Light Commercial Operation.

f. Zurn Plumbing Products Group; Specification Drainage Operation.
g. Josam Company; Josam Div.

2. Standard: ASME A112.36.2M for cleanout.
3. Size: Same as connected branch.
4. Closure: Brass plug with straight threads and gasket
5. Riser: ASTM A 74, Service class, cast-iron drainage pipe fitting and riser to cleanout.
6. Standard: ASME A112.3.1.
7. Size: Same as connected branch.
8. Housing: Stainless steel.
9. Closure: Stainless steel with seal.
10. Riser: Stainless-steel drainage pipe fitting to cleanout.
11. See plumbing fixture schedule for additional requirements

C. Cast-Iron Wall Cleanouts
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Josam Company; Josam Div.
b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
c. Tyler Pipe; Wade Div.
d. Watts Drainage Products Inc.
e. Zurn Plumbing Products Group; Specification Drainage Operation.

2. Standard: ASME A112.36.2M. Include wall access.
3. Size: Same as connected drainage piping.
4. Body: As required to match connected piping.
5. Closure: Countersunk brass plug.
6. Closure Plug Size: Same as or not more than one size smaller than cleanout size.
7. Wall Access: Round, flat, chrome-plated brass or stainless-steel cover plate with screw.
8. Wall Access: Round stainless-steel wall-installation frame and cover.
9. See plumbing fixture schedule for additional requirements

2.2 FLOOR DRAINS

A. Cast-Iron Floor Drains
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
a. Josam Company; Josam Div.
b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
c. Tyler Pipe; Wade Div.
d. Watts Drainage Products Inc.
e. Zurn Plumbing Products Group; Light Commercial Operation.
f. Zurn Plumbing Products Group; Specification Drainage Operation.

2. Standard: ASME A112.6.3.
3. Body Material: See Fixture Schedule.
4. Seepage Flange: See Fixture Schedule
5. Anchor Flange: See Fixture Schedule.
6. Clamping Device: See Fixture Schedule.
7. Outlet: Bottom
8. Trap Pattern: Deep-seal P-trap
9. See plumbing fixture schedule for additional requirements

2.3 TRENCH DRAINS

A. Trench Drains
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Josam Company; Josam Div.
    b. Smith, Jay R. Mfg. Co.; Division of Smith Industries, Inc.
    c. Tyler Pipe; Wade Div.
    d. Watts Drainage Products Inc.
    e. Zurn Plumbing Products Group; Specification Drainage Operation.

2. Standard: ASME A112.6.3 for trench drains.
3. Material: Ductile or gray iron.
4. Outlet: See drawings
5. See plumbing fixture schedule for additional requirements

2.4 ROOF FLASHING ASSEMBLIES

A. Roof Flashing Assemblies
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Acorn Engineering Company; Elmdor/Stoneman Div.
    b. Thaler Metal Industries Ltd.

B. Description: Lead flashing collar and skirt extending at least 8 inches from pipe, with galvanized-steel boot reinforcement and counterflashing fitting.

1. Open-Top Vent Cap: Without cap.
2. Low-Silhouette Vent Cap: With vandal-proof vent cap.
3. Extended Vent Cap: With field-installed, vandal-proof vent cap.

2.5 THROUGH-PENETRATION FIRESTOP ASSEMBLIES

A. Through-Penetration Firestop Assemblies:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

    a. ProSet Systems Inc.

2. Standard: UL 1479 assembly of sleeve and stack fitting with firestopping plug.
3. Size: Same as connected soil, waste, or vent stack.
4. Sleeve: Molded PVC plastic, of length to match slab thickness and with integral nailing flange on one end for installation in cast-in-place concrete slabs.
5. Stack Fitting: ASTM A 48/A 48M, gray-iron, hubless-pattern, wye branch with neoprene O-ring at base and gray-iron plug in thermal-release harness. Include PVC protective cap for plug.
6. Special Coating: Corrosion resistant on interior of fittings.

2.6 MISCELLANEOUS SANITARY DRAINAGE PIPING SPECIALTIES

A. Deep-Seal Traps:

1. Description: Cast-iron or bronze casting, with inlet and outlet matching connected piping and cleanout trap-seal primer valve connection.
2. Size: Same as connected waste piping.

    a. NPS 2: 4-inch- minimum water seal.
    b. NPS 2-1/2 and Larger: 5-inch- minimum water seal.

B. Floor-Drain, Trap-Seal Primer Fittings:

1. Description: Cast iron, with threaded inlet and threaded or spigot outlet, and trap-seal primer valve connection.
2. Size: Same as floor drain outlet with NPS 1/2 side inlet.

C. Air-Gap Fittings:

1. Standard: ASME A112.1.2, for fitting designed to ensure fixed, positive air gap between installed inlet and outlet piping.
2. Body: Bronze or cast iron.
3. Inlet: Opening in top of body.
4. Outlet: Larger than inlet.
5. Size: Same as connected waste piping and with inlet large enough for associated indirect waste piping.

D. Sleeve Flashing Device:

1. Description: Manufactured, cast-iron fitting, with clamping device, that forms sleeve for pipe floor penetrations of floor membrane. Include galvanized-steel pipe extension in top of fitting that will extend 2 inches above finished floor and galvanized-steel pipe extension in bottom of fitting that will extend through floor slab.

2. Size: As required for close fit to riser or stack piping.

E. Stack Flashing Fittings

1. Description: Counterflashing-type, cast-iron fitting, with bottom recess for terminating roof membrane, and with threaded or hub top for extending vent pipe.
2. Size: Same as connected stack vent or vent stack.

F. Vent Caps

1. Description: Cast-iron body with threaded or hub inlet and vandal-proof design. Include vented hood and setscrews to secure to vent pipe.
2. Size: Same as connected stack vent or vent stack.

G. Frost-Resistant Vent Terminals

1. Description: Manufactured or shop-fabricated assembly constructed of copper, lead-coated copper, or galvanized steel.
2. Design: To provide 1-inch enclosed air space between outside of pipe and inside of flashing collar extension, with counterflashing.

H. Expansion Joints

1. Standard: ASME A112.21.2M.
2. Body: Cast iron with bronze sleeve, packing, and gland.
3. End Connections: Matching connected piping.
4. Size: Same as connected soil, waste, or vent piping.

2.7 FLASHING MATERIALS

A. Lead Sheet: ASTM B 749, Type L51121, copper bearing, with the following minimum weights and thicknesses, unless otherwise indicated:

1. General Use: 4.0-lb/sq. ft., 0.0625-inch thickness.
2. Vent Pipe Flashing: 3.0-lb/sq. ft., 0.0469-inch thickness.
3. Burning: 6-lb/sq. ft., 0.0938-inch thickness.

B. Copper Sheet: ASTM B 152/B 152M, of the following minimum weights and thicknesses, unless otherwise indicated:

1. General Applications: 12 oz./sq. ft. thickness.
2. Vent Pipe Flashing: 8 oz./sq. ft. thickness.

C. Zinc-Coated Steel Sheet: ASTM A 653/A 653M, with 0.20 percent copper content and 0.04-inch minimum thickness, unless otherwise indicated. Include G90 hot-dip galvanized, mill-phosphatized finish for painting if indicated.

D. Elastic Membrane Sheet: ASTM D 4068, flexible, chlorinated polyethylene, 40-mil minimum thickness.

E. Fasteners: Metal compatible with material and substrate being fastened.

F. Metal Accessories: Sheet metal strips, clamps, anchoring devices, and similar accessory units required for installation; matching or compatible with material being installed.

G. Solder: ASTM B 32, lead-free alloy.

H. Bituminous Coating: SSPC-Paint 12, solvent-type, bituminous mastic.

PART 3 - EXECUTION

3.1 CONCRETE BASES

A. Anchor grease interceptors and solids interceptors to concrete bases.

1. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 19-inch centers around full perimeter of base.
2. For installed equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete floor.
3. Place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be imbedded.
4. Install anchor bolts to elevations required for proper attachment to supported equipment.
5. Concrete base construction requirements are specified in Division 22 Section "Common Work Results for Plumbing."
6. Cast-in-place concrete materials and placement requirements are specified in Division 03.

3.2 INSTALLATION

A. Refer to Division 22 Section "Common Work Results for Plumbing" for piping joining materials, joint construction, and basic installation requirements.

B. Install backwater valves in building drain piping where noted. For interior installation, provide cleanout deck plate flush with floor and centered over backwater valve cover, and of adequate size to remove valve cover for servicing.

C. Install cleanouts in aboveground piping and building drain piping according to the following, unless otherwise indicated:

1. Size same as drainage piping up to NPS 4. Use NPS 4 for larger drainage piping unless larger cleanout is indicated.
2. Locate at each change in direction of piping greater than 45 degrees.
3. Locate at minimum intervals of 50 feet for piping NPS 4 and smaller and 100 feet for larger piping.
4. Locate at base of each vertical soil and waste stack.

D. For floor cleanouts for piping below floors, install cleanout deck plates with top flush with finished floor.

E. For cleanouts located in concealed piping, install cleanout wall access covers, of types indicated, with frame and cover flush with finished wall.

F. Install floor drains at low points of surface areas to be drained. Set grates of drains flush with finished floor, unless otherwise indicated.

1. Position floor drains for easy access and maintenance.
2. Set floor drains below elevation of surrounding finished floor to allow floor drainage. Set with grates depressed according to the following drainage area radii:

    a. Radius, 30 Inches or Less: Equivalent to 1 percent slope, but not less than 1/4-inch total depression.
    b. Radius, 30 to 60 Inches: Equivalent to 1 percent slope.
    c. Radius, 60 Inches or Larger: Equivalent to 1 percent slope, but not greater than 1-inch total depression.

3. Install floor-drain flashing collar or flange so no leakage occurs between drain and adjoining flooring. Maintain integrity of waterproof membranes where penetrated.
4. Install individual traps for floor drains connected to sanitary building drain, unless otherwise indicated.

G. Install trench drains at low points of surface areas to be drained. Set grates of drains flush with finished surface, unless otherwise indicated.

H. Assemble and install ASME A112.3.1, stainless-steel channel drainage systems according to ASME A112.3.1. Install on support devices so that top will be flush with surface.

I. Assemble non-ASME A112.3.1, stainless-steel channel drainage system components according to manufacturer's written instructions. Install on support devices so that top will be flush with adjacent surface.

J. Assemble FRP channel drainage system components according to manufacturer's written instructions. Install on support devices so that top will be flush with adjacent surface.

K. Assemble plastic channel drainage system components according to manufacturer's written instructions. Install on support devices so that top will be flush with adjacent surface.

L. Install fixture air-admittance valves on fixture drain piping.

M. Install stack air-admittance valves at top of stack vent and vent stack piping.

N. Install air-admittance-valve wall boxes recessed in wall.

O. Install roof flashing assemblies on sanitary stack vents and vent stacks that extend through roof.

P. Install flashing fittings on sanitary stack vents and vent stacks that extend through roof.

Q. Install through-penetration firestop assemblies in plastic at floor penetrations.

R. Assemble open drain fittings and install with top of hub 2 inches above floor.

S. Install deep-seal traps on floor drains and other waste outlets, if indicated.

T. Install floor-drain, trap-seal primer fittings on inlet to floor drains that require trap-seal primer connection.

1. Exception: Fitting may be omitted if trap has trap-seal primer connection.
2. Size: Same as floor drain inlet.

U. Install air-gap fittings on draining-type backflow preventers and on indirect-waste piping discharge into sanitary drainage system.

V. Install sleeve flashing device with each riser and stack passing through floors with waterproof membrane.

W. Install vent caps on each vent pipe passing through roof.

X. Install frost-resistant vent terminals on each vent pipe passing through roof. Maintain 1-inch clearance between vent pipe and roof substrate.

Y. Install expansion joints on vertical stacks and conductors. Position expansion joints for easy access and maintenance.

Z. Install frost-proof vent caps on each vent pipe passing through roof. Maintain 1-inch clearance between vent pipe and roof substrate.

AA. Install cleanout immediately downstream from all interceptors that do not have integral cleanout on outlet. Install trap on interceptors that do not have integral trap and are connected to sanitary drainage and vent systems.

BB. Install traps on plumbing specialty drain outlets. Omit traps on indirect wastes unless trap is indicated.

3.3 CONNECTIONS

A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.

B. Install piping adjacent to equipment to allow service and maintenance.

C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."

D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

3.4 FLASHING INSTALLATION

A. Fabricate flashing from single piece unless large pans, sumps, or other drainage shapes are required. Join flashing according to the following if required:

1. Lead Sheets: Burn joints of lead sheets 6.0-lb/sq. ft., 0.0938-inch thickness or thicker. Solder joints of lead sheets 4.0-lb/sq. ft., 0.0625-inch thickness or thinner.
2. Copper Sheets: Solder joints of copper sheets.

B. Install sheet flashing on pipes, sleeves, and specialties passing through or embedded in floors and roofs with waterproof membrane.

1. Pipe Flashing: Sleeve type, matching pipe size, with minimum length of 10 inches, and skirt or flange extending at least 8 inches around pipe.
2. Sleeve Flashing: Flat sheet, with skirt or flange extending at least 8 inches around sleeve.
3. Embedded Specialty Flashing: Flat sheet, with skirt or flange extending at least 8 inches around specialty.

C. Set flashing on floors and roofs in solid coating of bituminous cement.

D. Secure flashing into sleeve and specialty clamping ring or device.

E. Install flashing for piping passing through roofs with counterflashing or commercially made flashing fittings, according to Division 07 Section "Sheet Metal Flashing and Trim."

F. Extend flashing up vent pipe passing through roofs and turn down into pipe, or secure flashing into cast-iron sleeve having calking recess.

G. Fabricate and install flashing and pans, sumps, and other drainage shapes.

3.5 LABELING AND IDENTIFYING

A. Equipment Nameplates and Signs: Install engraved plastic-laminate equipment nameplate or sign on or near each of the following:
1. Oil interceptors.
2. Sand/Sediment interceptors.

B. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in

addition to identifying unit. Nameplates and signs are specified in Division 22 Section "Identification for Plumbing Piping and Equipment."

3.6 FIELD QUALITY CONTROL

A. Tests and Inspections:

1. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
2. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

3.7 PROTECTION

A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.

B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

3.8 DEMONSTRATION

A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain oil and sand interceptors.

END OF SECTION 221319

SECTION 221343 - PACKAGED DUPLEX GRINDER PUMPS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. The contractor shall provide labor, materials, equipment and incidentals required to provide one 2HP Grinder Pump Package, consisting of two (2) centrifugal grinder pumps as specified herein. The pump models shall be LSG Series three phase grinder pumps as per Omnivore D3684LSGX203-S-IP as manufactured by Liberty Pumps or approved similar.

B. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes wet-well, packaged pumping stations with submersible grinder sewage pumps.

1.3 PERFORMANCE REQUIREMENTS

A. Pressure Rating of Sewage Pumps and Discharge Piping Components: At least equal to sewage pump discharge pressure, but not less than 125 psig.

B. Pressure Rating of Other Piping Components: At least equal to system operating pressure.

1.4 ACTION SUBMITTALS

A. Product Data: Include rated capacities, operating characteristics, furnished specialties, and accessories.

B. Shop Drawings: Show fabrication and installation details for each packaged sewage pumping station. Detail equipment assemblies and indicate dimensions; shipping, installed, and operating weights; loads; required clearances; method of field assembly; components; electrical characteristics; and location and size of each field connection.

1. Wiring Diagrams: Power, signal, and control wiring.

1.5 INFORMATIONAL SUBMITTALS

A. Product Certificates: For each type of sewage pump, signed by product manufacturer.

B. Manufacturer Seismic Qualification Certification: Submit certification that packaged sewage pumping station, accessories, and components will withstand seismic forces defined in Section 220548 "Vibration and Seismic Controls for Plumbing Piping and Equipment." Include the following:

1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.

    a. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified."
    b. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."

2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.

3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.

C. Qualification Data: For Installer.

D. Source quality-control test reports.

E. Field quality-control test reports.

F. Warranty: Special warranty specified in this Section.

1.6 CLOSEOUT SUBMITTALS

A. Operation and Maintenance Data: For equipment to include in emergency, operation, and maintenance manuals.

1.7 QUALITY ASSURANCE

A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.

B. Comply with HI 1.1-1.2, "Centrifugal Pumps for Nomenclature and Definitions"; HI 1.3, "Centrifugal Pumps for Design and Application"; and HI 1.4, "Centrifugal Pumps for Installation, Operation and Maintenance," for sewage pumps.

C. Comply with UL 778, "Motor-Operated Water Pumps," for sewage pumps.

1.8 PROJECT CONDITIONS

A. Interruption of Existing Sanitary Sewer Service: Do not interrupt sanitary sewer service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary sanitary sewer service according to requirements indicated:

1. Notify Engineer and Owner no fewer than two days in advance of proposed interruption of sanitary sewer service.
2. Do not proceed with interruption of sanitary sewer service without Engineer or Owner's written permission.

1.9 COORDINATION

A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Section 033000 "Cast-in-Place Concrete."

1.10 WARRANTY

A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of packaged sewage pumping stations that fail in materials or workmanship within specified warranty period.

1. Failures include, but are not limited to, the following:

    a. Structural failures including shell.
    b. Faulty operation of sewage pumps, controls, or accessories.
    c. Deterioration of metals, metal finishes, and other materials beyond normal use.
2. Warranty Period for Shell: 3 years from date of Substantial Completion.
3. Warranty Period for Sewage Pumps and Controls: 3 years from date of Substantial Completion.
4. Warranty Period for Accessories: 3 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 WET-WELL, PACKAGED SEWAGE GRINDER PUMPING STATIONS

A. Wet-Well, Packaged Sewage Pumping Station with Submersible Grinder Sewage Pumps:

1. Description: Factory fabricated, assembled, and tested with wet well for sewage pumps and collection of sanitary sewage and with dry equipment chamber for controls and accessories.

    a. Orientation: Shell underground with dry equipment chamber underground with top flush with grade.
    b. Shell: Factory fabricated from fiberglass.
    c. Sewage Pumps: Two submersible grinder-type sewage pumps, with guide rail, quick-disconnect system, controls, and piping. Include stainless-steel grinder impeller and hermetically sealed motor with moisture-sensing probe, mechanical seals, and waterproof power cable.

2. Capacities and Characteristics:

    a. Diameter or Dimensions of Shell: 36 inches.
    b. Height of Shell Base Section: 72 inches.
    c. Pumping Station, Inlet Pipe Size: 4-inches with flange gasket and pipe seal.
    d. Pumping Station, Discharge Pipe Size: 2" Schedule 80 PVC
    e. Sewage Pumps: Two required.
    f. Each Sump Pump:

        1) Capacity: 36 gpm.
        2) Total Dynamic Head: 55 feet.
        3) Speed: 3450 rpm
        4) Impeller: Grinder type.
        5) Inlet Size: 4" With flange gasket and pipe seal.
        6) Discharge Size: 2" Schedule 40 PVC.
        7) Motor Size: 2 hp.
        8) Electrical Characteristics:

            a) Volts: 208 V.
            b) Phases: Three
            c) Hertz: 60.

    g. Characteristics:

        1) Full-Load Amperes: 10.6.
        2) Minimum Circuit Ampacity: 30 Amp
        3) Maximum Overcurrent Protection: 30 Amp

2.2 CONTROLS

A. Control Sequence of Operation: Cycle each sewage pump on and off automatically to maintain wet-well sewage level. Automatic control operates both pumps in parallel if wet-well level rises above starting point of low-level pump, until shutoff level is

reached. Automatic alternator, with manual disconnect switch, changes sequence of lead-lag sewage pumps at completion of each pumping cycle.

B. Transducer System: Senses variations of sewage level in wet well. Include high and low adjustments capable of operating on 6-inch minimum differential of liquid level.

C. Motor Controllers: Magnetic, full voltage, non-reversing. Include undervoltage release, thermal-overload heaters in each phase, manual reset buttons, and hand-automatic selector switches. Include circuit breakers to provide branch-circuit protection for each controller.

D. 120-V accessory controls with 15-A, single-phase circuit breakers or fuses for each item.

E. Control Panel: NEMA 4X weatherproof enclosure for indoor/outdoor mounting with audible 80 DBI and visual high-water alarm, complying with UL 508A with separate compartments and covers for controllers, circuit breakers, transformers, alternators, and single-phase controls. Include 20-A duplex receptacle in NEMA WD 1, Configuration 5-20R mounted on exterior of control panel.

1. Mounting: At Grinder Pump
2. Enclosure: NEMA 4X

F. Install labels on panel face to identify switches and controls.

G. Wiring: copper wiring.

H. The electrical system has a backup emergency generator. The station must restart upon transfer of power.

2.3 ACCESSORIES

A. Ventilation system is designed to be vented from the 4-inch diameter inlet pipe through a Office Building Vent Stack.

B. High-Water Audio Alarm: Horn for audio indication of station high-water level, energized by °Remote Alarm Circuit: Include contacts for connection to remote alarm panel.

2.4 MOTORS

A. Motors shall be oil filled and class B insulated NEMA B design, rated for continuous duty.

2.5 MISCELLANEOUS MATERIALS

A. Grout: ASTM C 1107, Grade B, non-shrink cement grout.

1. Design Mix: 4000-psi 28-day compressive strength.

B. Concrete: Concrete is specified in Section 033000 "Cast-in-Place Concrete."

2.6 PACKAGED SEWAGE PUMPING STATION FABRICATION

A. Fabricate shell from fiberglass with structural-steel reinforcement.

1. Attach structural-steel reinforcement to top and bottom heads.
2. Fabricate shell with continuous joints to make watertight and gastight construction.
3. Attach air vent to pump chamber.

B. Entrance tube may be furnished separately for field installation.

C. Entrance Cover: Waterproof and corrosion resistant, with lock. Include way to open cover from inside tube if cover is locked.

D. Air Vent: Duct fabricated from corrosion-resistant material, extended to above grade, outlet turned down, and with insect screen in outlet.

E. Valves:

1. Sewage Pump Piping: Include gate valve on each pump inlet and gate and check valves on each discharge pipe.

F. Wiring: Tin-coated copper.

2.7 SOURCE QUALITY CONTROL

A. Test and inspect sewage pumps according to HI 1.6, "Centrifugal Pump Tests." Include test recordings that substantiate correct performance of pumps at design head, capacity, speed, and horsepower.

B. Test accessories and controls through complete cycle. Include test recordings that substantiate correct performance.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine substrates and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance.

B. Examine roughing-in of sewerage piping systems to verify actual locations of piping connections before packaged sewage pumping station installation.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 EARTHWORK

A. Excavation, trenching, and backfilling are specified in Section 312000 "Earth Moving."

3.3 INSTALLATION

A. Install packaged sewage pumping station components where indicated, according to specific equipment and piping arrangement indicated.

3.4 CONNECTIONS

A. Sanitary sewer piping installation requirements are specified in Section 02627 "HDPE Pipe and Fittings." Drawings indicate general arrangement of piping.

B. Ground equipment according to Section 260526 "Grounding and Bonding for Electrical Systems."

3.5 IDENTIFICATION

A. Install identifying labels permanently attached to equipment.

B. Install operating instruction signs permanently attached to equipment or on pumping station wall near control equipment.

3.6 FIELD QUALITY CONTROL

A. Tests and Inspections:

1. After installing packaged sewage pumping stations and after electrical circuitry has been energized, test for compliance with requirements. Furnish water required for pump tests.

2. Leak Test: After installation, charge systems and test for leaks. Repair leaks and retest until no leaks exist.
3. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

B. Remove and replace packaged sewage pumping stations that do not pass tests and inspections and retest as specified above.

3.7 STARTUP SERVICE

1. Complete installation and startup check according to manufacturer's written instructions.
2. Adjust pump, accessory, and control settings, and safety and alarm devices.

END OF SECTION 221343

SECTION 224000 - PLUMBING FIXTURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes plumbing fixtures and related components.

B. Related Sections include the following:

1. Provide plumbing fixtures in accordance with the fixtures schedules provided on the drawings.

1.3 DEFINITIONS

A. Accessible Fixture: Plumbing fixture that can be approached, entered, and used by people with disabilities.

B. Fitting: Device that controls flow of water into or out of plumbing fixture. Fittings specified in this Section include supplies and stops, faucets and spouts, shower heads and tub spouts, drains and tailpieces, and traps and waste pipes. Piping and general-duty valves are included where indicated.

1.4 SUBMITTALS

A. Product Data: Include selected fixture and trim, fittings, accessories, appliances, appurtenances, equipment, and supports and indicate materials and finishes, dimensions, construction details, and flow-control rates for each type of fixture scheduled.

B. Maintenance Data: For plumbing fixtures to include in maintenance manuals specified in Division 1.

1.5 QUALITY ASSURANCE

A. Source Limitations: Obtain plumbing fixtures, faucets, and other components in the same category through one source from a single manufacturer.

B. Regulatory Requirements: Comply with requirements in ICC A117.1, "Accessible and Usable Buildings and Facilities"[; Public Law 90-480, "Architectural Barriers Act"; and Public Law 101-336, "Americans with Disabilities Act";] about plumbing fixtures for people with disabilities.

C. Regulatory Requirements: Comply with requirements in Public Law 102-486, "Energy Policy Act," about water flow and consumption rates for plumbing fixtures.

D. NSF Standard: Comply with NSF 61, "Drinking Water System Components--Health Effects," for fixture materials that will be in contact with potable water.

E. Select combinations of fixtures and trim, faucets, fittings, and other components that are compatible.

F. Comply with the following applicable standards and other requirements specified for faucets:

1. Faucets: ASME A112.18.1M.
2. Integral, Atmospheric Vacuum Breakers: ASSE 1001.
3. Supply and Drain Fittings: ASME A112.18.1M.
4. Combination, Pressure-Equalizing and Thermostatic-Control Antiscald Faucets: ASSE 1016.
5. Faucets: ASME A112.18.1M.
6. High-Temperature-Limit Controls for Thermal-Shock-Preventing Devices: ASTM F 445.
7. Thermostatic-Control Antiscald Faucets: ASTM F 444 and ASSE 1016.

G. Comply with the following applicable standards and other requirements specified for miscellaneous components:
1. Floor Drains: ASME A112.21.1M.
2. Grab Bars: ASTM F 446.
3. Hose-Coupling Threads: ASME B1.20.7.
4. Hot-Water Dispensers: ASSE 1023 and UL 499.
5. Off-Floor Fixture Supports: ASME A112.6.1M.
6. Pipe Threads: ASME B1.20.1.
7. Plastic Toilet Seats: ANSI Z124.5.
8. Supply and Drain Protective Shielding Guards: ICC A117.1.

1.6 COORDINATION

A. Coordinate roughing-in and final plumbing fixture locations, and verify that fixtures can be installed to comply with original design and referenced standards.

1.7 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Supply, Flow-Control Fittings: Equal to 5 percent of amount of each type and size installed.
2. Flushometer Valve, Repair Kits: Equal to 5 percent of amount of each type installed, but not less than 10 of each type.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the products specified in other Part 2 articles.

B. Provide plumbing fixtures in accordance with the plumbing fixture schedule included with the contract drawings. Provide all accessories (carriers, mounting hardware, seats, etc) as required to install and operate plumbing fixtures even if not specifically shown on the drawings or required by the specifications.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine roughing-in for water soil and for waste piping systems and supports to verify actual locations and sizes of piping connections and that locations and types of supports match those indicated, before plumbing fixture installation. Use manufacturer's roughing-in data if roughing-in data are not indicated.

B. Examine walls, floors, and cabinets for suitable conditions where fixtures are to be installed.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 FIXTURE INSTALLATION

A. Assemble fixtures, trim, fittings, and other components according to manufacturers' written instructions.

B. Install counter-mounting fixtures in and attached to casework.

C. Install fixtures level and plumb according to manufacturers' written instructions and roughing-in drawings.

D. Install water-supply piping with stop on each supply to each fixture to be connected to water distribution piping. Attach supplies to supports or substrate within pipe spaces behind fixtures. Install stops in locations where they can be easily reached for operation.

1. Exception: Use ball, gate, or globe valve if stops are not specified with fixture.

E. Install trap and tubular waste piping on drain outlet of each fixture an connect to drainage system.

F. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for people with disabilities to reach.

G. Install toilet seats on water closets.

H. Install traps on fixture outlets.

1. Exception: Omit trap on fixtures with integral traps.
2. Exception: Omit trap on indirect wastes, unless otherwise indicated.

I. Install escutcheons at piping wall ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep-pattern escutcheons if required to conceal protruding fittings.

J. Seal joints between fixtures and walls, floors, and counters using sanitary-type, one-part, mildew-resistant, silicone sealant. Match sealant color to fixture color.

3.3 CONNECTIONS

A. Piping installation requirements are specified in other Plumbing Specification Sections. Drawings indicate general arrangement of piping, fittings, and specialties.

B. Connect water supplies from water distribution piping to fixtures.

C. Connect drain piping from fixtures to drainage piping.

D. Supply and Waste Connections to Plumbing Fixtures: Connect fixtures with water supplies, stops, risers, traps, and waste piping. Use size fittings required to match fixtures. Connect to plumbing piping.

E. Supply and Waste Connections to Fixtures and Equipment Specified in Other Sections: Connect fixtures and equipment with water supplies, stops, risers, traps, and waste piping specified. Use size fittings required to match fixtures and equipment. Connect to plumbing piping.

3.4 FIELD QUALITY CONTROL

A. Verify that installed fixtures are categories and types specified for locations where installed.

B. Check that fixtures are complete with trim, faucets, fittings, and other specified components.

C. Inspect installed fixtures for damage. Replace damaged fixtures and components.

D. Test installed fixtures after water systems are pressurized for proper operation. Replace malfunctioning fixtures and components, then retest. Repeat procedure until units operate properly.

3.5 ADJUSTING

A. Operate and adjust faucets and controls. Replace damaged and malfunctioning fixtures, fittings, and controls.

B. Replace washers and seals of leaking and dripping faucets and stops.

3.6 CLEANING

A. Clean fixtures, faucets, and other fittings with manufacturers' recommended cleaning methods and materials. Do the following:

1. Remove faucet spouts and strainers, remove sediment and debris, and reinstall strainers and spouts.
2. Remove sediment and debris from drains.
3. Clean fixtures to a reasonable degree of shine. No visable grease or other marks from construction should be apparent.

3.7 PROTECTION

A. Provide protective covering for installed fixtures and fittings.

B. Do not allow use of fixtures for temporary facilities unless approved in writing by Owner.

END OF SECTION 224000

SECTION 230500 - COMMON WORK REQUIREMENTS FOR HVAC

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Piping materials and installation instructions common to most piping systems.
2. Dielectric fittings.
3. Mechanical sleeve seals.
4. Sleeves.
5. Escutcheons.
6. Grout.
7. HVAC demolition.
8. Equipment installation requirements common to equipment sections.
9. Concrete bases.
10. Supports and anchorages.

1.2 DEFINITIONS

A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.

B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.

C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.

D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and chases.

E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.

1.3 SUBMITTALS

A. Welding certificates.

1.4 QUALITY ASSURANCE

A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."

B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."

1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.

C. Electrical Characteristics for HVAC Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

D. Sheet metal construction documents are diagrammatic. Equivalent sizes can be substituted when construction begins as long as aspect ratios are no greater then 3:1 for rectangular, or round instead of square substitutions provide the same static pressure per 100ft. Duct runs are to be coordinated in the field with the other trades. Duct materials can not be changed without the permission of the engineer. Flex ducts are to be no longer than eight feet and must be supported from overhead.

PART 2 - PRODUCTS

2.1 PIPE, TUBE, AND FITTINGS

A. Refer to individual Division 23 piping Sections for pipe, tube, and fitting materials and joining methods.

B. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

2.2 JOINING MATERIALS

A. Refer to individual Division 23 piping Sections for special joining materials not listed below.

B. Pipe-Flange Gasket Materials: ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch (3.2-mm) maximum thickness unless thickness or specific material is indicated.

C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.

E. Brazing Filler Metals: AWS A5.8, BCuP Series or BAg1, unless otherwise indicated.

F. Welding Filler Metals: Comply with AWS D10.12.

G. Solvent Cements for Joining Plastic Piping:

1. CPVC Piping: ASTM F 493.
2. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.

2.3 DIELECTRIC FITTINGS

A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.

B. Insulating Material: Suitable for system fluid, pressure, and temperature.

C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig (1725-kPa) minimum working pressure at 180 deg F (82 deg C).

D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150- or 300-psig (1035- or 2070-kPa) minimum working pressure as required to suit system pressures.

E. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig (2070-kPa) minimum working pressure at 225 deg F (107 deg C).

F. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig (2070-kPa) minimum working pressure at 225 deg F (107 deg C).

2.4 MECHANICAL SLEEVE SEALS

A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.

B. Sealing Elements: EPDM interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.

C. Pressure Plates: Stainless steel. Include two for each sealing element.

D. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

2.5 SLEEVES

A. Galvanized-Steel Sheet: 0.0239-inch (0.6-mm) minimum thickness; round tube closed with welded longitudinal joint.

B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.

C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

D. Stack Sleeve Fittings: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring and bolts and nuts for membrane flashing.

1. Underdeck Clamp: Clamping ring with set screws.

E. Molded PVC: Permanent, with nailing flange for attaching to wooden forms.

F. PVC Pipe: ASTM D 1785, Schedule 40.

G. Molded PE: Reusable, PE, tapered-cup shaped, and smooth-outer surface with nailing flange for attaching to wooden forms.

2.6 ESCUTCHEONS

A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.

B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.

C. One-Piece, Cast-Brass Type: With set screw.

1. Finish: Polished chrome-plated

D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.

1. Finish: Polished chrome-plated.

2.7 GROUT

A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.

1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
2. Design Mix: 5000-psi (34.5-MPa), 28-day compressive strength.

3. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 HVAC DEMOLITION

A. Refer to Division 01 Section "Cutting and Patching" and Division 02 Section "Selective Structure Demolition" for general demolition requirements and procedures.

B. Disconnect, demolish, and remove HVAC systems, equipment, and components indicated to be removed.

1. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
2. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material.
3. Ducts to Be Removed: Remove portion of ducts indicated to be removed and plug remaining ducts with same or compatible ductwork material.
4. Ducts to Be Abandoned in Place: Cap or plug ducts with same or compatible ductwork material.
5. Equipment to Be Removed: Disconnect and cap services and remove equipment.
6. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
7. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.

C. If pipe, insulation, or equipment to remain is damaged in appearance or is unserviceable, remove damaged or unserviceable portions and replace with new products of equal capacity and quality.

3.2 PIPING SYSTEMS - COMMON REQUIREMENTS

A. Install piping according to the following requirements and Division 23 Sections specifying piping systems.

B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.

C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.

D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.

F. Install piping to permit valve servicing.

G. Install piping at indicated slopes.

H. Install piping free of sags and bends.

I. Install fittings for changes in direction and branch connections.

J. Install piping to allow application of insulation.

K. Select system components with pressure rating equal to or greater than system operating pressure.

L. Install escutcheons for penetrations of walls, ceilings, and floors.

M. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.

N. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.

1. Install steel pipe for sleeves smaller than 6 inches (150 mm) in diameter.
2. Install cast-iron "wall pipes" for sleeves 6 inches (150 mm) and larger in diameter.
3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

O. Underground, Exterior-Wall Pipe Penetrations: Install cast-iron "wall pipes" for sleeves. Seal pipe penetrations using mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.

1. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

P. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 07 Section "Penetration Firestopping" for materials.

Q. Verify final equipment locations for roughing-in.

R. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

3.3 PIPING JOINT CONSTRUCTION

A. Join pipe and fittings according to the following requirements and Division 23 Sections specifying piping systems.

B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.

D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.

E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.

F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.

G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.

H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

I. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:

1. Comply with ASTM F 402, for safe-handling practice of cleaners, primers, and solvent cements.
2. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
3. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
4. PVC Nonpressure Piping: Join according to ASTM D 2855.

J. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.

K. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.

L. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D 2657.

1. Plain-End Pipe and Fittings: Use butt fusion.
2. Plain-End Pipe and Socket Fittings: Use socket fusion.

M. Fiberglass Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

3.4 PIPING CONNECTIONS

A. Make connections according to the following, unless otherwise indicated:

1. Install unions, in piping NPS 2 (DN 50) and smaller, adjacent to each valve and at final connection to each piece of equipment.
2. Install flanges, in piping NPS 2-1/2 (DN 65) and larger, adjacent to flanged valves and at final connection to each piece of equipment.
3. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.
4. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

3.5 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.

B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.

C. Install HVAC equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.

D. Install equipment to allow right of way for piping installed at required slope.

3.6 CONCRETE BASES

A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.

1. Construct concrete bases of dimensions indicated, but not less than 4 inches (100 mm) larger in both directions than supported unit.
2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch (450-mm) centers around the full perimeter of the base.
3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
5. Install anchor bolts to elevations required for proper attachment to supported equipment.
6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
7. Use 3000-psi (20.7-MPa), 28-day compressive-strength concrete and reinforcement as specified in Division 03 Sections.

3.7 PAINTING AND FINISHING

A. Apply semi-gloss, acrylic-enamel finish to exposed piping according to the following:

1. Interior, Ferrous Piping and Ferrous Supports: Finish coat over enamel undercoat and primer.
2. Interior and Exterior, Galvanized-Steel Piping: Two finish coats over galvanized metal primer.

3. Exterior, Ferrous Piping and Ferrous Supports: Two finish coats over rust-inhibitive metal primer.
4. Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

3.8 CUTTING AND PATCHING

A. Cut, channel, chase, and drill floors, walls, partitions, ceilings, and other surfaces necessary for mechanical installations. Perform cutting by skilled mechanics of trades involved. Repair cut surfaces to match adjacent surfaces.

3.9 CONTROLS COORDINATION

A. For electrical interface of controls the following is the method to be coordinated with division 23. Division 23 is to provide junction box with cover, conduit, and power to JB. The cover is to be labeled with its respective panel number and breaker number. Control contractor will provide the control transformers and all wiring there after to devices and is to coordinate with Division 16 in the field.

3.10 ERECTION OF METAL SUPPORTS AND ANCHORAGES

A. Refer to Division 05 Section "Metal Fabrications" for structural steel.

B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor HVAC materials and equipment.

C. Field Welding: Comply with AWS D1.1.

3.11 ERECTION OF WOOD SUPPORTS AND ANCHORAGES

A. Cut, fit, and place wood grounds, nailers, blocking, and anchorages to support, and anchor HVAC materials and equipment.

B. Select fastener sizes that will not penetrate members if opposite side will be exposed to view or will receive finish materials. Tighten connections between members. Install fasteners without splitting wood members.

C. Attach to substrates as required to support applied loads.

3.12 GROUTING

A. Mix and install grout for HVAC equipment base bearing surfaces, pump and other equipment base plates, and anchors.

B. Clean surfaces that will come into contact with grout.

C. Provide forms as required for placement of grout.

D. Avoid air entrapment during placement of grout.

E. Place grout, completely filling equipment bases.

F. Place grout on concrete bases and provide smooth bearing surface for equipment.

G. Place grout around anchors.

H. Cure placed grout.

END OF SECTION 230500

SECTION 230513 - COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section includes general requirements for single-phase and polyphase, general-purpose, horizontal, small and medium, squirrel-cage induction motors for use on ac power systems up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.

1.3 COORDINATION

A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:

1. Motor controllers.
2. Torque, speed, and horsepower requirements of the load.
3. Ratings and characteristics of supply circuit and required control sequence.
4. Ambient and environmental conditions of installation location.

PART 2 - PRODUCTS

2.1 GENERAL MOTOR REQUIREMENTS

A. Comply with requirements in this Section except when stricter requirements are specified in HVAC equipment schedules or Sections.

B. Comply with NEMA MG 1 unless otherwise indicated.

C. Comply with IEEE 841 for severe-duty motors.

2.2 MOTOR CHARACTERISTICS

A. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 feet above sea level.

B. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

2.3 POLYPHASE MOTORS

A. Description: NEMA MG 1, Design B, medium induction motor.

B. Efficiency: Energy efficient, as defined in NEMA MG 1.

C. Service Factor: 1.15.

D. Multispeed Motors: Variable torque.

1. For motors with 2:1 speed ratio, consequent pole, single winding.
2. For motors with other than 2:1 speed ratio, separate winding for each speed.

E. Multispeed Motors: Separate winding for each speed.

F. Rotor: Random-wound, squirrel cage.

G. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.

H. Temperature Rise: Match insulation rating.

I. Insulation: Class F.

J. Code Letter Designation:

1. Motors 15 HP and Larger: NEMA starting Code F or Code G.
2. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.

K. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.

2.4 POLYPHASE MOTORS WITH ADDITIONAL REQUIREMENTS

A. Motors Used with Reduced-Voltage and Multispeed Controllers: Match wiring connection requirements for controller with required motor leads. Provide terminals in motor terminal box, suited to control method.

B. Motors Used with Variable Frequency Controllers: Ratings, characteristics, and features coordinated with and approved by controller manufacturer.

1. Windings: Copper magnet wire with moisture-resistant insulation varnish, designed and tested to resist transient spikes, high frequencies, and short time rise pulses produced by pulse-width modulated inverters.
2. Energy- and Premium-Efficient Motors: Class B temperature rise; Class F insulation.
3. Inverter-Duty Motors: Class F temperature rise; Class H insulation.
4. Thermal Protection: Comply with NEMA MG 1 requirements for thermally protected motors.

C. Severe-Duty Motors: Comply with IEEE 841, with 1.15 minimum service factor.

2.5 SINGLE-PHASE MOTORS

A. Motors larger than 1/20 hp shall be one of the following, to suit starting torque and requirements of specific motor application:

1. Permanent-split capacitor.
2. Split phase.
3. Capacitor start, inductor run.
4. Capacitor start, capacitor run.

B. Multispeed Motors: Variable-torque, permanent-split-capacitor type.

C. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.

D. Motors 1/20 HP and Smaller: Shaded-pole type.

E. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device shall automatically reset when motor temperature returns to normal range.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 230513

SECTION 230529 - HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Metal pipe hangers and supports.
2. Trapeze pipe hangers.
3. Fiberglass pipe hangers.
4. Metal framing systems.
5. Fiberglass strut systems.
6. Thermal-hanger shield inserts.
7. Fastener systems.
8. Pipe stands.
9. Equipment supports.

B. Related Sections:
1. Division 23 Section "Vibration and Seismic Controls for HVAC Piping and Equipment" for vibration isolation devices.
2. Division 23 Section(s) "Metal Ducts" for duct hangers and supports.

1.3 DEFINITIONS

A. MSS: Manufacturers Standardization Society of The Valve and Fittings Industry Inc.

1.4 PERFORMANCE REQUIREMENTS

A. Delegated Design: Design trapeze pipe hangers and equipment supports, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

B. Structural Performance: Hangers and supports for HVAC piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.

1. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.

2. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
3. Design seismic-restraint hangers and supports for piping and equipment and obtain approval from authorities having jurisdiction.

1.5 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings: Signed and sealed by a qualified professional engineer. Show fabrication and installation details and include calculations for the following; include Product Data for components:

1. Trapeze pipe hangers.
2. Metal framing systems.
3. Fiberglass strut systems.
4. Pipe stands.
5. Equipment supports.

C. Delegated-Design Submittal: For trapeze hangers indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1. Detail fabrication and assembly of trapeze hangers.
2. Design Calculations: Calculate requirements for designing trapeze hangers.

D. Welding certificates.

1.6 QUALITY ASSURANCE

A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

PART 2 - PRODUCTS

2.1 METAL PIPE HANGERS AND SUPPORTS

A. Carbon-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: Pregalvanized or hot dipped.
3. Nonmetallic Coatings: Plastic coating, jacket, or liner.

4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
5. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

B. Stainless-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

C. Copper Pipe Hangers:

1. Description: MSS SP-58, Types 1 through 58, copper-coated-steel, factory-fabricated components.
2. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

2.2 TRAPEZE PIPE HANGERS

A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

2.3 FIBERGLASS PIPE HANGERS

A. Clevis-Type, Fiberglass Pipe Hangers:

1. Description: Similar to MSS SP-58, Type 1, steel pipe hanger except hanger is made of fiberglass or fiberglass-reinforced resin.
2. Hanger Rods: Continuous-thread rod, washer, and nuts made of stainless steel.

B. Strap-Type, Fiberglass Pipe Hangers:

1. Description: Similar to MSS SP-58, Type 9 or Type 10, steel pipe hanger except hanger is made of fiberglass-reinforced resin.
2. Hanger Rod and Fittings: Continuous-thread rod, washer, and nuts made of stainless steel.

2.4 METAL FRAMING SYSTEMS

A. MFMA Manufacturer Metal Framing Systems:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Allied Tube & Conduit.
b. Cooper B-Line, Inc.

c. Flex-Strut Inc.
d. GS Metals Corp.
e. Thomas & Betts Corporation.
f. Unistrut Corporation; Tyco International, Ltd.
g. Wesanco, Inc.

2. Description: Shop- or field-fabricated pipe-support assembly for supporting multiple parallel pipes.
3. Standard: MFMA-4.
4. Channels: Continuous slotted steel channel with inturned lips.
5. Channel Nuts: Formed or stamped steel nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
6. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.
7. Metallic Coating: Electroplated zinc.
8. Paint Coating: Epoxy.
9. Plastic Coating: Epoxy.

2.5 FIBERGLASS STRUT SYSTEMS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Allied Tube & Conduit.
2. Champion Fiberglass, Inc.
3. Cooper B-Line, Inc.
4. SEASAFE, INC.; a Gibraltar Industries Company.

B. Description: Shop- or field-fabricated pipe-support assembly similar to MFMA-4 for supporting multiple parallel pipes.

1. Channels: Continuous slotted fiberglass channel with inturned lips.
2. Channel Nuts: Fiberglass nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

2.6 THERMAL-HANGER SHIELD INSERTS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Carpenter & Paterson, Inc.
2. Clement Support Services.
3. ERICO International Corporation.
4. National Pipe Hanger Corporation.
5. PHS Industries, Inc.
6. Pipe Shields, Inc.; a subsidiary of Piping Technology & Products, Inc.
7. Piping Technology & Products, Inc.

8. Rilco Manufacturing Co., Inc.
9. Value Engineered Products, Inc.

B. Insulation-Insert Material for Cold Piping: ASTM C 552, Type II cellular glass with 100-psig minimum compressive strength and vapor barrier.

C. Insulation-Insert Material for Hot Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate with 100-psig minimum compressive strength.

D. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.

E. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.

F. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

2.7 FASTENER SYSTEMS

A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

B. Mechanical-Expansion Anchors: Insert-wedge-type, stainless-steel anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

2.8 PIPE STANDS

A. General Requirements for Pipe Stands: Shop- or field-fabricated assemblies made of manufactured corrosion-resistant components to support roof-mounted piping.

B. Compact Pipe Stand: One-piece plastic unit with integral-rod roller, pipe clamps, or V-shaped cradle to support pipe, for roof installation without membrane penetration.

C. Low-Type, Single-Pipe Stand: One-piece stainless-steel base unit with plastic roller, for roof installation without membrane penetration.

D. High-Type, Single-Pipe Stand:

1. Description: Assembly of base, vertical and horizontal members, and pipe support, for roof installation without membrane penetration.
2. Base: Stainless steel.
3. Vertical Members: Two or more cadmium-plated-steel or stainless-steel, continuous-thread rods.
4. Horizontal Member: Cadmium-plated-steel or stainless-steel rod with plastic or stainless-steel, roller-type pipe support.

E. High-Type, Multiple-Pipe Stand:

1. Description: Assembly of bases, vertical and horizontal members, and pipe supports, for roof installation without membrane penetration.
2. Bases: One or more; plastic.
3. Vertical Members: Two or more protective-coated-steel channels.
4. Horizontal Member: Protective-coated-steel channel.
5. Pipe Supports: Galvanized-steel, clevis-type pipe hangers.

F. Curb-Mounted-Type Pipe Stands: Shop- or field-fabricated pipe supports made from structural-steel shapes, continuous-thread rods, and rollers, for mounting on permanent stationary roof curb.

2.9 EQUIPMENT SUPPORTS

A. Description: Welded, shop- or field-fabricated equipment support made from structural carbon-steel shapes.

2.10 MISCELLANEOUS MATERIALS

A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.

B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.

1. Properties: Nonstaining, noncorrosive, and nongaseous.
2. Design Mix: 5000-psi, 28-day compressive strength.

PART 3 - EXECUTION

3.1 HANGER AND SUPPORT INSTALLATION

A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.

B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.

1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
2. Field fabricate from ASTM A 36/A 36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.

C. Fiberglass Pipe-Hanger Installation: Comply with applicable portions of MSS SP-69 and MSS SP-89. Install hangers and attachments as required to properly support piping from building structure.

D. Metal Framing System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled metal framing systems.

E. Fiberglass Strut System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled fiberglass struts.

F. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.

G. Fastener System Installation:

1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.

H. Pipe Stand Installation:

1. Pipe Stand Types except Curb-Mounted Type: Assemble components and mount on smooth roof surface. Do not penetrate roof membrane.
2. Curb-Mounted-Type Pipe Stands: Assemble components or fabricate pipe stand and mount on permanent, stationary roof curb. See Division 07 Section "Roof Accessories" for curbs.

I. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.

J. Equipment Support Installation: Fabricate from welded-structural-steel shapes.

K. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.

L. Install lateral bracing with pipe hangers and supports to prevent swaying.

M. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.

N. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.

O. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.

P. Insulated Piping:

1. Attach clamps and spacers to piping.

    a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
    b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
    c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.

2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.

    a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.

3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.

    a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.

4. Shield Dimensions for Pipe: Not less than the following:

    a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
    b. NPS 4: 12 inches long and 0.06 inch thick.
    c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
    d. NPS 8 to NPS 14: 24 inches long and 0.075 inch thick.
    e. NPS 16 to NPS 24: 24 inches long and 0.105 inch thick.

5. Pipes NPS 8 and Larger: Include wood or reinforced calcium-silicate-insulation inserts of length at least as long as protective shield.
6. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

3.2 EQUIPMENT SUPPORTS

A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.

B. Grouting: Place grout under supports for equipment and make bearing surface smooth.

C. Provide lateral bracing, to prevent swaying, for equipment supports.

3.3 METAL FABRICATIONS

A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.

B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.

C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:

1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
2. Obtain fusion without undercut or overlap.
3. Remove welding flux immediately.
4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

3.4 ADJUSTING

A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.

B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

3.5 PAINTING

A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.

1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.

B. Touchup: Cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal are specified in painting Sections.

C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

3.6 HANGER AND SUPPORT SCHEDULE

A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.

B. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.

C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.

D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.

E. Use carbon-steel metal trapeze pipe hangers and metal framing systems and attachments for general service applications.

F. Use stainless-steel pipe hangers and stainless-steel attachments for hostile environment applications.

G. Use copper-plated pipe hangers and copper stainless-steel attachments for copper piping and tubing.

H. Use padded hangers for piping that is subject to scratching.

I. Use thermal-hanger shield inserts for insulated piping and tubing.

J. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30.
2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of up to 1050 deg F,pipes NPS 4 to NPS 24, requiring up to 4 inches of insulation.
3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes NPS 3/4 to NPS 36, requiring clamp flexibility and up to 4 inches of insulation.
4. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes NPS 1/2 to NPS 24 if little or no insulation is required.
5. Pipe Hangers (MSS Type 5): For suspension of pipes NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.
6. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated, stationary pipes NPS 3/4 to NPS 8.
7. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
8. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
9. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.

10. Split Pipe Ring with or without Turnbuckle Hangers (MSS Type 11): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 8.
11. Extension Hinged or Two-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 3.
12. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
13. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
14. Pipe Saddle Supports (MSS Type 36): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate.
15. Pipe Stanchion Saddles (MSS Type 37): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate, and with U-bolt to retain pipe.
16. Adjustable Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes NPS 2-1/2 to NPS 36 if vertical adjustment is required, with steel-pipe base stanchion support and cast-iron floor flange.
17. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur.
18. Adjustable Roller Hangers (MSS Type 43): For suspension of pipes NPS 2-1/2 to NPS 24, from single rod if horizontal movement caused by expansion and contraction might occur.
19. Complete Pipe Rolls (MSS Type 44): For support of pipes NPS 2 to NPS 42 if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is not necessary.
20. Pipe Roll and Plate Units (MSS Type 45): For support of pipes NPS 2 to NPS 24 if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is not necessary.
21. Adjustable Pipe Roll and Base Units (MSS Type 46): For support of pipes NPS 2 to NPS 30 if vertical and lateral adjustment during installation might be required in addition to expansion and contraction.

K. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.

L. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.

4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.

M. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joist construction, to attach to top flange of structural shape.
3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
6. C-Clamps (MSS Type 23): For structural shapes.
7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
10. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
11. Malleable-Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
12. Welded-Steel Brackets: For support of pipes from below or for suspending from above by using clip and rod. Use one of the following for indicated loads:

    a. Light (MSS Type 31): 750 lb.
    b. Medium (MSS Type 32): 1500 lb.
    c. Heavy (MSS Type 33): 3000 lb.

13. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
14. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.
15. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.

N. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.

O. Spring Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Restraint-Control Devices (MSS Type 47): Where indicated to control piping movement.
2. Spring Cushions (MSS Type 48): For light loads if vertical movement does not exceed 1-1/4 inches.
3. Spring-Cushion Roll Hangers (MSS Type 49): For equipping Type 41, roll hanger with springs.
4. Spring Sway Braces (MSS Type 50): To retard sway, shock, vibration, or thermal expansion in piping systems.
5. Variable-Spring Hangers (MSS Type 51): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from hanger.
6. Variable-Spring Base Supports (MSS Type 52): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from base support.
7. Variable-Spring Trapeze Hangers (MSS Type 53): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from trapeze support.
8. Constant Supports: For critical piping stress and if necessary to avoid transfer of stress from one support to another support, critical terminal, or connected equipment. Include auxiliary stops for erection, hydrostatic test, and load-adjustment capability. These supports include the following types:

    a. Horizontal (MSS Type 54): Mounted horizontally.
    b. Vertical (MSS Type 55): Mounted vertically.
    c. Trapeze (MSS Type 56): Two vertical-type supports and one trapeze member.

P. Comply with MSS SP-69 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.

Q. Comply with MFMA-103 for metal framing system selections and applications that are not specified in piping system Sections.

R. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.

END OF SECTION 230529

SECTION 230548 - VIBRATION AND SEISMIC CONTROLS FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the contract, including general and supplementary conditions and Division 1 specification sections, apply to this section.

1.2 SUMMARY

A. Provide seismic restraints and supports for all mechanical equipment, piping, plumbing, and fire protection in accordance with the International Building Code, NFPA-13, SMACNA and standard practice.

B. Provide vibration isolators on all piping, ductwork, and equipment.

1.3 SUBMITTALS:

A. Product Data: Include load deflection curves for each vibration isolation device.

B. Shop Drawings: Include the following:

1. Design Calculations: Calculate requirements for selecting vibration isolators and for vibration isolation bases. All calculations shall be signed and sealed by a professional Engineer licensed in the state of New Jersey.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

2.2 VIBRATION ISOLATORS

A. Manufacturers:
1. Mason Industries, Inc.
2. Amber/Booth Company, Inc.
3. Kinetics Noise Control, Inc.

B. Spring Isolators: Freestanding, laterally stable, open-spring isolators.

1. Outside Spring Diameter: Not less than 80 percent of the compressed height of the spring at rated load.
2. Minimum Additional Travel: 50 percent of the required deflection at rated load.
3. Lateral Stiffness: More than 80 percent of the rated vertical stiffness.
4. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
5. Baseplates: Factory drilled for bolting to structure and bonded to 1/4-inch- thick, rubber isolator pad attached to baseplate underside. Baseplates shall limit floor load to 100 psig.
6. Top Plate and Adjustment Bolt: Threaded top plate with adjustment bolt and cap screw to fasten and level equipment.

C. Housed Spring Mounts: Housed spring isolator with integral seismic snubbers.

1. Housing: Ductile-iron or steel housing to provide all-directional seismic restraint.
2. Base: Factory drilled for bolting to structure.
3. Snubbers: Vertically adjustable to allow a maximum of 1/4-inch travel before contacting a resilient collar.

D. Spring Hangers: Combination coil-spring and elastomeric-insert hanger with spring and insert in compression.

1. Frame: Steel, fabricated for connection to threaded hanger rods and to allow for a maximum of 30 degrees of angular hanger-rod misalignment without binding or reducing isolation efficiency.
2. Outside Spring Diameter: Not less than 80 percent of the compressed height of the spring at rated load.
3. Minimum Additional Travel: 50 percent of the required deflection at rated load.
4. Lateral Stiffness: More than 80 percent of the rated vertical stiffness.
5. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
6. Elastomeric Element: Molded, oil-resistant rubber or neoprene. Steel-washer-reinforced cup to support spring and bushing projecting through bottom of frame.

E. Resilient Isolation Washers and Bushings: 1-piece, molded, bridge-bearing neoprene complying with AASHTO M 251 and having a durometer of 50, plus or minus 5, with a flat washer face.

2.3 VIBRATION ISOLATION EQUIPMENT BASES

A. Manufacturers:

1. Amber/Booth Company, Inc.
2. California Dynamics Corp.
3. Isolation Technology, Inc.
4. Kinetics Noise Control, Inc.

5. Mason Industries, Inc.
6. Vibration Eliminator Co., Inc.
7. Vibration Isolation Co., Inc.
8. Vibration Mountings & Controls/Korfund.

B. Inertia Base: Factory-fabricated, welded, structural-steel bases and rails ready for field-applied, cast-in-place concrete.

1. Design Requirements: Lowest possible mounting height with not less than 1-inch clearance above the floor. Include equipment anchor bolts and auxiliary motor slide bases or rails. Include supports for suction and discharge elbows for pumps.
2. Structural Steel: Steel shapes, plates, and bars complying with ASTM A 36/A 36M. Bases shall have shape to accommodate supported equipment.
3. Support Brackets: Factory-welded steel angles on frame for outrigger isolation mountings and to provide for anchor bolts and equipment support.
4. Fabrication: Fabricate steel templates to hold equipment anchor-bolt sleeves and anchors in place during placement of concrete. Obtain anchor-bolt templates from supported equipment manufacturer.

2.4 FACTORY FINISHES

A. Manufacturer's standard prime-coat finish ready for field painting.

B. Finish: Manufacturer's standard paint applied to factory-assembled and -tested equipment before shipping.

1. Powder coating on springs and housings.
2. All hardware shall be electrogalvanized. Hot-dip galvanize metal components for exterior use.
3. Baked enamel for metal components on isolators for interior use.
4. Color-code or otherwise mark vibration isolation and seismic-control devices to indicate capacity range.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine areas and equipment to receive vibration isolation and seismic-control devices for compliance with requirements, installation tolerances, and other conditions affecting performance

B. Examine roughing-in of reinforcement and cast-in-place anchors to verify actual locations before installation.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

A. Install thrust limits at centerline of thrust, symmetrical on either side of equipment.

B. Install resilient bolt isolation washers on equipment anchor bolts.

3.3 EQUIPMENT BASES

A. Fill concrete inertia bases, after installing base frame, with 3000-psi concrete; trowel to a smooth finish.

B. Concrete Bases: Anchor equipment to concrete base according to supported equipment manufacturer's written instructions for seismic codes at Project site.

1. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of the base.
2. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base and anchor into structural concrete floor.
3. Place and secure anchorage devices. Use Setting Drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
4. Install anchor bolts to elevations required for proper attachment to supported equipment.
5. Install anchor bolts according to anchor-bolt manufacturer's written instructions.

3.4 FIELD QUALITY CONTROL

A. Testing: Perform the following field quality-control testing:

1. Isolator deflection.

3.5 ADJUSTING

A. Adjust isolators after piping systems have been filled and equipment is at operating weight.

B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.

C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4-inch movement during start and stop.

D. Adjust active height of spring isolators.

3.6 CLEANING

A. After completing equipment installation, inspect vibration isolation and seismic-control devices. Remove paint splatters and other spots, dirt, and debris.

END OF SECTION 230548

SECTION 230553 - IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Equipment labels.
2. Warning signs and labels.
3. Pipe labels.
4. Duct labels.
5. Stencils.
6. Valve tags.
7. Warning tags.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Samples: For color, letter style, and graphic representation required for each identification material and device.

C. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.

D. Valve numbering scheme.

E. Valve Schedules: For each piping system to include in maintenance manuals.

1.4 COORDINATION

A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.

B. Coordinate installation of identifying devices with locations of access panels and doors.

C. Install identifying devices before installing acoustical ceilings and similar concealment.

PART 2 - PRODUCTS

2.1 EQUIPMENT LABELS

A. Metal Labels for Equipment:

1. Material and Thickness: Stainless steel, 0.025-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
2. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
3. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
4. Fasteners: Stainless-steel self-tapping screws.
5. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

B. Label Content: Include equipment's Drawing designation or unique equipment number, Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified.

C. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch bond paper. Tabulate equipment identification number and identify Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

2.2 WARNING SIGNS AND LABELS

A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/8 inch thick, and having predrilled holes for attachment hardware.

B. Letter Color: White

C. Background Color: Red

D. Maximum Temperature: Able to withstand temperatures up to 160 deg F.

E. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.

F. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

G. Fasteners: Stainless-steel self-tapping screws.

H. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

I. Label Content: Include caution and warning information, plus emergency notification instructions.

2.3 PIPE LABELS

A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.

B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to cover full circumference of pipe and to attach to pipe without fasteners or adhesive.

C. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.

D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings, pipe size, and an arrow indicating flow direction.

1. Flow-Direction Arrows: Integral with piping system service lettering to accommodate both directions, or as separate unit on each pipe label to indicate flow direction.
2. Lettering Size: At least 1-1/2 inches high.

2.4 DUCT LABELS

A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/8 inch thick, and having predrilled holes for attachment hardware.

B. Letter Color: White .

C. Background Color: Black

D. Maximum Temperature: Able to withstand temperatures up to 160 deg F.

E. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.

F. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

G. Fasteners: Stainless-steel self-tapping screws.

H. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

I. Duct Label Contents: Include identification of duct service using same designations or abbreviations as used on Drawings, duct size, and an arrow indicating flow direction.

1. Flow-Direction Arrows: Integral with duct system service lettering to accommodate both directions, or as separate unit on each duct label to indicate flow direction.
2. Lettering Size: At least 1-1/2 inches high.

2.5 VALVE TAGS

A. Valve Tags: Stamped or engraved with 1/4-inch letters for piping system abbreviation and 1/2-inch numbers.

1. Tag Material: Stainless steel, 0.025-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.
2. Fasteners: Brass beaded chain.

B. Valve Schedules: For each piping system, on 8-1/2-by-11-inch bond paper. Tabulate valve number, piping system, system abbreviation (as shown on valve tag), location of valve (room or space), normal-operating position (open, closed, or modulating), and variations for identification. Mark valves for emergency shutoff and similar special uses.

1. Valve-tag schedule shall be included in operation and maintenance data.

2.6 WARNING TAGS

A. Warning Tags: Preprinted or partially preprinted, accident-prevention tags, of plasticized card stock with matte finish suitable for writing.

1. Size: Approximately 4 by 7 inches
2. Fasteners: Brass grommet and wire
3. Nomenclature: Large-size primary caption such as "DANGER," "CAUTION," or "DO NOT OPERATE."
4. Color: Yellow background with black lettering.

PART 3 - EXECUTION

3.1 PREPARATION

A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

3.2 EQUIPMENT LABEL INSTALLATION

A. Install or permanently fasten labels on each major item of mechanical equipment.

B. Locate equipment labels where accessible and visible.

3.3 PIPE LABEL INSTALLATION

A. Piping Color-Coding: Painting of piping is specified in Division 09 Section "Interior Painting".

B. Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:

1. Near each valve and control device.
2. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
3. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
4. At access doors, manholes, and similar access points that permit view of concealed piping.
5. Near major equipment items and other points of origination and termination.
6. Spaced at maximum intervals of 50 feet along each run. Reduce intervals to 25 feet in areas of congested piping and equipment.
7. On piping above removable acoustical ceilings. Omit intermediately spaced labels.

C. Pipe Label Color Schedule:

1. Refrigerant Piping:

   a. Background Color: Black.
   b. Letter Color: Yellow.

3.4 DUCT LABEL INSTALLATION

A. Install plastic-laminated duct labels with permanent adhesive on air ducts in the following color codes:

1. Blue For cold-air supply ducts.
2. Yellow For hot-air supply ducts.
3. Green For exhaust-, outside-, relief-, return-, and mixed-air ducts.
4. ASME A13.1 Colors and Designs: For hazardous material exhaust.

B. Locate labels near points where ducts enter into concealed spaces and at maximum intervals of 50 feet in each space where ducts are exposed or concealed by removable ceiling system.

3.5 VALVE-TAG INSTALLATION

A. Install tags on valves and control devices in piping systems, except check valves; valves within factory-fabricated equipment units; shutoff valves; faucets; convenience and lawn-watering hose connections; and HVAC terminal devices and similar roughing-in connections of end-use fixtures and units. List tagged valves in a valve schedule.

B. Valve-Tag Application Schedule: Tag valves according to size, shape, and color scheme and with captions similar to those indicated in the following subparagraphs:

1. Valve-Tag Size and Shape:

    a. Chilled Water: 2 inches, round.
    b. Condenser Water: 2 inches, round.
    c. Refrigerant: 2 inches, round.
    d. Hot Water: 2 inches, round.
    e. Gas: 2 inches, round.

2. Valve-Tag Color:

    a. Chilled Water: Blue.
    b. Condenser Water: Yellow.
    c. Refrigerant: Black.
    d. Hot Water: Red.
    e. Gas: Yellow.

3. Letter Color:

    a. Chilled Water: White.
    b. Condenser Water: Black.
    c. Refrigerant: White.
    d. Hot Water: White.
    e. Gas: Black.

3.6 WARNING-TAG INSTALLATION

A. Write required message on, and attach warning tags to, equipment and other items where required.

END OF SECTION 230553

SECTION 230593 - TESTING, ADJUSTING AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Balancing Air Systems:

a. Constant-volume air systems.

1.3 DEFINITIONS

A. AABC: Associated Air Balance Council.

B. NEBB: National Environmental Balancing Bureau.

C. TAB: Testing, adjusting, and balancing.

D. TABB: Testing, Adjusting, and Balancing Bureau.

E. TAB Specialist: An entity engaged to perform TAB Work.

1.4 SUBMITTALS

A. Qualification Data: Submit documentation that the TAB contractor and this Project's TAB team members meet the qualifications specified in "Quality Assurance" Article.

B. Certified TAB reports.

C. Sample report forms.

D. Instrument calibration reports, to include the following:

1. Instrument type and make.
2. Serial number.
3. Application.
4. Dates of use.
5. Dates of calibration.

1.5 QUALITY ASSURANCE

A. TAB Contractor Qualifications: Engage a TAB entity certified by AABC, NEBB or TABB.

B. TAB Report Forms: Use standard TAB contractor's forms approved by Engineer

C. Instrumentation Type, Quantity, Accuracy, and Calibration: As described in ASHRAE 111, Section 5, "Instrumentation."

1.6 PROJECT CONDITIONS

A. Partial Owner Occupancy: Owner may occupy completed areas of building before Substantial Completion. Cooperate with Owner during TAB operations to minimize conflicts with Owner's operations.

1.7 COORDINATION

A. Notice: Provide seven days' advance notice for each test. Include scheduled test dates and times.

B. Perform TAB after leakage and pressure tests on air and water distribution systems have been satisfactorily completed.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems' designs that may preclude proper TAB of systems and equipment.

B. Examine systems for installed balancing devices, such as test ports, gage cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are accessible.

C. Examine the approved submittals for HVAC systems and equipment.

D. Examine design data including HVAC system descriptions, statements of design assumptions for environmental conditions and systems' output, and statements of philosophies and assumptions about HVAC system and equipment controls.

E. Examine ceiling plenums and underfloor air plenums used for supply, return, or relief air to verify that they meet the leakage class of connected ducts as specified in Division 23 Section "Metal Ducts" and are properly separated from adjacent areas. Verify that penetrations in plenum walls are sealed and fire-stopped if required.

F. Examine equipment performance data including fan and pump curves.

1. Relate performance data to Project conditions and requirements, including system effects that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
2. Calculate system-effect factors to reduce performance ratings of HVAC equipment when installed under conditions different from the conditions used to rate equipment performance. To calculate system effects for air systems, use tables and charts found in AMCA 201, "Fans and Systems," or in SMACNA's "HVAC Systems - Duct Design." Compare results with the design data and installed conditions.

G. Examine system and equipment installations and verify that field quality-control testing, cleaning, and adjusting specified in individual Sections have been performed.

H. Examine test reports specified in individual system and equipment Sections.

I. Examine HVAC equipment and filters and verify that bearings are greased, belts are aligned and tight, and equipment with functioning controls is ready for operation.

J. Examine terminal units, such as variable-air-volume boxes, and verify that they are accessible and their controls are connected and functioning.

K. Examine strainers. Verify that startup screens are replaced by permanent screens with indicated perforations.

L. Examine three-way valves for proper installation for their intended function of diverting or mixing fluid flows.

M. Examine heat-transfer coils for correct piping connections and for clean and straight fins.

N. Examine system pumps to ensure absence of entrained air in the suction piping.

O. Examine operating safety interlocks and controls on HVAC equipment.

P. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.

3.2 PREPARATION

A. Prepare a TAB plan that includes strategies and step-by-step procedures.

B. Complete system-readiness checks and prepare reports. Verify the following:

1. Permanent electrical-power wiring is complete.
2. Hydronic systems are filled, clean, and free of air.
3. Automatic temperature-control systems are operational.
4. Equipment and duct access doors are securely closed.
5. Balance, smoke, and fire dampers are open.
6. Isolating and balancing valves are open and control valves are operational.
7. Ceilings are installed in critical areas where air-pattern adjustments are required and access to balancing devices is provided.
8. Windows and doors can be closed so indicated conditions for system operations can be met.

3.3 GENERAL PROCEDURES FOR TESTING AND BALANCING

A. Perform testing and balancing procedures on each system in accordance with the following:

1. Comply with requirements in ASHRAE 62.1-2004, Section 7.2.2, "Air Balancing."

B. Cut insulation, ducts, pipes, and equipment cabinets for installation of test probes to the minimum extent necessary for TAB procedures.

1. After testing and balancing, patch probe holes in ducts with same material and thickness as used to construct ducts.
2. After testing and balancing, install test ports and duct access doors that comply with requirements in Division 23 Section "Air Duct Accessories."
3. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish according to Division 23 Section "HVAC Insulation."

C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.

D. Take and report testing and balancing measurements in inch-pound (IP) units.

3.4 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.

B. Prepare schematic diagrams of systems' "as-built" duct layouts.

C. For variable-air-volume systems, develop a plan to simulate diversity.

D. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.

E. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.

F. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.

G. Verify that motor starters are equipped with properly sized thermal protection.

H. Check dampers for proper position to achieve desired airflow path.

I. Check for airflow blockages.

J. Check condensate drains for proper connections and functioning.

K. Check for proper sealing of air-handling-unit components.

L. Verify that air duct system is sealed as specified in Division 23 Section "Metal Ducts."

3.5 PROCEDURES FOR CONSTANT-VOLUME AIR SYSTEMS

A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.

1. Measure total airflow.

    a. Where sufficient space in ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow.

2. Measure fan static pressures as follows to determine actual static pressure:

    a. Measure outlet static pressure as far downstream from the fan as practical and upstream from restrictions in ducts such as elbows and transitions.
    b. Measure static pressure directly at the fan outlet or through the flexible connection.
    c. Measure inlet static pressure of single-inlet fans in the inlet duct as near the fan as possible, upstream from the flexible connection, and downstream from duct restrictions.
    d. Measure inlet static pressure of double-inlet fans through the wall of the plenum that houses the fan.

3. Measure static pressure across each component that makes up an air-handling unit, rooftop unit, and other air-handling and -treating equipment.

    a. Report the cleanliness status of filters and the time static pressures are measured.

4. Measure static pressures entering and leaving other devices, such as sound traps, heat-recovery equipment, and air washers, under final balanced conditions.
5. Review Record Documents to determine variations in design static pressures versus actual static pressures. Calculate actual system-effect factors. Recommend adjustments to accommodate actual conditions.
6. Obtain approval from Engineer for adjustment of fan speed higher or lower than indicated speed. Comply with requirements in Division 23 Sections for air-handling units for adjustment of fans, belts, and pulley sizes to achieve indicated air-handling-unit performance.
7. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload will occur. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.

B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows within specified tolerances.

1. Measure airflow of submain and branch ducts.

    a. Where sufficient space in submain and branch ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow for that zone.

2. Measure static pressure at a point downstream from the balancing damper, and adjust volume dampers until the proper static pressure is achieved.
3. Remeasure each submain and branch duct after all have been adjusted. Continue to adjust submain and branch ducts to indicated airflows within specified tolerances.

C. Measure air outlets and inlets without making adjustments.

1. Measure terminal outlets using a direct-reading hood or outlet manufacturer's written instructions and calculating factors.

D. Adjust air outlets and inlets for each space to indicated airflows within specified tolerances of indicated values. Make adjustments using branch volume dampers rather than extractors and the dampers at air terminals.

1. Adjust each outlet in same room or space to within specified tolerances of indicated quantities without generating noise levels above the limitations prescribed by the Contract Documents.
2. Adjust patterns of adjustable outlets for proper distribution without drafts.

3.6 PROCEDURES FOR MOTORS

A. Motors, 1/2 HP and Larger: Test at final balanced conditions and record the following data:

1. Manufacturer's name, model number, and serial number.
2. Motor horsepower rating.
3. Motor rpm.
4. Efficiency rating.
5. Nameplate and measured voltage, each phase.
6. Nameplate and measured amperage, each phase.
7. Starter thermal-protection-element rating.

B. Motors Driven by Variable-Frequency Controllers: Test for proper operation at speeds varying from minimum to maximum. Test the manual bypass of the controller to prove proper operation. Record observations including name of controller manufacturer, model number, serial number, and nameplate data.

3.7 PROCEDURES FOR CONDENSING UNITS

A. Verify proper rotation of fans.

B. Measure entering- and leaving-air temperatures.

C. Record compressor data.

3.8 TOLERANCES

A. Set HVAC system's air flow rates and water flow rates within the following tolerances:

1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus or minus 10 percent.
2. Air Outlets and Inlets: Plus or minus 10 percent.
3. Heating-Water Flow Rate: Plus or minus 10 percent.
4. Cooling-Water Flow Rate: Plus or minus 10 percent.

3.9 REPORTING

A. Initial Construction-Phase Report: Based on examination of the Contract Documents as specified in "Examination" Article, prepare a report on the adequacy of design for systems' balancing devices. Recommend changes and additions to systems' balancing devices to facilitate proper performance measuring and balancing. Recommend changes and additions to HVAC systems and general construction to allow access for performance measuring and balancing devices.

B. Status Reports: Prepare monthly progress reports to describe completed procedures, procedures in progress, and scheduled procedures. Include a list of deficiencies and problems found in systems being tested and balanced. Prepare a separate report for each system and each building floor for systems serving multiple floors.

3.10 FINAL REPORT

A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.

1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
2. Include a list of instruments used for procedures, along with proof of calibration.

B. Final Report Contents: In addition to certified field-report data, include the following:

1. Pump curves.
2. Fan curves.
3. Manufacturers' test data.
4. Field test reports prepared by system and equipment installers.
5. Other information relative to equipment performance; do not include Shop Drawings and product data.

C. General Report Data: In addition to form titles and entries, include the following data:

1. Title page.
2. Name and address of the TAB contractor.
3. Project name.
4. Project location.
5. Architect's name and address.
6. Engineer's name and address.
7. Contractor's name and address.
8. Report date.
9. Signature of TAB supervisor who certifies the report.
10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
11. Summary of contents including the following:

    a. Indicated versus final performance.
    b. Notable characteristics of systems.
    c. Description of system operation sequence if it varies from the Contract Documents.

12. Nomenclature sheets for each item of equipment.
13. Data for terminal units, including manufacturer's name, type, size, and fittings.
14. Notes to explain why certain final data in the body of reports vary from indicated values.
15. Test conditions for fans and pump performance forms including the following:

    a. Settings for outdoor-, return-, and exhaust-air dampers.
    b. Conditions of filters.
    c. Cooling coil, wet- and dry-bulb conditions.
    d. Face and bypass damper settings at coils.

e. Fan drive settings including settings and percentage of maximum pitch diameter.
f. Inlet vane settings for variable-air-volume systems.
g. Settings for supply-air, static-pressure controller.
h. Other system operating conditions that affect performance.

D. System Diagrams: Include schematic layouts of air and hydronic distribution systems. Present each system with single-line diagram and include the following:

1. Quantities of outdoor, supply, return, and exhaust airflows.
2. Water and steam flow rates.
3. Duct, outlet, and inlet sizes.
4. Pipe and valve sizes and locations.
5. Terminal units.
6. Balancing stations.
7. Position of balancing devices.

E. Air-Handling-Unit Test Reports: For air-handling units with coils, include the following:

1. Unit Data:

a. Unit identification.
b. Location.
c. Make and type.
d. Model number and unit size.
e. Manufacturer's serial number.
f. Unit arrangement and class.
g. Discharge arrangement.
h. Sheave make, size in inches, and bore.
i. Center-to-center dimensions of sheave, and amount of adjustments in inches.
j. Number, make, and size of belts.
k. Number, type, and size of filters.

2. Motor Data:

a. Motor make, and frame type and size.
b. Horsepower and rpm.
c. Volts, phase, and hertz.
d. Full-load amperage and service factor.
e. Sheave make, size in inches , and bore.
f. Center-to-center dimensions of sheave, and amount of adjustments in inches.

3. Test Data (Indicated and Actual Values):

a. Total air flow rate in cfm .
b. Total system static pressure in inches wg .

c. Fan rpm.
d. Discharge static pressure in inches wg.
e. Filter static-pressure differential in inches wg .
f. Preheat-coil static-pressure differential in inches wg.
g. Cooling-coil static-pressure differential in inches wg.
h. Heating-coil static-pressure differential in inches wg.
i. Outdoor airflow in cfm.
j. Return airflow in cfm.
k. Outdoor-air damper position.
l. Return-air damper position.
m. Vortex damper position.

F. Apparatus-Coil Test Reports:

1. Coil Data:

a. System identification.
b. Location.
c. Coil type.
d. Number of rows.
e. Fin spacing in fins per inch o.c.
f. Make and model number.
g. Face area in sq. ft.
h. Tube size in NPS
i. Tube and fin materials.
j. Circuiting arrangement.

2. Test Data (Indicated and Actual Values):

a. Air flow rate in cfm
b. Average face velocity in fpm
c. Air pressure drop in inches wg
d. Outdoor-air, wet- and dry-bulb temperatures in deg F
e. Return-air, wet- and dry-bulb temperatures in deg F.
f. Entering-air, wet- and dry-bulb temperatures in deg F.
g. Leaving-air, wet- and dry-bulb temperatures in deg F.
h. Water flow rate in gpm.
i. Water pressure differential in feet of head or psig.
j. Entering-water temperature in deg F.
k. Leaving-water temperature in deg F.
l. Refrigerant expansion valve and refrigerant types.
m. Refrigerant suction pressure in psig.
n. Refrigerant suction temperature in deg F.
o. Inlet steam pressure in psig.

G. Gas- and Oil-Fired Heat Apparatus Test Reports: In addition to manufacturer's factory startup equipment reports, include the following:

1. Unit Data:

a. System identification.
b. Location.
c. Make and type.
d. Model number and unit size.
e. Manufacturer's serial number.
f. Fuel type in input data.
g. Output capacity in Btu/h.
h. Ignition type.
i. Burner-control types.
j. Motor horsepower and rpm.
k. Motor volts, phase, and hertz.
l. Motor full-load amperage and service factor.
m. Sheave make, size in inches, and bore.
n. Center-to-center dimensions of sheave, and amount of adjustments in inches.

2. Test Data (Indicated and Actual Values):

a. Total air flow rate in cfm.
b. Entering-air temperature in deg F.
c. Leaving-air temperature in deg F.
d. Air temperature differential in deg F.
e. Entering-air static pressure in inches wg.
f. Leaving-air static pressure in inches wg.
g. Air static-pressure differential in inches wg.
h. Low-fire fuel input in Btu/h.
i. High-fire fuel input in Btu/h.
j. Manifold pressure in psig.
k. High-temperature-limit setting in deg F.
l. Operating set point in Btu/h.
m. Motor voltage at each connection.
n. Motor amperage for each phase.
o. Heating value of fuel in Btu/h.

H. Fan Test Reports: For supply, return, and exhaust fans, include the following:

1. Fan Data:

a. System identification.
b. Location.
c. Make and type.
d. Model number and size.
e. Manufacturer's serial number.
f. Arrangement and class.
g. Sheave make, size in inches, and bore.
h. Center-to-center dimensions of sheave, and amount of adjustments in inches.

2. Motor Data:

a. Motor make, and frame type and size.
b. Horsepower and rpm.
c. Volts, phase, and hertz.
d. Full-load amperage and service factor.
e. Sheave make, size in inches, and bore.
f. Center-to-center dimensions of sheave, and amount of adjustments in inches.
g. Number, make, and size of belts.

3. Test Data (Indicated and Actual Values):

a. Total airflow rate in cfm.
b. Total system static pressure in inches wg.
c. Fan rpm.
d. Discharge static pressure in inches wg.
e. Suction static pressure in inches wg.

I. Round, Flat-Oval, and Rectangular Duct Traverse Reports: Include a diagram with a grid representing the duct cross-section and record the following:

1. Report Data:

a. System and air-handling-unit number.
b. Location and zone.
c. Traverse air temperature in deg F.
d. Duct static pressure in inches wg.
e. Duct size in inches.
f. Duct area in sq. ft..
g. Indicated air flow rate in cfm.
h. Indicated velocity in fpm.
i. Actual air flow rate in cfm.
j. Actual average velocity in fpm.
k. Barometric pressure in psig.

J. Air-Terminal-Device Reports:

1. Unit Data:

a. System and air-handling unit identification.
b. Location and zone.
c. Apparatus used for test.
d. Area served.
e. Make.
f. Number from system diagram.
g. Type and model number.
h. Size.
i. Effective area in sq. ft..

2. Test Data (Indicated and Actual Values):

a. Air flow rate in cfm.
b. Air velocity in fpm.
c. Preliminary air flow rate as needed in cfm.
d. Preliminary velocity as needed in fpm.
e. Final air flow rate in cfm.
f. Final velocity in fpm.
g. Space temperature in deg F.

K. System-Coil Reports: For reheat coils and water coils of terminal units, include the following:

1. Unit Data:

a. System and air-handling-unit identification.
b. Location and zone.
c. Room or riser served.
d. Coil make and size.
e. Flowmeter type.

2. Test Data (Indicated and Actual Values):

a. Air flow rate in cfm.
b. Entering-water temperature in deg F.
c. Leaving-water temperature in deg F.
d. Water pressure drop in feet of head or psig.
e. Entering-air temperature in deg F.
f. Leaving-air temperature in deg F.

L. Pump Test Reports: Calculate impeller size by plotting the shutoff head on pump curves and include the following:

1. Unit Data:

a. Unit identification.
b. Location.
c. Service.
d. Make and size.
e. Model number and serial number.
f. Water flow rate in gpm.
g. Water pressure differential in feet of head or psig.
h. Required net positive suction head in feet of head or psig.
i. Pump rpm.
j. Impeller diameter in inches.
k. Motor make and frame size.
l. Motor horsepower and rpm.
m. Voltage at each connection.
n. Amperage for each phase.
o. Full-load amperage and service factor.
p. Seal type.

2. Test Data (Indicated and Actual Values):

    a. Static head in feet of head or psig.
    b. Pump shutoff pressure in feet of head or psig.
    c. Actual impeller size in inches.
    d. Full-open flow rate in gpm.
    e. Full-open pressure in feet of head or psig.
    f. Final discharge pressure in feet of head or psig.
    g. Final suction pressure in feet of head or psig.
    h. Final total pressure in feet of head or psig.
    i. Final water flow rate in gpm.
    j. Voltage at each connection.
    k. Amperage for each phase.

M. Instrument Calibration Reports:

1. Report Data:

    a. Instrument type and make.
    b. Serial number.
    c. Application.
    d. Dates of use.
    e. Dates of calibration.

3.11 INSPECTIONS

A. Initial Inspection:

1. After testing and balancing are complete, operate each system and randomly check measurements to verify that the system is operating according to the final test and balance readings documented in the final report.
2. Check the following for each system:

    a. Measure airflow of at least 10 percent of air outlets.
    b. Measure water flow of at least 5 percent of terminals.
    c. Measure room temperature at each thermostat/temperature sensor. Compare the reading to the set point.
    d. Verify that balancing devices are marked with final balance position.
    e. Note deviations from the Contract Documents in the final report.

B. Final Inspection:

1. After initial inspection is complete and documentation by random checks verifies that testing and balancing are complete and accurately documented in the final report, request that a final inspection be made by Engineer
2. The TAB contractor's test and balance engineer shall conduct the inspection in the presence of Engineer

3. Engineer shall randomly select measurements, documented in the final report, to be rechecked. Rechecking shall be limited to either 10 percent of the total measurements recorded or the extent of measurements that can be accomplished in a normal 8-hour business day.
4. If rechecks yield measurements that differ from the measurements documented in the final report by more than the tolerances allowed, the measurements shall be noted as "FAILED."
5. If the number of "FAILED" measurements is greater than 10 percent of the total measurements checked during the final inspection, the testing and balancing shall be considered incomplete and shall be rejected.

C. TAB Work will be considered defective if it does not pass final inspections. If TAB Work fails, proceed as follows:

1. Recheck all measurements and make adjustments. Revise the final report and balancing device settings to include all changes; resubmit the final report and request a second final inspection.
2. If the second final inspection also fails, Owner may contract the services of another TAB contractor to complete TAB Work according to the Contract Documents and deduct the cost of the services from the original TAB contractor's final payment.

D. Prepare test and inspection reports.

3.12 ADDITIONAL TESTS

A. Within 90 days of completing TAB, perform additional TAB to verify that balanced conditions are being maintained throughout and to correct unusual conditions.

B. Seasonal Periods: If initial TAB procedures were not performed during near-peak summer and winter conditions, perform additional TAB during near-peak summer and winter conditions.

END OF SECTION 230593

SECTION 230700 - HVAC INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Insulation Materials:

a. Calcium silicate.
b. Cellular glass.
c. Flexible elastomeric.
d. Mineral fiber.
e. Phenolic.
f. Polyisocyanurate.
g. Polyolefin.
h. Polystyrene.

2. Fire-rated insulation systems.
3. Insulating cements.
4. Adhesives.
5. Mastics.
6. Lagging adhesives.
7. Sealants.
8. Factory-applied jackets.
9. Field-applied fabric-reinforcing mesh.
10. Field-applied cloths.
11. Field-applied jackets.
12. Tapes.
13. Securements.
14. Corner angles.

B. Related Sections:

1. Division 22 Section "Plumbing Insulation."
2. Division 23 Section "Metal Ducts" for duct liners.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated. Include thermal conductivity, thickness, and jackets (both factory and field applied, if any).

B. Shop Drawings:

1. Detail application of protective shields, saddles, and inserts at hangers for each type of insulation and hanger.
2. Detail attachment and covering of heat tracing inside insulation.
3. Detail insulation application at pipe expansion joints for each type of insulation.
4. Detail insulation application at elbows, fittings, flanges, valves, and specialties for each type of insulation.
5. Detail removable insulation at piping specialties, equipment connections, and access panels.
6. Detail application of field-applied jackets.
7. Detail application at linkages of control devices.
8. Detail field application for each equipment type.

C. Samples: For each type of insulation and jacket indicated. Identify each Sample, describing product and intended use.

1. Sample Sizes:

a. Preformed Pipe Insulation Materials: 12 inches long by NPS 2.
b. Sheet Form Insulation Materials: 12 inches square.
c. Jacket Materials for Pipe: 12 inches long by NPS 2.
d. Sheet Jacket Materials: 12 inches square.
e. Manufacturer's Color Charts: For products where color is specified, show the full range of colors available for each type of finish material.

D. Qualification Data: For qualified Installer.

E. Material Test Reports: From a qualified testing agency acceptable to authorities having jurisdiction indicating, interpreting, and certifying test results for compliance of insulation materials, sealers, attachments, cements, and jackets, with requirements indicated. Include dates of tests and test methods employed.

F. Field quality-control reports.

1.4 QUALITY ASSURANCE

A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.

B. Fire-Test-Response Characteristics: Insulation and related materials shall have fire-test-response characteristics indicated, as determined by testing identical products per

ASTM E 84, by a testing and inspecting agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing and inspecting agency.

1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

C. Mockups: Before installing insulation, build mockups for each type of insulation and finish listed below to demonstrate quality of insulation application and finishes. Build mockups in the location indicated or, if not indicated, as directed by Architect. Use materials indicated for the completed Work.

1. Piping Mockups:

   a. One 10-foot section of NPS 2 straight pipe.
   b. One each of a 90-degree threaded, welded, and flanged elbow.
   c. One each of a threaded, welded, and flanged tee fitting.
   d. One NPS 2 or smaller valve, and one NPS 2-1/2 or larger valve.
   e. Four support hangers including hanger shield and insert.
   f. One threaded strainer and one flanged strainer with removable portion of insulation.
   g. One threaded reducer and one welded reducer.
   h. One pressure temperature tap.
   i. One mechanical coupling.

2. Ductwork Mockups:

   a. One 10-foot section each of rectangular and round straight duct.
   b. One each of a 90-degree mitered round and rectangular elbow, and one each of a 90-degree radius round and rectangular elbow.
   c. One rectangular branch takeoff and one round branch takeoff from a rectangular duct. One round tee fitting.
   d. One rectangular and round transition fitting.
   e. Four support hangers for round and rectangular ductwork.

3. Equipment Mockups:

   a. One chilled-water pump and one heating-hot-water pump.
   b. One tank or vessel.

4. For each mockup, fabricate cutaway sections to allow observation of application details for insulation materials, adhesives, mastics, attachments, and jackets.
5. Notify Engineer seven days in advance of dates and times when mockups will be constructed.
6. Obtain Engineer's approval of mockups before starting insulation application.

7. Approval of mockups does not constitute approval of deviations from the Contract Documents contained in mockups unless Engineer specifically approves such deviations in writing.
8. Maintain mockups during construction in an undisturbed condition as a standard for judging the completed Work.
9. Demolish and remove mockups when directed.

1.5 DELIVERY, STORAGE, AND HANDLING

A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.6 COORDINATION

A. Coordinate size and location of supports, hangers, and insulation shields specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."

B. Coordinate clearance requirements with piping Installer for piping insulation application, duct Installer for duct insulation application, and equipment Installer for equipment insulation application. Before preparing piping and ductwork Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

C. Coordinate installation and testing of heat tracing.

1.7 SCHEDULING

A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.

B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

A. Comply with requirements in Part 3 schedule articles for where insulating materials shall be applied.

B. Products shall not contain asbestos, lead, mercury, or mercury compounds.

C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.

D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.

E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.

F. Cellular Glass: Inorganic, incombustible, foamed or cellulated glass with annealed, rigid, hermetically sealed cells. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Cell-U-Foam Corporation; Ultra-CUF.
    b. Pittsburgh Corning Corporation; Foamglas Super K.

2. Block Insulation: ASTM C 552, Type I.
3. Special-Shaped Insulation: ASTM C 552, Type III.
4. Board Insulation: ASTM C 552, Type IV.
5. Preformed Pipe Insulation without Jacket: Comply with ASTM C 552, Type II, Class 1.
6. Preformed Pipe Insulation with Factory-Applied ASJ-SSL: Comply with ASTM C 552, Type II, Class 2.
7. Factory fabricate shapes according to ASTM C 450 and ASTM C 585.

G. Flexible Elastomeric: Closed-cell, sponge- or expanded-rubber materials. Comply with ASTM C 534, Type I for tubular materials and Type II for sheet materials.

1. Products: Subject to compliance with requirements, provide one of the following:

    a. Aeroflex USA Inc.; Aerocel.
    b. Armacell LLC; AP Armaflex.
    c. Rubatex Corp.
    d. Armstrong World Industries, Inc.

H. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 553, Type II without facing and with all service jacket manufactured from kraft paper, reinforcing scrim, aluminum foil and vinyl film

1. Products: Subject to compliance with requirements, provide one of the following:

    a. CertainTeed Corp.; Duct Wrap.
    b. Johns Manville; Microlite.
    c. Knauf Insulation; Duct Wrap.
    d. Manson Insulation Inc.; Alley Wrap.
    e. Owens Corning; All-Service Duct Wrap.

I. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IB. without facing and with all service jacket manufactured from kraft paper, reinforcing scrim, aluminum foil and vinyl film

1. Products: Subject to compliance with requirements, provide one of the following:

   a. CertainTeed Corp.; Commercial Board.
   b. Fibrex Insulations Inc.; FBX.
   c. Johns Manville; 800 Series Spin-Glas.
   d. Knauf Insulation; Insulation Board.
   e. Manson Insulation Inc.; AK Board.
   f. Owens Corning; Fiberglas 700 Series.

J. Mineral-Fiber, Preformed Pipe Insulation:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Fibrex Insulations Inc.; Coreplus 1200.
   b. Johns Manville; Micro-Lok.
   c. Knauf Insulation; 1000 Pipe Insulation.
   d. Manson Insulation Inc.; Alley-K.
   e. Owens Corning; Fiberglas Pipe Insulation.

2. Type I, 850 deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with all purpose factory applied vapor-retarder jacket.

3. Type II, 1200 deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type II, Grade A, with all purpose factory applied vapor-retarder jacket.

K. Mineral-Fiber, Pipe and Tank Insulation: Mineral or glass fibers bonded with a thermosetting resin. Semirigid board material with factory-applied jacket complying with ASTM C 1393, Type II or Type IIIA Category 2, or with properties similar to ASTM C 612, Type IB. Nominal density is 2.5 lb/cu. ft. or more. Thermal conductivity (k-value) at 100 deg F is 0.29 Btu x in./h x sq. ft. x deg F or less.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. CertainTeed Corp.; CrimpWrap.
   b. Johns Manville; MicroFlex.
   c. Knauf Insulation; Pipe and Tank Insulation.
   d. Manson Insulation Inc.; AK Flex.
   e. Owens Corning; Fiberglas Pipe and Tank Insulation.

2.2 INSULATING CEMENTS

A. Mineral-Fiber Insulating Cement: Comply with ASTM C 195.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Insulco, Division of MFS, Inc.; Triple I.
   b. P. K. Insulation Mfg. Co., Inc.; Super-Stik.

B. Expanded or Exfoliated Vermiculite Insulating Cement: Comply with ASTM C 196.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. P. K. Insulation Mfg. Co., Inc.; Thermal-V-Kote.

C. Mineral-Fiber, Hydraulic-Setting Insulating and Finishing Cement: Comply with ASTM C 449/C 449M.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Insulco, Division of MFS, Inc.; SmoothKote.
   b. P. K. Insulation Mfg. Co., Inc.; PK No. 127, and Quik-Cote.
   c. Rock Wool Manufacturing Company; Delta One Shot.

2.3 ADHESIVES

A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.

B. Flexible Elastomeric and Polyolefin Adhesive: Comply with MIL-A-24179A, Type II, Class I.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Aeroflex USA Inc.; Aeroseal.
   b. Armacell LCC; 520 Adhesive.
   c. Foster Products Corporation, H. B. Fuller Company; 85-75.
   d. RBX Corporation; Rubatex Contact Adhesive.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

C. Cellular-Glass, Phenolic, Polyisocyanurate, and Polystyrene Adhesive: Solvent-based resin adhesive, with a service temperature range of minus 75 to plus 300 deg F.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-96.
   b. Foster Products Corporation, H. B. Fuller Company; 81-33.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

D. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-82.
b. Foster Products Corporation, H. B. Fuller Company; 85-20.
c. ITW TACC, Division of Illinois Tool Works; S-90/80.
d. Marathon Industries, Inc.; 225.
e. Mon-Eco Industries, Inc.; 22-25.

2. For indoor applications, use adhesive that has a VOC content of 80 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

E. PVC Jacket Adhesive: Compatible with PVC jacket.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Dow Chemical Company (The); 739, Dow Silicone.
b. Johns-Manville; Zeston Perma-Weld, CEEL-TITE Solvent Welding Adhesive.
c. P.I.C. Plastics, Inc.; Welding Adhesive.
d. Speedline Corporation; Speedline Vinyl Adhesive.

2. For indoor applications, use adhesive that has a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.4 MASTICS

A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-C-19565C, Type II.

B. Vapor-Barrier Mastic: Water based; suitable for indoor and outdoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-35.
b. Foster Products Corporation, H. B. Fuller Company; 30-90.
c. ITW TACC, Division of Illinois Tool Works; CB-50.
d. Marathon Industries, Inc.; 590.
e. Mon-Eco Industries, Inc.; 55-40.
f. Vimasco Corporation; 749.

2. Water-Vapor Permeance: ASTM E 96, Procedure B, 0.013 perm at 43-mil dry film thickness.
3. Service Temperature Range: Minus 20 to plus 180 deg F .

4. Solids Content: ASTM D 1644, 59 percent by volume and 71 percent by weight.
5. Color: White.

C. Vapor-Barrier Mastic: Solvent based; suitable for indoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-30.
b. Foster Products Corporation, H. B. Fuller Company; 30-35.
c. ITW TACC, Division of Illinois Tool Works; CB-25.
d. Marathon Industries, Inc.; 501.
e. Mon-Eco Industries, Inc.; 55-10.

2. Water-Vapor Permeance: ASTM F 1249, 0.05 perm at 35-mil dry film thickness.
3. Service Temperature Range: 0 to 180 deg F .
4. Solids Content: ASTM D 1644, 44 percent by volume and 62 percent by weight.
5. Color: White.

D. Vapor-Barrier Mastic: Solvent based; suitable for outdoor use on below ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; Encacel.
b. Foster Products Corporation, H. B. Fuller Company; 60-95/60-96.
c. Marathon Industries, Inc.; 570.
d. Mon-Eco Industries, Inc.; 55-70.

2. Water-Vapor Permeance: ASTM F 1249, 0.05 perm at 30-mil dry film thickness.
3. Service Temperature Range: Minus 50 to plus 220 deg F .
4. Solids Content: ASTM D 1644, 33 percent by volume and 46 percent by weight.
5. Color: White.

2.5 LAGGING ADHESIVES

A. Description: Comply with MIL-A-3316C Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; CP-52.
b. Foster Products Corporation, H. B. Fuller Company; 81-42.
c. Marathon Industries, Inc.; 130.
d. Mon-Eco Industries, Inc.; 11-30.
e. Vimasco Corporation; 136.

2. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over duct, equipment, and pipe insulation.
3. Service Temperature Range: Minus 50 to plus 180 deg F.
4. Color: White.

2.6 SEALANTS

A. Metal Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-76-8.
   b. Foster Products Corporation, H. B. Fuller Company; 95-44.
   c. Marathon Industries, Inc.; 405.
   d. Mon-Eco Industries, Inc.; 44-05.
   e. Vimasco Corporation; 750.

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: Aluminum.
6. For indoor applications, use sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

B. PVC Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products, Division of ITW; CP-76.
   b. Foster Products Corporation, H. B. Fuller Company; 95-44.
   c. Marathon Industries, Inc.; 405.
   d. Mon-Eco Industries, Inc.; 44-05.
   e. Vimasco Corporation; 750.

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: White.
6. For indoor applications, use sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.7 FIELD-APPLIED FABRIC-REINFORCING MESH

A. Woven Glass-Fiber Fabric for Pipe Insulation: Approximately 2 oz./sq. yd. with a thread count of 10 strands by 10 strands/sq. inch for covering pipe and pipe fittings.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; Chil-Glas No. 5.

b. Vimasco Corporation; Elastafab 894.

B. Woven Glass-Fiber Fabric for Duct and Equipment Insulation: Approximately 6 oz./sq. yd. with a thread count of 5 strands by 5 strands/sq. inch for covering equipment.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; Chil-Glas No. 5.
b. Vimasco Corporation; Elastafab 894.

2.8 FIELD-APPLIED JACKETS

A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.

B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.

1. Products: Subject to compliance with requirements, provide one of the following:

a. Johns Manville; Zeston.
b. P.I.C. Plastics, Inc.; FG Series.
c. Proto PVC Corporation; LoSmoke.
d. Speedline Corporation; SmokeSafe.

2. Adhesive: As recommended by jacket material manufacturer.
3. Color: White
4. Factory-fabricated fitting covers to match jacket.

a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, mechanical joints, and P-trap and supply covers for lavatories.

5. Factory-fabricated tank heads and tank side panels.

C. Metal Jacket:

1. Products: Subject to compliance with requirements, provide one of the following:

a. Childers Products, Division of ITW; Metal Jacketing Systems.
b. PABCO Metals Corporation; Surefit.
c. RPR Products, Inc.; Insul-Mate.

2. Aluminum Jacket: Comply with ASTM B 209 (ASTM B 209M), Alloy 3003, 3005, 3105 or 5005, Temper H-14.

   a. Factory cut and rolled to size.
   b. Finish and thickness are indicated in field-applied jacket schedules.
   c. Moisture Barrier for Indoor Applications: 1-mil- thick, heat-bonded polyethylene and kraft paper .
   d. Moisture Barrier for Outdoor Applications: 3-mil- thick, heat-bonded polyethylene and kraft paper.
   e. Factory-Fabricated Fitting Covers:

      1) Same material, finish, and thickness as jacket.
      2) Preformed 2-piece or gore, 45- and 90-degree, short- and long-radius elbows.
      3) Tee covers.
      4) Flange and union covers.
      5) End caps.
      6) Beveled collars.
      7) Valve covers.
      8) Field fabricate fitting covers only if factory-fabricated fitting covers are not available.

D. Underground Direct-Buried Jacket: 125-mil- thick vapor barrier and waterproofing membrane consisting of a rubberized bituminous resin reinforced with a woven-glass fiber or polyester scrim and laminated aluminum foil.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Pittsburgh Corning Corporation; Pittwrap.
   b. Polyguard; Insulrap No Torch 125.

2.9 TAPES

A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0835.
   b. Compac Corp.; 104 and 105.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 428 AWF ASJ.
   d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.

2. Width: 3 inches.
3. Thickness: 11.5 mils .
4. Adhesion: 90 ounces force/inch in width.
5. Elongation: 2 percent.
6. Tensile Strength: 40 lbf/inch in width.

7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.

B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0827.
   b. Compac Corp.; 110 and 111.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 491 AWF FSK.
   d. Venture Tape; 1525 CW, 1528 CW, and 1528 CW/SQ.

2. Width: 3 inches .
3. Thickness: 6.5 mils .
4. Adhesion: 90 ounces force/inch in width.
5. Elongation: 2 percent.
6. Tensile Strength: 40 lbf/inch in width.
7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.

C. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive. Suitable for indoor and outdoor applications.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0555.
   b. Compac Corp.; 130.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 370 White PVC tape.
   d. Venture Tape; 1506 CW NS.

2. Width: 2 inches .
3. Thickness: 6 mils .
4. Adhesion: 64 ounces force/inch in width.
5. Elongation: 500 percent.
6. Tensile Strength: 18 lbf/inch in width.

D. Aluminum-Foil Tape: Vapor-retarder tape with acrylic adhesive.

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0800.
   b. Compac Corp.; 120.
   c. Ideal Tape Co., Inc., an American Biltrite Company; 488 AWF.
   d. Venture Tape; 3520 CW.

2. Width: 2 inches.
3. Thickness: 3.7 mils.
4. Adhesion: 100 ounces force/inch in width.
5. Elongation: 5 percent.
6. Tensile Strength: 34 lbf/inch in width.

2.10 SECUREMENTS

A. Bands:

1. Products: Subject to compliance with requirements, provide one of the following:

   a. Childers Products; Bands.
   b. PABCO Metals Corporation; Bands.
   c. RPR Products, Inc.; Bands.

2. Stainless Steel: ASTM A 167 or ASTM A 240/A 240M, Type 304 0.015 inch thick, 3/4 inch wide with wing or closed seal.
3. Aluminum: ASTM B 209 , Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with wing or closed seal.
4. Springs: Twin spring set constructed of stainless steel with ends flat and slotted to accept metal bands. Spring size determined by manufacturer for application.

B. Insulation Pins and Hangers:

1. Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch- diameter shank, length to suit depth of insulation indicated.

2. Products: Subject to compliance with requirements, provide one of the following:

   1) AGM Industries, Inc.; CWP-1.
   2) GEMCO; CD.
   3) Midwest Fasteners, Inc.; CD.
   4) Nelson Stud Welding; TPA, TPC, and TPS.

3. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch- diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.

   a. Products: Subject to compliance with requirements, provide one of the following:

      1) AGM Industries, Inc.; CWP-1.
      2) GEMCO; Cupped Head Weld Pin.
      3) Midwest Fasteners, Inc.; Cupped Head.
      4) Nelson Stud Welding; CHP.

4. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick, galvanized-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.

   a. Products: Subject to compliance with requirements, provide one of the following:

1) AGM Industries, Inc.; RC-150.
2) GEMCO; R-150.
3) Midwest Fasteners, Inc.; WA-150.
4) Nelson Stud Welding; Speed Clips.

b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.

C. Staples: Outward-clinching insulation staples, nominal 3/4-inch- wide, stainless steel or Monel.

D. Wire: 0.080-inch nickel-copper alloy, 0.062-inch soft-annealed, stainless steel or 0.062-inch soft-annealed, galvanized steel.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. C & F Wire.
b. Childers Products.
c. PABCO Metals Corporation.
d. RPR Products, Inc.

2.11 CORNER ANGLES

A. PVC Corner Angles: 30 mils thick, minimum 1 by 1 inch, PVC according to ASTM D 1784, Class 16354-C. White or color-coded to match adjacent surface.

B. Aluminum Corner Angles: 0.040 inch thick, minimum 1 by 1 inch , aluminum according to ASTM B 209 , Alloy 3003, 3005, 3105 or 5005; Temper H-14.

C. Stainless-Steel Corner Angles: 0.024 inch thick, minimum 1 by 1 inch , stainless steel according to ASTM A 167 or ASTM A 240/A 240M, Type 304.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine substrates and conditions for compliance with requirements for installation and other conditions affecting performance of insulation application.

1. Verify that systems and equipment to be insulated have been tested and are free of defects.
2. Verify that surfaces to be insulated are clean and dry.
3. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

B. Surface Preparation: Clean and prepare surfaces to be insulated. Before insulating, apply a corrosion coating to insulated surfaces as follows:

1. Stainless Steel: Coat 300 series stainless steel with an epoxy primer 5 mils thick and an epoxy finish 5 mils thick if operating in a temperature range between 140 and 300 deg F. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
2. Carbon Steel: Coat carbon steel operating at a service temperature between 32 and 300 deg F with an epoxy coating. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.

C. Coordinate insulation installation with the trade installing heat tracing. Comply with requirements for heat tracing that apply to insulation.

D. Mix insulating cements with clean potable water; if insulating cements are to be in contact with stainless-steel surfaces, use demineralized water.

3.3 GENERAL INSTALLATION REQUIREMENTS

A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of equipment, ducts and fittings, and piping including fittings, valves, and specialties.

B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of equipment, duct system, and pipe system as specified in insulation system schedules.

C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.

D. Install insulation with longitudinal seams at top and bottom of horizontal runs.

E. Install multiple layers of insulation with longitudinal and end seams staggered.

F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.

G. Keep insulation materials dry during application and finishing.

H. Provide an additional five hundred feet of preformed insulation and five hundred square feet of blanket and board type insulation as well as accessories and labor for

each size, thickness and type used on the project to accommodate any changes required to resolve interferences or as directed by the Engineer.

I. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.

J. Install insulation with least number of joints practical.

K. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.

1. Install insulation continuously through hangers and around anchor attachments.
2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.

L. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.

M. Install insulation with factory-applied jackets as follows:

1. Draw jacket tight and smooth.
2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 4 inches o.c.

    a. For below ambient services, apply vapor-barrier mastic over staples.

4. Cover joints and seams with tape as recommended by insulation material manufacturer to maintain vapor seal.
5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct and pipe flanges and fittings.

N. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.

O. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.

P. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.

Q. For above ambient services, do not install insulation to the following:

1. Vibration-control devices.
2. Testing agency labels and stamps.
3. Nameplates and data plates.
4. Manholes.
5. Handholes.
6. Cleanouts.

3.4 PENETRATIONS

A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.

1. Seal penetrations with flashing sealant.
2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
4. Seal jacket to roof flashing with flashing sealant.

B. Insulation Installation at Underground Exterior Wall Penetrations: Terminate insulation flush with sleeve seal. Seal terminations with flashing sealant.

C. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.

1. Seal penetrations with flashing sealant.
2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.
4. Seal jacket to wall flashing with flashing sealant.

D. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.

E. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions. Terminate insulation at fire damper sleeves for fire-rated wall and partition penetrations.

Externally insulate damper sleeves to match adjacent insulation and overlap duct insulation at least 2 inches.

1. Comply with requirements in Division 07 Section "Penetration Firestopping" and fire-resistive joint sealers.

F. Insulation Installation at Floor Penetrations:

1. Duct: Install insulation continuously through floor penetrations that are not fire rated. For penetrations through fire-rated assemblies, terminate insulation at fire damper sleeves and externally insulate damper sleeve beyond floor to match adjacent duct insulation. Overlap damper sleeve and duct insulation at least 2 inches .
2. Pipe: Install insulation continuously through floor penetrations.
3. Seal penetrations through fire-rated assemblies. Comply with requirements in Division 07 Section "Penetration Firestopping."

3.5 EQUIPMENT, TANK, AND VESSEL INSULATION INSTALLATION

A. Mineral Fiber, Pipe and Tank Insulation Installation for Tanks and Vessels: Secure insulation with adhesive and anchor pins and speed washers.

1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of tank and vessel surfaces.
2. Groove and score insulation materials to fit as closely as possible to equipment, including contours. Bevel insulation edges for cylindrical surfaces for tight joints. Stagger end joints.
3. Protect exposed corners with secured corner angles.
4. Install adhesively attached or self-sticking insulation hangers and speed washers on sides of tanks and vessels as follows:

    a. Do not weld anchor pins to ASME-labeled pressure vessels.
    b. Select insulation hangers and adhesive that are compatible with service temperature and with substrate.
    c. On tanks and vessels, maximum anchor-pin spacing is 3 inches from insulation end joints, and 16 inches o.c. in both directions.
    d. Do not overcompress insulation during installation.
    e. Cut and miter insulation segments to fit curved sides and domed heads of tanks and vessels.
    f. Impale insulation over anchor pins and attach speed washers.
    g. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.

5. Secure each layer of insulation with stainless-steel or aluminum bands. Select band material compatible with insulation materials.
6. Where insulation hangers on equipment and vessels are not permitted or practical and where insulation support rings are not provided, install a girdle network for

securing insulation. Stretch prestressed aircraft cable around the diameter of vessel and make taut with clamps, turnbuckles, or breather springs. Place one circumferential girdle around equipment approximately 6 inches from each end. Install wire or cable between two circumferential girdles 12 inches o.c. Install a wire ring around each end and around outer periphery of center openings, and stretch prestressed aircraft cable radially from the wire ring to nearest circumferential girdle. Install additional circumferential girdles along the body of equipment or tank at a minimum spacing of 48 inches o.c. Use this network for securing insulation with tie wire or bands.

7. Stagger joints between insulation layers at least 3 inches .
8. Install insulation in removable segments on equipment access doors, manholes, handholes, and other elements that require frequent removal for service and inspection.
9. Bevel and seal insulation ends around manholes, handholes, ASME stamps, and nameplates.
10. For equipment with surface temperatures below ambient, apply mastic to open ends, joints, seams, breaks, and punctures in insulation.

B. Flexible Elastomeric Thermal Insulation Installation for Tanks and Vessels: Install insulation over entire surface of tanks and vessels.

1. Apply 100 percent coverage of adhesive to surface with manufacturer's recommended adhesive.
2. Seal longitudinal seams and end joints.

C. Insulation Installation on Pumps:

1. Fabricate metal boxes lined with insulation. Fit boxes around pumps and coincide box joints with splits in pump casings. Fabricate joints with outward bolted flanges. Bolt flanges on 6-inch centers, starting at corners. Install 3/8-inch-diameter fasteners with wing nuts. Alternatively, secure the box sections together using a latching mechanism.
2. Fabricate boxes from aluminum, at least 0.060 inch thick.
3. For below ambient services, install a vapor barrier at seams, joints, and penetrations. Seal between flanges with replaceable gasket material to form a vapor barrier.

3.6 GENERAL PIPE INSULATION INSTALLATION

A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.

B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:

1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity, unless otherwise indicated.

2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below ambient services, provide a design that maintains vapor barrier.
6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.
7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below ambient services and a breather mastic for above ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
8. For services not specified to receive a field-applied jacket except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
9. Stencil or label the outside insulation jacket of each union with the word "UNION." Match size and color of pipe labels.

C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes, vessels, and equipment. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.

D. Install removable insulation covers at locations indicated. Installation shall conform to the following:

1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
3. Construct removable valve insulation covers in same manner as for flanges except divide the two-part section on the vertical center line of valve body.
4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.
5. Unless a PVC jacket is indicated in field-applied jacket schedules, finish exposed surfaces with a metal jacket.

3.7 CELLULAR-GLASS INSULATION INSTALLATION

A. Insulation Installation on Straight Pipes and Tubes:
1. Secure each layer of insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above ambient services, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below ambient services, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

B. Insulation Installation on Pipe Flanges:
1. Install preformed pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of cellular-glass block insulation of same thickness as pipe insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch , and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:
1. Install preformed sections of same material as straight segments of pipe insulation when available. Secure according to manufacturer's written instructions.

2. When preformed sections of insulation are not available, install mitered sections of cellular-glass insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:
1. Install preformed sections of cellular-glass insulation to valve body.
2. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
3. Install insulation to flanges as specified for flange insulation application.

3.8 FLEXIBLE ELASTOMERIC INSULATION INSTALLATION

A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

B. Insulation Installation on Pipe Flanges:

1. Install pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as pipe insulation.
4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install mitered sections of pipe insulation.
2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed valve covers manufactured of same material as pipe insulation when available.
2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
3. Install insulation to flanges as specified for flange insulation application.
4. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

3.9 MINERAL-FIBER INSULATION INSTALLATION

A. Insulation Installation on Straight Pipes and Tubes:

1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
3. For insulation with factory-applied jackets on above ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
4. For insulation with factory-applied jackets on below ambient surfaces, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.

B. Insulation Installation on Pipe Flanges:

1. Install preformed pipe insulation to outer diameter of pipe flange.
2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch , and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

E. Blanket Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.

1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.

2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:

    a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
    b. On duct sides with dimensions larger than 18 inches, place pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
    c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
    d. Do not overcompress insulation during installation.
    e. Impale insulation over pins and attach speed washers.
    f. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.

4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from 1 edge and 1 end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.

    a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
    b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to 2 times the insulation thickness but not less than 3 inches.

5. Overlap unfaced blankets a minimum of 2 inches on longitudinal seams and end joints. At end joints, secure with steel bands spaced a maximum of 18 inches o.c.
6. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
7. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

F. Board Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.

1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:

    a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
    b. On duct sides with dimensions larger than 18 inches, space pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
    c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
    d. Do not overcompress insulation during installation.
    e. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.

4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from 1 edge and 1 end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.

    a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
    b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to 2 times the insulation thickness but not less than 3 inches.

5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Groove and score insulation to fit as closely as possible to outside and inside radius of elbows. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

3.10 FIELD-APPLIED JACKET INSTALLATION

A. Where glass-cloth jackets are indicated, install directly over bare insulation or insulation with factory-applied jackets.

1. Draw jacket smooth and tight to surface with 2-inch overlap at seams and joints.
2. Embed glass cloth between two 0.062-inch- thick coats of lagging adhesive.
3. Completely encapsulate insulation with coating, leaving no exposed insulation.

B. Where FSK jackets are indicated, install as follows:

1. Draw jacket material smooth and tight.
2. Install lap or joint strips with same material as jacket.
3. Secure jacket to insulation with manufacturer's recommended adhesive.
4. Install jacket with 1-1/2-inch laps at longitudinal seams and 3-inch- wide joint strips at end joints.
5. Seal openings, punctures, and breaks in vapor-retarder jackets and exposed insulation with vapor-barrier mastic.

C. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications, install with longitudinal seams along top and bottom of tanks and vessels. Seal with manufacturer's recommended adhesive.

1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.

D. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless-steel bands 12 inches (300 mm) o.c. and at end joints.

3.11 FIRE-RATED INSULATION SYSTEM INSTALLATION

A. Where fire-rated insulation system is indicated, secure system to ducts and duct hangers and supports to maintain a continuous fire rating.

B. Insulate duct access panels and doors to achieve same fire rating as duct.

C. Install firestopping at penetrations through fire-rated assemblies. Fire-stop systems are specified in Division 07 Section "Penetration Firestopping."

3.12 FINISHES

A. Duct, Equipment, and Pipe Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Division 09 painting Sections.

1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.

    a. Finish Coat Material: Interior, flat, latex-emulsion size.

B. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.

C. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.

D. Do not field paint aluminum or stainless-steel jackets.

3.13 FIELD QUALITY CONTROL

A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.

B. Perform tests and inspections.

C. Tests and Inspections:

1. Inspect ductwork, randomly selected by Engineer, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to ten location(s) for each duct system defined in the "Duct Insulation Schedule, General" Article.
2. Inspect field-insulated equipment, randomly selected by Engineer, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to ten location(s) for each type of equipment defined in the "Equipment Insulation Schedule" Article. For large equipment, remove only a portion adequate to determine compliance.
3. Inspect pipe, fittings, strainers, and valves, randomly selected by Engineer, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to ten locations of straight pipe, ten locations of threaded fittings, ten locations of welded fittings, five locations of threaded strainers, five locations of welded strainers, ten locations of threaded valves, and ten locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.

D. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

3.14 DUCT INSULATION SCHEDULE, GENERAL

A. Plenums and Ducts Requiring Insulation:

1. Indoor, concealed supply and outdoor air.
2. Indoor, exposed supply and outdoor air.

3. Indoor, concealed return located in nonconditioned space.
4. Indoor, exposed return located in nonconditioned space.
5. Indoor, concealed, Type I, commercial, kitchen hood exhaust.
6. Indoor, exposed, Type I, commercial, kitchen hood exhaust.
7. Indoor, concealed oven and warewash exhaust.
8. Indoor, exposed oven and warewash exhaust.
9. Indoor, concealed exhaust between isolation damper and penetration of building exterior.
10. Indoor, exposed exhaust between isolation damper and penetration of building exterior.
11. Outdoor, concealed supply and return.
12. Outdoor, exposed supply and return.

B. Items Not Insulated:

1. Factory-insulated plenums and casings.
2. Flexible connectors.
3. Vibration-control devices.
4. Factory-insulated access panels and doors.

3.15 INDOOR DUCT AND PLENUM INSULATION SCHEDULE

A. Concealed, round and flat-oval, supply-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

B. Concealed, round and flat-oval, return-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

C. Concealed, round and flat-oval, outdoor-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

D. Concealed, round and flat-oval, exhaust-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

E. Concealed, rectangular, supply-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

F. Concealed, rectangular, return-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

G. Concealed, rectangular, outdoor-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

H. Concealed, rectangular, exhaust-air duct insulation between isolation damper and penetration of building exterior shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

I. Concealed, Type I, Commercial, Kitchen Hood Exhaust Duct and Plenum Insulation: Fire-rated blanket; thickness as required to achieve 2-hour fire rating.

J. Concealed, supply-air plenum insulation shall be the following:
1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

K. Concealed, return-air plenum insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

L. Concealed, outdoor-air plenum insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

M. Concealed, exhaust-air plenum insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

N. Exposed, round and flat-oval, supply-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

O. Exposed, round and flat-oval, return-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

P. Exposed, round and flat-oval, outdoor-air duct insulation shall be the following:

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

Q. Exposed, round and flat-oval, exhaust-air duct insulation shall be the following:

R.

1. Mineral-Fiber Blanket: 2 inches thick and 1.5-lb/cu. ft. nominal density.

S. Exposed, rectangular, supply-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

T. Exposed, rectangular, return-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

U. Exposed, rectangular, outdoor-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

V. Exposed, rectangular, exhaust-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

W. Exposed, Type I, Commercial, Kitchen Hood Exhaust Duct and Plenum Insulation: Fire-rated board, thickness as required to achieve 2-hour fire rating.

X. Exposed, supply-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

Y. Exposed, return-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

Z. Exposed, outdoor-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

AA. Exposed, exhaust-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

3.16 ABOVEGROUND, OUTDOOR DUCT AND PLENUM INSULATION SCHEDULE

A. Concealed, round and flat-oval, supply-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

B. Concealed, round and flat-oval, return-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

C. Concealed, round and flat-oval, outdoor-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

D. Concealed, rectangular, supply-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

E. Concealed, rectangular, return-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

F. Concealed, supply-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

G. Concealed, return-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

H. Exposed, round and flat-oval, supply-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

I. Exposed, round and flat-oval, return-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

J. Exposed, rectangular, supply-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

K. Exposed, rectangular, return-air duct insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

L. Exposed, supply-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

M. Exposed, return-air plenum insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

3.17 EQUIPMENT INSULATION SCHEDULE

A. Insulate indoor and outdoor equipment in paragraphs below that is not factory insulated.

B. Chillers: Insulate cold surfaces on chillers, including, but not limited to, evaporator bundles, condenser bundles, suction piping, compressor inlets, tube sheets, water boxes, and nozzles with the following:
1. Flexible Elastomeric: 1 inch thick.

C. Chilled-water pump insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

D. Condenser-water pump insulation shall bethe following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

E. Dual-service heating and cooling pump insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

F. Heating-hot-water pump insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

G. Heat-recovery pump insulation shall be the following:

1. Mineral-Fiber Board: 2 inches thick 3-lb/cu. ft. nominal density.

H. Chilled-water expansion/compression tank insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

I. Condenser-water expansion/compression tank insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

J. Dual-service heating and cooling expansion/compression tank insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

K. Heating-hot-water expansion/compression tank insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

L. Heat-recovery expansion/compression tank insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

M. Chilled-water air-separator insulation shall be the following:
1. Mineral-Fiber Pipe and Tank: 2 inches thick.

N. Condenser-water air-separator insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

O. Dual-service heating and cooling air-separator insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

P. Heating-hot-water air-separator insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

Q. Heat-recovery air-separator insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

R. Piping system filter-housing insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

S. Outdoor, aboveground, heated, fuel-oil storage tank insulation shall be the following:

1. Mineral-Fiber Pipe and Tank: 2 inches thick.

3.18 PIPING INSULATION SCHEDULE, GENERAL

A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.

3.19 INDOOR PIPING INSULATION SCHEDULE

A. Condensate and Equipment Drain Water below 60 Deg F :

1. All Pipe Sizes: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.

B. Chilled Water and Brine:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 3 inches

C. Condenser-Water Supply and Return:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 3 inches

D. Heating-Hot-Water Supply and Return:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 3 inches

E. Refrigerant Suction and Hot-Gas Piping:

1. All Pipe Sizes: Insulation shall be the following:

a. Flexible Elastomeric: 1-1/2 inches thick.

F. Refrigerant Suction and Hot-Gas Flexible Tubing:

1. All Pipe Sizes: Insulation shall be the following:

a. Flexible Elastomeric: 1-1/2 inches thick.

3.20 OUTDOOR, ABOVEGROUND PIPING INSULATION SCHEDULE

A. Chilled Water and Brine:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

B. Condenser-Water Supply and Return:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

C. Heating-Hot-Water Supply and Return:

1. NPS 3 and Smaller: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.

2. NPS 4 to NPS 12 : Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe, Type I: 2-1/2 inches

3. NPS 14 and Larger: Insulation shall be the following:

D. Refrigerant Suction and Hot-Gas Piping:

1. All Pipe Sizes: Insulation shall be the following:

a. Flexible Elastomeric: 2 inches thick.

E. Refrigerant Suction and Hot-Gas Flexible Tubing:

1. All Pipe Sizes: Insulation shall be the following:

a. Flexible Elastomeric: 2 inches thick.

F. Fuel Oil Piping, Heated:

1. All Pipe Sizes: Insulation shall be the following:

a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 2 inches thick.

3.21 OUTDOOR, UNDERGROUND PIPING INSULATION SCHEDULE

A. Chilled Water, All Sizes: Cellular glass, 3 inches thick.

B. Condenser-Water Supply and Return, All Sizes: Cellular glass, 3 inches thick.

C. Heating-Hot-Water Supply and Return, All Sizes,: Cellular glass, 3 inches thick.

D. Fuel Oil Piping, All Sizes, Heated: Cellular glass, 3 inches thick.

3.22 INDOOR, FIELD-APPLIED JACKET SCHEDULE

A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.

B. If more than one material is listed, selection from materials listed is Contractor's option.

C. Ducts and Plenums, Concealed:

1. Paper and Foil with Vapor Retarder

D. Ducts and Plenums, Exposed:

1. Painted Aluminum, Smooth: 0.032 inches thick.

E. Equipment, Concealed:

1. Paper and Foil with Vapor Retarder

F. Equipment, Exposed, up to 48 Inches in Diameter or with Flat Surfaces up to 72 Inches :

1. PVC 30 mils thick.

G. Equipment, Exposed, Larger Than 48 Inches in Diameter or with Flat Surfaces Larger Than 72 Inches :

1. Painted Aluminum, Smooth 0.032 inch thick.

H. Piping, Concealed:

1. Paper and Foil with Vapor Retarder

I. Piping, Exposed:

1. PVC 30 mils thick.

3.23 OUTDOOR, FIELD-APPLIED JACKET SCHEDULE

A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.

B. If more than one material is listed, selection from materials listed is Contractor's option.

C. Ducts and Plenums, Concealed:

1. Aluminum, Smooth 0.040 inch thick.

D. Ducts and Plenums, Exposed, up to 48 Inches in Diameter or with Flat Surfaces up to 72 Inches:

1. Aluminum, Smooth 0.040 inch thick.

E. Ducts and Plenums, Exposed, Larger Than 48 Inches in Diameter or with Flat Surfaces Larger Than 72 Inches :

1. Aluminum, Smooth 0.040 inch thick.

F. Equipment, Concealed:

1. Aluminum, Smooth 0.040 inch thick.

G. Equipment, Exposed, up to 48 Inches in Diameter or with Flat Surfaces up to 72 Inches :

1. Aluminum, Smooth 0.040 inch thick.

H. Equipment, Exposed, Larger Than 48 Inches in Diameter or with Flat Surfaces Larger Than 72 Inches :

1. Aluminum, Smooth 0.040 inch thick.

I. Piping, Concealed:

1. Aluminum, Smooth 0.040 inch thick.

J. Piping, Exposed:

1. Aluminum, Smooth 0.040 inch thick.

3.24 UNDERGROUND, FIELD-INSTALLED INSULATION JACKET

A. For underground direct-buried piping applications, install underground direct-buried jacket over insulation material. 125-mil- thick vapor barrier and waterproofing membrane consisting of a rubberized bituminous resin reinforced with a woven-glass fiber or polyester scrim and laminated aluminum foil.

END OF SECTION 230700

SECTION 231123 - FACILITY NATURAL-GAS PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Pipes, tubes, and fittings.
2. Piping specialties.
3. Piping and tubing joining materials.
4. Valves.
5. Pressure regulators.
6. Service meters.
7. Concrete bases.

1.3 DEFINITIONS

A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct shafts, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.

B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.

C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.

1.4 PERFORMANCE REQUIREMENTS

A. Minimum Operating-Pressure Ratings:

1. Piping and Valves: 100 psig minimum unless otherwise indicated.
2. Service Regulators: 100 psig minimum unless otherwise indicated.
3. Minimum Operating Pressure of Service Meter: 65 psig .

B. Natural-Gas System Pressures within Buildings: Two pressure ranges. Primary pressure is more than 0.5 psig but not more than 2 psig, and is reduced to secondary pressure of 0.5 psig or less.

C. Delegated Design: Design restraints and anchors for natural-gas piping and equipment, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

1.5 SUBMITTALS

A. Product Data: For each type of the following:

1. Piping specialties.
2. Corrugated, stainless-steel tubing with associated components.
3. Valves. Include pressure rating, capacity, settings, and electrical connection data of selected models.
4. Pressure regulators. Indicate pressure ratings and capacities.
5. Service meters. Indicate pressure ratings and capacities. Include bypass fittings and meter bars
6. Dielectric fittings.

B. Shop Drawings: For facility natural-gas piping layout. Include plans, piping layout and elevations, sections, and details for fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to building structure. Detail location of anchors, alignment guides, and expansion joints and loops.

1. Shop Drawing Scale: 1/4 inch per foot .
2. Detail mounting, supports, and valve arrangements for service meter assembly and pressure regulator assembly.

C. Delegated-Design Submittal: For natural-gas piping and equipment indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1. Detail fabrication and assembly of seismic restraints.
2. Design Calculations: Calculate requirements for selecting seismic restraints.

D. Coordination Drawings: Plans and details, drawn to scale, on which natural-gas piping is shown and coordinated with other installations, using input from installers of the items involved.

E. Site Survey: Plans, drawn to scale, on which natural-gas piping is shown and coordinated with other services and utilities.

F. Qualification Data: For qualified professional engineer.

G. Welding certificates.

H. Field quality-control reports.

I. Operation and Maintenance Data: For motorized gas valves, pressure regulators and service meters to include in emergency, operation, and maintenance manuals.

1.6 QUALITY ASSURANCE

A. Steel Support Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

1.7 DELIVERY, STORAGE, AND HANDLING

A. Handling Flammable Liquids: Remove and dispose of liquids from existing natural-gas piping according to requirements of authorities having jurisdiction.

B. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.

C. Store and handle pipes and tubes having factory-applied protective coatings to avoid damaging coating, and protect from direct sunlight.

D. Protect stored PE pipes and valves from direct sunlight.

1.8 PROJECT CONDITIONS

A. Perform site survey, research public utility records, and verify existing utility locations. Contact utility-locating service for area where Project is located.

B. Interruption of Existing Natural-Gas Service: Do not interrupt natural-gas service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide purging and startup of natural-gas supply according to requirements indicated:

1. Notify Architect, Construction Manager, Owner and Engineer no fewer than ten days in advance of proposed interruption of natural-gas service.
2. Do not proceed with interruption of natural-gas service without Construction Manager's and Owner's written permission.

1.9 COORDINATION

A. Coordinate sizes and locations of concrete bases with actual equipment provided.

B. Coordinate requirements for access panels and doors for valves installed concealed behind finished surfaces. Comply with requirements in Division 08 Section "Access Doors and Frames."

PART 2 - PRODUCTS

2.1 PIPES, TUBES, AND FITTINGS

A. Steel Pipe: ASTM A 53/A 53M, black steel, Schedule 40, Type E or S, Grade B.

1. Malleable-Iron Threaded Fittings: ASME B16.3, Class 150, standard pattern.
2. Wrought-Steel Welding Fittings: ASTM A 234/A 234M for butt welding and socket welding.
3. Unions: ASME B16.39, Class 150, malleable iron with brass-to-iron seat, ground joint, and threaded ends.
4. Forged-Steel Flanges and Flanged Fittings: ASME B16.5, minimum Class 150, including bolts, nuts, and gaskets of the following material group, end connections, and facings:

    a. Material Group: 1.1.
    b. End Connections: Threaded or butt welding to match pipe.
    c. Lapped Face: Not permitted underground.
    d. Gasket Materials: ASME B16.20, metallic, flat, asbestos free, aluminum o-rings, and spiral-wound metal gaskets.
    e. Bolts and Nuts: ASME B18.2.1, carbon steel aboveground and stainless steel underground.

5. Protective Coating for Underground Piping: Factory-applied, three-layer coating of epoxy, adhesive, and PE.

    a. Joint Cover Kits: Epoxy paint, adhesive, and heat-shrink PE sleeves.

6. Mechanical Couplings:

    a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

        1) Dresser Piping Specialties; Division of Dresser, Inc.
        2) Smith-Blair, Inc.

    b. Stainless-steel flanges and tube with epoxy finish.
    c. Buna-nitrile seals.
    d. Stainless-steel bolts, washers, and nuts.

e. Coupling shall be capable of joining PE pipe to PE pipe, steel pipe to PE pipe, or steel pipe to steel pipe.
f. Steel body couplings installed underground on plastic pipe shall be factory equipped with anode.

B. Corrugated, Stainless-Steel Tubing: Comply with ANSI/IAS LC 1.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. OmegaFlex, Inc.
b. Parker Hannifin Corporation; Parflex Division.
c. Titeflex.
d. Tru-Flex Metal Hose Corp.

2. Tubing: ASTM A 240/A 240M, corrugated, Series 300 stainless steel.
3. Coating: PE with flame retardant.

a. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E 84 by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.

1) Flame-Spread Index: 25 or less.
2) Smoke-Developed Index: 50 or less.

4. Fittings: Copper-alloy mechanical fittings with ends made to fit and listed for use with corrugated stainless-steel tubing and capable of metal-to-metal seal without gaskets. Include brazing socket or threaded ends complying with ASME B1.20.1.
5. Striker Plates: Steel, designed to protect tubing from penetrations.
6. Manifolds: Malleable iron or steel with factory-applied protective coating. Threaded connections shall comply with ASME B1.20.1 for pipe inlet and corrugated tubing outlets.
7. Operating-Pressure Rating: 5 psig.

2.2 PIPING SPECIALTIES

A. Appliance Flexible Connectors:

1. Indoor, Fixed-Appliance Flexible Connectors: Comply with ANSI Z21.24.
2. Indoor, Movable-Appliance Flexible Connectors: Comply with ANSI Z21.69.
3. Outdoor, Appliance Flexible Connectors: Comply with ANSI Z21.75.
4. Corrugated stainless-steel tubing with polymer coating.
5. Operating-Pressure Rating: 0.5 psig .
6. End Fittings: Zinc-coated steel.
7. Threaded Ends: Comply with ASME B1.20.1.
8. Maximum Length: 72 inches .

B. Quick-Disconnect Devices: Comply with ANSI Z21.41.

1. Copper-alloy convenience outlet and matching plug connector.
2. Nitrile seals.
3. Hand operated with automatic shutoff when disconnected.
4. For indoor or outdoor applications.
5. Adjustable, retractable restraining cable.

C. Y-Pattern Strainers:

1. Body: ASTM A 126, Class B, cast iron with bolted cover and bottom drain connection.
2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
3. Strainer Screen: 60 mesh startup strainer, and perforated stainless-steel basket with 50 percent free area.
4. CWP Rating: 125 psig .

D. Basket Strainers:

1. Body: ASTM A 126, Class B, high-tensile cast iron with bolted cover and bottom drain connection.
2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
3. Strainer Screen: 60-mesh startup strainer, and perforated stainless-steel basket with 50 percent free area.
4. CWP Rating: 125 psig .

E. T-Pattern Strainers:

1. Body: Ductile or malleable iron with removable access coupling and end cap for strainer maintenance.
2. End Connections: Grooved ends.
3. Strainer Screen: 60-mesh startup strainer, and perforated stainless-steel basket with 57 percent free area.
4. CWP Rating: 750 psig .

F. Weatherproof Vent Cap: Cast- or malleable-iron increaser fitting with corrosion-resistant wire screen, with free area at least equal to cross-sectional area of connecting pipe and threaded-end connection.

2.3 JOINING MATERIALS

A. Joint Compound and Tape: Suitable for natural gas.

B. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

C. Brazing Filler Metals: Alloy with melting point greater than 1000 deg F complying with AWS A5.8/A5.8M. Brazing alloys containing more than 0.05 percent phosphorus are prohibited.

2.4 MANUAL GAS SHUTOFF VALVES

A. See "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles for where each valve type is applied in various services.

B. General Requirements for Metallic Valves, NPS 2 and Smaller: Comply with ASME B16.33.

1. CWP Rating: 125 psig .
2. Threaded Ends: Comply with ASME B1.20.1.
3. Dryseal Threads on Flare Ends: Comply with ASME B1.20.3.
4. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
5. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction for valves 1 inch and smaller.
6. Service Mark: Valves 1-1/4 inches to NPS 2 shall have initials "WOG" permanently marked on valve body.

C. General Requirements for Metallic Valves, NPS 2-1/2 and Larger: Comply with ASME B16.38.

1. CWP Rating: 125 psig
2. Flanged Ends: Comply with ASME B16.5 for steel flanges.
3. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
4. Service Mark: Initials "WOG" shall be permanently marked on valve body.

D. One-Piece, Bronze Ball Valve with Bronze Trim: MSS SP-110.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. BrassCraft Manufacturing Company; a Masco company.
    b. Conbraco Industries, Inc.; Apollo Div.
    c. Lyall, R. W. & Company, Inc.
    d. McDonald, A. Y. Mfg. Co.
    e. Perfection Corporation; a subsidiary of American Meter Company.

2. Body: Bronze, complying with ASTM B 584.
3. Ball: Chrome-plated brass.
4. Stem: Bronze; blowout proof.

5. Seats: Reinforced TFE; blowout proof.
6. Packing: Separate packnut with adjustable-stem packing threaded ends.
7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
8. CWP Rating: 600 psig .
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

E. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim: MSS SP-110.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. BrassCraft Manufacturing Company; a Masco company.
    b. Conbraco Industries, Inc.; Apollo Div.
    c. Lyall, R. W. & Company, Inc.
    d. McDonald, A. Y. Mfg. Co.
    e. Perfection Corporation; a subsidiary of American Meter Company.
    f. .

2. Body: Bronze, complying with ASTM B 584.
3. Ball: Chrome-plated bronze.
4. Stem: Bronze; blowout proof.
5. Seats: Reinforced TFE; blowout proof.
6. Packing: Threaded-body packnut design with adjustable-stem packing.
7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
8. CWP Rating: 600 psig (4140 kPa).
9. Listing: Valves NPS 1 (DN 25) and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

F. Two-Piece, Regular-Port Bronze Ball Valves with Bronze Trim: MSS SP-110.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. BrassCraft Manufacturing Company; a Masco company.
    b. Conbraco Industries, Inc.; Apollo Div.
    c. Lyall, R. W. & Company, Inc.
    d. McDonald, A. Y. Mfg. Co.
    e. Perfection Corporation; a subsidiary of American Meter Company.

2. Body: Bronze, complying with ASTM B 584.
3. Ball: Chrome-plated bronze.
4. Stem: Bronze; blowout proof.

5. Seats: Reinforced TFE.
6. Packing: Threaded-body packnut design with adjustable-stem packing.
7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
8. CWP Rating: 600 psig .
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

G. Bronze Plug Valves: MSS SP-78.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Lee Brass Company.
    b. McDonald, A. Y. Mfg. Co.

2. Body: Bronze, complying with ASTM B 584.
3. Plug: Bronze.
4. Ends: Threaded, socket, or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
5. Operator: Square head or lug type with tamperproof feature where indicated.
6. Pressure Class: 125 psig.
7. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
8. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

H. Cast-Iron, Nonlubricated Plug Valves: MSS SP-78.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. McDonald, A. Y. Mfg. Co.
    b. Mueller Co.; Gas Products Div.
    c. Xomox Corporation; a Crane company.

2. Body: Cast iron, complying with ASTM A 126, Class B.
3. Plug: Bronze or nickel-plated cast iron.
4. Seat: Coated with thermoplastic.
5. Stem Seal: Compatible with natural gas.
6. Ends: Threaded or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
7. Operator: Square head or lug type with tamperproof feature where indicated.
8. Pressure Class: 125 psig .
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.

10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

I. Cast-Iron, Lubricated Plug Valves: MSS SP-78.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Flowserve.
   b. Homestead Valve; a division of Olson Technologies, Inc.
   c. McDonald, A. Y. Mfg. Co.
   d. Milliken Valve Company.
   e. Mueller Co.; Gas Products Div.
   f. R&M Energy Systems, A Unit of Robbins & Myers, Inc.

2. Body: Cast iron, complying with ASTM A 126, Class B.
3. Plug: Bronze or nickel-plated cast iron.
4. Seat: Coated with thermoplastic.
5. Stem Seal: Compatible with natural gas.
6. Ends: Threaded or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
7. Operator: Square head or lug type with tamperproof feature where indicated.
8. Pressure Class: 125 psig .
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

J. PE Ball Valves: Comply with ASME B16.40.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Kerotest Manufacturing Corp.
   b. Lyall, R. W. & Company, Inc.
   c. Perfection Corporation; a subsidiary of American Meter Company.

2. Body: PE.
3. Ball: PE.
4. Stem: Acetal.
5. Seats and Seals: Nitrile.
6. Ends: Plain or fusible to match piping.
7. CWP Rating: 80 psig
8. Operating Temperature: Minus 20 to plus 140 deg F
9. Operator: Nut or flat head for key operation.
10. Include plastic valve extension.
11. Include tamperproof locking feature for valves where indicated on Drawings.

K. Valve Boxes:

1. Cast-iron, two-section box.
2. Top section with cover with "GAS" lettering.
3. Bottom section with base to fit over valve and barrel a minimum of 5 inches (125 mm) in diameter.
4. Adjustable cast-iron extensions of length required for depth of bury.
5. Include tee-handle, steel operating wrench with socket end fitting valve nut or flat head, and with stem of length required to operate valve.

2.5 MOTORIZED GAS VALVES

A. Automatic Gas Valves: Comply with ANSI Z21.21.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. ASCO Power Technologies, LP; Division of Emerson.
    b. Dungs, Karl, Inc.
    c. Eaton Corporation; Controls Div.
    d. Eclipse Combustion, Inc.
    e. Honeywell International Inc.
    f. Johnson Controls.

2. Body: Brass or aluminum.
3. Seats and Disc: Nitrile rubber.
4. Springs and Valve Trim: Stainless steel.
5. Normally closed.
6. Visual position indicator.
7. Electrical operator for actuation by appliance automatic shutoff device.

B. Electrically Operated Valves: Comply with UL 429.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. ASCO Power Technologies, LP; Division of Emerson.
    b. Dungs, Karl, Inc.
    c. Eclipse Combustion, Inc.
    d. Goyen Valve Corp.; Tyco Environmental Systems.
    e. Magnatrol Valve Corporation.
    f. Parker Hannifin Corporation; Climate & Industrial Controls Group; Skinner Valve Div.
    g. Watts Regulator Co.; Division of Watts Water Technologies, Inc.

2. Pilot operated.
3. Body: Brass or aluminum.
4. Seats and Disc: Nitrile rubber.
5. Springs and Valve Trim: Stainless steel.

6. 120-V ac, 60 Hz, Class B, continuous-duty molded coil, and replaceable.
7. NEMA ICS 6, Type 4, coil enclosure.
8. Normally closed.
9. Visual position indicator.

2.6 EARTHQUAKE VALVES

A. Earthquake Valves: Comply with ASCE 25.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Vanguard Valves, Inc.

2. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction.
3. Maximum Operating Pressure: 5 psig .
4. Cast-aluminum body with nickel-plated chrome steel internal parts.
5. Nitrile-rubber valve washer.
6. Sight windows for visual indication of valve position.
7. Threaded end connections complying with ASME B1.20.1.
8. Wall mounting bracket with bubble level indicator.

B. Earthquake Valves: Comply with ASCE 25.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Pacific Seismic Products, Inc.

2. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction.
3. Maximum Operating Pressure: 7 psig
4. Cast-aluminum body with stainless-steel internal parts.
5. Nitrile-rubber, reset-stem o-ring seal.
6. Valve position, open or closed, indicator.
7. Composition valve seat with clapper held by spring or magnet locking mechanism.
8. Level indicator.
9. End Connections: Threaded for valves NPS 2 and smaller; flanged for valves NPS 2-1/2 and larger.

2.7 PRESSURE REGULATORS

A. General Requirements:

1. Single stage and suitable for natural gas.

2. Steel jacket and corrosion-resistant components.
3. Elevation compensator.
4. End Connections: Threaded for regulators NPS 2 and smaller; flanged for regulators NPS 2-1/2 and larger.

B. Service Pressure Regulators: Comply with ANSI Z21.80.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Actaris.
   b. American Meter Company.
   c. Fisher Control Valves and Regulators; Division of Emerson Process Management.
   d. Invensys.
   e. Richards Industries; Jordan Valve Div.

2. Body and Diaphragm Case: Cast iron or die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.
4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber resistant to gas impurities, abrasion, and deformation at the valve port.
6. Orifice: Aluminum; interchangeable.
7. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
8. Single-port, self-contained regulator with orifice no larger than required at maximum pressure inlet, and no pressure sensing piping external to the regulator.
9. Pressure regulator shall maintain discharge pressure setting downstream, and not exceed 150 percent of design discharge pressure at shutoff.
10. Overpressure Protection Device: Factory mounted on pressure regulator.
11. Atmospheric Vent: Factory- or field-installed, stainless-steel screen in opening if not connected to vent piping.
12. Maximum Inlet Pressure: 100 psig (690 kPa).

C. Line Pressure Regulators: Comply with ANSI Z21.80.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Actaris.
   b. American Meter Company.
   c. Eclipse Combustion, Inc.
   d. Fisher Control Valves and Regulators; Division of Emerson Process Management.
   e. Invensys.
   f. Maxitrol Company.
   g. Richards Industries; Jordan Valve Div.

2. Body and Diaphragm Case: Cast iron or die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.

4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber resistant to gas impurities, abrasion, and deformation at the valve port.
6. Orifice: Aluminum; interchangeable.
7. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
8. Single-port, self-contained regulator with orifice no larger than required at maximum pressure inlet, and no pressure sensing piping external to the regulator.
9. Pressure regulator shall maintain discharge pressure setting downstream, and not exceed 150 percent of design discharge pressure at shutoff.
10. Overpressure Protection Device: Factory mounted on pressure regulator.
11. Atmospheric Vent: Factory- or field-installed, stainless-steel screen in opening if not connected to vent piping.
12. Maximum Inlet Pressure: 5 psig (34.5 kPa).

D. Appliance Pressure Regulators: Comply with ANSI Z21.18.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Canadian Meter Company Inc.
    b. Eaton Corporation; Controls Div.
    c. Harper Wyman Co.
    d. Maxitrol Company.
    e. SCP, Inc.

2. Body and Diaphragm Case: Die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.
4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber.
6. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
7. Factory-Applied Finish: Minimum three-layer polyester and polyurethane paint finish.
8. Regulator may include vent limiting device, instead of vent connection, if approved by authorities having jurisdiction.
9. Maximum Inlet Pressure: 2 psig

2.8 SERVICE METERS

A. Diaphragm-Type Service Meters: Comply with ANSI B109.1 and ANSI B109.2.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. Actaris.
    b. American Meter Company.
    c. Invensys.

2. Case: Die-cast aluminum.
3. Connections: Steel threads.
4. Diaphragm: Synthetic fabric.
5. Diaphragm Support Bearings: Self-lubricating.
6. Compensation: Continuous temperature and pressure.
7. Meter Index: Cubic feet and liters.
8. Meter Case and Index: Tamper resistant.
9. Remote meter reader compatible.
10. Maximum Inlet Pressure: 100 psig.
11. Pressure Loss: Maximum 0.5-inch wg.
12. Accuracy: Maximum plus or minus 1.0 percent.

B. Rotary-Type Service Meters: Comply with ANSI B109.3.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. American Meter Company.
    b. Invensys.

2. Case: Extruded aluminum.
3. Connection: Flange.
4. Impellers: Polished aluminum.
5. Rotor Bearings: Self-lubricating.
6. Compensation: Continuous temperature and pressure.
7. Meter Index: Cubic feet and liters.
8. Tamper resistant.
9. Remote meter reader compatible.
10. Maximum Inlet Pressure: 100 psig .
11. Accuracy: Maximum plus or minus 2.0 percent.

C. Turbine Meters: Comply with ASME MFC-4M.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

    a. American Meter Company.
    b. Invensys.

2. Housing: Cast iron or welded steel.
3. Connection Threads or Flanges: Steel.
4. Turbine: Aluminum or plastic.
5. Turbine Bearings: Self-lubricating.
6. Compensation: Continuous temperature and pressure.
7. Meter Index: Cubic feet and liters.
8. Tamper resistant.
9. Remote meter reader compatible.
10. Maximum Inlet Pressure: 100 psig .

11. Accuracy: Maximum plus or minus 2.0 percent.

D. Service-Meter Bars:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Actaris.
   b. American Meter Company.
   c. Lyall, R. W. & Company, Inc.
   d. McDonald, A. Y. Mfg. Co.
   e. Mueller Co.; Gas Products Div.
   f. Perfection Corporation; a subsidiary of American Meter Company.

2. Malleable- or cast-iron frame for supporting service meter.
3. Include offset swivel pipes, meter nuts with o-ring seal, and factory- or field-installed dielectric unions.
4. Omit meter offset swivel pipes if service-meter bar dimensions match service-meter connections.

E. Service-Meter Bypass Fittings:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Lyall, R. W. & Company, Inc.
   b. Williamson, T. D., Inc.

2. Ferrous, tee, pipe fitting with capped side inlet for temporary natural-gas supply.
3. Integral ball-check bypass valve.

2.9 DIELECTRIC FITTINGS

A. Dielectric Unions:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Capitol Manufacturing Company.
   b. Central Plastics Company.
   c. Hart Industries International, Inc.
   d. McDonald, A. Y. Mfg. Co.
   e. Watts Regulator Co.; Division of Watts Water Technologies, Inc.
   f. Wilkins; Zurn Plumbing Products Group.

2. Minimum Operating-Pressure Rating: 150 psig .
3. Combination fitting of copper alloy and ferrous materials.

4. Insulating materials suitable for natural gas.
5. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

B. Dielectric Flanges:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Capitol Manufacturing Company.
   b. Central Plastics Company.
   c. Watts Regulator Co.; Division of Watts Water Technologies, Inc.
   d. Wilkins; Zurn Plumbing Products Group.

2. Minimum Operating-Pressure Rating: 150 psig .
3. Combination fitting of copper alloy and ferrous materials.
4. Insulating materials suitable for natural gas.
5. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

C. Dielectric-Flange Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

   a. Advance Products & Systems, Inc.
   b. Calpico Inc.
   c. Central Plastics Company.
   d. Pipeline Seal and Insulator, Inc.

2. Minimum Operating-Pressure Rating: 150 psig.
3. Companion-flange assembly for field assembly.
4. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or PE bolt sleeves, phenolic washers, and steel backing washers.
5. Insulating materials suitable for natural gas.
6. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

2.10 LABELING AND IDENTIFYING

A. Detectable Warning Tape: Acid- and alkali-resistant, PE film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches wide and 4 mils thick, continuously inscribed with a description of utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches deep; colored yellow.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine roughing-in for natural-gas piping system to verify actual locations of piping connections before equipment installation.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Close equipment shutoff valves before turning off natural gas to premises or piping section.

B. Inspect natural-gas piping according to the International Fuel Gas Code to determine that natural-gas utilization devices are turned off in piping section affected.

C. Comply with the International Fuel Gas Code requirements for prevention of accidental ignition.

3.3 OUTDOOR PIPING INSTALLATION

A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.

B. Install underground, natural-gas piping buried at least 36 inches below finished grade. Comply with requirements in Division 31 Section "Earth Moving" for excavating, trenching, and backfilling.

1. If natural-gas piping is installed less than 36 inches below finished grade, install it in containment conduit.

C. Install underground, PE, natural-gas piping according to ASTM D 2774.

D. Steel Piping with Protective Coating:

1. Apply joint cover kits to pipe after joining to cover, seal, and protect joints.
2. Repair damage to PE coating on pipe as recommended in writing by protective coating manufacturer.
3. Replace pipe having damaged PE coating with new pipe.

E. Copper Tubing with Protective Coating:

1. Apply joint cover kits over tubing to cover, seal, and protect joints.
2. Repair damage to PE coating on pipe as recommended in writing by protective coating manufacturer.

F. Install fittings for changes in direction and branch connections.

G. Install pressure gage upstream and downstream from each service regulator. Pressure gages are specified in Division 23 Section "Meters and Gages for HVAC Piping."

3.4 INDOOR PIPING INSTALLATION

A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.

B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.

C. Arrange for pipe spaces, chases, slots, sleeves, and openings in building structure during progress of construction, to allow for mechanical installations.

D. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.

E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.

G. Locate valves for easy access.

H. Install natural-gas piping at uniform grade of 2 percent down toward drip and sediment traps.

I. Install piping free of sags and bends.

J. Install fittings for changes in direction and branch connections.

K. Verify final equipment locations for roughing-in.

L. Comply with requirements in Sections specifying gas-fired appliances and equipment for roughing-in requirements.

M. Provide an additional one-hundred feet of gas piping and accessories and installation labor for each size of pipe used on the project to accommodate any changes required to resolve interferences or as directed by the engineer.

N. Drips and Sediment Traps: Install drips at points where condensate may collect, including service-meter outlets. Locate where accessible to permit cleaning and emptying. Do not install where condensate is subject to freezing.

1. Construct drips and sediment traps using tee fitting with bottom outlet plugged or capped. Use nipple a minimum length of 3 pipe diameters, but not less than 3 inches long and same size as connected pipe. Install with space below bottom of drip to remove plug or cap.

O. Extend relief vent connections for service regulators, line regulators, and overpressure protection devices to outdoors and terminate with weatherproof vent cap.

P. Conceal pipe installations in walls, pipe spaces, utility spaces, above ceilings, below grade or floors, and in floor channels unless indicated to be exposed to view.

Q. Concealed Location Installations: Except as specified below, install concealed natural-gas piping and piping installed under the building in containment conduit constructed of steel pipe with welded joints as described in Part 2. Install a vent pipe from containment conduit to outdoors and terminate with weatherproof vent cap.

1. Above Accessible Ceilings: Natural-gas piping, fittings, valves, and regulators may be installed in accessible spaces without containment conduit.
2. In Floors: Install natural-gas piping with welded or brazed joints and protective coating in cast-in-place concrete floors. Cover piping to be cast in concrete slabs with minimum of 1-1/2 inches of concrete. Piping may not be in physical contact with other metallic structures such as reinforcing rods or electrically neutral conductors. Do not embed piping in concrete slabs containing quick-set additives or cinder aggregate.
3. In Floor Channels: Install natural-gas piping in floor channels. Channels must have cover and be open to space above cover for ventilation.
4. In Walls or Partitions: Protect tubing installed inside partitions or hollow walls from physical damage using steel striker barriers at rigid supports.

    a. Exception: Tubing passing through partitions or walls does not require striker barriers.

5. Prohibited Locations:

    a. Do not install natural-gas piping in or through circulating air ducts, clothes or trash chutes, chimneys or gas vents (flues), ventilating ducts, or dumbwaiter or elevator shafts.
    b. Do not install natural-gas piping in solid walls or partitions.

R. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.

S. Connect branch piping from top or side of horizontal piping.

T. Install unions in pipes NPS 2 and smaller, adjacent to each valve, at final connection to each piece of equipment. Unions are not required at flanged connections.

U. Do not use natural-gas piping as grounding electrode.

V. Install strainer on inlet of each line-pressure regulator and automatic or electrically operated valve.

W. Install pressure gage upstream and downstream from each line regulator. Pressure gages are specified in Division 23 Section "Meters and Gages for HVAC Piping."

X. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Division 23 Section "Sleeves and Sleeve Seals for HVAC Piping."

Y. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Division 23 Section "Sleeves and Sleeve Seals for HVAC Piping."

Z. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Division 23 Section "Escutcheons for HVAC Piping."

3.5 SERVICE-METER ASSEMBLY INSTALLATION

A. Install service-meter assemblies aboveground, on concrete bases.

B. Install metal shutoff valves upstream from service regulators. Shutoff valves are not required at second regulators if two regulators are installed in series.

C. Install strainer on inlet of service-pressure regulator and meter set.

D. Install service regulators mounted outside with vent outlet horizontal or facing down. Install screen in vent outlet if not integral with service regulator.

E. Install metal shutoff valves upstream from service meters. Install dielectric fittings downstream from service meters.

F. Install service meters downstream from pressure regulators.

G. Install metal bollards to protect meter assemblies. Comply with requirements in Division 05 Section "Metal Fabrications" for pipe bollards.

3.6 VALVE INSTALLATION

A. Install manual gas shutoff valve for each gas appliance ahead of corrugated stainless-steel tubing, aluminum, or copper connector.

B. Install underground valves with valve boxes.

C. Install regulators and overpressure protection devices with maintenance access space adequate for servicing and testing.

D. Install earthquake valves aboveground outside buildings according to listing.

E. Install anode for metallic valves in underground PE piping.

3.7 PIPING JOINT CONSTRUCTION

A. Ream ends of pipes and tubes and remove burrs.

B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.

C. Threaded Joints:

1. Thread pipe with tapered pipe threads complying with ASME B1.20.1.
2. Cut threads full and clean using sharp dies.
3. Ream threaded pipe ends to remove burrs and restore full inside diameter of pipe.
4. Apply appropriate tape or thread compound to external pipe threads unless dryseal threading is specified.
5. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.

D. Welded Joints:

1. Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators.
2. Bevel plain ends of steel pipe.
3. Patch factory-applied protective coating as recommended by manufacturer at field welds and where damage to coating occurs during construction.

E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter.

F. Flanged Joints: Install gasket material, size, type, and thickness appropriate for natural-gas service. Install gasket concentrically positioned.

3.8 HANGER AND SUPPORT INSTALLATION

A. Install seismic restraints on piping. Comply with requirements for seismic-restraint devices specified in Division 23 Section "Vibration and Seismic Controls for HVAC Piping and Equipment."

B. Comply with requirements for pipe hangers and supports specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."

C. Install hangers for horizontal steel piping with the following maximum spacing and minimum rod sizes:

1. NPS 1 and Smaller: Maximum span, 96 inches ; minimum rod size, 3/8 inch.

2. NPS 1-1/4: Maximum span, 108 inches; minimum rod size, 3/8 inch.
3. NPS 1-1/2 and NPS 2: Maximum span, 108 inches; minimum rod size, 3/8 inch.
4. NPS 2-1/2 to NPS 3-1/2: Maximum span, 10 feet; minimum rod size, 1/2 inch.
5. NPS 4 and Larger: Maximum span, 10 feet; minimum rod size, 5/8 inch.

3.9 CONNECTIONS

A. Connect to utility's gas main according to utility's procedures and requirements.

B. Install natural-gas piping electrically continuous, and bonded to gas appliance equipment grounding conductor of the circuit powering the appliance according to NFPA 70.

C. Install piping adjacent to appliances to allow service and maintenance of appliances.

D. Connect piping to appliances using manual gas shutoff valves and unions. Install valve within 72 inches of each gas-fired appliance and equipment. Install union between valve and appliances or equipment.

E. Sediment Traps: Install tee fitting with capped nipple in bottom to form drip, as close as practical to inlet of each appliance.

3.10 LABELING AND IDENTIFYING

A. Comply with requirements in Division 23 Section "Identification for HVAC Piping and Equipment" for piping and valve identification.

B. Install detectable warning tape directly above gas piping, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

3.11 PAINTING

A. Comply with requirements in Division 09 painting Sections for painting interior and exterior natural-gas piping.

B. Paint exposed, exterior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.

1. Alkyd System: MPI EXT 5.1D.

a. Prime Coat: Alkyd anticorrosive metal primer.
b. Intermediate Coat: Exterior alkyd enamel matching topcoat.
c. Topcoat: Exterior alkyd enamel gloss.
d. Color: Yellow.

C. Paint exposed, interior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.

1. Latex Over Alkyd Primer System: MPI INT 5.1Q.

a. Prime Coat: Alkyd anticorrosive metal primer.
b. Intermediate Coat: Interior latex matching topcoat.
c. Topcoat: Interior latex gloss.
d. Color: Yellow.

D. Damage and Touchup: Repair marred and damaged factory-applied finishes with materials and by procedures to match original factory finish.

3.12 FIELD QUALITY CONTROL

A. Perform tests and inspections.

B. Tests and Inspections:

1. Test, inspect, and purge natural gas according to the International Fuel Gas Code and authorities having jurisdiction.

C. Natural-gas piping will be considered defective if it does not pass tests and inspections.

D. Prepare test and inspection reports.

3.13 DEMONSTRATION

A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain earthquake valves.

3.14 OUTDOOR PIPING SCHEDULE

A. Underground natural-gas piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints, or mechanical couplings. Coat pipe and fittings with protective coating for steel piping.

B. Aboveground natural-gas piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints.

C. Branch Piping in Cast-in-Place Concrete to Single Appliance: Annealed-temper copper tube with wrought-copper fittings and brazed joints. Install piping embedded in concrete with no joints in concrete.

D. Containment Conduit: Steel pipe with wrought-steel fittings and welded joints. Coat pipe and fittings with protective coating for steel piping.

3.15 INDOOR PIPING SCHEDULE FOR SYSTEM PRESSURES LESS THAN 0.5 PSIG

A. Aboveground, branch piping NPS 1 and smaller shall be the following:

1. Steel pipe with malleable-iron fittings and threaded joints.

B. Aboveground, distribution piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints.

C. Underground, below building, piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints.

D. Containment Conduit: Steel pipe with wrought-steel fittings and welded joints. Coat pipe and fittings with protective coating for steel piping.

E. Containment Conduit Vent Piping: Steel pipe with malleable-iron fittings and threaded or wrought-steel fittings with welded joints. Coat underground pipe and fittings with protective coating for steel piping.

3.16 INDOOR PIPING SCHEDULE FOR SYSTEM PRESSURES MORE THAN 0.5 PSIG AND LESS THAN 5 PSIG

A. Aboveground, branch piping NPS 1 and smaller shall be the following:

1. Steel pipe with malleable-iron fittings and threaded joints.

B. Aboveground, distribution piping shall be the following:

1. Steel pipe with steel welding fittings and welded joints.

C. Underground, below building, piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints.

D. Containment Conduit: Steel pipe with wrought-steel fittings and welded joints. Coat underground pipe and fittings with protective coating for steel piping.

E. Containment Conduit Vent Piping: Steel pipe with malleable-iron fittings and threaded or wrought-steel fittings with welded joints. Coat underground pipe and fittings with protective coating for steel piping.

3.17 INDOOR PIPING SCHEDULE FOR SYSTEM PRESSURES MORE THAN 5 PSIG

A. Aboveground Piping: Maximum operating pressure more than 5 psig.

B. Aboveground, Branch Piping: Steel pipe with steel welding fittings and welded joints.

C. Aboveground, distribution piping shall be the following:

1. Steel pipe with steel welding fittings and welded joints.

D. Underground, below building, piping shall be the following:

1. Steel pipe with wrought-steel fittings and welded joints.

E. Containment Conduit: Steel pipe with wrought-steel fittings and welded joints. Coat pipe and fittings with protective coating for steel piping.

F. Containment Conduit Vent Piping: Steel pipe with malleable-iron fittings and threaded or wrought-steel fittings with welded joints. Coat underground pipe and fittings with protective coating for steel piping.

3.18 UNDERGROUND MANUAL GAS SHUTOFF VALVE SCHEDULE

A. Connections to Existing Gas Piping: Use valve and fitting assemblies made for tapping utility's gas mains and listed by an NRTL.

B. Underground:

1. NPS 2-1/2 and Larger: Cast-iron, lubricated plug valves.

3.19 ABOVEGROUND MANUAL GAS SHUTOFF VALVE SCHEDULE

A. Valves for pipe sizes NPS 2 and smaller at service meter shall be the following:

1. Two-piece, full-port, bronze ball valves with bronze trim.

B. Valves for pipe sizes NPS 2-1/2 and larger at service meter shall be the following:

1. Two-piece, full-port, bronze ball valves with bronze trim.

C. Distribution piping valves for pipe sizes NPS 2 and smaller shall be the following:

1. Two-piece, full-port, bronze ball valves with bronze trim.

D. Distribution piping valves for pipe sizes NPS 2-1/2 and larger shall be the following:

1. Two-piece, full-port, bronze ball valves with bronze trim.

E. Valves in branch piping for single appliance shall be the following:

1. Two-piece, full-port, bronze ball valves with bronze trim.

END OF SECTION 231123

SECTION 233113 - METAL DUCTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. This Section includes rectangular, round, and flat-oval metal ducts and plenums for heating, ventilating, and air-conditioning systems in pressure classes from minus 2- to plus 10-inch wg.

B. Related Sections:

1. Division 23 Section "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing requirements for metal ducts.
2. Division 23 Section "Air Duct Accessories" for dampers, sound-control devices, duct-mounting access doors and panels, turning vanes, and flexible ducts.
3. Division 23 Section "Duct Insulation" for insulation for metal ducts.

1.3 PERFORMANCE REQUIREMENTS

A. Delegated Duct Design: Duct construction, including sheet metal thicknesses, seam and joint construction, reinforcements, and hangers and supports, shall comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and performance requirements and design criteria indicated in "Duct Schedule" Article.

B. Structural Performance: Duct hangers and supports and seismic restraints shall withstand the effects of gravity and seismic loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and ASCE/SEI 7, SMACNA's "Seismic Restraint Manual: Guidelines for Mechanical Systems.

1. Seismic Hazard Level A: Seismic force to weight ratio, 0.48.
2. Seismic Hazard Level B: Seismic force to weight ratio, 0.30.
3. Seismic Hazard Level C: Seismic force to weight ratio, 0.15.

C. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2004.

1.4 SUBMITTALS

A. Product Data: For each type of the following products:

1. Liners and adhesives.
2. Sealants and gaskets.
3. Seismic-restraint devices.

B. Shop Drawings:

1. Fabrication, assembly, and installation, including plans, elevations, sections, components, and attachments to other work.
2. Factory- and shop-fabricated ducts and fittings.
3. Duct layout indicating sizes, configuration, liner material, and static-pressure classes.
4. Elevation of top of ducts.
5. Dimensions of main duct runs from building grid lines.
6. Fittings.
7. Reinforcement and spacing.
8. Seam and joint construction.
9. Penetrations through fire-rated and other partitions.
10. Equipment installation based on equipment being used on Project.
11. Locations for duct accessories, including dampers, turning vanes, and access doors and panels.
12. Hangers and supports, including methods for duct and building attachment, seismic restraints, and vibration isolation.

C. Delegated-Design Submittal:

1. Sheet metal thicknesses.
2. Joint and seam construction and sealing.
3. Reinforcement details and spacing.
4. Materials, fabrication, assembly, and spacing of hangers and supports.
5. Design Calculations: Calculations, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation for selecting hangers and supports and seismic restraints.

D. Coordination Drawings: Plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:

1. Duct installation in congested spaces, indicating coordination with general construction, building components, and other building services. Indicate proposed changes to duct layout.
2. Suspended ceiling components.
3. Structural members to which duct will be attached.
4. Size and location of initial access modules for acoustical tile.
5. Penetrations of smoke barriers and fire-rated construction.
6. Items penetrating finished ceiling including the following:

a. Lighting fixtures.
b. Air outlets and inlets.
c. Speakers.
d. Sprinklers.
e. Access panels.

E. Welding certificates.

F. Field quality-control reports.

1.5 QUALITY ASSURANCE

A. Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel," for hangers and supports. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum," for aluminum supports. AWS D9.1M/D9.1, "Sheet Metal Welding Code," for duct joint and seam welding.

B. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1-2004, Section 5 - "Systems and Equipment" and Section 7 - "Construction and System Start-Up."

C. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1-2004, Section 6.4.4 - "HVAC System Construction and Insulation."

D. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," unless otherwise indicated.

E. Comply with NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems," unless otherwise indicated.

F. Comply with NFPA 96, "Ventilation Control and Fire Protection of Commercial Cooking Operations," Chapter 3, "Duct System," for range hood ducts, unless otherwise indicated.

PART 2 - PRODUCTS

2.1 SINGLE-WALL RECTANGULAR DUCTS AND FITTINGS

A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated.

B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-4, "Transverse (Girth) Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-5, "Longitudinal Seams - Rectangular Ducts," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 2, "Fittings and Other Construction," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.2 DOUBLE-WALL RECTANGULAR DUCTS AND FITTINGS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. McGill AirFlow LLC.
2. Sheet Metal Connectors, Inc.

B. Rectangular Ducts: Fabricate ducts with indicated dimensions for the inner duct.

C. Outer Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated.

D. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-4, "Transverse (Girth) Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

E. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-5, "Longitudinal Seams - Rectangular Ducts," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

F. Interstitial Insulation: Fibrous-glass liner complying with ASTM C 1071, NFPA 90A, or NFPA 90B; and with NAIMA AH124, "Fibrous Glass Duct Liner Standard."

1. Maximum Thermal Conductivity: 0.27 Btu x in./h x sq. ft. x deg F at 75 deg F mean temperature.
2. Install spacers that position the inner duct at uniform distance from outer duct without compressing insulation.
3. Coat insulation with antimicrobial coating.
4. Cover insulation with polyester film complying with UL 181, Class 1.

G. Inner Duct: Minimum 0.028-inch solid steel galvanized sheet steel.

H. Formed-on Transverse Joints (Flanges): Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-4, "Traverse (Girth) Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

I. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-5, "Longitudinal Seams - Rectangular Ducts," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.3 SINGLE-WALL ROUND DUCTS AND FITTINGS

A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 3, "Round, Oval, and Flexible Duct," based on indicated static-pressure class unless otherwise indicated.

1. Manufacturers: Subject to compliance with requirements provide products by one of the following:

   a. Lindab Inc.
   b. McGill AirFlow LLC.
   c. SEMCO Incorporated.

   d. Sheet Metal Connectors, Inc.
   e. Spiral Manufacturing Co., Inc.

B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-2, "Transverse Joints - Round Duct," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

1. Transverse Joints in Ducts Larger Than 60 Inches in Diameter: Flanged.

C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-1, "Seams - Round Duct and Fittings," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

1. Fabricate round ducts larger than 90 inches in diameter with butt-welded longitudinal seams.
2. Fabricate flat-oval ducts larger than 72 inches in width (major dimension) with butt-welded longitudinal seams.

D. Tees and Laterals: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "90 Degree Tees and Laterals," and Figure 3-5, "Conical Tees," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.4 DOUBLE-WALL ROUND DUCTS AND FITTINGS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Lindab Inc.
2. McGill AirFlow LLC.
3. SEMCO Incorporated.
4. Sheet Metal Connectors, Inc.

B. Outer Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 3, "Round, Oval, and Flexible Duct," based on static-pressure class unless otherwise indicated.

1. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-2, "Transverse Joints - Round Duct," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

    a. Transverse Joints in Ducts Larger Than 60 Inches in Diameter: Flanged.

2. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-1, "Seams - Round Duct and Fittings," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

    a. Fabricate round ducts larger than 90 inch in diameter with butt-welded longitudinal seams.
    b. Fabricate flat-oval ducts larger than 72 inches in width (major dimension) with butt-welded longitudinal seams.

3. Tees and Laterals: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "90 Degree Tees and Laterals," and Figure 3-5, "Conical Tees," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

C. Inner Duct: Minimum 0.028-inch solid galvanized sheet steel.

D. Interstitial Insulation: Fibrous-glass liner complying with ASTM C 1071, NFPA 90A, or NFPA 90B; and with NAIMA AH124, "Fibrous Glass Duct Liner Standard."

1. Maximum Thermal Conductivity: 0.27 Btu x in./h x sq. ft. x deg F at 75 deg F mean temperature.
2. Install spacers that position the inner duct at uniform distance from outer duct without compressing insulation.
3. Coat insulation with antimicrobial coating.
4. Cover insulation with polyester film complying with UL 181, Class 1.

2.5 SHEET METAL MATERIALS

A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.

B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.

1. Galvanized Coating Designation: G90.
2. Finishes for Surfaces Exposed to View: Mill phosphatized.

C. PVC-Coated, Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.

1. Galvanized Coating Designation: G90.
2. Minimum Thickness for Factory-Applied PVC Coating: 4 mils thick on sheet metal surface of ducts and fittings exposed to corrosive conditions, and minimum 1 mil thick on opposite surface.
3. Coating Materials: Acceptable to authorities having jurisdiction for use on ducts listed and labeled by an NRTL for compliance with UL 181, Class 1.

D. Carbon-Steel Sheets: Comply with ASTM A 1008/A 1008M, with oiled, matte finish for exposed ducts.

E. Stainless-Steel Sheets: Comply with ASTM A 480/A 480M, Type 304 or 316, as indicated in the "Duct Schedule" Article; cold rolled, annealed, sheet. Exposed surface finish shall be No. 2B, No. 2D, No. 3, or No. 4 as indicated in the "Duct Schedule" Article.

F. Aluminum Sheets: Comply with ASTM B 209 Alloy 3003, H14 temper; with mill finish for concealed ducts, and standard, one-side bright finish for duct surfaces exposed to view.

G. Factory- or Shop-Applied Antimicrobial Coating:

1. Apply to the surface of sheet metal that will form the interior surface of the duct. An untreated clear coating shall be applied to the exterior surface.
2. Antimicrobial compound shall be tested for efficacy by an NRTL and registered by the EPA for use in HVAC systems.

3. Coating containing the antimicrobial compound shall have a hardness of 2H, minimum, when tested according to ASTM D 3363.
4. Surface-Burning Characteristics: Maximum flame-spread index of 25 and maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.
5. Shop-Applied Coating Color: Black.
6. Antimicrobial coating on sheet metal is not required for duct containing liner treated with antimicrobial coating.

H. Reinforcement Shapes and Plates: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.

1. Where black- and galvanized-steel shapes and plates are used to reinforce aluminum ducts, isolate the different metals with butyl rubber, neoprene, or EPDM gasket materials.

I. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

2.6 SEALANT AND GASKETS

A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.

B. Two-Part Tape Sealing System:

1. Tape: Woven cotton fiber impregnated with mineral gypsum and modified acrylic/silicone activator to react exothermically with tape to form hard, durable, airtight seal.
2. Tape Width: 4 inches.
3. Sealant: Modified styrene acrylic.
4. Water resistant.
5. Mold and mildew resistant.
6. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
7. Service: Indoor and outdoor.
8. Service Temperature: Minus 40 to plus 200 deg F.
9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum.
10. For indoor applications, use sealant that has a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

C. Water-Based Joint and Seam Sealant:

1. Application Method: Brush on.
2. Solids Content: Minimum 65 percent.
3. Shore A Hardness: Minimum 20.
4. Water resistant.

5. Mold and mildew resistant.
6. VOC: Maximum 75 g/L (less water).
7. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
8. Service: Indoor or outdoor.
9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.

D. Flanged Joint Sealant: Comply with ASTM C 920.

1. General: Single-component, acid-curing, silicone, elastomeric.
2. Type: S.
3. Grade: NS.
4. Class: 25.
5. Use: O.
6. For indoor applications, use sealant that has a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

E. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.

F. Round Duct Joint O-Ring Seals:

1. Seal shall provide maximum leakage class of 3 cfm/100 sq. ft. at 1-inch wg and shall be rated for 10-inch wg static-pressure class, positive or negative.
2. EPDM O-ring to seal in concave bead in coupling or fitting spigot.
3. Double-lipped, EPDM O-ring seal, mechanically fastened to factory-fabricated couplings and fitting spigots.

2.7 HANGERS AND SUPPORTS

A. Hanger Rods for Noncorrosive Environments: Cadmium-plated steel rods and nuts.

B. Hanger Rods for Corrosive Environments: Electrogalvanized, all-thread rods or galvanized rods with threads painted with zinc-chromate primer after installation.

C. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 4-1, "Rectangular Duct Hangers Minimum Size," and Table 4-2, "Minimum Hanger Sizes for Round Duct."

D. Steel Cables for Galvanized-Steel Ducts: Galvanized steel complying with ASTM A 603.

E. Steel Cables for Stainless-Steel Ducts: Stainless steel complying with ASTM A 492.

F. Steel Cable End Connections: Cadmium-plated steel assemblies with brackets, swivel, and bolts designed for duct hanger service; with an automatic-locking and clamping device.

G. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.

H. Trapeze and Riser Supports:

1. Supports for Galvanized-Steel Ducts: Galvanized-steel shapes and plates.
2. Supports for Stainless-Steel Ducts: Stainless-steel shapes and plates.
3. Supports for Aluminum Ducts: Aluminum or galvanized steel coated with zinc chromate.

2.8 SEISMIC-RESTRAINT DEVICES

A. Manufacturers: Subject to compliance with requirements provide products by one of the following:

1. Cooper B-Line, Inc.; a division of Cooper Industries.
2. Ductmate Industries, Inc.
3. Hilti Corp.
4. Kinetics Noise Control.
5. Loos & Co.; Cableware Division.
6. Mason Industries.
7. TOLCO; a brand of NIBCO INC.
8. Unistrut Corporation; Tyco International, Ltd.

B. General Requirements for Restraint Components: Rated strengths, features, and applications shall be as defined in reports by an evaluation service member of the ICC Evaluation Service.

1. Structural Safety Factor: Allowable strength in tension, shear, and pullout force of components shall be at least four times the maximum seismic forces to which they will be subjected.

C. Channel Support System: Shop- or field-fabricated support assembly made of slotted steel channels rated in tension, compression, and torsion forces and with accessories for attachment to braced component at one end and to building structure at the other end. Include matching components and corrosion-resistant coating.

D. Restraint Cables: ASTM A 492, stainless-steel cables with end connections made of cadmium-plated steel assemblies with brackets, swivel, and bolts designed for restraining cable service; and with an automatic-locking and clamping device or double-cable clips.

E. Hanger Rod Stiffener: Steel tube or steel slotted-support-system sleeve with internally bolted connections to hanger rod.

F. Mechanical Anchor Bolts: Drilled-in and stud-wedge or female-wedge type. Select anchor bolts with strength required for anchor and as tested according to ASTM E 488.

PART 3 - EXECUTION

3.1 DUCT INSTALLATION

A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations. Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and Coordination Drawings.

B. Install ducts according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" unless otherwise indicated.

C. Install round ducts in maximum practical lengths.

D. Install ducts with fewest possible joints.

E. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.

F. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.

G. Provide an extra 350 lbs of ductwork to accommodate ductwork revisions required to resolve interferences or as directed by the Engineer.

H. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.

I. Install ducts with a clearance of 1 inch, plus allowance for insulation thickness.

J. Route ducts to avoid passing through transformer vaults and electrical equipment rooms and enclosures.

K. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.

L. Where ducts pass through fire-rated interior partitions and exterior walls, install fire dampers. Comply with requirements in Division 23 Section "Air Duct Accessories" for fire and smoke dampers.

M. Protect duct interiors from moisture, construction debris and dust, and other foreign materials. Comply with SMACNA's "Duct Cleanliness for New Construction Guidelines."

3.2 INSTALLATION OF EXPOSED DUCTWORK

A. Protect ducts exposed in finished spaces from being dented, scratched, or damaged.

B. Trim duct sealants flush with metal. Create a smooth and uniform exposed bead. Do not use two-part tape sealing system.

C. Grind welds to provide smooth surface free of burrs, sharp edges, and weld splatter. When welding stainless steel with a No. 3 or 4 finish, grind the welds flush, polish the exposed welds, and treat the welds to remove discoloration caused by welding.

D. Maintain consistency, symmetry, and uniformity in the arrangement and fabrication of fittings, hangers and supports, duct accessories, and air outlets.

E. Repair or replace damaged sections and finished work that does not comply with these requirements.

3.3 DUCT SEALING

A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in "Duct Schedule" Article according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

B. Seal ducts to the following seal classes according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible":

1. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
2. Outdoor, Supply-Air Ducts: Seal Class A.
3. Outdoor, Exhaust Ducts: Seal Class C.
4. Outdoor, Return-Air Ducts: Seal Class C.
5. Unconditioned Space, Supply-Air Ducts in Pressure Classes 2-Inch wg and Lower: Seal Class B.
6. Unconditioned Space, Supply-Air Ducts in Pressure Classes Higher Than 2-Inch wg: Seal Class A.
7. Unconditioned Space, Exhaust Ducts: Seal Class C.
8. Unconditioned Space, Return-Air Ducts: Seal Class B.
9. Conditioned Space, Supply-Air Ducts in Pressure Classes 2-Inch wg and Lower: Seal Class C.
10. Conditioned Space, Supply-Air Ducts in Pressure Classes Higher Than 2-Inch wg: Seal Class B.
11. Conditioned Space, Exhaust Ducts: Seal Class B.
12. Conditioned Space, Return-Air Ducts: Seal Class C.

3.4 HANGER AND SUPPORT INSTALLATION

A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 4, "Hangers and Supports."

B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.

1. Where practical, install concrete inserts before placing concrete.
2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.
3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
5. Do not use powder-actuated concrete fasteners for seismic restraints.

C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 4-1, "Rectangular Duct Hangers Minimum Size," and Table 4-2, "Minimum Hanger Sizes for Round Duct," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.

D. Hangers Exposed to View: Threaded rod and angle or channel supports.

E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.

F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

3.5 SEISMIC-RESTRAINT-DEVICE INSTALLATION

A. Install ducts with hangers and braces designed to support the duct and to restrain against seismic forces required by applicable building codes. Comply with SMACNA's "Seismic Restraint Manual: Guidelines for Mechanical Systems." ASCE/SEI 7.

1. Space lateral supports a maximum of 40 feet o.c., and longitudinal supports a maximum of 80 feet o.c.
2. Brace a change of direction longer than 12 feet.

B. Select seismic-restraint devices with capacities adequate to carry present and future static and seismic loads.

C. Install cables so they do not bend across edges of adjacent equipment or building structure.

D. Install cable restraints on ducts that are suspended with vibration isolators.

E. Install seismic-restraint devices using methods approved by an agency acceptable to authorities having jurisdiction.

F. Attachment to Structure: If specific attachment is not indicated, anchor bracing and restraints to structure, to flanges of beams, to upper truss chords of bar joists, or to concrete members.

G. Drilling for and Setting Anchors:

1. Identify position of reinforcing steel and other embedded items prior to drilling holes for anchors. Do not damage existing reinforcement or embedded items during drilling. Notify the Architect if reinforcing steel or other embedded items are encountered during drilling. Locate and avoid prestressed tendons, electrical and telecommunications conduit, and gas lines.
2. Do not drill holes in concrete or masonry until concrete, mortar, or grout has achieved full design strength.
3. Wedge Anchors: Protect threads from damage during anchor installation. Heavy-duty sleeve anchors shall be installed with sleeve fully engaged in the structural element to which anchor is to be fastened.
4. Set anchors to manufacturer's recommended torque, using a torque wrench.
5. Install zinc-coated steel anchors for interior applications and stainless-steel anchors for applications exposed to weather.

3.6 CONNECTIONS

A. Make connections to equipment with flexible connectors complying with Division 23 Section "Air Duct Accessories."

B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for branch, outlet and inlet, and terminal unit connections.

3.7 PAINTING

A. Paint exterior of exposed ductwork with color as selected by the architect. Paint interior of metal ducts that are visible through registers and grilles. Apply one coat of flat, black, latex paint over a compatible galvanized-steel primer. Paint materials and application requirements are specified in Division 09 painting Sections.

3.8 FIELD QUALITY CONTROL

A. Perform tests and inspections.

B. Leakage Tests:

1. Comply with SMACNA's "HVAC Air Duct Leakage Test Manual." Submit a test report for each test.
2. Test the following systems:

    a. Supply Ducts with a Pressure Class of 2-Inch wg or Higher: Test duct sections totaling no less than 100 percent of total installed duct area for each designated pressure class.
    b. Return Ducts with a Pressure Class of 2-Inch wg or Higher: Test duct sections totaling no less than 100 percent of total installed duct area for each designated pressure class.
    c. Exhaust Ducts with a Pressure Class of 2-Inch wg or Higher: Test duct sections totaling no less than 100 percent of total installed duct area for each designated pressure class.
    d. Outdoor Air Ducts with a Pressure Class of 2-Inch wg or Higher: Test duct sections totaling no less than 100 percent of total installed duct area for each designated pressure class.

3. Disassemble, reassemble, and seal segments of systems to accommodate leakage testing and for compliance with test requirements.
4. Test for leaks before applying external insulation.
5. Conduct tests at static pressures equal to maximum design pressure of system or section being tested. If static-pressure classes are not indicated, test system at maximum system design pressure. Do not pressurize systems above maximum design operating pressure.
6. Give seven days' advance notice for testing.

C. Duct System Cleanliness Tests:

1. Visually inspect duct system to ensure that no visible contaminants are present.
2. Test sections of metal duct system, chosen randomly by Owner, for cleanliness according to "Vacuum Test" in NADCA ACR, "Assessment, Cleaning and Restoration of HVAC Systems."

    a. Acceptable Cleanliness Level: Net weight of debris collected on the filter media shall not exceed 0.75 mg/100 sq. cm.

D. Duct system will be considered defective if it does not pass tests and inspections.

E. Prepare test and inspection reports.

3.9 DUCT CLEANING

A. Clean new and existing duct system(s) before testing, adjusting, and balancing.

B. Use service openings for entry and inspection.

1. Create new openings and install access panels appropriate for duct static-pressure class if required for cleaning access. Provide insulated panels for insulated or lined duct. Patch insulation and liner as recommended by duct liner manufacturer. Comply with Division 23 Section "Air Duct Accessories" for access panels and doors.
2. Disconnect and reconnect flexible ducts as needed for cleaning and inspection.
3. Remove and reinstall ceiling to gain access during the cleaning process.

C. Particulate Collection and Odor Control:

1. When venting vacuuming system inside the building, use HEPA filtration with 99.97 percent collection efficiency for 0.3-micron-size (or larger) particles.
2. When venting vacuuming system to outdoors, use filter to collect debris removed from HVAC system, and locate exhaust downwind and away from air intakes and other points of entry into building.

D. Clean the following components by removing surface contaminants and deposits:

1. Air outlets and inlets (registers, grilles, and diffusers).
2. Supply, return, and exhaust fans including fan housings, plenums (except ceiling supply and return plenums), scrolls, blades or vanes, shafts, baffles, dampers, and drive assemblies.
3. Air-handling unit internal surfaces and components including mixing box, coil section, air wash systems, spray eliminators, condensate drain pans, humidifiers and dehumidifiers, filters and filter sections, and condensate collectors and drains.
4. Coils and related components.
5. Return-air ducts, dampers, actuators, and turning vanes except in ceiling plenums and mechanical equipment rooms.
6. Supply-air ducts, dampers, actuators, and turning vanes.
7. Dedicated exhaust and ventilation components and makeup air systems.

E. Mechanical Cleaning Methodology:

1. Clean metal duct systems using mechanical cleaning methods that extract contaminants from within duct systems and remove contaminants from building.
2. Use vacuum-collection devices that are operated continuously during cleaning. Connect vacuum device to downstream end of duct sections so areas being cleaned are under negative pressure.
3. Use mechanical agitation to dislodge debris adhered to interior duct surfaces without damaging integrity of metal ducts, duct liner, or duct accessories.
4. Clean fibrous-glass duct liner with HEPA vacuuming equipment; do not permit duct liner to get wet. Replace fibrous-glass duct liner that is damaged, deteriorated, or delaminated or that has friable material, mold, or fungus growth.
5. Clean coils and coil drain pans according to NADCA 1992. Keep drain pan operational. Rinse coils with clean water to remove latent residues and cleaning materials; comb and straighten fins.
6. Provide drainage and cleanup for wash-down procedures.

7. Antimicrobial Agents and Coatings: Apply EPA-registered antimicrobial agents if fungus is present. Apply antimicrobial agents according to manufacturer's written instructions after removal of surface deposits and debris.

3.10 START UP

A. Air Balance: Comply with requirements in Division 23 Section "Testing, Adjusting, and Balancing for HVAC."

3.11 DUCT SCHEDULE

A. Fabricate ducts with galvanized sheet steel except as otherwise indicated.

B. All exposed round ductwork as shown on the contract drawings shall be double wall insulated spiral type. Coordinate finish color with Architect.

C. Supply Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:

   a. Pressure Class: Positive 3-inch wg.
   b. Minimum SMACNA Seal Class: C.
   c. SMACNA Leakage Class for Rectangular: 6.
   d. SMACNA Leakage Class for Round and Flat Oval: 3.

2. Ducts Connected to Constant-Volume Air-Handling Units:

   a. Pressure Class: Positive 3-inch wg.
   b. Minimum SMACNA Seal Class: C.
   c. SMACNA Leakage Class for Rectangular: 6.
   d. SMACNA Leakage Class for Round and Flat Oval: 3.

D. Return Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:

   a. Pressure Class: Positive or negative 2-inch wg.
   b. Minimum SMACNA Seal Class: C.
   c. SMACNA Leakage Class for Rectangular: 6.
   d. SMACNA Leakage Class for Round and Flat Oval: 3.

2. Ducts Connected to Air-Handling Units:

   a. Pressure Class: Positive or negative 2-inch wg .
   b. Minimum SMACNA Seal Class: C.
   c. SMACNA Leakage Class for Rectangular: 6.
   d. SMACNA Leakage Class for Round and Flat Oval: 3.

E. Exhaust Ducts:

1. Ducts Connected to Fans Exhausting (ASHRAE 62.1, Class 1 and 2) Air:

    a. Pressure Class: Negative 2-inch wg.
    b. Minimum SMACNA Seal Class: C if negative pressure, and A if positive pressure.
    c. SMACNA Leakage Class for Rectangular: 6.
    d. SMACNA Leakage Class for Round and Flat Oval: 3.

2. Ducts Connected to Air-Handling Units:

    a. Pressure Class: Positive or negative 2-inch wg.
    b. Minimum SMACNA Seal Class: C if negative pressure, and A if positive pressure.
    c. SMACNA Leakage Class for Rectangular: 6.
    d. SMACNA Leakage Class for Round and Flat Oval: 3.

F. Outdoor-Air (Not Filtered, Heated, or Cooled) Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:

    a. Pressure Class: Positive or negative 2-inch wg.
    b. Minimum SMACNA Seal Class: A.
    c. SMACNA Leakage Class for Rectangular: 12.
    d. SMACNA Leakage Class for Round and Flat Oval: 12.

2. Ducts Connected to Air-Handling Units:

    a. Pressure Class: Positive or negative 2-inch wg.
    b. Minimum SMACNA Seal Class: A.
    c. SMACNA Leakage Class for Rectangular: 12.
    d. SMACNA Leakage Class for Round and Flat Oval: 12.

3. Ducts Connected to Equipment Not Listed Above:

    a. Pressure Class: Positive or negative 2-inch wg.
    b. Minimum SMACNA Seal Class: A.
    c. SMACNA Leakage Class for Rectangular: 12.
    d. SMACNA Leakage Class for Round and Flat Oval: 12.

G. Intermediate Reinforcement:

1. Galvanized-Steel Ducts: Galvanized steel.
2. PVC-Coated Ducts:

    a. Exposed to Airstream: Match duct material.
    b. Not Exposed to Airstream: Galvanized.

3. Stainless-Steel Ducts:

   a. Exposed to Airstream: Match duct material.
   b. Not Exposed to Airstream: Match duct material.

4. Aluminum Ducts: Aluminum.

H. Double-Wall Duct Interstitial Insulation:

1. Supply Air Ducts: 1 inch thick.
2. Return Air Ducts: 1 inch thick.
3. Exhaust Air Ducts: 1 inch thick.

I. Elbow Configuration:

1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Elbows."

   a. Velocity 1000 fpm or Lower:

      1) Radius Type RE 1 with minimum 0.5 radius-to-diameter ratio.
      2) Mitered Type RE 4 without vanes.

   b. Velocity 1000 to 1500 fpm:

      1) Radius Type RE 1 with minimum 1.0 radius-to-diameter ratio.
      2) Radius Type RE 3 with minimum 0.5 radius-to-diameter ratio and two vanes.
      3) Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-3, "Vanes and Vane Runners," and Figure 2-4, "Vane Support in Elbows."

   c. Velocity 1500 fpm or Higher:

      1) Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
      2) Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.
      3) Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-3, "Vanes and Vane Runners," and Figure 2-4, "Vane Support in Elbows."

2. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Elbows."

   a. Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
   b. Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.

c. Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-3, "Vanes and Vane Runners," and Figure 2-4, "Vane Support in Elbows."

3. Round Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-3, "Round Duct Elbows."

a. Minimum Radius-to-Diameter Ratio and Elbow Segments: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 3-1, "Mitered Elbows." Elbows with less than 90-degree change of direction have proportionately fewer segments.

1) Velocity 1000 fpm or Lower: 0.5 radius-to-diameter ratio and three segments for 90-degree elbow.
2) Velocity 1000 to 1500 fpm: 1.0 radius-to-diameter ratio and four segments for 90-degree elbow.
3) Velocity 1500 fpm or Higher: 1.5 radius-to-diameter ratio and five segments for 90-degree elbow.
4) Radius-to Diameter Ratio: 1.5.

b. Round Elbows, 12 Inches and Smaller in Diameter: Stamped or pleated.
c. Round Elbows, 14 Inches and Larger in Diameter: Welded.

J. Branch Configuration:

1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-6, "Branch Connections."

a. Rectangular Main to Rectangular Branch: 45-degree entry.
b. Rectangular Main to Round Branch: Spin in.

2. Round and Flat Oval: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "90 Degree Tees and Laterals," and Figure 3-5, "Conical Tees." Saddle taps are permitted in existing duct.

a. Velocity 1000 fpm or Lower: 90-degree tap.
b. Velocity 1000 to 1500 fpm: Conical tap.
c. Velocity 1500 fpm or Higher: 45-degree lateral.

END OF SECTION 233113

SECTION 233300 - AIR DUCT ACCESSORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Backdraft and pressure relief dampers.
2. Barometric relief dampers.
3. Manual volume dampers.
4. Control dampers.
5. Fire dampers.
6. Ceiling dampers.
7. Smoke dampers.
8. Combination fire and smoke dampers.
9. Corridor dampers.
10. Flange connectors.
11. Duct silencers.
12. Turning vanes.
13. Remote damper operators.
14. Duct-mounted access doors.
15. Flexible connectors.
16. Flexible ducts.
17. Duct security bars.
18. Duct accessory hardware.

B. Related Sections:

1. Division 23 Section "HVAC Power Ventilators" for roof-mounted ventilator caps.
2. Division 28 Section "Fire Detection and Alarm" for duct-mounted fire and smoke detectors.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated.

1. For duct silencers, include pressure drop and dynamic insertion loss data. Include breakout noise calculations for high transmission loss casings.

B. Shop Drawings: For duct accessories. Include plans, elevations, sections, details and attachments to other work.

1. Detail duct accessories fabrication and installation in ducts and other construction. Include dimensions, weights, loads, and required clearances; and method of field assembly into duct systems and other construction. Include the following:

a. Special fittings.
b. Manual volume damper installations.
c. Control damper installations.
d. Fire-damper, smoke-damper, combination fire- and smoke-damper, ceiling, and corridor damper installations, including sleeves; and duct-mounted access doors and remote damper operators.
e. Duct security bars.
f. Wiring Diagrams: For power, signal, and control wiring.

C. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which ceiling-mounted access panels and access doors required for access to duct accessories are shown and coordinated with each other, using input from Installers of the items involved.

D. Source quality-control reports.

E. Operation and Maintenance Data: For air duct accessories to include in operation and maintenance manuals.

1.4 QUALITY ASSURANCE

A. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," and with NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems."

B. Comply with AMCA 500-D testing for damper rating.

1.5 EXTRA MATERIALS

A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Fusible Links: Furnish quantity equal to 10 percent of amount installed.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.

B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.

1. Galvanized Coating Designation: G90.
2. Exposed-Surface Finish: Mill phosphatized.

C. Stainless-Steel Sheets: Comply with ASTM A 480/A 480M, Type 304, and having a No. 2 finish for concealed ducts and a polished finish for exposed ducts.

D. Aluminum Sheets: Comply with ASTM B 209, Alloy 3003, Temper H14; with mill finish for concealed ducts and standard, 1-side bright finish for exposed ducts.

E. Extruded Aluminum: Comply with ASTM B 221, Alloy 6063, Temper T6.

F. Reinforcement Shapes and Plates: Galvanized-steel reinforcement where installed on galvanized sheet metal ducts; compatible materials for aluminum and stainless-steel ducts.

G. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

2.2 BACKDRAFT AND PRESSURE RELIEF DAMPERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Air Balance Inc.; a division of Mestek, Inc.
2. American Warming and Ventilating; a division of Mestek, Inc.
3. Cesco Products; a division of Mestek, Inc.
4. Duro Dyne Inc.
5. Greenheck Fan Corporation.
6. Lloyd Industries, Inc.
7. Nailor Industries Inc.
8. NCA Manufacturing, Inc.
9. Pottorff; a division of PCI Industries, Inc.
10. Ruskin Company.
11. SEMCO Incorporated.
12. Vent Products Company, Inc.

B. Description: Gravity balanced.

C. Maximum Air Velocity: 2200 fpm.

D. Maximum System Pressure: 2-inch wg.

E. Frame: 0.052-inch- thick, galvanized sheet steel with welded corners and mounting flange.

F. Blades: Multiple single-piece blades, center-pivoted, maximum 6-inch width, 0.025-inch- thick, roll-formed aluminum with sealed edges.

G. Blade Action: Parallel.

H. Blade Seals: Neoprene, mechanically locked.

I. Blade Axles:

1. Material: Plated steel.
2. Diameter: 0.20 inch.

J. Tie Bars and Brackets: Galvanized steel.

K. Return Spring: Adjustable tension.

L. Bearings: Steel ball or synthetic pivot bushings.

M. Accessories:

1. Adjustment device to permit setting for varying differential static pressure.
2. Counterweights and spring-assist kits for vertical airflow installations.
3. Electric actuators.
4. Chain pulls.
5. Screen Mounting: Front mounted in sleeve.

    a. Sleeve Thickness: 20-gage minimum.
    b. Sleeve Length: 6 inches minimum.

6. Screen Material: Galvanized steel or Aluminum.
7. Screen Type: Insect.
8. 90-degree stops.

2.3 BAROMETRIC RELIEF DAMPERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Air Balance Inc.; a division of Mestek, Inc.

2. American Warming and Ventilating; a division of Mestek, Inc.
3. Cesco Products; a division of Mestek, Inc.
4. Duro Dyne Inc.
5. Greenheck Fan Corporation.
6. Lloyd Industries, Inc.
7. Nailor Industries Inc.
8. NCA Manufacturing, Inc.
9. Pottorff; a division of PCI Industries, Inc.
10. Ruskin Company.
11. SEMCO Incorporated.
12. Vent Products Company, Inc.

B. Suitable for horizontal or vertical mounting.

C. Maximum Air Velocity: 2200 fpm.

D. Maximum System Pressure: 2-inch wg.

E. Frame: 0.064-inch- thick, galvanized sheet steel, with welded corners and mounting flange.

F. Blades:

1. Multiple, 0.025-inch- thick, roll-formed aluminum.
2. Maximum Width: 6 inches.
3. Action: Parallel.
4. Balance: Gravity.
5. Eccentrically pivoted.

G. Blade Seals: Neoprene.

H. Blade Axles: Galvanized steel.

I. Tie Bars and Brackets:

1. Material: Galvanized steel.
2. Rattle free with 90-degree stop.

J. Return Spring: Adjustable tension.

K. Bearings: Synthetic or Stainless steel.

L. Accessories:

1. Flange on intake.
2. Adjustment device to permit setting for varying differential static pressures.

2.4 MANUAL VOLUME DAMPERS

A. Low-Leakage, Steel, Manual Volume Dampers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

    a. Air Balance Inc.; a division of Mestek, Inc.
    b. American Warming and Ventilating; a division of Mestek, Inc.
    c. Flexmaster U.S.A., Inc.
    d. McGill AirFlow LLC.
    e. METALAIRE, Inc.
    f. Nailor Industries Inc.
    g. Pottorff; a division of PCI Industries, Inc.
    h. Ruskin Company.
    i. Trox USA Inc.
    j. Vent Products Company, Inc.

2. Low-leakage rating, with linkage outside airstream, and bearing AMCA's Certified Ratings Seal for both air performance and air leakage.
3. Suitable for horizontal or vertical applications.
4. Frames:

    a. Hat, U, Angle shaped.
    b. Galvanized-steel channels, 0.064 inch thick.
    c. Mitered and welded corners.
    d. Flanges for attaching to walls and flangeless frames for installing in ducts.

5. Blades:

    a. Multiple or single blade.
    b. Parallel- or opposed-blade design.
    c. Stiffen damper blades for stability.
    d. Galvanized, roll-formed steel, 0.064 inch thick.

6. Blade Axles: Galvanized steel.
7. Bearings:

    a. Oil-impregnated bronze, Molded synthetic, Stainless-steel sleeve.
    b. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.

8. Blade Seals: Vinyl or Neoprene.
9. Jamb Seals: Cambered aluminum.
10. Tie Bars and Brackets: Galvanized steel.
11. Accessories:

    a. Include locking device to hold single-blade dampers in a fixed position without vibration.

B. Low-Leakage, Aluminum, Manual Volume Dampers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

    a. Air Balance Inc.; a division of Mestek, Inc.
    b. American Warming and Ventilating; a division of Mestek, Inc.
    c. Flexmaster U.S.A., Inc.
    d. McGill AirFlow LLC.
    e. METALAIRE, Inc.
    f. Nailor Industries Inc.
    g. Pottorff; a division of PCI Industries, Inc.
    h. Ruskin Company.
    i. Trox USA Inc.
    j. Vent Products Company, Inc.

2. Low-leakage rating, with linkage outside airstream, and bearing AMCA's Certified Ratings Seal for both air performance and air leakage.
3. Suitable for horizontal or vertical applications.
4. Frames: Hat, U, Angle-shaped, 0.10-inch- thick, aluminum sheet channels; frames with flanges for attaching to walls and flangeless frames for installing in ducts.
5. Blades:

    a. Multiple or single blade.
    b. Parallel- or opposed-blade design.
    c. Roll-Formed Aluminum Blades: 0.10-inch- thick aluminum sheet.
    d. Extruded-Aluminum Blades: 0.050-inch- thick extruded aluminum.

6. Blade Axles: Stainless steel.
7. Bearings:

    a. Oil-impregnated bronze, Molded synthetic, Stainless-steel sleeve.
    b. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.

8. Blade Seals: Vinyl or Neoprene.
9. Jamb Seals: Cambered aluminum.
10. Tie Bars and Brackets: Aluminum.
11. Accessories:

    a. Include locking device to hold single-blade dampers in a fixed position without vibration.

C. Jackshaft:

1. Size: 1-inch diameter.
2. Material: Galvanized-steel pipe rotating within pipe-bearing assembly mounted on supports at each mullion and at each end of multiple-damper assemblies.

C. Jackshaft:

1. Size: 1-inch diameter.
2. Material: Galvanized-steel pipe rotating within pipe-bearing assembly mounted on supports at each mullion and at each end of multiple-damper assemblies.
3. Length and Number of Mountings: As required to connect linkage of each damper in multiple-damper assembly.

D. Damper Hardware:

1. Zinc-plated, die-cast core with dial and handle made of 3/32-inch- thick zinc-plated steel, and a 3/4-inch hexagon locking nut.
2. Include center hole to suit damper operating-rod size.
3. Include elevated platform for insulated duct mounting.

2.5 CONTROL DAMPERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. American Warming and Ventilating; a division of Mestek, Inc.
2. Arrow United Industries; a division of Mestek, Inc.
3. Cesco Products; a division of Mestek, Inc.
4. Duro Dyne Inc.
5. Flexmaster U.S.A., Inc.
6. Greenheck Fan Corporation.
7. Lloyd Industries, Inc.
8. M&I Air Systems Engineering; Division of M&I Heat Transfer Products Ltd.
9. McGill AirFlow LLC.
10. METALAIRE, Inc.
11. Metal Form Manufacturing, Inc.
12. Nailor Industries Inc.
13. NCA Manufacturing, Inc.
14. Ruskin Company.
15. Vent Products Company, Inc.
16. Young Regulator Company.

B. Low-leakage rating, with linkage outside airstream, and bearing AMCA's Certified Ratings Seal for both air performance and air leakage.

C. Frames:

1. Hat, U, Angle shaped.
2. Galvanized-steel channels, 0.064 inch thick.
3. Mitered and welded corners.

D. Blades:

E. Blade Axles: 1/2-inch- diameter; galvanized steel; blade-linkage hardware of zinc-plated steel and brass; ends sealed against blade bearings.

1. Operating Temperature Range: From minus 40 to plus 200 deg F.

F. Bearings:

1. Oil-impregnated bronze, Molded synthetic or Stainless-steel sleeve.
2. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.
3. Thrust bearings at each end of every blade.

2.6 FIRE DAMPERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Air Balance Inc.; a division of Mestek, Inc.
2. Arrow United Industries; a division of Mestek, Inc.
3. Cesco Products; a division of Mestek, Inc.
4. Greenheck Fan Corporation.
5. McGill AirFlow LLC.
6. METALAIRE, Inc.
7. Nailor Industries Inc.
8. NCA Manufacturing, Inc.
9. PHL, Inc.
10. Pottorff; a division of PCI Industries, Inc.
11. Prefco; Perfect Air Control, Inc.
12. Ruskin Company.
13. Vent Products Company, Inc.
14. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Type: Static; rated and labeled according to UL 555 by an NRTL.

C. Fire Rating: 1-1/2 and 3 hours.

D. Frame: Curtain type with blades outside airstream; fabricated with roll-formed, 0.034-inch- thick galvanized steel; with mitered and interlocking corners.

E. Mounting Sleeve: Factory- or field-installed, galvanized sheet steel.

1. Minimum Thickness: 0.052 or 0.138 inch thick, as indicated, and of length to suit application.
2. Exception: Omit sleeve where damper-frame width permits direct attachment of perimeter mounting angles on each side of wall or floor; thickness of damper frame must comply with sleeve requirements.

F. Mounting Orientation: Vertical or horizontal as indicated.

G. Blades: Roll-formed, interlocking, 0.034-inch- thick, galvanized sheet steel. In place of interlocking blades, use full-length, 0.034-inch- thick, galvanized-steel blade connectors.

H. Horizontal Dampers: Include blade lock and stainless-steel closure spring.

I. Heat-Responsive Device: Replaceable, 165 deg F rated, fusible links.

2.7 SMOKE DAMPERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Air Balance Inc.; a division of Mestek, Inc.
2. Cesco Products; a division of Mestek, Inc.
3. Greenheck Fan Corporation.
4. Nailor Industries Inc.
5. PHL, Inc.
6. Ruskin Company.

B. General Requirements: Label according to UL 555S by an NRTL.

C. Smoke Detector: Integral, factory wired for single-point connection.

D. Frame: Curtain type with blades outside airstream; fabricated with roll-formed, 0.034-inch- thick galvanized steel; with mitered and interlocking corners.

E. Blades: Roll-formed, horizontal, interlocking, 0.034-inch- thick, galvanized sheet steel. In place of interlocking blades, use full-length, 0.034-inch- thick, galvanized-steel blade connectors.

F. Leakage: Class I .

G. Rated pressure and velocity to exceed design airflow conditions.

H. Mounting Sleeve: Factory-installed, 0.052-inch- thick, galvanized sheet steel; length to suit wall or floor application with factory-furnished silicone calking.

I. Damper Motors: Modulating or two-position action.

J. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements for motors specified in Division 23 Section "Common Motor Requirements for HVAC Equipment."

1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
2. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in Division 23 Section "Instrumentation and Control for HVAC." Division 26 Sections.

3. Permanent-Split-Capacitor or Shaded-Pole Motors: With oil-immersed and sealed gear trains.
4. Spring-Return Motors: Equip with an integral spiral-spring mechanism where indicated. Enclose entire spring mechanism in a removable housing designed for service or adjustments. Size for running torque rating of 150 in. x lbf and breakaway torque rating of 150 in. x lbf.
5. Outdoor Motors and Motors in Outdoor-Air Intakes: Equip with O-ring gaskets designed to make motors weatherproof. Equip motors with internal heaters to permit normal operation at minus 40 deg F.
6. Nonspring-Return Motors: For dampers larger than 25 sq. ft., size motor for running torque rating of 150 in. x lbf and breakaway torque rating of 300 in. x lbf.
7. Electrical Connection: 115 V, single phase, 60 Hz.

K. Accessories:

1. Auxiliary switches for signaling fan control or position indication.
2. Momentary test switch, remote mounted.

2.8 FLANGE CONNECTORS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Ductmate Industries, Inc.
2. Nexus PDQ; Division of Shilco Holdings Inc.
3. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Description: Add-on or roll-formed, factory-fabricated, slide-on transverse flange connectors, gaskets, and components.

C. Material: Galvanized steel.

D. Gage and Shape: Match connecting ductwork.

2.9 DUCT SILENCERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Industrial Noise Control, Inc.
2. McGill AirFlow LLC.
3. Ruskin Company.
4. Vibro-Acoustics.

B. General Requirements:

1. Factory fabricated.

2. Fire-Performance Characteristics: Adhesives, sealants, packing materials, and accessory materials shall have flame-spread index not exceeding 25 and smoke-developed index not exceeding 50 when tested according to ASTM E 84.
3. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2004.

C. Shape:

1. Rectangular straight with splitters or baffles.
2. Round straight with center bodies or pods.
3. Rectangular elbow with splitters or baffles.
4. Round elbow with center bodies or pods.
5. Rectangular transitional with splitters or baffles.

D. Rectangular Silencer Outer Casing: ASTM A 653/A 653M, G90, galvanized sheet steel, 0.040 inch thick.

E. Round Silencer Outer Casing: ASTM A 653/A 653M, G90, galvanized sheet steel.

1. Sheet Metal Thickness for Units up to 24 Inches in Diameter: 0.034 inch thick.
2. Sheet Metal Thickness for Units 26 through 40 Inches in Diameter: 0.040 inch thick.
3. Sheet Metal Thickness for Units 42 through 52 Inches in Diameter: 0.052 inch thick.
4. Sheet Metal Thickness for Units 54 through 60 Inches in Diameter: 0.064 inch thick.

F. Inner Casing and Baffles: ASTM A 653/A 653M, G90 galvanized sheet metal, 0.034 inch thick, and with 1/8-inch- diameter perforations.

G. Special Construction:

1. Suitable for outdoor use.
2. High transmission loss to achieve STC 45.

H. Connection Sizes: Match connecting ductwork unless otherwise indicated.

I. Principal Sound-Absorbing Mechanism:

1. Controlled impedance membranes and broadly tuned resonators without absorptive media.
2. Dissipative type with fill material.

    a. Fill Material: Moisture-proof nonfibrous material.
    b. Erosion Barrier: Polymer bag enclosing fill, and heat sealed before assembly.

3. Lining: Mylar.

J. Fabricate silencers to form rigid units that will not pulsate, vibrate, rattle, or otherwise react to system pressure variations. Do not use mechanical fasteners for unit assemblies.

1. Flange connections.
2. Suspended Units: Factory-installed suspension hooks or lugs attached to frame in quantities and spaced to prevent deflection or distortion.
3. Reinforcement: Cross or trapeze angles for rigid suspension.

K. Accessories:

1. Factory-installed end caps to prevent contamination during shipping.
2. Removable splitters.
3. Airflow measuring devices.

L. Source Quality Control: Test according to ASTM E 477.

1. Record acoustic ratings, including dynamic insertion loss and generated-noise power levels with an airflow of at least 2000-fpm face velocity.
2. Leak Test: Test units for airtightness at 200 percent of associated fan static pressure or 6-inch wg static pressure, whichever is greater.

2.10 TURNING VANES

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Ductmate Industries, Inc.
2. Duro Dyne Inc.
3. METALAIRE, Inc.
4. SEMCO Incorporated.
5. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Manufactured Turning Vanes for Metal Ducts: Curved blades of galvanized sheet steel; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.

1. Acoustic Turning Vanes: Fabricate airfoil-shaped aluminum extrusions with perforated faces and fibrous-glass fill.

C. Manufactured Turning Vanes for Nonmetal Ducts: Fabricate curved blades of resin-bonded fiberglass with acrylic polymer coating; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.

D. General Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figures 2-3, "Vanes and Vane Runners," and 2-4, "Vane Support in Elbows."

E.

F. Vane Construction: Single wall for ducts up to 8 inches wide and double wall for larger dimensions.

2.11 DUCT-MOUNTED ACCESS DOORS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. American Warming and Ventilating; a division of Mestek, Inc.
2. Cesco Products; a division of Mestek, Inc.
3. Ductmate Industries, Inc.
4. Flexmaster U.S.A., Inc.
5. Greenheck Fan Corporation.
6. McGill AirFlow LLC.
7. Nailor Industries Inc.
8. Pottorff; a division of PCI Industries, Inc.
9. Ventfabrics, Inc.
10. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Duct-Mounted Access Doors: Fabricate access panels according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figures 2-10, "Duct Access Doors and Panels," and 2-11, "Access Panels - Round Duct."

1. Door:

   a. Double wall, rectangular.
   b. Galvanized sheet metal with insulation fill and thickness as indicated for duct pressure class.
   c. Vision panel.
   d. Hinges and Latches: 1-by-1-inch butt or piano hinge and cam latches.
   e. Fabricate doors airtight and suitable for duct pressure class.

2. Frame: Galvanized sheet steel, with bend-over tabs and foam gaskets.
3. Number of Hinges and Locks:

   a. Access Doors Less Than 12 Inches Square: No hinges and two sash locks.
   b. Access Doors up to 18 Inches Square: Two hinges and two sash locks.
   c. Access Doors up to 24 by 48 Inches: Three hinges and two compression latches[with outside and inside handles.
   d. Access Doors Larger Than 24 by 48 Inches: Four hinges and two compression latches with outside and inside handles.

C. Pressure Relief Access Door:

1. Door and Frame Material: Galvanized sheet steel.

2. Door: Double wall with insulation fill with metal thickness applicable for duct pressure class.
3. Operation: Open outward for positive-pressure ducts and inward for negative-pressure ducts.
4. Factory set at 10-inch wg.
5. Doors close when pressures are within set-point range.
6. Hinge: Continuous piano.
7. Latches: Cam.
8. Seal: Neoprene or foam rubber.
9. Insulation Fill: 1-inch- thick, fibrous-glass or polystyrene-foam board.

2.12 DUCT ACCESS PANEL ASSEMBLIES

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Ductmate Industries, Inc.
2. Flame Gard, Inc.
3. 3M.

B. Labeled according to UL 1978 by an NRTL.

C. Panel and Frame: Minimum thickness 0.0528-inch carbon steel.

D. Fasteners: Stainless steel. Panel fasteners shall not penetrate duct wall.

E. Gasket: Comply with NFPA 96; grease-tight, high-temperature ceramic fiber, rated for minimum 2000 deg F.

F. Minimum Pressure Rating: 10-inch wg, positive or negative.

2.13 FLEXIBLE CONNECTORS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Ductmate Industries, Inc.
2. Duro Dyne Inc.
3. Ventfabrics, Inc.
4. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Materials: Flame-retardant or noncombustible fabrics.

C. Coatings and Adhesives: Comply with UL 181, Class 1.

D. Metal-Edged Connectors: Factory fabricated with a fabric strip 5-3/4 inches wide attached to 2 strips of 2-3/4-inch- wide, 0.028-inch- thick, galvanized sheet steel or 0.032-inch- thick aluminum sheets. Provide metal compatible with connected ducts.

E. Indoor System, Flexible Connector Fabric: Glass fabric double coated with neoprene.

1. Minimum Weight: 26 oz./sq. yd..
2. Tensile Strength: 480 lbf/inch in the warp and 360 lbf/inch in the filling.
3. Service Temperature: Minus 40 to plus 200 deg F.

F. Outdoor System, Flexible Connector Fabric: Glass fabric double coated with weatherproof, synthetic rubber resistant to UV rays and ozone.

1. Minimum Weight: 24 oz./sq. yd..
2. Minimum Tensile Strength: 500 lbf/inch in the warp and 440 lbf/inch in the filling.
3. Service Temperature: Minus 50 to plus 250 deg F.

G. High-Temperature System, Flexible Connectors: Glass fabric coated with silicone rubber.

1. Minimum Weight: 16 oz./sq. yd..
2. Tensile Strength: 285 lbf/inch in the warp and 185 lbf/inch in the filling.
3. Service Temperature: Minus 67 to plus 500 deg F.

H. High-Corrosive-Environment System, Flexible Connectors: Glass fabric with chemical-resistant coating.

1. Minimum Weight: 14 oz./sq. yd..
2. Tensile Strength: 450 lbf/inch in the warp and 340 lbf/inch in the filling.
3. Service Temperature: Minus 67 to plus 500 deg F.

I. Thrust Limits: Combination coil spring and elastomeric insert with spring and insert in compression, and with a load stop. Include rod and angle-iron brackets for attaching to fan discharge and duct.

1. Frame: Steel, fabricated for connection to threaded rods and to allow for a maximum of 30 degrees of angular rod misalignment without binding or reducing isolation efficiency.
2. Outdoor Spring Diameter: Not less than 80 percent of the compressed height of the spring at rated load.
3. Minimum Additional Travel: 50 percent of the required deflection at rated load.
4. Lateral Stiffness: More than 80 percent of rated vertical stiffness.
5. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
6. Elastomeric Element: Molded, oil-resistant rubber or neoprene.
7. Coil Spring: Factory set and field adjustable for a maximum of 1/4-inch movement at start and stop.

2.14 FLEXIBLE DUCTS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Flexmaster U.S.A., Inc.
2. McGill AirFlow LLC.
3. Ward Industries, Inc.; a division of Hart & Cooley, Inc.

B. Insulated, Flexible Duct: UL 181, Class 1, 2-ply vinyl film supported by helically wound, spring-steel wire; fibrous-glass insulation; polyethylene vapor-barrier film.

1. Pressure Rating: 10-inch wg positive and 1.0-inch wg negative.
2. Maximum Air Velocity: 4000 fpm.
3. Temperature Range: Minus 10 to plus 160 deg F.
4. Insulation R-value: Comply with ASHRAE/IESNA 90.1-2004.

C. Flexible Duct Connectors:

1. Clamps: Stainless-steel band with cadmium-plated hex screw to tighten band with a worm-gear action in sizes 3 through 18 inches, to suit duct size.

2.15 DUCT SECURITY BARS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following manufacturers:

1. Carnes.
2. KEES, Inc.
3. Lloyd Industries, Inc.
4. Metal Form Manufacturing, Inc.
5. Price Industries.

B. Description: Field- or factory-fabricated and field-installed duct security bars.

C. Configuration:

1. Frame: 10 gage by 2 inches.
2. Sleeve: 3/16-inch, continuously welded steel frames with 1-by-1-by-3/16-inch angle frame factory welded to 1 end and furnished loose for field welding on other end. To be poured in place or set with concrete block or welded or bolted to wall, one side only. Duct connections on both sides.
3. Horizontal Bars: 1/2 inch.
4. Vertical Bars: 3/4 inch.
5. Bar Spacing: 6 inches.
6. Mounting: Ductwork or other framing.

2.16 DUCT ACCESSORY HARDWARE

A. Instrument Test Holes: Cast iron or cast aluminum to suit duct material, including screw cap and gasket. Size to allow insertion of pitot tube and other testing instruments and of length to suit duct-insulation thickness.

B. Adhesives: High strength, quick setting, neoprene based, waterproof, and resistant to gasoline and grease.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install duct accessories according to applicable details in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts and in NAIMA AH116, "Fibrous Glass Duct Construction Standards," for fibrous-glass ducts.

B. Install duct accessories of materials suited to duct materials; use galvanized-steel accessories in galvanized-steel and fibrous-glass ducts, stainless-steel accessories in stainless-steel ducts, and aluminum accessories in aluminum ducts.

C. Install backdraft dampers at inlet of exhaust fans or exhaust ducts as close as possible to exhaust fan unless otherwise indicated.

D. Install volume dampers at points on supply, return, and exhaust systems where branches extend from larger ducts. Where dampers are installed in ducts having duct liner, install dampers with hat channels of same depth as liner, and terminate liner with nosing at hat channel.

1. Install steel volume dampers in steel ducts.
2. Install aluminum volume dampers in aluminum ducts.

E. Set dampers to fully open position before testing, adjusting, and balancing.

F. Install test holes at fan inlets and outlets and elsewhere as indicated.

G. Install fire dampers according to UL listing.

H. Install duct security bars. Construct duct security bars from 0.164-inch steel sleeve, continuously welded at all joints and 1/2-inch- diameter steel bars, 6 inches o.c. in each direction in center of sleeve. Weld each bar to steel sleeve and each crossing bar. Weld 2-1/2-by-2-1/2-by-1/4-inch steel angle to 4 sides and both ends of sleeve. Connect duct security bars to ducts with flexible connections. Provide 12-by-12-inch hinged access panel with cam lock in duct in each side of sleeve.

I. Connect ducts to duct silencers rigidly.

J. Install duct access doors on sides of ducts to allow for inspecting, adjusting, and maintaining accessories and equipment at the following locations:

1. On both sides of duct coils.
2. Upstream and downstream from duct filters.
3. At outdoor-air intakes and mixed-air plenums.
4. At drain pans and seals.
5. Downstream from manual volume dampers, control dampers, backdraft dampers, and equipment.
6. Adjacent to and close enough to fire or smoke dampers, to reset or reinstall fusible links. Access doors for access to fire or smoke dampers having fusible links shall be pressure relief access doors and shall be outward operation for access doors installed upstream from dampers and inward operation for access doors installed downstream from dampers.
7. At each change in direction and at maximum 50-foot spacing.
8. Upstream from turning vanes.
9. Upstream or downstream from duct silencers.
10. Control devices requiring inspection.
11. Elsewhere as indicated.

K. Install access doors with swing against duct static pressure.

L. Access Door Sizes:

1. One-Hand or Inspection Access: 8 by 5 inches.
2. Two-Hand Access: 12 by 6 inches.
3. Head and Hand Access: 18 by 10 inches.
4. Head and Shoulders Access: 21 by 14 inches.
5. Body Access: 25 by 14 inches.
6. Body plus Ladder Access: 25 by 17 inches.

M. Label access doors according to Division 23 Section "Identification for HVAC Piping and Equipment" to indicate the purpose of access door.

N. Install flexible connectors to connect ducts to equipment.

O. For fans developing static pressures of 5-inch wg and more, cover flexible connectors with loaded vinyl sheet held in place with metal straps.

P. Connect terminal units to supply ducts directly.

Q. Connect diffusers or light troffer boots to ducts directly or with maximum 10'-0" lengths of flexible duct clamped or strapped in place.

R. Connect flexible ducts to metal ducts with stainless steel clamps.

S. Install duct test holes where required for testing and balancing purposes.

T. Install thrust limits at centerline of thrust, symmetrical on both sides of equipment. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4-inch movement during start and stop of fans.

3.2 FIELD QUALITY CONTROL

A. Tests and Inspections:

1. Operate dampers to verify full range of movement.
2. Inspect locations of access doors and verify that purpose of access door can be performed.
3. Operate fire, smoke, and combination fire and smoke dampers to verify full range of movement and verify that proper heat-response device is installed.
4. Inspect turning vanes for proper and secure installation.
5. Operate remote damper operators to verify full range of movement of operator and damper.

END OF SECTION 233300

SECTION 233423 - HVAC POWER VENTILATORS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes the following:
   1. Centrifugal roof ventilators.
   2. Ceiling-mounting ventilators.
   3. Propeller fans.
   4. In-line centrifugal fans

1.3 PERFORMANCE REQUIREMENTS

A. Project Altitude: Base fan-performance ratings on actual Project site elevations.

B. Operating Limits: Classify according to AMCA 99.

1.4 SUBMITTALS

A. Product Data: Include rated capacities, furnished specialties, and accessories for each type of product indicated and include the following:

   1. Certified fan performance curves with system operating conditions indicated.
   2. Certified fan sound-power ratings.
   3. Motor ratings and electrical characteristics, plus motor and electrical accessories.
   4. Material thickness and finishes, including color charts.
   5. Dampers, including housings, linkages, and operators.
   6. Roof curbs.
   7. Fan speed controllers.

B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.

   1. Wiring Diagrams: Power, signal, and control wiring.
   2. Design Calculations: Calculate requirements for selecting vibration isolators and seismic restraints and for designing vibration isolation bases.

3. Vibration Isolation Base Details: Detail fabrication, including anchorages and attachments to structure and to supported equipment. Include auxiliary motor slides and rails, and base weights.

C. Coordination Drawings: Reflected ceiling plans and other details, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:

1. Roof framing and support members relative to duct penetrations.
2. Ceiling suspension assembly members.
3. Size and location of initial access modules for acoustical tile.
4. Ceiling-mounted items including light fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.

D. Field quality-control test reports.

E. Operation and Maintenance Data: For power ventilators to include in emergency, operation, and maintenance manuals.

1.5 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

B. AMCA Compliance: Products shall comply with performance requirements and shall be licensed to use the AMCA-Certified Ratings Seal.

C. NEMA Compliance: Motors and electrical accessories shall comply with NEMA standards.

D. UL Standard: Power ventilators shall comply with UL 705.

1.6 DELIVERY, STORAGE, AND HANDLING

A. Deliver fans as factory-assembled unit, to the extent allowable by shipping limitations, with protective crating and covering.

B. Disassemble and reassemble units, as required for moving to final location, according to manufacturer's written instructions.

C. Lift and support units with manufacturer's designated lifting or supporting points.

1.7 COORDINATION

A. Coordinate size and location of structural-steel support members.

B. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 03.

C. Coordinate installation of roof curbs, equipment supports, and roof penetrations. These items are specified in Division 07 Section "Roof Accessories."

1.8 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Belts: two set(s) for each belt-driven unit.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Centrifugal Roof Ventilators:

a. Greenheck Fan Corp (Basis of Design).
b. Cook, Loren Company
c. Penn Ventilation Companies, Inc.

2. Ceiling-Mounting Ventilators:

a. Greenheck Fan Corp (Basis of Design).
b. Cook, Loren Company.
c. Penn Ventilation Companies, Inc.

3. Propeller Fans:

a. Cook, Loren Company (Basis of Design).
b. Greenheck Fan Corp.
c. Penn Ventilation Companies, Inc.
d. Or approved equal

2.2 CENTRIFUGAL ROOF VENTILATORS

A. Description: Belt-driven and direct-driven centrifugal fans consisting of housing, wheel, fan shaft, bearings, motor and disconnect switch, drive assembly, curb base, and accessories as scheduled on the contract drawings.

B. Housing: Removable, spun-aluminum, dome top and outlet baffle; square, one-piece, aluminum base with venturi inlet cone.

C. Fan Wheels: Aluminum hub and wheel with backward-inclined blades.

D. Belt-Driven Drive Assembly: Resiliently mounted to housing, with the following features:

1. Fan Shaft: Turned, ground, and polished steel; keyed to wheel hub.
2. Shaft Bearings: Permanently lubricated, permanently sealed, self-aligning ball bearings.
3. Pulleys: Cast-iron, adjustable-pitch motor pulley.
4. Fan and motor isolated from exhaust airstream.

E. Accessories:

1. Disconnect Switch: Nonfusible type, with thermal-overload protection mounted inside fan housing, factory wired through an internal aluminum conduit.
2. Bird Screens: Removable, 1/2-inch mesh, aluminum or brass wire.
3. Motorized Dampers: Parallel-blade dampers mounted in curb base with electric actuator; wired to close when fan stops.
4. Variable-Speed Controller for Direct Drive Fans: Solid-state control to reduce speed from 100 percent to less than 50 percent.
5. Additional accessories as noted on the exhaust fan equipment schedules.

F. Roof Curbs: Roof curb shall be Trapezoidal fixed cell standing seam roof sloped seismic roof curb by Thybar or approved equal. Coordinate final roof type with Architect and Structural contractor.

1. Overall Height: 18 inches.
2. Sound Curb: Curb with sound-absorbing insulation matrix.
3. Pitch Mounting: Manufacture curb for roof slope.
4. Metal Liner: Galvanized steel.
5. Hinged Subbase: Galvanized steel hinged arrangement permitting service and maintenance.
6. Mounting Pedestal: Galvanized steel with removable access panel.

2.3 CEILING-MOUNTING VENTILATORS

A. Description: Centrifugal fans designed for installing in ceiling or wall or for concealed in-line applications.

B. Housing: Steel, lined with acoustical insulation.

C. Fan Wheel: Centrifugal wheels directly mounted on motor shaft. Fan shrouds, motor, and fan wheel shall be removable for service.

D. Grille: Painted Steel, louvered grille with flange on intake and thumbscrew attachment to fan housing.

E. Electrical Requirements: Junction box for electrical connection on housing and receptacle for motor plug-in.

F. Accessories:

1. Variable-Speed Controller: Solid-state control to reduce speed from 100 percent to less than 50 percent.
2. Manufacturer's standard roof jack or wall cap, and transition fittings.
3. Isolation: Rubber-in-shear vibration isolators.
4. Additional accessories as noted on the exhaust fan equipment schedules.

2.4 PROPELLER FANS

A. Description: Belt-driven propeller fans consisting of fan blades, hub, housing, orifice ring, motor, drive assembly, and accessories.

B. Housing: Galvanized-steel sheet with flanged edges and integral orifice ring with baked-enamel finish coat applied after assembly.

C. Steel Fan Wheels: Formed-steel blades riveted to heavy-gage steel spider bolted to cast-iron hub.

D. Fan Wheel: Replaceable, cast-aluminum, airfoil blades fastened to cast-aluminum hub; factory set pitch angle of blades.

E. Belt-Driven Drive Assembly: Resiliently mounted to housing, statically and dynamically balanced and selected for continuous operation at maximum rated fan speed and motor horsepower, with final alignment and belt adjustment made after installation.

1. Service Factor Based on Fan Motor Size: 1.4.
2. Fan Shaft: Turned, ground, and polished steel; keyed to wheel hub.
3. Shaft Bearings: Permanently lubricated, permanently sealed, self-aligning ball bearings.

    a. Ball-Bearing Rating Life: ABMA 9, L_{10} of 100,000 hours.

4. Pulleys: Cast iron with split, tapered bushing; dynamically balanced at factory.
5. Motor Pulleys: Adjustable pitch for use with motors through 5 hp; fixed pitch for use with larger motors. Select pulley so pitch adjustment is at the middle of adjustment range at fan design conditions.

6. Belts: Oil resistant, nonsparking, and nonstatic; matched sets for multiple belt drives.
7. Belt Guards: Fabricate of steel for motors mounted on outside of fan cabinet.

F. Accessories:

1. Gravity Shutters: Aluminum blades in aluminum frame; interlocked blades with nylon bearings.
2. Motor-Side Back Guard: Galvanized steel, complying with OSHA specifications, removable for maintenance.
3. Wall Sleeve: Galvanized steel to match fan and accessory size.
4. Weathershield Hood: Galvanized steel to match fan and accessory size.
5. Weathershield Front Guard: Galvanized steel with expanded metal screen.
6. Variable-Speed Controller: Solid-state control to reduce speed from 100 to less than 50 percent.
7. Disconnect Switch: Nonfusible type, with thermal-overload protection mounted inside fan housing, factory wired through an internal aluminum conduit.

2.5 IN-LINE CENTRIFUGAL FANS

A. Description: In-line, belt or direct-driven centrifugal fans consisting of housing, wheel, outlet guide vanes, fan shaft, bearings, motor and disconnect switch, drive assembly, mounting brackets, and accessories.

B. Housing: Split, spun aluminum with aluminum straightening vanes, inlet and outlet flanges, and support bracket adaptable to floor, side wall, or ceiling mounting.

C. Direct-Driven Units: Motor encased in housing outside of airstream, factory wired to disconnect switch located on outside of fan housing.

D. Belt-Driven Units: Motor mounted on adjustable base, with adjustable sheaves, enclosure around belts within fan housing, and lubricating tubes from fan bearings extended to outside of fan housing.

E. Fan Wheels: Aluminum, airfoil blades welded to aluminum hub.

F. Accessories:

1. Volume-Control Damper: Manually operated with quadrant lock, located in fan outlet.
2. Companion Flanges: For inlet and outlet duct connections.
3. Fan Guards: 1/2- by 1-inch mesh of galvanized steel in removable frame. Provide guard for inlet or outlet for units not connected to ductwork.
4. Motor and Drive Cover (Belt Guard): Epoxy-coated steel.

2.6 Additional accessories as noted on the exhaust fan schedules.

2.7 MOTORS

A. Refer to Division 15 Section "Motors" for general requirements for factory-installed motors.

B. Motor Construction: NEMA MG 1, general purpose, continuous duty, Design B.

C. Enclosure Type: TEFC.

2.8 SOURCE QUALITY CONTROL

A. Sound-Power Level Ratings: Comply with AMCA 301, "Methods for Calculating Fan Sound Ratings from Laboratory Test Data." Factory test fans according to AMCA 300, "Reverberant Room Method for Sound Testing of Fans." Label fans with the AMCA-Certified Ratings Seal.

B. Fan Performance Ratings: Establish flow rate, pressure, power, air density, speed of rotation, and efficiency by factory tests and ratings according to AMCA 210, "Laboratory Methods of Testing Fans for Rating."

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install power ventilators level and plumb.

B. Secure roof-mounting fans to roof curbs with cadmium-plated hardware. Refer to Division 07 Section "Roof Accessories" for installation of roof curbs.

C. Ceiling Units: Suspend units from structure; use steel wire or metal straps.

D. Provide one additional exhaust fan similar to EF-8 as scheduled on the drawings to be used as directed by the Engineer.

E. Support suspended units from structure using threaded steel rods and spring hangers with vertical-limit stops having a static deflection of 1 inch. Vibration-control devices are specified in Division 23 Section "Vibration and Seismic Controls for HVAC Piping and Equipment."

F. Install units with clearances for service and maintenance.

G. Label units according to requirements specified in Division 23 Section "Identification for HVAC Piping and Equipment."

3.2 CONNECTIONS

A. Duct installation and connection requirements are specified in other Division 23 Sections. Drawings indicate general arrangement of ducts and duct accessories. Make final duct connections with flexible connectors. Flexible connectors are specified in Division 23 Section "Air Duct Accessories."

B. Install ducts adjacent to power ventilators to allow service and maintenance.

C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."

D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

3.3 FIELD QUALITY CONTROL

A. Perform the following field tests and inspections and prepare test reports:

1. Verify that shipping, blocking, and bracing are removed.
2. Verify that unit is secure on mountings and supporting devices and that connections to ducts and electrical components are complete. Verify that proper thermal-overload protection is installed in motors, starters, and disconnect switches.
3. Verify that cleaning and adjusting are complete.
4. Disconnect fan drive from motor, verify proper motor rotation direction, and verify fan wheel free rotation and smooth bearing operation. Reconnect fan drive system, align and adjust belts, and install belt guards.
5. Adjust belt tension.
6. Adjust damper linkages for proper damper operation.
7. Verify lubrication for bearings and other moving parts.
8. Verify that manual and automatic volume control and fire and smoke dampers in connected ductwork systems are in fully open position.
9. Disable automatic temperature-control operators, energize motor and adjust fan to indicated rpm, and measure and record motor voltage and amperage.
10. Shut unit down and reconnect automatic temperature-control operators.
11. Remove and replace malfunctioning units and retest as specified above.

B. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

3.4 ADJUSTING

A. Adjust damper linkages for proper damper operation.

B. Adjust belt tension.

C. Refer to Division 23 Section "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing procedures.

D. Replace fan and motor pulleys as required to achieve design airflow.

E. Lubricate bearings.

END OF SECTION 233423

SECTION 233713 - DIFFUSERS, REGISTERS AND GRILLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes ceiling- and wall-mounted diffusers, registers, and grilles.

B. Related Sections:
   1. Division 23 Section "Air Duct Accessories" for fire and smoke dampers and volume-control dampers not integral to diffusers, registers, and grilles.
   2. Division 23 Section "Testing, Adjusting, and Balancing for HVAC" for balancing diffusers, registers and grilles.

1.3 SUBMITTALS

A. Product Data: For each type of product indicated, include the following:

   1. Data Sheet: Indicate materials of construction, finish, and mounting details; and performance data including throw and drop, static-pressure drop, and noise ratings.
   2. Diffuser, Register, and Grille Schedule: Indicate drawing designation, room location, quantity, model number, size, and accessories furnished.

B. Samples for Initial Selection: For diffusers, registers, and grilles with factory-applied color finishes.

C. Samples for Verification: For diffusers, registers, and grilles, in manufacturer's standard sizes to verify color selected.

D. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from Installers of the items involved:

   1. Ceiling suspension assembly members.
   2. Method of attaching hangers to building structure.
   3. Size and location of initial access modules for acoustical tile.
   4. Ceiling-mounted items including lighting fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.

5. Duct access panels.

E. Source quality-control reports.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
   1. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

B. Manufacturers:
   1. Titus
   2. Tuttle & Bailey
   3. Price (Basis of Design)
   4. Krueger

2.2 SOURCE QUALITY CONTROL

A. Verification of Performance: Rate diffusers, registers, and grilles according to ASHRAE 70, "Method of Testing for Rating the Performance of Air Outlets and Inlets."

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine areas where diffusers, registers, and grilles are to be installed for compliance with requirements for installation tolerances and other conditions affecting performance of equipment.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

A. Install diffusers, registers, and grilles level and plumb.

B. Ceiling-Mounted Outlets and Inlets: Drawings indicate general arrangement of ducts, fittings, and accessories. Air outlet and inlet locations have been indicated to achieve design requirements for air volume, noise criteria, airflow pattern, throw, and pressure drop. Make final locations where indicated, as much as practical. For units installed in lay-in ceiling panels, locate units in the center of panel. Where architectural features or

other items conflict with installation, notify Architect for a determination of final location.

C. Provide an additional five diffusers/registers of each type and size used on the project to accommodate ductwork revisions required to resolve interferences or as directed by the Engineer.

D. Install diffusers, registers, and grilles with airtight connections to ducts and to allow service and maintenance of dampers, air extractors, and fire dampers.

3.3 ADJUSTING

A. After installation, adjust diffusers, registers, and grilles to air patterns indicated, or as directed, before starting air balancing.

3.4 CLEANING

A. After installation of diffusers, registers, and grilles, inspect exposed finish. Clean exposed surfaces to remove burrs, dirt, and smudges. Replace diffusers, registers, and grilles that have damaged finishes.

END OF SECTION 233713

SECTION 235523 – NATURAL GAS RADIANT HEATERS

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes gas-fired, tubular infrared radiant heaters.

1.2 SUBMITTALS

A. Product Data: For each type of gas-fired radiant heater indicated. Include rated capacities, operating characteristics, and accessories.

B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.

1. Wiring Diagrams: Power, signal, and control wiring.

C. Field quality-control test reports.

D. Operation and maintenance data.

1.3 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

1.4 WARRANTY

A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of gas-fired radiant heater that fails in materials or workmanship within specified warranty period.

1. Warranty Period: Two years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 TUBULAR INFRARED HEATERS

A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Solaronics, Inc..
2. Combustion Research Corporation.
3. Reznor/Thomas & Betts Corporation.
4. Sterling HVAC Products; Div. of Mestek Technology Inc.

B. Description: Factory assembled, piped, and wired, and complying with ANSI Z83.20/CSA 2.34.

C. Fuel Type: Design burner for natural gas having characteristics same as those of gas available at Project site.

D. Combustion Tubing: 4-inch- diameter 14 gauge aluminized titanium alloy steel with high-emissivity, high-temperature, corrosion-resistant black coating. Turbulator shall be factory installed in the last ten feet of heat exchanger for optimal turbulation.

E. Tubing Connections: Stainless-steel couplings or flared joints with stainless-steel draw bolts.

F. Reflector: 0.025" thickness #3003H25 aluminum bright finish having a geometrically designed configuration not having less than 91.7% reflectional efficiency. Deflectors shall be independently rotatable from 0 to 30 degrees without disassembly and be removable without tools..

1. Reflector Extension Shields: Same material as reflectors, arranged for fixed connection to lower reflector lip and rigid support to provide 100 percent cutoff of direct radiation from tubing at angles greater than 30 degrees from vertical.
2. Include hanger kit.

G. Burner Safety Controls:

1. Gas Control Valve: Single-stage, regulated redundant 24-V ac gas valve containing pilot solenoid valve, electric gas valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff all in one body.
2. Blocked Vent Safety: Differential pressure switch in burner safety circuit to stop burner operation with high discharge or suction pressure.
3. Control Panel Interlock: Stops burner if panel is open.
4. Indicator Lights: Burner-on indicator light.

H. Burner and Emitter Type: Gravity-vented power burner, with the following features:

1. Venting: Connector at exit end of emitter tubing for vent-pipe connection.

   a. Vent Terminal: Vertical.

2. Burner/Ignition: Stainless-steel burner cup and head with balanced-rotor draft fan and spark ignition with electronic flame supervision.
3. Burner Lightoff Inspection Window: The burner shall have an inspection window to permit observation from floor level of the spark and burner lightoff.

2.2 CONTROLS

A. Thermostat: Single-stage, wall-mounting type with 50 to 90 deg F operating range and fan on switch.

1. Control Transformer: Integrally mounted.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install and connect gas-fired radiant heaters and associated fuel and vent features and systems according to NFPA 54, applicable local codes and regulations, and manufacturer's written installation instructions.

B. Suspended Units: Suspend from substrate using chain hanger kits and building attachments.

C. Maintain manufacturers' recommended clearances to combustibles.

D. Install piping adjacent to gas-fired radiant heaters to allow service and maintenance.

E. Gas Piping: Comply with Division 15 Section "Fuel Gas Piping." Connect gas piping to gas train inlet; provide union with enough clearance for burner removal and service.

F. Vent Connections: Comply with Division 15 Section "Breechings, Chimneys, and Stacks."

G. Electrical Connections: Comply with applicable requirements in Division 16 Sections.

1. Install electrical devices furnished with heaters but not specified to be factory mounted.

H. Adjust initial temperature set points.

I. Adjust burner and other unit components for optimum heating performance and efficiency.

3.2 FIELD QUALITY CONTROL

A. Tests and Inspections: Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

END SECTION 235523

SECTION 235533 – NATURAL GAS UNIT HEATERS

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes gas -fired unit heaters.

1.2 SUBMITTALS

A. Product Data: For each type of fuel-fired unit heater indicated. Include rated capacities, operating characteristics, and accessories.

B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.

1. Wiring Diagrams: Power and control wiring.

C. Field quality-control test reports.

D. Operation and maintenance data.

1.3 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

1.4 WARRANTY

A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace heat exchanger of fuel-fired unit heater that fails in materials or workmanship within specified warranty period.

1. Warranty Period: two (2) years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 GAS-FIRED UNIT HEATERS

A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

B. Basis-of-Design Product: Subject to compliance with requirements a comparable product by one of the following:

1. Reznor/Thomas & Betts Corporation. (Basis of Design)
2. Lennox Industries, Inc.
3. Modine Manufacturing Company.
4. Sterling HVAC Products; Div. of Mestek Technology Inc.

C. Description: Factory assembled, piped, and wired, and complying with ANSI Z83.8/CSA 2.6.

D. Fuel Type: Design burner for natural gas having characteristics same as those of gas available at Project site.

E. Type of Venting: separated combustion, power vented.

F. Housing: Steel, with integral draft hood and inserts for suspension mounting rods.

G. Heat Exchanger: Stainless steel.

H. Unit Fan: Propeller blades riveted to heavy-gage steel spider bolted to cast-iron hub, dynamically balanced, and resiliently mounted.

I. Controls: Regulated redundant gas valve containing pilot solenoid valve, electric gas valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff all in one body.

1. Gas Control Valve: Two stage.
2. Ignition: Electronically controlled electric spark with flame sensor.
3. Fan Thermal Switch: Operates fan on heat-exchanger temperature.
4. Vent Flow Verification: Flame rollout switch.
5. Control transformer.
6. High Limit: Thermal switch or fuse to stop burner.
7. Thermostat: 2-stage, wall-mounting type with 50 to 90 deg F (10 to 32 deg C) operating range and fan on switch.

J. Discharge Louvers: Independently adjustable horizontal blades.

K. Accessories:

1. Vertical discharge louvers.
2. Discharge Nozzle: Discharge at 25 to 65 degrees from horizontal.
3. Four-point suspension kit.
4. Summer fan switch.
5. Unit-mounted thermostat bracket.
6. Power Venter: Centrifugal aluminized-steel fan, with stainless-steel shaft; 120-V ac motor.

7. Concentric, Terminal Vent Assembly: Combined combustion-air inlet and power-vent outlet with wall or roof caps. Include adapter assembly for connection to inlet and outlet pipes, and flashing for wall or roof penetration.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install and connect gas-fired unit heaters and associated fuel and vent features and systems according to NFPA 54, applicable local codes and regulations, and manufacturer's written installation instructions.

B. Install and connect oil-fired unit heaters and associated fuel and vent piping according to NFPA 31, applicable local codes and regulations, and manufacturer's written installation instructions.

C. Suspended Units: Suspend from substrate using threaded rods, spring hangers, and building attachments. Secure rods to unit hanger attachments. Adjust hangers so unit is level and plumb.

D. Install piping adjacent to fuel-fired unit heater to allow service and maintenance.

E. Gas Piping: Comply with Division 23 Section "Facility Natural-Gas Piping." Connect gas piping to gas train inlet; provide union with enough clearance for burner removal and service.

F. Electrical Connections: Comply with applicable requirements in Division 26 Sections.

1. Install electrical devices furnished with heaters but not specified to be factory mounted.

G. Adjust initial temperature set points.

H. Adjust burner and other unit components for optimum heating performance and efficiency.

3.2 FIELD QUALITY CONTROL

A. Tests and Inspections: Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

END OF SECTION 235533

SECTION 238233 – ELECTRIC BASEBOARD RADIATION

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes:

1. Electric baseboard radiators.

1.2 SUBMITTALS

A. Product Data: For each type of product indicated. Include rated capacities, furnished specialties, and accessories.

B. Shop Drawings: Diagram power, signal, and control wiring.

C. Samples for Initial Selection: For units with factory-applied color finishes.

D. Field quality-control test reports.

E. Operation and Maintenance Data: For electric radiators to include in maintenance manuals.

F. Warranties: Special warranties specified in this Section.

1.3 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

PART 2 - PRODUCTS

2.1 BASEBOARD RADIATORS

A. Manufacturers:

1. Chromalox, Inc.; a division of Emerson Electric Company.
2. Markel Products; a division of TPI Corporation. (Basis of Design)
3. Trane.

B. Heating Elements: Nickel-chromium heating wire element enclosed in metallic sheath mechanically expanded into fins, with high-temperature cutout. Element supports eliminate thermal expansion noise.

C. Enclosures: One piece, steel, with full-height back, full-length damper, end panel, end caps, corners, and joiner pieces to snap together. Front panel shall be easily removable.

1. Enclosure Height: 6 inches.
2. Finish: Factory-applied baked enamel in color selected by Architect from manufacturer's standard colors.
3. Element Brackets: Galvanized steel to support front panel and element glide.

D. Unit Controls: Integral electronic thermostat.

E. Capacity: as scheduled.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine roughing-in for electric radiators to verify actual locations of electrical connections before equipment installation.

B. Examine walls for suitable conditions where electric radiators will be installed.

C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

A. Install electric baseboard level and plumb and according to the following, unless otherwise indicated:

1. Install continuously around corners, using manufacturer's outside and inside corner fittings.
2. Join sections with manufacturer's splicer, plates, and filler pieces to provide continuous cabinet.
3. Install manufacturer's access fitting in cabinets for access to electrical connections, controls, and other fittings.
4. Terminate enclosures with manufacturer's end caps.

3.3 CONNECTIONS

A. Ground equipment according to Division 16 Section "Grounding and Bonding."

B. Connect wiring according to Division 16 Section "Conductors and Cables."

C. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

3.4 FIELD QUALITY CONTROL

A. Testing: Perform the following field quality-control testing and prepare test reports:

1. Operate electric heating elements through each stage to verify proper operation and electrical connections.
2. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

END OF SECTION 238233

SECTION 260500 - COMMON WORK REQUIREMENTS FOR ELECTRICAL

1.1 SUMMARY

A. This Section includes the following:

1. Raceways.
2. Building wire and connectors.
3. Supporting devices for electrical components.
4. Electrical identification.
5. Utility company electricity-metering components.
6. Concrete equipment bases.
7. Electrical demolition.
8. Cutting and patching for electrical construction.

1.2 SUBMITTALS

A. Product Data: For utility company electricity-metering components.

B. Shop Drawings: Dimensioned plans and sections or elevation layouts and single-line diagram of electricity-metering component assemblies specific to this Project.

1.3 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

B. The contractor shall be fully responsible for all coordination of the electrical work required to meet the design intent and the scope of work related to the project. This includes but not limited to all other trades, material handling, equipment rentals, tools, automobiles, parking and travel expenses, engineering review and consult, as-built drawings and any/all construction site requirements that are necessary to provide a turnkey electrical installation.

C. The 'Basis of Design' is the product that is specified which supports the design data contained within the contract documents. Should the contractor elect to use an alternate manufacturer listed within the specifications the contractor is still required to meet the full intent and specifications and the contract documents. Any deviation of the contract documents will be the sole responsibility of the contractor to maintain specification requirements at no additional cost to the owner.

D. It shall be the contractor's responsibility to acknowledge any long lead delivery items with written response from the manufacturer, at the time of Notice to Proceed. Should

the contractor fail to inform the client and the A/E of any material or equipment delays at the time Notice to Proceed has been given, the contractor will take full responsibility in completing the project in the same allowed construction period, based on the approved construction schedule.

E. The contractor shall be fully responsible in the coordination and installation of all electrical products as per the manufacturer's recommendations. Should the contractor alter or change the manufacturer's installation recommendations, the contractor shall submit a certified installation report from the manufactures representative stating the installed is acceptable. Any discrepancies in the installation shall be corrected per the manufacturer's requirements at no additional cost to the owner and before final closeout of the project.

F. Devices for Utility Company Electricity Metering: Comply and coordinate with local utility company requirements and Specification Section 262713 – Electricity Metering.

G. Comply with NFPA 70.

1.4 COORDINATION

A. The contractor shall be fully responsible for the coordination of all electrical work required to meet the design intent and the scope of work related to the project. This includes but not limited to all other trades, material handling, equipment rentals, rigging equipment, cranes, high reach man lifts, tools, automobiles, parking and travel expenses, engineering review and consult, as-built drawings and any/all construction site requirements that are necessary to provide a turnkey electrical installation.

B. Coordinate chases, slots, inserts, sleeves, and openings with general construction work and arrange in building structure during progress of construction to facilitate the electrical installations that follow.

1. Set inserts and sleeves in poured-in-place concrete, masonry work, and other structural components as they are constructed.

C. Sequence, coordinate, and integrate installing electrical materials and equipment for efficient flow of the Work. Coordinate installing large equipment requiring positioning before closing in the building.

D. Coordinate electrical service connections to components furnished by utility companies.

1. Coordinate installation and connection of exterior underground and overhead utilities and services, including provision for electricity-metering components.
2. Comply with requirements of authorities having jurisdiction and of utility company providing electrical power and other services.

E. Devices for Utility Company Electricity Metering: Comply and coordinate with local utility company requirements and published standards.

F. Coordinate location of access panels and doors for electrical items that are concealed by finished surfaces.

G. Where electrical identification devices are applied to field-finished surfaces, coordinate installation of identification devices with completion of finished surface.

H. Where electrical identification markings and devices will be concealed by acoustical ceilings and similar finishes, coordinate installation of these items before ceiling installation.

I. The contractor shall field verify all existing conductor phasing for each individual circuit feeder whether it be primary or secondary feeds to and from the new electrical equipment. The contractor is fully responsible for tagging and phasing all branch circuits. Any disruption or equipment failure caused by phase crossing shall be the full responsibility of the contractor to replace and or repair any/all damages that may occur at no additional cost.

1.5 ITEMS NOT SHOWN OR SPECIFIED

A. Any item of material not indicated on the drawings and/or not specified, but which is required for the complete and proper installation and/or operation of any part of the work, shall be provided as if indicated and specified, at no additional cost to the Owner.

B. Any work not indicated on the drawings and/or not specified, but which is required for compliance with applicable codes and regulations, shall be provided as if indicated and specified, at no additional cost to the Owner.

PART 2 - PRODUCTS

2.1 RACEWAYS

A. EMT: Electrical metallic tubing; ANSI C80.3, zinc-coated steel, with compression fittings.

B. FMC: Flexible metal conduit; zinc-coated steel.

C. IMC: Intermediate metal conduit; ANSI C80.6, zinc-coated steel, with threaded fittings.

D. LFMC: Liquidtight flexible metal conduit; zinc-coated steel with sunlight-resistant and mineral-oil-resistant plastic jacket.

E. RMC: Rigid metal conduit; galvanized rigid steel; ANSI C80.1.

F. RNC: Rigid nonmetallic conduit; NEMA TC 2, Schedule 40 PVC, with NEMA TC3 fittings.

G. Raceway Fittings: Specifically designed for raceway type with which used.

2.2 WIRES, CABLES, AND CONNECTIONS

A. Conductors, No. 10 AWG and Smaller: Solid or stranded copper.

B. Conductors, Larger Than No. 10 AWG: Stranded copper.

C. Insulation: Thermoplastic, rated 600 V, 75 deg C minimum, Type THW, THHN-THWN, or USE depending on application..

D. Wire Connectors and Splices: Units of size, ampacity rating, material, type, and class suitable for service indicated.

2.3 SUPPORTING DEVICES

A. Material: Cold-formed steel, with corrosion-resistant coating.

B. Metal Items for Use Outdoors or in Damp Locations: Hot-dip galvanized steel.

C. Slotted-Steel Channel: Flange edges turned toward web, and 9/16-inch- (14-mm-) diameter slotted holes at a maximum of 2 inches (50 mm) o.c., in webs. Strength rating to suit structural loading.

D. Nonmetallic Slotted Channel and Angle: Structural-grade, factory-formed, glass-fiber-resin channels and angles with 9/16-inch- (14-mm-) diameter holes at a maximum of 8 inches (203 mm) o.c., in at least one surface. Strength rating to suit structural loading.

E. Slotted Channel Fittings and Accessories: Recommended by the manufacturer for use with the type and size of channel with which used.

1. Materials: Same as channels and angles, except metal items may be stainless steel.

F. Raceway and Cable Supports: Manufactured clevis hangers, riser clamps, straps, threaded C-clamps with retainers, ceiling trapeze hangers, wall brackets, and spring-steel clamps or click-type hangers.

G. Pipe Sleeves: ASTM A 53, Type E, Grade A, Schedule 40, galvanized steel, plain ends.

H. Cable Supports for Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug for nonarmored electrical cables in riser conduits. Plugs have number and size of conductor gripping holes as required to suit individual risers. Body constructed of malleable-iron casting with hot-dip galvanized finish.

I. Expansion Anchors: Carbon-steel wedge or sleeve type.

J. Toggle Bolts: All-steel springhead type.

K. Powder-Driven Threaded Studs: Heat-treated steel.

2.4 ELECTRICAL IDENTIFICATION

A. Identification Device Colors: Use those prescribed by ANSI A13.1, NFPA 70, and these Specifications.

B. Colored Adhesive Marking Tape for Raceways, Wires, and Cables: Self-adhesive vinyl tape, not less than 1 inch wide by 3 mils thick (25 mm wide by 0.08 mm thick).

C. Tape Markers for Conductors: Vinyl or vinyl-cloth, self-adhesive, wraparound type with preprinted numbers and letters.

D. Color-Coding Cable Ties: Type 6/6 nylon, self-locking type. Colors to suit coding scheme.

E. Underground Warning Tape: Permanent, bright-colored, continuous-printed, vinyl tape compounded for permanent direct-burial service, and with the following features:

1. Not less than 6 inches wide by 4 mils thick (150 mm wide by 0.102 mm thick).
2. Embedded continuous metallic strip or core.
3. Printed legend that indicates type of underground line.

F. Engraved-Plastic Labels, Signs, and Instruction Plates: Engraving stock, melamine plastic laminate punched or drilled for mechanical fasteners 1/16-inch (1.6-mm) minimum thickness for signs up to 20 sq. in. (129 sq. cm) and 1/8-inch (3.2-mm) minimum thickness for larger sizes. Engraved legend in black letters on white background.

G. Warning and Caution Signs: Preprinted; comply with 29 CFR 1910.145, Chapter XVII. Colors, legend, and size appropriate to each application.

1. Interior Units: Aluminum, baked-enamel-finish, punched or drilled for mechanical fasteners.
2. Exterior Units: Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate with 0.0396-inch (1-mm), galvanized-steel backing. 1/4-inch (6-mm) grommets in corners for mounting.

H. Fasteners for Nameplates and Signs: Self-tapping, stainless-steel screws or No. 10/32 stainless-steel machine screws with nuts and flat and lock washers.

2.5 EQUIPMENT FOR UTILITY COMPANY'S ELECTRICITY METERING

A. Comply with requirements of the local electrical power utility company for meter sockets and current transformer cabinet and as per Specification Section 262713 – Electricity Metering.

B. Provide Cold Sequence Meter Protection Switch as required by the Local Utility Company.

C. The contractor shall coordinate and provide any/all metering equipment for low and medium voltage equipment provisions not directly supplied by the local utility company.

2.6 CONCRETE BASES

A. Provide 6" high concrete sub-bases for all floor mounted electrical equipment within spaces that are below exterior finished grade and/or in spaces that are installed where water or liquids may be dispersed from local equipment or building appurtenances.

B. Where concrete bases are required, provide approved anchoring systems and methods to apply the base to the flooring and for the equipment being supported.

PART 3 - EXECUTION

3.1 ELECTRICAL EQUIPMENT INSTALLATION

A. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom.

B. Materials and Components: Install level, plumb, and parallel and perpendicular to other building systems and components, unless otherwise indicated.

C. Equipment: Install to facilitate service, maintenance, and repair or replacement of components. Connect for ease of disconnecting, with minimum interference with other installations.

D. Electrical equipment shall be installed at elevations where the disconnecting means is not greater than 6'-6" above the accessible, working floor elevation (unless noted otherwise).

E. Right of Way: Give to raceways and piping systems installed at a required slope.

3.2 RACEWAY APPLICATION

A. Outdoor Installations:

1. Exposed: RMC.
2. Concealed: RNC.
3. Underground, Single Run: RNC.
4. Underground, Grouped: RNC.
5. Connection to Vibrating Equipment: LFMC.
6. Boxes and Enclosures: NEMA 250, Type 3R or Type 4, unless otherwise indicated.

B. Indoor Installations:

1. Exposed: EMT except in wet or damp locations, use IMC.
2. Concealed in Walls or Ceilings: FMC.
3. In Concrete Slab: RNC.
4. Below Slab on Grade or in Crawlspace: RNC
5. Connection to Vibrating Equipment: FMC; except in wet or damp locations: LFMC.
6. Boxes and Enclosures: NEMA 250, Type 1, unless otherwise indicated.

3.3 RACEWAY AND CABLE INSTALLATION

A. Conceal raceways and cables, unless otherwise indicated, within finished walls, ceilings, and floors.

B. Keep legs of raceway bends in the same plane and keep straight legs of offsets parallel.

C. Use RMC elbows where RNC turns out of slab.

D. Where required to provide a Rough-in Only device application concealed within the vertical walls the contractor shall provide the device work box and ¾" EMT raceway to above the ceiling with a 90 degree bend turned into the ceiling space and apply an open end plastic bushing or cap for future wiring application.

E. Install pull wires in empty raceways. Use No. 14 AWG zinc-coated steel or woven polypropylene or monofilament plastic line with not less than 200-lb (90-kg) tensile strength. Leave at least 12 inches (300 mm) of slack at each end of pull wires.

F. Connect motors and equipment subject to vibration, noise transmission, or movement with a maximum of 72-inches (1830-mm) flexible conduit. Install LFMC in wet or damp locations. Install separate ground conductor across flexible connections.

3.4 WIRING METHODS FOR POWER, LIGHTING, AND CONTROL CIRCUITS

A. Application: Use wiring methods specified below to the extent permitted by applicable codes as interpreted by authorities having jurisdiction.

B. Exposed Feeders: Insulated single conductors in raceway.

C. Concealed Feeders in Concrete: Insulated single conductors in PVC raceway.

D. Exposed Branch Circuits Insulated single conductors in raceway.

E. Concealed Branch Circuits: Insulated single conductors in FMC raceway.

F. Underground Feeders and Branch Circuits: Insulated single conductors in raceway.

G. Remote-Control Signaling and Power-Limited Circuits, Classes 1, 2, and 3: Insulated conductors in FMC raceway unless otherwise indicated.

H. Provide PVC pipe sleeves for all non-fire rated interior masonry and below grade wall penetrations. Provide caulk/sealant of all wall penetrations installed.

I. Provide Rigid metallic pipe sleeves for all fire rated masonry and exterior wall penetrations. Provide the rated fire caulk/sealant for all wall penetrations that match the rating of the fire wall.

3.5 WIRING INSTALLATION

A. The contractor shall minimize all wire splices or taps. Should the need to provide splices or taps provide materials that are compatible with the connecting conductor material and that possess equivalent or better mechanical strength and insulation ratings than un-spliced conductors.

B. Unless specified otherwise the contractor shall not exceed four (4) current carrying conductors plus ground in a single raceway.

3.6 ELECTRICAL SUPPORTING DEVICE APPLICATION

A. Damp Locations and Outdoors: Hot-dip galvanized materials or nonmetallic, slotted channel system components.

B. Dry Locations: Steel materials.

C. Strength of Supports: Adequate to carry present and future loads, times a safety factor of at least four with, 200-lb (90-kg) minimum design load for each support element.

3.7 SUPPORT INSTALLATION

A. Support parallel runs of horizontal raceways together on trapeze- or bracket-type hangers.

B. Size supports for multiple raceway or cable runs so capacity can be increased by a 25 percent minimum in the future.

C. Support individual horizontal single raceways with separate, malleable-iron pipe hangers or clamps.

D. Install sleeves for cable and raceway penetrations of concrete slabs and walls unless core-drilled holes are used in existing walls or floors. Install sleeves for cable and raceway penetrations of masonry and fire-rated gypsum walls and of all other fire-rated floor and wall assemblies. Install sleeves during erection of concrete and masonry walls.

E. Secure electrical items and their supports to building structure, using the following methods unless other fastening methods are indicated:

1. Wood: Wood screws or screw-type nails.
2. Gypsum Board: Toggle bolts. Seal around sleeves with joint compound, both sides of wall.
3. Masonry: Toggle bolts on hollow block and expansion bolts on solid block. Seal around sleeves with mortar, both sides of wall.
4. New Concrete: Concrete inserts with machine screws and bolts.
5. Existing Concrete: Expansion bolts or threaded studs driven by powder charge and provided with lock washers.
6. Structural Steel: Welded threaded studs.

    a. Comply with AWS D1.1 for field welding.

7. Light Steel Framing: Sheet metal screws.
8. Fasteners for Damp, Wet, or Weather-Exposed Locations: Stainless steel.
9. Light Steel: Sheet-metal screws.
10. Fasteners: Select so load applied to each fastener does not exceed 25 percent of its proof-test load.

3.8 FIRESTOPPING

A. Apply firestopping to cable and raceway sleeves and other penetrations of fire-rated floor and wall assemblies to restore original undisturbed fire-resistance ratings of assemblies.

3.9 DEMOLITION

A. Protect existing electrical equipment and installations indicated to remain. If damaged or disturbed in the course of the Work, remove damaged portions and install new products of equal capacity, quality, and functionality.

B. Accessible Work: Remove exposed electrical equipment and installations, indicated to be demolished, in their entirety and back to electrical panel source..

C. Abandoned Work: Cut and remove buried raceway and wiring, indicated to be abandoned in place, 2 inches (50 mm) below the surface of adjacent construction. Cap raceways and patch surface to match existing finish.

D. Remove, store, clean, reinstall, reconnect, and make operational components indicated for relocation.

3.10 TEMPORARY ELECTRICAL POWER / SERVICES

A. Provide all necessary temporary electrical construction power by either a temporary service power pole or by portable generator to maintain adequate electrical power requirements for the duration of construction, at no additional cost to the project or owner.

B. Should the project include demolition or disruption of an existing electrical service the contractor shall provide temporary back-up power source and connection that meets the demand requirements of the disturbed service at no additional cost to the project or owner.

3.11 CUTTING AND PATCHING

A. Cut, channel, chase, and drill floors, walls, partitions, ceilings, and other surfaces required to permit electrical installations. Perform cutting by skilled mechanics of trades involved.

B. Repair, refinish and touch up disturbed finish materials and other surfaces to match adjacent undisturbed surfaces.

END OF SECTION 260500

SECTION 260519 - CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes building wires and cables and associated connectors, splices, and terminations for wiring systems rated 600 V and less.

1.3 SUBMITTALS

A. Field Test Reports: Indicate and interpret test results for compliance with performance requirements.

1.4 QUALITY ASSURANCE

A. Listing and Labeling: Provide wires and cables specified in this Section that are listed and labeled.

1. The Terms "Listed" and "Labeled" as defined in NFPA 70, Article 100.
2. Listing and Labeling Agency Qualifications: A "Nationally Recognized Testing Laboratory" as defined in OSHA Regulation 1910.7.

B. Comply with NFPA 70.

1.5 DELIVERY, STORAGE AND HANDLING

A. Deliver wires and cables according to NEMA WC 26.

1.6 COORDINATION

A. Coordinate layout and installation of cables with other installations.
B. Revise locations and elevations from those indicated, as required to suit field conditions and as approved by Engineer.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the manufacturers specified.

2.2 CONDUCTORS AND CABLES

A. Manufacturers:

1. American Insulated Wire Corp.; a Leviton Company.
2. General Cable Corporation.
3. Rome Cable Company.

B. Refer to Part 3 "Conductor and Insulation Applications" Article for insulation type, cable construction, and ratings.

C. Conductor Material: Copper complying with NEMA WC 5 or 7; solid conductor for No. 10 AWG and smaller, stranded for No. 8 AWG and larger.

D. Conductor Insulation Types: Type THW, THHN-THWN, XHHW and SO complying with NEMA WC 5 or 7.

E. Conductor Insulation Type: Type XHHW where used exterior and below grade or in extreme wet location areas.

F. Multi-conductor Cable: Armored cable Type FAC, Metal-clad cable Type FMC, and Type SO with ground wire. Armor shall be steel interlocked covering in NEMA 1 applications.

2.3 CONNECTORS AND SPLICES

A. Manufacturers:

1. AFC Cable Systems, Inc.
2. AMP Incorporated/Tyco International.
3. Hubbell/Anderson.
4. O-Z/Gedney; EGS Electrical Group LLC.
5. 3M Company; Electrical Products Division.

B. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

2.4 HEAT TRACE CABLES AND COMPONENTS

A. Provide a heat trace freeze protection system for above ground piping with a minimum rating of -20°F. Basis of Design: Raychem by Tyco Thermal Controls.

Other Approved Manufacturers:
1. Nelson Heat Trace – Emerson Industrial Automation

B. The Raychem XL-Trace System shall be provided with all required control monitoring devices and 30-mA ground fault protection.device.

C. System shall be UL listed and FM approved for non-hazardous locations. Where hazardous locations apply comply with all current NFPA and EPA requirements.

D. The self regulating, Raychem 12XL2 (12 watt/ft) heating cable shall be permanently secured to the metallic pipes with Raychem GT-66 glass reinforced tape. The cable shall be minimum 20 amp, 208 volt rated.

E. For above ground system include the following devices:
1. Power Connector – RayClip-PC
2. Electronic thermostat – Raychem model EC-TS-AM8.
3. Splices – RayClic-S
4. Tees – RayClic-T
5. End seal – RayClic – E
6. Provide all miscellaneous installation components required by the manufacturer for a turnkey installation.

PART 3 - EXECUTION

3.1 CONDUCTOR AND INSULATION APPLICATIONS

A. Service Entrance: Type THHN-THWN, single conductors in raceway, XHHW, single conductors in raceway.

B. Exposed Feeders in raceway: Type THHN-THWN.

C. Feeders Concealed in Ceilings, Walls, and Partitions: Type THHN-THWN, single conductors in EMT, FAC or FMC raceway.

D. Feeders Concealed in Concrete or below Slabs-on-Grade: Type THHN-THWN, single conductors in PVC raceway.

E. Exposed Branch Circuits, including in Crawlspaces: Type THHN-THWN, single conductors in raceway that meets the crawlspace environment (no FAC or FMC).

F. Branch Circuits Concealed in Ceilings, Walls, and Partitions: Type THHN-THWN, single conductors in raceway, Electrical Metallic Tubing Type EMT, Armored cable Type FAC, or Metal-clad cable Type FMC.

G. Branch Circuits Concealed in Concrete and below Slabs-on-Grade: Type THHN-THWN, single conductors in PVC raceway.

H. Branch circuit homeruns exposed: Type THHN-THWN, single conductors in EMT or RMC.

I. Cord Drops and Portable Appliance Connections: Type SO, hard service cord sized in accordance with the overcurrent protection device (breaker or fuse size) 'not' the amperage rating of the appliance.

J. Exposed Fire Alarm Circuits: Type THHN-THWN, in raceway or Power-limited, fire-protective, signaling circuit cable in steel armor spiral cover, colored red or labeled EMT.

K. Exposed Fire Alarm Circuits where existing architecturally finished wall surfaces exist to remain, the contractor shall provide Surface Mounted Raceway (such as Wiremold).

L. Class 1 Control Circuits: Type THHN-THWN, in raceway.

M. Class 2 Control Circuits: Power-limited cable, concealed in building finishes (above acoustical ceilings and walls).

3.2 INSTALLATION

A. Conceal cables in finished walls, ceilings, and floors, unless otherwise indicated.

B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.

C. Use pulling means; including fish tape, cable, rope, and basket-weave wire/cable grips, which will not damage cables or raceway.

D. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.

E. Support cables according to Division 26 Section "Hangers & Supports"

F. Provide an additional four hundred linear feet of cable/conductor and accessories of each type and size used on the project to accommodate any changes required to resolve interferences as directed by the Engineer.

G. Seal around cables penetrating fire-rated elements according to Division 7 Section "Through-Penetration Firestop Systems."

H. Identify and color-code conductors and cables according to Division 16 Section "Electrical Identification."

3.3 CONNECTIONS

A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

B. Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than un-spliced conductors.
   1. Use oxide inhibitor in each splice and tap conductor for aluminum conductors.

C. Wiring at Outlets: Install conductor at each outlet, with at least 12 inches (300 mm) of slack.

3.4 FIELD QUALITY CONTROL

A. Testing: Perform the following field quality-control testing:
   1. After installing conductors and cables and before electrical circuitry has been energized, test for compliance with requirements.
   2. Perform each electrical test and visual and mechanical inspection stated in NETA ATS, Section 7.3.1. Certify compliance with test parameters.
   3. It is the electrical contractor's responsibility to confirm all wire and cable installations meet the necessary inspections and testing indicated in item 260519-3.4A paragraph #2 of this section. Should any failures be found during or immediately after construction the contractor will be required to provide and third party NETA testing agency to prepare a detailed inspection and approval report detailing all corrective measures at no additional cost. In addition the contractor will be required to replace 100% of all damaged or failing installations at the contractor's expense. Should any work require replacement the contractor will be required to provide at no additional cost another NETA testing inspection to confirm corrective measure have been met.

B. Test Reports: Prepare a written report to record the following should 260519-3.4A paragraph #3 be required:

   1. Test procedures used.
   2. Test results that comply with requirements.
   3. Test results that do not comply with requirements and corrective action taken to achieve compliance with requirements.

END OF SECTION 260519

SECTION 260526 - GROUNDING AND BONDING

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes grounding of electrical systems and equipment. Requirements specified in this Section may be supplemented by requirements of other Sections.

1.2 SUBMITTALS

A. Product Data: For ground rods and chemical rods.

B. Field quality-control test reports.

1.3 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled under UL 467 as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

B. Comply with NFPA 70; for overhead-line construction and medium-voltage underground construction, comply with IEEE C2.

C. Comply with NFPA 780 and UL 96 when interconnecting with lightning protection system.

1.4 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Ground Rods-Provide an additional 4 ground rods of each type and size utilized on this project.
2. Ground Conductors-Provide an additional 150 feet of each ground conductor type and size utilized on this project.
3. Ground Connections-Provide an additional 4 connections of each type and size utilized on this project.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Apache Grounding/Erico Inc.
2. Boggs, Inc.
3. Chance/Hubbell.
4. Copperweld Corp.
5. Dossert Corp.
6. Erico Inc.; Electrical Products Group.
7. Framatome Connectors/Burndy Electrical.
8. Ideal Industries, Inc.
9. ILSCO.
10. Kearney/Cooper Power Systems.
11. Korns, C. C. Co.; Division of Robroy Industries.
12. Lightning Master Corp.
13. Lyncole XIT Grounding.
14. O-Z/Gedney Co.; a business of the EGS Electrical Group.
15. Raco, Inc.; Division of Hubbell.
16. Robbins Lightning, Inc.
17. Salisbury, W. H. & Co.
18. Superior Grounding Systems, Inc.
19. Thomas & Betts, Electrical.

2.2 GROUNDING CONDUCTORS

A. For insulated conductors, comply with Division 16 Section "Conductors and Cables."

B. Equipment Grounding Conductors: Insulated with green-colored insulation.

C. Isolated Ground Conductors: Insulated with green-colored insulation with yellow stripe. On feeders with isolated ground, use colored tape, alternating bands of green and yellow tape to provide a minimum of three bands of green and two bands of yellow.

D. Grounding Electrode Conductors: Stranded cable.

E. Underground Conductors: Bare, tinned, stranded, unless otherwise indicated.

F. Bare, Solid-Copper Conductors: ASTM B 3.

G. Assembly of Bare, Stranded-Copper Conductors: ASTM B 8.

H. Bare, Tinned-Copper Conductors: ASTM B 33.

I. Copper Bonding Conductor: No. 4 or No. 6 AWG, stranded copper conductor.

J. Copper Bonding Jumper: Bare copper tape, braided bare copper conductors, terminated with copper ferrules; 1-5/8 inches (42 mm) wide and 1/16 inch (1.5 mm) thick.

K. Tinned-Copper Bonding Jumper: Tinned-copper tape, braided copper conductors, terminated with copper ferrules; 1-5/8 inches (42 mm) wide and 1/16 inch (1.5 mm) thick.

L. Ground Conductor for Overhead Distribution: No. 4 AWG minimum, soft-drawn copper.

M. Grounding Bus: Bare, annealed copper bars of rectangular cross section, with insulated spacer.

N. Connectors: Comply with IEEE 837 and UL 467; listed for use for specific types, sizes, and combinations of conductors and connected items. Compression type or exothermic-welded type, in kit form, selected per manufacturer's written instructions.

2.3 GROUNDING ELECTRODES

A. Ground Rods: Copper-clad steel.

B. Ground Rods: Sectional type; copper-clad steel.

1. Size: **3/4 by 120 inches (19 by 3000 mm)** in diameter.

C. Chemical Electrodes: Copper tube, straight or L-shaped, filled with nonhazardous chemical salts, terminated with a 4/0 bare conductor. Provide backfill material recommended by manufacturer.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Use only copper conductors for both insulated and bare grounding conductors in direct contact with earth, concrete, masonry, crushed stone, and similar materials.

B. In raceways, use insulated equipment grounding conductors.

C. Exothermic-Welded Connections: Use for connections to structural steel and for underground connections.

D. Grounding Bus: Install in electrical and telephone equipment rooms, in rooms housing service equipment, and elsewhere as indicated.

1. Use insulated spacer; space 1 inch (25.4 mm) from wall and support from wall 6 inches (150 mm) above finished floor, unless otherwise indicated.

2. At doors, route the bus up to the top of the door frame, across the top of the doorway, and down to the indicated height above the floor.

E. Underground Grounding Conductors: Use tinned-copper conductor, No. 2/0 AWG minimum. Bury at least 24 inches (600 mm) below grade or bury 12 inches (300 mm) above duct bank when installed as part of the duct bank.

F. Equipment Grounding Conductors: Comply with NFPA 70, Article 250, for types, sizes, and quantities of equipment grounding conductors, unless specific types, larger sizes, or more conductors than required by NFPA 70 are indicated.

1. Install insulated equipment grounding conductors in feeders and branch circuits.
2. Busway Supply Circuits: Install insulated equipment grounding conductor from the grounding bus in the switchgear, switchboard, or distribution panel to equipment grounding bar terminal on busway.
3. Computer Outlet Circuits: Install insulated equipment grounding conductor in branch-circuit runs from computer-area power panels or power-distribution units.
4. Isolated Grounding Receptacle Circuits: Install an insulated equipment grounding conductor connected to the receptacle grounding terminal. Isolate grounding conductor from raceway and from panelboard grounding terminals. Terminate at equipment grounding conductor terminal of the applicable derived system or service, unless otherwise indicated.
5. Isolated Equipment Enclosure Circuits: For designated equipment supplied by a branch circuit or feeder, isolate equipment enclosure from supply raceway with a nonmetallic raceway fitting listed for the purpose. Install fitting where raceway enters enclosure, and install an insulated equipment grounding conductor. Isolate equipment grounding conductor from raceway and from panelboard grounding terminals. Terminate at equipment grounding conductor terminal of the applicable derived system or service, unless otherwise indicated.
6. Nonmetallic Raceways: Install an equipment grounding conductor in nonmetallic raceways unless they are designated for telephone or data cables.
7. Air-Duct Equipment Circuits: Install an insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners and heaters. Bond conductor to each unit and to air duct.
8. Water Heater, Heat-Tracing, and Antifrost Heating Cables: Install an insulated equipment grounding conductor to each electric water heater, heat-tracing, and antifrost heating cable. Bond conductor to heater units, piping, connected equipment, and components.
9. Signal and Communication Systems: For telephone, alarm, voice and data, and other communication systems, provide No. 4 AWG minimum insulated grounding conductor in raceway from grounding electrode system to each service location, terminal cabinet, wiring closet, and central equipment location.

    a. Service and Central Equipment Locations and Wiring Closets: Terminate grounding conductor on a 1/4-by-2-by-12-inch (6.4-by-50-by-300-mm) grounding bus.

b. Terminal Cabinets: Terminate grounding conductor on cabinet grounding terminal.

10. Metal Poles Supporting Outdoor Lighting Fixtures: Provide a grounding electrode in addition to installing an insulated equipment grounding conductor with supply branch-circuit conductors.
11. Common Ground Bonding with Lightning Protection System: Bond electrical power system ground directly to lightning protection system grounding conductor at closest point to electrical service grounding electrode. Use bonding conductor sized same as system grounding electrode conductor, and install in conduit.

G. Metal Frame Grounding for Buildings: Drive a ground rod at the base of every corner column and at intermediate exterior columns at distances not more than 60 feet (18 m) apart. Connect rod to column with an underground grounding conductor. Interconnect ground rods with a continuous underground conductor, extending around the perimeter of the building, 24 inches (600 mm) minimum from building foundation. Use tinned-copper conductor not less than No. 2/0 AWG for underground conductor, and bury 18 inches (450 mm) below grade, minimum.

H. Building Ground Rings: Provide a perimeter ground ring for the entire building as required per the National Electrical Code Article 250.66C.

I. Bond all concrete encased electrode (foundation/footing reinforcing) Provide as required per National Electrical Code Article 250.66B.

J. Ground Rods: Install at least three rods spaced at least one-rod length from each other and located at least the same distance from other grounding electrodes.

1. Drive ground rods until tops are 2 inches (50 mm) below finished floor or final grade, unless otherwise indicated.
2. Interconnect ground rods with grounding electrode conductors. Use exothermic welds, except as otherwise indicated. Make connections without exposing steel or damaging copper coating.

K. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.

L. Bonding Straps and Jumpers: Install so vibration by equipment mounted on vibration isolation hangers or supports is not transmitted to rigidly mounted equipment. Use exothermic-welded connectors for outdoor locations, unless a disconnect-type connection is required; then, use a bolted clamp. Bond straps directly to the basic structure taking care not to penetrate any adjacent parts. Install straps only in locations accessible for maintenance.

M. Metal Water Service Pipe: Provide insulated copper grounding conductors, in conduit, from building's main service equipment, or grounding bus, to main metal water service entrances to building. Connect grounding conductors to main metal water service pipes

by grounding clamp connectors. Where a dielectric main water fitting is installed, connect grounding conductor to street side of fitting. Bond metal grounding conductor conduit or sleeve to conductor at each end.

N. Water Meter Piping: Use braided-type bonding jumpers to electrically bypass water meters. Connect to pipe with grounding clamp connectors.

O. Comply with NFPA 780 and UL 96 when interconnecting with lightning protection system.

P. Bond interior metal piping systems and metal air ducts to equipment grounding conductors of associated pumps, fans, blowers, electric heaters, and air cleaners. Use braided-type bonding straps.

Q. Bond each aboveground portion of gas piping system upstream from equipment shutoff valve.

R. Connections: Make connections so galvanic action or electrolysis possibility is minimized. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact will be galvanically compatible.

1. Use electroplated or hot-tin-coated materials to ensure high conductivity and to make contact points closer to order of galvanic series.
2. Make connections with clean, bare metal at points of contact.
3. Make aluminum-to-steel connections with stainless-steel separators and mechanical clamps.
4. Make aluminum-to-galvanized steel connections with tin-plated copper jumpers and mechanical clamps.
5. Coat and seal connections having dissimilar metals with inert material to prevent future penetration of moisture to contact surfaces.
6. Exothermic-Welded Connections: Comply with manufacturer's written instructions. Welds that are puffed up or that show convex surfaces indicating improper cleaning are not acceptable.
7. Equipment Grounding Conductor Terminations: For No. 8 AWG and larger, use pressure-type grounding lugs. No. 10 AWG and smaller grounding conductors may be terminated with winged pressure-type connectors.
8. Noncontact Metal Raceway Terminations: If metallic raceways terminate at metal housings without mechanical and electrical connection to housing, terminate each conduit with a grounding bushing. Connect grounding bushings with a bare grounding conductor to grounding bus or terminal in housing. Bond electrically noncontinuous conduits at entrances and exits with grounding bushings and bare grounding conductors, unless otherwise indicated.
9. Tighten screws and bolts for grounding and bonding connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
10. Compression-Type Connections: Use hydraulic compression tools to provide correct circumferential pressure for compression connectors. Use tools and dies

recommended by connector manufacturer. Provide embossing die code or other standard method to make a visible indication that a connector has been adequately compressed on grounding conductor.

11. Moisture Protection: If insulated grounding conductors are connected to ground rods or grounding buses, insulate entire area of connection and seal against moisture penetration of insulation and cable.

S. Overhead Line Grounding: Comply with IEEE C2 except where stricter requirements are indicated. Use 2 or more parallel ground rods if a single ground rod electrode resistance to ground exceeds 25 ohms.

1. Drive ground rods to a depth of 12 inches (300 mm) below finished grade in undisturbed earth.
2. Ground Rod Connections: Use clamp-type connectors listed for the purpose for underground connections and connections to rods.
3. Lightning Arresters: Separate arrester grounds from other grounding conductors.
4. Secondary Neutral and Tank of Transformer: Interconnect and connect to grounding conductor.
5. Protect grounding conductors on surface of wood poles with molding extended from grade level up to and through communication service and transformer spaces.

T. Duct Banks: Install a grounding conductor with at least 50 percent ampacity of the largest phase conductor in the duct bank.

U. Manholes and Handholes: Install a driven ground rod close to wall and set rod depth so 4 inches (100 mm) will extend above finished floor. If necessary, install ground rod before manhole is placed and provide a No. 1/0 AWG bare, tinned-copper conductor from ground rod into manhole through a waterproof sleeve in manhole wall. Protect ground rods passing through concrete floor with a double wrapping of pressure-sensitive tape or heat-shrunk insulating sleeve from 2 inches (50 mm) above to 6 inches (150 mm) below concrete. Seal floor opening with waterproof, nonshrink grout.

V. Connections to Manhole Components: Connect exposed-metal parts, such as inserts, cable racks, pulling irons, ladders, and cable shields within each manhole or handhole, to ground rod or grounding conductor. Make connections with No. 4 AWG minimum, stranded, hard-drawn copper conductor. Train conductors level or plumb around corners and fasten to manhole walls. Connect to cable armor and cable shields as recommended by manufacturer of splicing and termination kits.

W. Pad-Mounted Transformers and Switches: Install two ground rods and counterpoise circling pad. Ground pad-mounted equipment and noncurrent-carrying metal items associated with substations by connecting them to underground cable and grounding electrodes. Use tinned-copper conductor not less than No. 2 AWG for counterpoise and for taps to equipment ground pad. Bury counterpoise not less than 18 inches (450 mm) below grade and 6 inches (150 mm) from the foundation.

3.2 FIELD QUALITY CONTROL

A. Testing: Perform the following field quality-control testing:

1. After installing grounding system but before permanent electrical circuitry has been energized, test for compliance with requirements.
2. Test completed grounding system at each location where a maximum ground-resistance level is indicated and at service disconnect enclosure grounding terminal. Measure ground resistance not less than two full days after the last trace of precipitation, and without the soil being moistened by any means other than natural drainage or seepage and without chemical treatment or other artificial means of reducing natural ground resistance. Perform tests, by the fall-of-potential method according to IEEE 81.
3. Provide drawings locating each ground rod, ground rod assembly, and other grounding electrodes. Identify each by letter in alphabetical order, and key to the record of tests and observations. Include the number of rods driven and their depth at each location and include observations of weather and other phenomena that may affect test results. Describe measures taken to improve test results. Nominal maximum values are as follows:

    a. Equipment Rated 500 kVA and Less: 10 ohms.
    b. Equipment Rated 500 to 1000 kVA: 5 ohms.
    c. Equipment Rated More Than 1000 kVA: 3 ohms.
    d. Overhead Distribution Line Equipment: 25 ohms.
    e. Substations and Pad-Mounted Switching Equipment: 5 ohms.
    f. Manhole Grounds: 10 ohms.

END OF SECTION 260526

SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes:

1. Hangers and supports for electrical equipment and systems.
2. Construction requirements for concrete bases.

1.2 PERFORMANCE REQUIREMENTS

A. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.

B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

C. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of **five (5)** times the applied force.

1.3 SUBMITTALS

A. Product Data: For steel slotted support systems.

B. Shop Drawings Show fabrication and installation details and include calculations for the following:

1. Trapeze hangers. Include Product Data for components.
2. Steel slotted channel systems. Include Product Data for components.
3. Equipment supports.

C. Welding certificates.

1.4 QUALITY ASSURANCE

A. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

B. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

A. Steel Slotted Support Systems: Comply with MFMA-4, factory-fabricated components for field assembly.
   1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

      a. Allied Tube & Conduit.
      b. Cooper B-Line, Inc.; a division of Cooper Industries.
      c. ERICO International Corporation.
      d. GS Metals Corp.
      e. Thomas & Betts Corporation.
      f. Unistrut; Tyco International, Ltd.

   2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
   3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
   4. Channel Dimensions: Selected for applicable load criteria.

B. Raceway and Cable Supports: As described in NECA 1 and NECA 101.

C. Conduit and Cable Support Devices: **Steel** hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.

D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.

E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.

F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:

   1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
      a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

         1) Hilti Inc.
         2) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.

3) Simpson Strong-Tie Co., Inc.; Masterset Fastening Systems Unit.

2. Mechanical-Expansion Anchors: Insert-wedge-type, **stainless** steel, for use in hardened portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
   a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

      1) Cooper B-Line, Inc.; a division of Cooper Industries.
      2) Empire Tool and Manufacturing Co., Inc.
      3) Hilti Inc.
      4) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.

3. Concrete Inserts: Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
6. Toggle Bolts: All-steel springhead type.
7. Hanger Rods: Threaded steel.

2.2 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

A. Description: Welded or bolted, structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.

B. Materials: Comply with requirements in Division 05 Section "Metal Fabrications" for steel shapes and plates.

PART 3 - EXECUTION

3.1 APPLICATION

A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.

B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as **required by** NFPA 70. Minimum rod size shall be 3/8 inch in diameter.

C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted support system, sized so capacity can be increased by at least **50** percent in future without exceeding specified design load limits.

1. Secure raceways and cables to these supports with **two-bolt conduit clamps** and/or **single-bolt conduit clamps using spring friction action for retention in support channel.**

3.2 SUPPORT INSTALLATION

A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.

B. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb (90 kg).

C. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:

1. To Wood: Fasten with lag screws or through bolts.
2. To New Concrete: Bolt to concrete inserts.
3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
4. To Existing Concrete: Expansion anchor fasteners.
5. To Steel: **Beam clamps (MSS Type 19, 21, 23, 25, or 27) complying with MSS SP-69.**
6. To Light Steel: Sheet metal screws.
7. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate **by means that meet seismic-restraint strength and anchorage requirements.**

D. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.

3.3 INSTALLATION OF FABRICATED METAL SUPPORTS

A. Comply with installation requirements in Division 05 Section "Metal Fabrications" for site-fabricated metal supports.

B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.

C. Provide an additional 20 metal supports with required fasteners of each size and type used on the project to accommodate any changes required to resolve interferences or directed by the Engineer..

D. Field Welding: Comply with AWS D1.1/D1.1M.

3.4 CONCRETE BASES

A. Construct concrete bases of dimensions indicated but not less than 4 inches (100 mm) larger in both directions than supported unit, and so anchors will be a minimum of 10 bolt diameters from edge of the base.

B. Use 4000-psi, 28-day compressive-strength concrete. Concrete materials, reinforcement, and placement requirements are specified in Division 03 Section "**Cast-in-Place Concrete**"

C. Anchor equipment to concrete base.

1. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
2. Install anchor bolts to elevations required for proper attachment to supported equipment.
3. Install anchor bolts according to anchor-bolt manufacturer's written instructions.

3.5 PAINTING

A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.

1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils (0.05 mm).

B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 260529

SECTION 260533 – RACEWAYS AND BOXES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes raceways, fittings, boxes, enclosures, and cabinets for electrical wiring.

B. Related Sections include the following:

1. Division 26 Section "Underground Ducts" for exterior ductbanks, manholes, and underground utility construction.
2. Division 26 Section "Basic Electrical Materials and Methods" for supports, anchors, and identification products.
3. Division 26 Section "Wiring Devices" for devices installed in boxes and for floor-box service fittings.

1.3 DEFINITIONS

A. EMT: Electrical metallic tubing.

B. ENT (PVC): Electrical nonmetallic tubing.

C. FAC: Flexible armored conduit.

D. FMC: Flexible metal conduit.

E. IMC: Intermediate metal conduit.

F. LFMC: Liquidtight flexible metal conduit.

G. LFNC: Liquidtight flexible metal conduit.

H. RMC: Rigid Metal Conduit.

I. RNC (PVC): Rigid nonmetallic conduit.

1.4 SUBMITTALS

A. Product Data: For surface raceways, wireways and fittings.

1.5 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

B. Comply with NFPA 70.

1.6 COORDINATION

A. Coordinate layout and installation of raceways, boxes, enclosures, cabinets, and suspension system with other construction that penetrates ceilings or is supported by them, including light fixtures, HVAC equipment, fire-suppression system, and partition assemblies.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:

1. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

2.2 METAL CONDUIT AND TUBING

A. Manufacturer:

1. AFC Cable Systems, Inc.
2. Alflex Inc.
3. Anamet Electrical, Inc.; Anaconda Metal Hose.
4. Electri-Flex Co.
5. Grinnell Co./Tyco International; Allied Tube and Conduit Div.
6. LTV Steel Tubular Products Company.
7. Manhattan/CDT/Cole-Flex.
8. O-Z Gedney; Unit of General Signal.
9. Wheatland Tube Co.

B. Rigid Steel Conduit: ANSI C80.1.

C. IMC: ANSI C80.6.

D. EMT and Fittings: ANSI C80.3.

1. Fittings: Compression type up to 1-1/2 in. conduit, 2 in. and larger use set screw type.

E. FMC: Zinc-coated steel.

F. LFMC: Flexible steel conduit with PVC jacket.

G. Fittings: NEMA FB 1; compatible with conduit and tubing materials.

2.3 NONMETALLIC CONDUITS AND FITTINGS

A. Nonmetallic Conduit:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

   a. AFC Cable Systems; a part of Atkore International.
   b. Anamet Electrical, Inc.
   c. Arnco Corporation.
   d. CANTEX INC.
   e. CertainTeed Corporation.
   f. Lamson & Sessions.
   g. RACO; Hubbell.
   h. Thomas & Betts Corporation; A Member of the ABB Group.

B. Listing and Labeling: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

1. ENT: Comply with NEMA TC 13 and UL 1653.
2. RNC: Type EPC-40-PVC, complying with NEMA TC 2 and UL 651 unless otherwise indicated.
3. LFNC: Comply with UL 1660.

C. Nonmetallic Fittings:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

   a. AFC Cable Systems; a part of Atkore International.
   b. Anamet Electrical, Inc.

c. Arnco Corporation.
d. CANTEX INC.
e. CertainTeed Corporation.
f. Lamson & Sessions.
g. RACO; Hubbell.
h. Thomas & Betts Corporation; A Member of the ABB Group.

2. Fittings, General: Listed and labeled for type of conduit, location, and use.
3. Fittings for ENT and RNC: Comply with NEMA TC 3; match to conduit or tubing type and material.
4. Fittings for LFNC: Comply with UL 514B.
5. Pipe Solvents and Adhesives: As recommended by conduit manufacturer.

2.4 METAL WIREWAYS

A. Manufacturer:

1. Hoffman.
2. Square D.

.

B. Material and Construction: Sheet metal sized and shaped as indicated, NEMA 1 or 3R.

C. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, plastic edge covers, and other fittings to match and mate with wireways as required for complete system.

D. Select features, unless otherwise indicated, as required to complete wiring system and to comply with NFPA 70.

E. Wireway Covers: Screw cover type, Flanged and gasketed type at exterior.

F. Finish: Manufacturer's standard enamel finish.

2.5 SURFACE RACEWAYS

A. Surface Metal Raceways: Galvanized steel with snap-on covers. Finish with manufacturer's standard grey finish coat.

1. Manufacturer:
   a. Legrand
   b. Panduit.

B. Types, sizes, and channels as indicated and required for each application, with fittings that match and mate with raceways.

C. Surface Non-Metallic Raceways: Polyvinyl with snap-on covers. Finish with manufacturer's light ivory color. Note, see drawings for locations where acceptable, provide metallic unless noted otherwise.
1. Manufacturer:
   a. Hubbell Inc.
   b. Legrand
   c. Panduit

D. Types, sizes, and channels as indicated and required for each application, with fittings that match and mate with raceways.
1. Single channel polyvinyl (raceway for branch circuit power and/or low potential services shall be Premise Trak (Latching) as manufactured by Hubbell.
2. The two-piece single channel shall consist of a base section, 5 feet length, latching snap on cover, 0.38 in 2 channel base. Provide 1-gang or 2-gang boxes as required. Apply channel with mechanical fasteners. Adhesives and tapes are NOT acceptable.
3. Two channel polyvinyl raceway for branch circuit power and low potential services shall be Wall Trak as manufactured by Hubbell.
4. The two-piece, two channel raceway shall consist of a base section, 5 feet length, latching snap on cover, 0.81 in 2 and 0.79 in2 channel bases. Provide 1-gang or 2-gang boxes as required. Apply base with mechanical fasteners. Adhesives and tapes are NOT acceptable.

2.6 BOXES, ENCLOSURES, AND CABINETS

A. Manufacturer:

1. Cooper Crouse-Hinds; Div. of Cooper Industries, Inc.
2. Emerson/General Signal; Appleton Electric Company.
3. Erickson Electrical Equipment Co.
4. Hoffman.
5. Hubbell, Inc.; Killark Electric Manufacturing Co.
6. O-Z/Gedney; Unit of General Signal.
7. RACO; Division of Hubbell, Inc.
8. Robroy Industries, Inc.; Enclosure Division.
9. Scott Fetzer Com.; Adalet-PLM Division.
10. Spring City Electrical Manufacturing Co.
11. Thomas & Betts Corporation.
12. Walker Systems, Inc.; Wiremold Company (The).
13. Woodhead, Daniel Company; Woodhead Industries, Inc. Subsidiary.

B. Sheet Metal Outlet and Device Boxes: NEMA OS 1.

C. Cast-Metal Outlet and Device Boxes: NEMA FB 1, Type FD, with gasketed cover.

D. Floor Boxes: Cast metal, fully adjustable, rectangular.

E. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.

F. Cast-Metal Pull and Junction Boxes: NEMA FB 1, cast aluminum with gasketed cover.

G. Hinged-Cover Enclosures: NEMA 250, Type 1, with continuous hinge cover and flush latch.

1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
2. Nonmetallic Enclosures: Plastic, finished inside with radio-frequency-resistant paint.

H. Cabinets: NEMA 250, Type 1, galvanized steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel. Hinged door in front cover with flush latch and concealed hinge. Key latch to match panelboards. Include metal barriers to separate wiring of different systems and voltage and include accessory feet where required for freestanding equipment.

2.7 FACTORY FINISHES

A. Finish: For raceway, enclosure, or cabinet components, provide manufacturer's standard gray paint applied to factory-assembled surface raceways, enclosures, and cabinets before shipping.

PART 3 - EXECUTION

3.1 RACEWAY APPLICATION

A. Outdoors:

1. Exposed: Rigid galvanized steel: RMC or IMC.
2. Concealed: Rigid galvanized steel or IMC.
3. Underground, Single Run: RMC or RNC.
4. Underground, Grouped: RMC or RNC.
5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC.
6. Boxes and Enclosures: NEMA 250, Type 3R or 4.

B. Indoors:

1. Exposed: EMT, surface metal raceway.
2. Concealed: EMT, FAC, FMC.

3. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC; except use LFMC in damp or wet locations.
4. Damp or Wet Locations: Rigid galvanized steel conduit.
5. Boxes and Enclosures: NEMA 250, Type 1, except as follows:
   a. Damp or Wet Locations: NEMA 250, Type 4..

C. Minimum Raceway Size: 3/4-inch trade size (DN 21)

D. Raceway Fittings: Compatible with raceways and suitable for use and location.

1. Intermediate Steel Conduit: Use threaded rigid steel conduit fittings, unless otherwise indicated.

3.2 INSTALLATION

A. Keep raceways at least 6 inches (150 mm) away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.

B. Complete raceway installation before starting conductor installation.

C. Support raceways as specified in Division 26 Section "Hangers & Supports."

D. Install temporary closures to prevent foreign matter from entering raceways.

E. Protect stub-ups from damage where conduits rise through floor slabs. Arrange so curved portions of bends are not visible above the finished slab.

F. Provide an additional one hundred feet of raceway and accessories of each type and size used on the project to accommodate any changes required to resolve interferences as directed by the Engineer.

G. Make bends and offsets so ID is not reduced. Keep legs of bends in the same plane and keep straight legs of offsets parallel, unless otherwise indicated.

H. Conceal conduit and EMT within finished walls, ceilings, and floors, unless otherwise indicated.

1. Install concealed raceways with a minimum of bends in the shortest practical distance, considering type of building construction and obstructions, unless otherwise indicated.

I. Raceways Embedded in Slabs: Install in middle 1/3 of slab thickness where practical and leave at least 2 inches (50 mm) of concrete cover.

1. Secure raceways to reinforcing rods to prevent sagging or shifting during concrete placement.
2. Space raceways laterally to prevent voids in concrete.
3. Run conduit larger than 1-inch trade size (DN 27) parallel or at right angles to main reinforcement. Where at right angles to reinforcement, place conduit close to slab support.
4. Change from nonmetallic tubing to Schedule 40 nonmetallic conduit, rigid steel conduit, or IMC before rising above the floor.

J. Install exposed raceways parallel or at right angles to nearby surfaces or structural members and follow surface contours as much as possible.

1. Run parallel or banked raceways together on common supports.
2. Make parallel bends in parallel or banked runs. Use factory elbows only where elbows can be installed parallel; otherwise, provide field bends for parallel raceways.

K. Join raceways with fittings designed and approved for that purpose and make joints tight.

1. Use insulating bushings to protect conductors.

L. Terminations:

1. Where raceways are terminated with locknuts and bushings, align raceways to enter squarely and install locknuts with dished part against box. Use two locknuts, one inside and one outside box.
2. Where raceways are terminated with threaded hubs, screw raceways or fittings tightly into hub so end bears against wire protection shoulder. Where chase nipples are used, align raceways so coupling is square to box; tighten chase nipple so no threads are exposed.

M. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb (90-kg) tensile strength. Leave at least 12 inches (300 mm) of slack at each end of pull wire.

N. Telephone and Signal System Raceways, 2-Inch Trade Size (DN 53) and Smaller: In addition to above requirements, install raceways in maximum lengths of 150 feet (45 m) and with a maximum of two 90-degree bends or equivalent. Separate lengths with pull or junction boxes where necessary to comply with these requirements

O. Install raceway sealing fittings at suitable, approved, and accessible locations and fill them with UL-listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points:

1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
2. Where otherwise required by NFPA 70.

P. Stub-up Connections: Extend conduits through concrete floor for connection to freestanding equipment. Install with an adjustable top or coupling threaded inside for plugs set flush with finished floor. Extend conductors to equipment with rigid steel conduit; FMC may be used 6 inches (150 mm) above the floor. Install screwdriver-operated, threaded plugs flush with floor for future equipment connections.

Q. Flexible Connections: Use maximum of 72 inches (1830 mm) of flexible conduit for recessed and semirecessed lighting fixtures; for equipment subject to vibration, noise transmission, or movement; and for all motors. Use LFMC in damp or wet locations. Install separate ground conductor across flexible connections.

R. Provide five additional boxes (floor, junction, etc.) and accessories of each size and type used on the project to accommodate any changes required to resolve interferences as directed by the Engineer.

S. Surface Raceways: Install a separate, green, ground conductor in raceways from junction box supplying raceways to receptacle or fixture ground terminals.

T. Set floor boxes level and flush with finished floor surface.

U. Set floor boxes level. Trim after installation to fit flush with finished floor surface.

V. Install hinged-cover enclosures and cabinets plumb. Support at each corner.

3.3 PROTECTION

A. Provide final protection and maintain conditions that ensure coatings, finishes, and cabinets are without damage or deterioration at time of Substantial Completion.

1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
2. Repair damage to PVC or paint finishes with matching touchup coating recommended by manufacturer.

3.4 CLEANING

A. After completing installation of exposed, factory-finished raceways and boxes, inspect exposed finishes and repair damaged finishes.

END OF SECTION 260533

SECTION 260543 - UNDERGROUND DUCTS AND RACEWAYS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Metal conduits and fittings, including GRC and PVC-coated steel conduit.
2. Rigid nonmetallic duct.
3. Flexible nonmetallic duct.
4. Duct accessories.
5. Polymer concrete handholes and boxes with polymer concrete cover.

1.2 DEFINITIONS

A. Direct Buried: Duct or a duct bank that is buried in the ground, without any additional casing materials such as concrete.

B. Duct: A single duct or multiple ducts. Duct may be either installed singly or as component of a duct bank.

C. Duct Bank:

1. Two or more ducts installed in parallel, with or without additional casing materials.
2. Multiple duct banks.

1.3 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Shop Drawings:

1. Factory-Fabricated Handholes and Boxes Other Than Precast Concrete:

a. Include dimensioned plans, sections, and elevations, and fabrication and installation details.
b. Include duct entry provisions, including locations and duct sizes.
c. Include cover design.
d. Include grounding details.
e. Include dimensioned locations of cable rack inserts, and pulling-in and lifting irons.

1.4 INFORMATIONAL SUBMITTALS

A. Duct and Duct-Bank Coordination Drawings: Show duct profiles and coordination with other utilities and underground structures. Drawings shall be signed and sealed by a qualified professional engineer.

B. Product Certificates: For concrete and steel used in precast concrete handholes, as required by ASTM C 858.

C. Source quality-control reports.

D. Field quality-control reports.

1.5 QUALITY ASSURANCE

A. Testing Agency Qualifications: Qualified according to ASTM E 329 for testing indicated.

PART 2 - PRODUCTS

2.1 METAL CONDUIT AND FITTINGS

A. GRC: Comply with ANSI C80.1 and UL 6.

B. Listed and labeled as defined in NFPA 70, by a nationally recognized testing laboratory, and marked for intended location and application.

2.2 RIGID NONMETALLIC DUCT

A. Underground Plastic Utilities Duct: Type EPC-40-PVC RNC, complying with NEMA TC 2 and UL 651, with matching fittings complying with NEMA TC 3 by same manufacturer as duct.

B. Acceptable Manufacturer:
1. ARNCO Corp
2. Cantex Inc.
3. Certain Teed Corp.
4. Condux Internations, Inc.
5. Crown Line Plastics
6. ElecSys, Inc.
7. Electri-Flex Co.
8. Lamson & Sesions
9. National Pipe & Plastics
10. Or equal

C. Listed and labeled as defined in NFPA 70, by a nationally recognized testing laboratory, and marked for intended location and application.

D. Solvents and Adhesives: As recommended by conduit manufacturer.

2.3 FLEXIBLE NONMETALLIC DUCTS

A. HDPE Duct: Type EPEC-40 HDPE, complying with NEMA TC 7 and UL 651A.
   1. ABB, Electrification Products
   2. ARNCO Corp.
   3. National Pipe & Plastics
   4. Premier Conduit
   5. Or equal

B. Listed and labeled as defined in NFPA 70, by a nationally recognized testing laboratory, and marked for intended location and application.

2.4 DUCT ACCESSORIES

A. Duct Spacers: Factory-fabricated, rigid, PVC interlocking spacers; sized for type and size of duct with which used, and selected to provide minimum duct spacing indicated while supporting duct during concreting or backfilling.
   1. ABB, Electrification Products
   2. Allied Tube & Conduit
   3. Cantex Inc.
   4. IPEX USA LLC
   5. PenCell Plastics
   6. Underground Devices, Inc.
   7. Or equal

B. Underground-Line Warning Tape: Comply with requirements for underground-line warning tape specified in Section 260553 "Identification for Electrical Systems."

2.5 POLYMER CONCRETE HANDHOLES AND BOXES WITH POLYMER CONCRETE COVER

A. Description: Molded of sand and aggregate, bound together with a polymer resin, and reinforced with steel or fiberglass or a combination of the two.

B. Acceptable Manufacturers:
   1. Armorcast Products Co.
   2. MacLean Highline
   3. Oldcastle Infrastructure
   4. Quazite, Hubbell Inc. (Basis of Design)

C. Standard: Comply with SCTE 77. Comply with tier requirements in "Underground Enclosure Application" Article.

D. Color: Gray.

E. Configuration: Units shall be designed for flush burial and have open bottom unless otherwise indicated.

F. Cover: Weatherproof, secured by tamper-resistant locking devices and having structural load rating consistent with enclosure.

G. Cover Finish: Nonskid finish shall have a minimum coefficient of friction of 0.50.

H. Cover Legend: Molded lettering, "ELECTRIC."

I. Direct-Buried Wiring Entrance Provisions: Knockouts equipped with insulated bushings or end-bell fittings, selected to suit box material, sized for wiring indicated, and arranged for secure, fixed installation in enclosure wall.

J. Duct Entrance Provisions: Duct-terminating fittings shall mate with entering duct for secure, fixed installation in enclosure wall.

K. Handholes shall have factory-installed inserts for cable racks and pulling-in irons.

2.6 SOURCE QUALITY CONTROL

A. Nonconcrete Handhole and Pull-Box Prototype Test: Test prototypes of manholes and boxes for compliance with SCTE 77. Strength tests shall be for specified tier ratings of products supplied.
   1. Strength tests of complete boxes and covers shall be by an independent testing agency or manufacturer. A qualified registered professional engineer shall certify tests by manufacturer.
   2. Testing machine pressure gages shall have current calibration certification, complying with ISO 9000 and ISO 10012, and traceable to NIST standards.

PART 3 - EXECUTION

3.1 PREPARATION

A. Coordinate layout and installation of duct, duct bank, manholes, handholes, and boxes with final arrangement of other utilities, site grading, and surface features as determined in the field. Notify Architect if there is a conflict between areas of excavation and existing structures or archaeological sites to remain.

B. Coordinate elevations of duct and duct-bank entrances into manholes, handholes, and boxes with final locations and profiles of duct and duct banks, as determined by

coordination with other utilities, underground obstructions, and surface features. Revise locations and elevations as required to suit field conditions and to ensure that duct and duct bank will drain to manholes and handholes, and as approved by Architect.

3.2 UNDERGROUND DUCT APPLICATION

A. Duct for Electrical Feeders 600 V and Less: RNC Type EPC-40-PVC, concrete-encased unless otherwise indicated.

B. Duct for Electrical Feeders 600 V and Less: RNC Type EPC-40-PVC, direct-buried unless otherwise indicated.

C. Duct for Electrical Branch Circuits: RNC Type EPC-40-PVC, direct-buried unless otherwise indicated.

D. Bored Underground Duct: Type EPEC-40 HDPE unless otherwise indicated.

E. Underground Ducts Crossing Paved Paths and Walks direct-buried unless otherwise indicated.

F. Underground Ducts Crossing: Driveways, Roadways and Railroads: RNC Type EPC-40 PVC, encased in reinforced concrete.

G. Stub-ups: Concrete-encased RNC and GRC.

3.3 EARTHWORK

A. Excavation and Backfill: Comply with Section 312000 "Earth Moving," but do not use heavy-duty, hydraulic-operated, compaction equipment.

B. Restoration: Replace area immediately after backfilling is completed.

C. Restore surface features at areas disturbed by excavation, and re-establish original grades unless otherwise indicated. Replace removed sod immediately after backfilling is completed.

D. Restore areas disturbed by trenching, storing of dirt, cable laying, and other work. Restore vegetation and include necessary topsoiling, fertilizing, liming, seeding, sodding, sprigging, and mulching. Comply with Section 329200 "Turf and Grasses" and Section 329300 "Plants."

E. Cut and patch existing pavement in the path of underground duct, duct bank, and underground structures according to "Cutting and Patching" Article in Section 017300 "Execution."

3.4 DUCT AND DUCT-BANK INSTALLATION

A. Where indicated on Drawings, install duct, spacers, and accessories into the duct-bank configuration shown. Duct installation requirements in this Section also apply to duct bank.

B. Install duct according to NEMA TCB 2.

C. Slope: Pitch duct a minimum slope of 1:300 down toward manholes and handholes and away from buildings and equipment. Slope duct from a high point between two manholes, to drain in both directions.

D. Curves and Bends: Use 5-degree angle couplings for small changes in direction. Use manufactured long sweep bends with a minimum radius of 36" when used for Fiber Optic Cable, both horizontally and vertically, at other locations unless otherwise indicated.

E. Joints: Use solvent-cemented joints in duct and fittings and make watertight according to manufacturer's written instructions. Stagger couplings so those of adjacent duct do not lie in same plane.

F. Installation Adjacent to High-Temperature Steam Lines: Where duct is installed parallel to underground steam lines, perform calculations showing the duct will not be subject to environmental temperatures above 40 deg C. Where environmental temperatures are calculated to rise above 40 deg C, and anywhere the duct crosses above an underground steam line, install insulation blankets listed for direct burial to isolate the duct bank from the steam line.

G. End Bell Entrances to Manholes and Concrete and Polymer Concrete Handholes: Use end bells, spaced approximately 10 inches (250 mm) o.c. for 5-inch (125-mm) duct, and vary proportionately for other duct sizes.

H. Terminator Entrances to Manholes and Concrete and Polymer Concrete Handholes: Use manufactured, cast-in-place duct terminators, with entrances into structure spaced approximately 6 inches (150 mm) o.c. for 4-inch (100-mm) duct, and vary proportionately for other duct sizes.

I. Building Wall Penetrations: Make a transition from underground duct to GRC at least 10 feet (3 m) outside the building wall, without reducing duct line slope away from the building and without forming a trap in the line. Use fittings manufactured for RNC-to-GRC transition. Install GRC penetrations of building walls as specified in Section 260544 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling."

J. Sealing: Provide temporary closure at terminations of duct with pulled cables. Seal spare duct at terminations. Use sealing compound and plugs to withstand at least 15-psig (1.03-MPa) hydrostatic pressure.

K. Pulling Cord: Install 200-lbf- (1000-N-) test nylon cord in empty ducts.

L. Concrete-Encased Ducts and Duct Bank:

1. Excavate trench bottom to provide firm and uniform support for duct. Prepare trench bottoms as specified in Section 312000 "Earth Moving" for pipes less than 6 inches (150 mm) in nominal diameter.
2. Width: Excavate trench 12 inches (300 mm) wider than duct on each side.
3. Width: Excavate trench 3 inches (75 mm) wider than duct on each side.
4. Depth: Install so top of duct envelope is at least 24 inches (600 mm) below finished grade in areas not subject to deliberate traffic, and at least 30 inches (750 mm) below finished grade in deliberate traffic paths for vehicles unless otherwise indicated.
5. Support duct on duct spacers coordinated with duct size, duct spacing, and outdoor temperature.
6. Spacer Installation: Place spacers close enough to prevent sagging and deforming of duct, with not less than five spacers per 20 feet (6 m) of duct. Place spacers within 24 inches (600 mm) of duct ends. Stagger spacers approximately 6 inches (150 mm) between tiers. Secure spacers to earth and to duct to prevent floating during concreting. Tie entire assembly together using fabric straps; do not use tie wires or reinforcing steel that may form conductive or magnetic loops around ducts or duct groups.
7. Elbows: Use manufactured duct elbows for stub-ups, at building entrances, and at changes of direction in duct unless otherwise indicated. Extend encasement throughout length of elbow.
8. Elbows: Use manufactured GRC elbows for stub-ups, at building entrances, and at changes of direction in duct run.
9. Reinforcement: Reinforce concrete-encased duct where crossing disturbed earth and where indicated. Arrange reinforcing rods and ties without forming conductive or magnetic loops around ducts or duct groups.
10. Forms: Use walls of trench to form side walls of duct bank where soil is self-supporting and concrete envelope can be poured without soil inclusions; otherwise, use forms.
11. Concrete Cover: Install a minimum of 3 inches (75 mm) of concrete cover between edge of duct to exterior envelope wall, 2 inches (50 mm) between duct of like services, and 4 inches (100 mm) between power and communications ducts.
12. Concreting Sequence: Pour each run of envelope between manholes or other terminations in one continuous operation.
13. Pouring Concrete: Comply with requirements in "Concrete Placement" Article in Section 033000 "Cast-in-Place Concrete." Place concrete carefully during pours to prevent voids under and between duct and at exterior surface of envelope. Do not allow a heavy mass of concrete to fall directly onto ducts. Allow concrete to flow around duct and rise up in middle, uniformly filling all open spaces. Do not use power-driven agitating equipment unless specifically designed for duct-installation application.

M. Direct-Buried Duct and Duct Bank:

1. Excavate trench bottom to provide firm and uniform support for duct. Comply with requirements in Section 312000 "Earth Moving" for preparation of trench bottoms for pipes less than 6 inches (150 mm) in nominal diameter.
2. Width: Excavate trench 12 inches (300 mm) wider than duct on each side.
3. Width: Excavate trench 3 inches (75 mm) wider than duct on each side.
4. Depth: Install top of duct at least 18 inches (900 mm) below finished grade unless otherwise indicated.
5. Set elevation of bottom of duct bank below frost line.
6. Support ducts on duct spacers coordinated with duct size, duct spacing, and outdoor temperature.
7. Spacer Installation: Place spacers close enough to prevent sagging and deforming of duct, with not less than five spacers per 20 feet (6 m) of duct. Place spacers within 24 inches (600 mm) of duct ends. Stagger spacers approximately 6 inches (150 mm) between tiers. Secure spacers to earth and to ducts to prevent floating during concreting. Tie entire assembly together using fabric straps; do not use tie wires or reinforcing steel that may form conductive or magnetic loops around ducts or duct groups.
8. Elbows: Install manufactured duct elbows for stub-ups, at building entrances, and at changes of direction in duct direction unless otherwise indicated. Encase elbows for stub-up ducts throughout length of elbow.
9. Install manufactured GRC elbows for stub-ups, at building entrances, and at changes of direction in duct.
10. After installing first tier of duct, backfill and compact. Start at tie-in point and work toward end of duct run, leaving ducts at end of run free to move with expansion and contraction as temperature changes during this process. Repeat procedure after placing each tier. After placing last tier, hand place backfill to 4 inches (100 mm) over duct and hand tamp. Firmly tamp backfill around ducts to provide maximum supporting strength. Use hand tamper only. After placing controlled backfill over final tier, make final duct connections at end of run and complete backfilling with normal compaction. Comply with requirements in Section 312000 "Earth Moving" for installation of backfill materials.

    a. Place minimum 3 inches (75 mm) of sand as a bed for duct. Place sand to a minimum of 6 inches (150 mm) above top level of duct.
    b. Place minimum 6 inches (150 mm) of engineered fill above concrete encasement of duct.

N. Underground-Line Warning Tape: Bury conducting underground line specified in Section 260553 "Identification for Electrical Systems" no less than 12 inches (300 mm) above all concrete-encased duct and duct banks and approximately 6" below grade. Align tape parallel to and within 3 inches (75 mm) of centerline of duct bank. Provide an additional warning tape for each 12-inch (300-mm) increment of duct-bank width over a nominal 18 inches (450 mm). Space additional tapes 12 inches (300 mm) apart, horizontally.

3.5 INSTALLATION OF HANDHOLES AND BOXES OTHER THAN PRECAST CONCRETE

A. Install handholes and boxes level and plumb and with orientation and depth coordinated with connecting duct, to minimize bends and deflections required for proper entrances. Use box extension if required to match depths of duct, and seal joint between box and extension as recommended by manufacturer.

B. Unless otherwise indicated, support units on a level bed of crushed stone or gravel, graded from 1/2-inch (12.5-mm) sieve to No. 4 (4.75-mm) sieve and compacted to same density as adjacent undisturbed earth.

C. Elevation: In paved areas and trafficways, set cover flush with finished grade. Set covers of other handholes 1 inch (25 mm) above finished grade.

D. Install handholes and boxes with bottom below frost line, <Insert depth of frost line below grade at Project site> below grade.

E. Install removable hardware, including pulling eyes, cable stanchions, cable arms, and insulators, as required for installation and support of cables and conductors and as indicated. Select arm lengths to be long enough to provide spare space for future cables, but short enough to preserve adequate working clearances in enclosure.

F. Field cut openings for duct according to enclosure manufacturer's written instructions. Cut wall of enclosure with a tool designed for material to be cut. Size holes for terminating fittings to be used, and seal around penetrations after fittings are installed.

G. For enclosures installed in asphalt paving and brick masonry pavers and subject to occasional, nondeliberate, heavy-vehicle loading, form and pour a concrete ring encircling, and in contact with, enclosure and with top surface screeded to top of box cover frame. Bottom of ring shall rest on compacted earth.

1. Concrete: 3000 psi (20 kPa), 28-day strength, complying with Section 033000 "Cast-in-Place Concrete," with a troweled finish.
2. Dimensions: 10 inches wide by 12 inches deep (250 mm wide by 300 mm deep).

3.6 GROUNDING

A. Ground underground ducts and utility structures according to Section 260526 "Grounding and Bonding for Electrical Systems."

3.7 FIELD QUALITY CONTROL

A. Perform the following tests and inspections:

1. Demonstrate capability and compliance with requirements on completion of installation of underground duct, duct bank, and utility structures.
2. Pull solid aluminum or wood test mandrel through duct to prove joint integrity and adequate bend radii, and test for out-of-round duct. Provide a minimum 12-inch- (300-mm-) long mandrel equal to duct size minus 1/4 inch (6 mm). If obstructions are indicated, remove obstructions and retest.
3. Test handhole grounding to ensure electrical continuity of grounding and bonding connections. Measure and report ground resistance as specified in Section 260526 "Grounding and Bonding for Electrical Systems."

B. Correct deficiencies and retest as specified above to demonstrate compliance.

C. Prepare test and inspection reports.

3.8 CLEANING

A. Pull leather-washer-type duct cleaner, with graduated washer sizes, through full length of duct until duct cleaner indicates that duct is clear of dirt and debris. Follow with rubber duct swab for final cleaning and to assist in spreading lubricant throughout ducts.

B. Clean internal surfaces of manholes, including sump.

1. Sweep floor, removing dirt and debris.
2. Remove foreign material.

END OF SECTION 260543

SECTION 260553 – ELECTRICAL IDENTIFICATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes electrical identification materials and devices required to comply with ANSI C2, NFPA 70, OSHA standards, and authorities having jurisdiction.

1.3 SUBMITTALS

A. Provide product data information on products used.

1.4 QUALITY ASSURANCE

A. Comply with ANSI C2.

B. Comply with NFPA 70.

C. Comply with ANSI A13.1 and NFPA 70 for color-coding.

PART 2 - PRODUCTS

2.1 RACEWAY AND CABLE LABELS

A. Comply with ANSI A13.1, Table 3, for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.

1. Color: Black letters on orange field.
2. Legend: Indicates voltage and service.

B. Adhesive Labels: Preprinted, flexible, self-adhesive vinyl with legend overlaminated with a clear, weather- and chemical-resistant coating.

C. Pretensioned, Wraparound Plastic Sleeves: Flexible, preprinted, color-coded, acrylic band sized to suit the diameter of the line it identifies and arranged to stay in place by pretensioned gripping action when placed in position.

D. Consider alternatives before specifying self-adhesive product in paragraph below. See Editing Instruction No. 1 in the Evaluations.

E. Colored Adhesive Tape: Self-adhesive vinyl tape not less than 3 mils thick by 1 to 2 inches wide (0.08 mm thick by 25 to 51 mm wide).

F. Underground-Line Warning Tape: Permanent, bright-colored, continuous-printed, vinyl tape.

1. Not less than 6 inches wide by 4 mils thick (152 mm wide by 0.102 mm thick).
2. Compounded for permanent direct-burial service.
3. Embedded continuous metallic strip or core.
4. Printed legend indicating type of underground line.

G. Tape Markers: Vinyl or vinyl-cloth, self-adhesive, wraparound type with preprinted numbers and letters.

H. Aluminum, Wraparound Marker Bands: Bands cut from 0.014-inch- (0.4-mm-) thick aluminum sheet, with stamped or embossed legend, and fitted with slots or ears for permanently securing around wire or cable jacket or around groups of conductors.

2.2 NAMEPLATES AND SIGNS

A. Safety Signs: Comply with 29 CFR, Chapter XVII, Part 1910.145.

B. Engraved Plastic Nameplates and Signs: Engraving stock, melamine plastic laminate, minimum 1/16 inch (1.6 mm) thick for signs up to 20 sq. in. (129 sq. cm) and 1/8 inch (3.2 mm) thick for larger sizes.

1. Engraved legend with black letters on white face.
2. Punched or drilled for mechanical fasteners.

C. Baked-Enamel Signs for Interior Use: Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for the application. 1/4-inch (6.4-mm) grommets in corners for mounting.

D. Exterior, Metal-Backed, Butyrate Signs: Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate signs with 0.0396-inch (1-mm) galvanized-steel backing; and with colors, legend, and size required for the application. 1/4-inch (6.4-mm) grommets in corners for mounting.

E. Fasteners for Nameplates and Signs: Self-tapping, stainless-steel screws or No. 10/32, stainless-steel machine screws with nuts and flat and lock washers.

2.3 MISCELLANEOUS IDENTIFICATION PRODUCTS

A. Cable Ties: Fungus-inert, self-extinguishing, one-piece, self-locking, Type 6/6 nylon cable ties.

1. Minimum Width: 3/16 inch (5 mm).
2. Tensile Strength: 50 lb (22.3 kg) minimum.
3. Temperature Range: Minus 40 to plus 185 deg F (Minus 40 to plus 85 deg C).
4. Color: According to color-coding.

B. Paint: Formulated for the type of surface and intended use.

1. Primer for Galvanized Metal: Single-component acrylic vehicle formulated for galvanized surfaces.
2. Primer for Concrete Masonry Units: Heavy-duty-resin block filler.
3. Primer for Concrete: Clear, alkali-resistant, binder-type sealer.
4. Enamel: Silicone-alkyd or alkyd urethane as recommended by primer manufacturer.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Identification Materials and Devices: Install at locations for most convenient viewing without interference with operation and maintenance of equipment.

B. Lettering, Colors, and Graphics: Coordinate names, abbreviations, colors, and other designations with corresponding designations in the Contract Documents or with those required by codes and standards. Use consistent designations throughout Project.

C. Sequence of Work: If identification is applied to surfaces that require finish, install identification after completing finish work.

D. Self-Adhesive Identification Products: Clean surfaces before applying.

E. Circuits with More Than 600 V: Identify raceway and cable with "DANGER--HIGH VOLTAGE" in black letters 2 inches (51 mm) high, stenciled with paint at 10-foot (3-m) intervals over a continuous, painted orange background. Identify the following:

1. Entire floor area directly above conduits running beneath and within 12 inches (305 mm) of a basement or ground floor that is in contact with earth or is framed above unexcavated space.
2. Wall surfaces directly external to conduits concealed within wall.
3. All accessible surfaces of concrete envelope around conduits in vertical shafts, exposed in the building, or concealed above suspended ceilings.
4. Entire surface of exposed conduits.

F. Install painted identification according to manufacturer's written instructions and as follows:

1. Clean surfaces of dust, loose material, and oily films before painting.
2. Prime surfaces using type of primer specified for surface.
3. Apply one intermediate and one finish coat of enamel.

G. Color Banding Raceways and Exposed Cables: Band exposed and accessible raceways of the systems listed below:

1. Bands: Pretensioned, wraparound plastic sleeves; colored adhesive tape; or a combination of both. Make each color band 2 inches (51 mm) wide, completely encircling conduit, and place adjacent bands of two-color markings in contact, side by side.
2. Band Locations: At changes in direction, at penetrations of walls and floors, at 50-foot (15-m) maximum intervals in straight runs, and at 25-foot (7.6-m) maximum intervals in congested areas.
3. Apply the following colors to the systems listed below:
   a. Fire Alarm System: Red.
   b. Fire-Suppression Supervisory and Control System: Red and yellow.
   c. Combined Fire Alarm and Security System: Red and blue.
   d. Security System: Blue and yellow.
   e. Mechanical and Electrical Supervisory System: Green and blue.
   f. Telecommunication System: Green and yellow.

H. Caution Labels for Indoor Boxes and Enclosures for Power and Lighting: Install pressure-sensitive, self-adhesive labels identifying system voltage with black letters on orange background. Install on exterior of door or cover.

I. Circuit Identification Labels on Boxes: Install labels externally.

1. Exposed Boxes: Pressure-sensitive, self-adhesive plastic label on cover.
2. Concealed Boxes: Plasticized card-stock tags.
3. Labeling Legend: Permanent, waterproof listing of panel and circuit number or equivalent.

J. Paths of Underground Electrical Lines: During trench backfilling, for exterior underground power, control, signal, and communication lines, install continuous underground plastic line marker located directly above line at 6 to 8 inches (150 to 200 mm) below finished grade. Where width of multiple lines installed in a common trench or concrete envelope does not exceed 16 inches (400 mm) overall, use a single line marker. Install line marker for underground wiring, both direct-buried cables and cables in raceway.

K. Color-Coding of Secondary Phase Conductors: Use the following colors for service feeder, and branch-circuit phase conductors:

1. 208/120-V Conductors:

a. Phase A: Black.
b. Phase B: Red.
c. Phase C: Blue.

2. 480/277-V Conductors:
   a. Phase A: Brown.
   b. Phase B: Orange.
   c. Phase C: Yellow
3. Factory apply color the entire length of conductors, except the following field-applied, color-coding methods may be used instead of factory-coded wire for sizes larger than No. 10 AWG:
   a. Colored, pressure-sensitive plastic tape in half-lapped turns for a distance of 6 inches (150 mm) from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Use 1-inch- (25-mm-) wide tape in colors specified. Adjust tape bands to avoid obscuring cable identification markings.
   b. Colored cable ties applied in groups of three ties of specified color to each wire at each terminal or splice point starting 3 inches (76 mm) from the terminal and spaced 3 inches (76 mm) apart. Apply with a special tool or pliers, tighten to a snug fit, and cut off excess length.

L. Power-Circuit Identification: Metal tags or aluminum, wraparound marker bands for cables, feeders, and power circuits in vaults, pull and junction boxes, manholes, and switchboard rooms.

1. Legend: 1/4-inch- (6.4-mm-) steel letter and number stamping or embossing with legend corresponding to indicated circuit designations.
2. Tag Fasteners: Nylon cable ties.
3. Band Fasteners: Integral ears.

M. Apply identification to conductors as follows:

1. Conductors to Be Extended in the Future: Indicate source and circuit numbers.
2. Multiple Power or Lighting Circuits in the Same Enclosure: Identify each conductor with source, voltage, circuit number, and phase. Use color-coding to identify circuits' voltage and phase.
3. Multiple Control and Communication Circuits in the Same Enclosure: Identify each conductor by its system and circuit designation. Use a consistent system of tags, color-coding, or cable marking tape.

N. Apply warning, caution, and instruction signs as follows:

1. Warnings, Cautions, and Instructions: Install to ensure safe operation and maintenance of electrical systems and of items to which they connect. Install engraved plastic-laminated instruction signs with approved legend where instructions are needed for system or equipment operation. Install metal-backed butyrate signs for outdoor items.

2. Emergency Operation: Install engraved laminated signs with white legend on red background with minimum 3/8-inch- (9-mm-) high lettering for emergency instructions on power transfer, load shedding, and other emergency operations.

O. Equipment Identification Labels: Engraved plastic laminate. Install on each unit of equipment, including central or master unit of each system. This includes power, lighting, communication, signal, and alarm systems, unless units are specified with their own self-explanatory identification. Unless otherwise indicated, provide a single line of text with 1/2-inch- (13-mm-) high lettering on 1-1/2-inch- (38-mm-) high label; where two lines of text are required, use labels 2 inches (50 mm) high. Use white lettering on black field. Apply labels for each unit of the following categories of equipment using mechanical fasteners:

1. Panelboards, electrical cabinets, and enclosures.
2. Access doors and panels for concealed electrical items.
3. Electrical switchgear and switchboards.
4. Emergency system boxes and enclosures.
5. Disconnect switches.
6. Enclosed circuit breakers.
7. Motor starters.
8. Push-button stations.
9. Power transfer equipment.
10. Contactors.
11. Remote-controlled switches.
12. Control devices.
13. Transformers.
14. Power-generating units.
15. Telephone switching equipment.
16. Clock/program master equipment.
17. Fire alarm master station or control panel.

END OF SECTION 260553

260923 – LIGHTING CONTROL DEVICES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Time switches.
2. Photoelectric switches.
3. Standalone daylight-harvesting switching and dimming controls.
4. Indoor occupancy and vacancy sensors.
5. Switchbox-mounted occupancy and vacancy sensors
6. Digital timer light switches.
7. High-bay occupancy and vacancy sensors.
8. Outdoor motion sensors.
9. Lighting contactors.

B. Related Requirements:

1. Section 262726 "Wiring Devices" for wall-box dimmers, non-networkable wall-switch occupancy sensors, and manual light switches.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Shop Drawings:

1. Show installation details for the following:

   a. Occupancy sensors.
   b. Vacancy sensors.

2. Interconnection diagrams showing field-installed wiring.
3. Include diagrams for power, signal, and control wiring.

1.3 INFORMATIONAL SUBMITTALS

A. Product Data, including technical specifications.

B. Field quality-control reports.

C. Sample warranty.

1.4 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

B. Software and firmware operational documentation.

1.5 WARRANTY

A. Manufacturer's Warranty: Manufacturer and Installer agree to repair or replace lighting control devices that fail(s) in materials or workmanship within specified warranty period.

1. Warranty Period: Three year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 TIME SWITCHES

A. Manufacturer's:
1. Intermatic (Basis of Design)
2. GE
3. Square D.
4. Or equal.

B. Electronic Time Control: Solid state, programmable, with alphanumeric display; complying with UL 917.

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
2. Contact Configuration: SPDP-DPDT.
3. Contact Rating: 20-A ballast load, 120-/240-V ac.
4. Programs: Astronomic, 365-Day, Multi-Circuit Electronic Control, 120-277VAC, 50/60Hz.
5. Circuitry: Allow connection of a photoelectric relay as substitute for on-off function of a program.
6. Astronomic Time: All channels.
7. Automatic daylight savings time changeover.
8. Battery Backup: Not less than seven days reserve, to maintain schedules and time clock.
9. Four (4) circuit model: Intermatic model #ET90415CR. (used with Electric Panel T lighting)
10. Eight (8) circuit model: Intermatic model #ET90815CR. (used with Electric Panel AP lighting)

2.2 INDOOR OCCUPANCY AND VACANCY SENSORS

A. Manufacturer's
   1. Hubbell Control Solutions
   2. Intermatic, Inc.
   3. Lutron
   4. Watt Stopper, Legrand
   5. Or equal.

B. General Requirements for Sensors:

   1. Ceiling-mounted, solid-state indoor occupancy sensors.
   2. Dual technology (ultrasonic and passive infrared).
   3. Integrated power pack.
   4. Hardwired connection to switch.
   5. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
   6. Operation:
      a. Combination Sensor: Unless otherwise indicated, sensor shall be programmed to turn lights on when coverage area is occupied and turn them off when unoccupied, or to turn off lights that have been manually turned on; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.

   7. Sensor Output: Contacts rated to operate the connected relay, complying with UL 773A.
   8. Power: Line voltage.
   9. Power Pack: Dry contacts rated for 20-A ballast or LED load at 120- and 277-V ac, for 13-A tungsten at 120-V ac, and for 1 hp at 120-V ac. Sensor has 24-V dc, 150-mA, Class 2 power source, as defined by NFPA 70.
   10. Mounting:

      a. Sensor: Suitable for mounting in any position on a standard outlet box.
      b. Relay: Externally mounted through a 1/2-inch (13-mm) knockout in a standard electrical enclosure.
      c. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.

   11. Indicator: Digital display, to show when motion is detected during testing and normal operation of sensor.
   12. Bypass Switch: Override the "on" function in case of sensor failure.
   13. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc (21.5 to 2152 lux); turn lights off when selected lighting level is present.

C. PIR Type: Ceiling mounted; detect occupants in coverage area by their heat and movement.

1. Detector Sensitivity: Detect occurrences of 6-inch- (150-mm-) minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. (232 sq. cm).
2. Detection Coverage in spaces that are less than 800 square feet (Room, Ceiling Mounted): Detect occupancy anywhere in a circular area of 1000 sq. ft. (93 sq. m) when mounted on a 96-inch- (2440-mm-) high ceiling.
3. Detection Coverage in spaces that are greater than 800 square feet (Corridor, Ceiling Mounted): Detect occupancy within 90 feet (27.4 m) when mounted on a 10-foot- (3-m-) high ceiling.

D. Ultrasonic Type: Ceiling mounted; detect occupants in coverage area through pattern changes of reflected ultrasonic energy.

1. Detector Sensitivity: Detect a person of average size and weight moving not less than 12 inches (305 mm) in either a horizontal or a vertical manner at an approximate speed of 12 inches/s (305 mm/s).
2. Detection Coverage in spaces less than 800 square feet (Standard Room): Detect occupancy anywhere within a circular area of 1000 sq. ft. (93 sq. m) when mounted on a 96-inch- (2440-mm-) high ceiling.
3. Detection Coverage in spaces greater than 800 square feet (Large Room): Detect occupancy anywhere within a circular area of 2000 sq. ft. (186 sq. m) when mounted on a 96-inch- (2440-mm-) high ceiling.

E. Dual-Technology Type: Ceiling mounted; detect occupants in coverage area using PIR and ultrasonic detection methods. The particular technology or combination of technologies that control on-off functions is selectable in the field by operating controls on unit.

1. Sensitivity Adjustment: Separate for each sensing technology.
2. Detector Sensitivity: Detect occurrences of 6-inch- (150-mm-) minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. (232 sq. cm), and detect a person of average size and weight moving not less than 12 inches (305 mm) in either a horizontal or a vertical manner at an approximate speed of 12 inches/s (305 mm/s).
3. Detection Coverage in spaces less than 800 square feet (Standard Room): Detect occupancy anywhere within a circular area of 1000 sq. ft. (93 sq. m) when mounted on a 96-inch- (2440-mm-) high ceiling.
4. Detection Coverage in spaces greater than 800 square feet (Large Room): Detect occupancy anywhere within a circular area of 2000 sq. ft. (186 sq. m) when mounted on a 96-inch- (2440-mm-) high ceiling.

2.3 SWITCHBOX-MOUNTED OCCUPANCY SENSORS

A. Used in spaces less than 200 square feet, unless otherwise specified.

B. General Requirements for Sensors: Automatic-wall-switch occupancy sensor with manual on-off switch, suitable for mounting in a single gang switchbox using hardwired connection.

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
2. Occupancy Sensor Operation: Unless otherwise indicated, turn lights on when coverage area is occupied, and turn lights off when unoccupied; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.
3. Operating Ambient Conditions: Dry interior conditions, 32 to 120 deg F (0 to 49 deg C).
4. Switch Rating: Not less than 800-VA ballast or LED load at 120 V, 1200-VA ballast or LED load at 277 V, and 800-W incandescent.

2.4 OUTDOOR MOTION SENSORS

A. Manufacturer's:
1. Hubbell Control Solutions
2. Cooper Industries, Inc.
3. Leviton Manufacturing Co.
4. Watt Stopper, Legrand.
5. Or equal.

B. General Requirements for Sensors: Solid-state outdoor motion sensors.

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
2. Dual-technology (PIR and infrared) type, weatherproof. Detect occurrences of 6-inch- (150-mm-) minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. (232 sq. cm). Comply with UL 773A.
3. Switch Rating:
    a. Luminaire-Mounted Sensor: 1000-W incandescent, 500-VA fluorescent/LED.
    b. Separately Mounted Sensor: Dry contacts rated for 20-A ballast load at 120- and 277-V ac, for 13-A tungsten at 120-V ac, and for 1 hp at 120-V ac. Sensor has 24-V dc, 150-mA, Class 2 power source, as defined by NFPA 70.
4. Voltage: Dual voltage, 120- and 277-V type.
5. Detector Coverage:
    a. Standard Range: 210-degree field of view, with a minimum coverage area of 900 sq. ft. (84 sq. m).
    b. Long Range: 180-degree field of view and 110-foot (34-m) detection range.

6. Ambient-Light Override: Concealed, field-adjustable, light-level sensor from 10 to 150 fc (108 to 1600 lux). The switch prevents the lights from turning on when the light level is higher than the set point of the sensor.
7. Concealed, "off" time-delay selector at 30 seconds and 5, 10, and 20 minutes.
8. Adaptive Technology: Self-adjusting circuitry detects and memorizes usage patterns of the space and help eliminate false "off" switching.
9. Operating Ambient Conditions: Suitable for operation in ambient temperatures ranging from minus 40 to plus 130 deg F (minus 40 to plus 54 deg C), rated as "raintight" according to UL 773A.

2.5 LIGHTING CONTACTORS

A. <Double click here to find, evaluate, and insert list of manufacturers and products.>

B. Manufacturer's:
1. ABB, Electrification Products Division
2. Allen Bradley/Rockwell Automation
3. Square D, Schneider Electric USA
4. Or Equal.

C. Description: Electrically operated and mechanically held, combination-type lighting contactors with fusible switch, complying with NEMA ICS 2 and UL 508.

1. Current Rating for Switching: Listing or rating consistent with type of load served, including tungsten filament, inductive, and high-inrush ballast (ballast with 15 percent or less THD of normal load current).
2. Fault Current Withstand Rating: Equal to or exceeding the available fault current at the point of installation.
3. Enclosure: Comply with NEMA 250.
4. Provide with control and pilot devices as indicated on Drawings, matching the NEMA type specified for the enclosure.

2.6 CONDUCTORS AND CABLES

A. Power Wiring to Supply Side of Remote-Control Power Sources: Not smaller than No. 12 AWG. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables."

B. Classes 2 and 3 Control Cable: Multiconductor cable with stranded-copper conductors not smaller than No. 18 AWG. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables."

C. Class 1 Control Cable: Multiconductor cable with stranded-copper conductors not smaller than No. 14 AWG. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables."

PART 3 - EXECUTION

3.1 INSTALLATION

A. Comply with NECA 1.

B. Examine lighting control devices before installation. Reject lighting control devices that are wet, moisture damaged, or mold damaged.

C. Coordinate layout and installation of ceiling-mounted devices with other construction that penetrates ceilings or is supported by them, including light fixtures, HVAC equipment, smoke detectors, fire-suppression systems, and partition assemblies.

D. Install and aim sensors in locations to achieve not less than 90-percent coverage of areas indicated. Do not exceed coverage limits specified in manufacturer's written instructions.

3.2 WIRING INSTALLATION

A. Wiring Method: Comply with Section 260519 "Low-Voltage Electrical Power Conductors and Cables." Minimum conduit size is 1/2 inch (13 mm).

B. Wiring within Enclosures: Separate power-limited and nonpower-limited conductors according to conductor manufacturer's written instructions.

C. Size conductors according to lighting control device manufacturer's written instructions unless otherwise indicated.

D. Splices, Taps, and Terminations: Make connections only on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures.

3.3 IDENTIFICATION

A. Identify components and power and control wiring according to Section 260553 "Identification for Electrical Systems."

B. Label time switches and contactors with a unique designation.

3.4 FIELD QUALITY CONTROL

A. Perform the following tests and inspections with the assistance of a factory-authorized service representative:

1. Operational Test: After installing time switches and sensors, and after electrical circuitry has been energized, start units to confirm proper unit operation.

2. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

B. Prepare test and inspection reports.

3.5 ADJUSTING

A. Occupancy Adjustments: When requested within 12 months from date of Substantial Completion, provide on-site assistance in adjusting lighting control devices to suit actual occupied conditions. Provide up to one visit to Project during other-than-normal occupancy hours for this purpose.

1. For occupancy and motion sensors, verify operation at outer limits of detector range. Set time delay to suit Owner's operations.
2. For daylighting controls, adjust set points and deadband controls to suit Owner's operations.
3. Align high-bay occupancy sensors using manufacturer's laser aiming tool.

3.6 SOFTWARE SERVICE AGREEMENT

A. Technical Support: Beginning at Substantial Completion, service agreement shall include software support for two years.

B. Upgrade Service: At Substantial Completion, update software to latest version. Install and program software upgrades that become available within two years from date of Substantial Completion. Upgrading software shall include operating system and new or revised licenses for using software.

1. Upgrade Notice: At least 60 days to allow Owner to schedule and access the system and to upgrade computer equipment if necessary.

3.7 DEMONSTRATION

A. Engage a factory-authorized service representative to train] Owner's maintenance personnel to adjust, operate, and maintain lighting control devices.

END OF SECTION 260923

SECTION 262200 - LOW-VOLTAGE DRY TYPE DISTRIBUTION TRANSFORMERS

PART 1 - GENERAL

1.1 SCOPE

A. Furnish and install dry type isolation transformers of the types, sizes and quantities indicated on the contract drawings. Provide all lugs, accessories and mounting hardware necessary for proper installation and operation.

B. It shall be the contractor's responsibility to confirm all existing and future access openings and proper ventilation to properly install the transformer in the designated locations. Should the contractor require any alterations to the building structure or require the dismantling of the transformer provided to meet this requirement the contractor shall provide this work at no additional cost.

1.2 RELATED DOCUMENTS

A. All drawings and general provisions of the Contract including General and Supplementary Conditions apply to this section.

1.3 SUBMITTALS

A. Provide product information prior to fabrication and installation. Product data shall include all dimensions, weights, electrical ratings, wiring diagrams and required clearances.

B. When requested, provide additional product data and certifications necessary to show conformance with this specification.

C. Provide information for record purposes including field test reports and maintenance data as required.

1.4 RELATED STANDARDS

A. Provide transformers in accordance with the following standards, where applicable:
   1. Underwriter's Laboratory 1561, Standard for Safety for Dry-Type General Purpose and Power Transformers
   2. Underwriter's Laboratory 506, Standard for Safety for Specialty Transformers
   3. NEMA ST 20, Dry Type Transformers for General Applications
   4. NEMA 250, Enclosures for Electrical Equipment (1000 V Max)
   5. ANSI / IEEE C57.12.91, Standard Test Code for Dry-Type Distribution and Power Transformers
   6. U.S. Department of Energy 10 CFR Part 431 Energy Conservation Program: Energy Conservation Standards for Distribution Transformers; Final Rule, dated April 18, 2013. These efficiency standards shall take effect January 1, 2016. All transformers covered in the scope of this document and this specification, manufactured after December 31, 2015, shall be compliant with the new standard.

B. Manufacturer Seismic Qualification: The low voltage general purpose dry type transformer (1000kVA max.) shall meet and be certified to seismic requirements specified in the IBC 2021 International Building Code.

1. The low voltage general purpose dry type transformer shall be complaint with IBC 2021 parameters.
   a. Ip – Importance Factor: 1.5 – Components must function after an earthquake for life safety purposes (Building Occupancy Code IV).
   b. Sds – For ventilated transformers Sds is <=2.00g as standard up to 1000kVA. Encapsulated transformers Sds is 2.00g
   c. z/h – Height factor ratio: 1.00 Note: Ratio is a calculated value equal to the floor the gear is installed on divided by 12. A 6th floor installation is a 0.5 value. A basement or ground floor installation is a 0.0 value.
2. Equipment shall be designed to be located in a concrete and steel, moment-resisting frame building not exceeding 12 stories in height with a minimum story height of 10 feet.]

1.5 QUALITY ASSURANCE

A. Manufacturer shall have produced similar electrical equipment for a minimum period of 10 years.

B. Products shall be listed by Underwriters Laboratories, Inc.

1.6 DELIVERY, STORAGE AND HANDLING

A. Handle transformers in accordance manufacturer's recommendations. Utilize factory provisions for all lifting, rigging, or hoisting.

B. Store transformers prior to installation in a temperature and humidity controlled space. If such a space is not available, apply temporary heat in accordance with the manufacturer's instructions within each ventilated type transformer case to exclude moisture and condensation.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. The low voltage, dry type transformer(s) shall be supplied by Siemens or pre-approved equal. Approved manufacturers are as follows:
   1. Siemens
   2. Square D
   3. Cutler Hammer
   4. General Electric
   5. Or equal

B. Transformers specified in this Section and power distribution equipment feeding and being fed by the transformers shall be warranted and serviced by the same manufacturer. Manufacturer shall have a local field service organization available on an as needed basis.

2.2 GENERAL REQUIREMENTS

A. Transformers shall be of the general purpose, self cooled, two winding, dry type designed for 60 Hz operation. Transformers shall be designed, manufactured and tested

in accordance with the latest ANSI, NEMA and IEEE Standards and shall be listed and labeled in accordance with UL 1561.

B. Insulation System
   1. Transformers 15 KVA and larger shall be of the ventilated type and have a UL recognized 220°C insulation system. The temperature ratings shall be based on an allowable 115°C winding temperature rise above a 30°C hot spot and 40°C ambient.
   2. Transformer design KVA rating shall be suitable for a 30°C average, 40°C maximum ambient temperature.

C. Core And Coil
   1. Core construction shall be of non-aging electrical grade grain-oriented silicon steel with high permeability, low hysteresis and low eddy current losses as needed to achieve these efficiency levels. Core laminations shall be tightly assembled and magnetic flux densities shall be kept well below the saturation point.
   2. Windings shall be wound of high quality aluminum.
   3. Ventilation of windings shall be accomplished by insulated spacers installed and arranged to brace coil layers and provide maximum ventilation. Core and coil assemblies shall be constructed to provide short circuit withstand capability as defined by ANSI and NEMA standards. The complete assembly shall be installed on vibration dampening pads to reduce noise and securely bolted to the enclosure base. A flexible grounding conductor shall be installed between the core and coil assembly and the transformer enclosure.
   4. Core and coil sealing process:
      a. The complete core and coil assembly shall be impregnated with non-hydroscopic thermo-setting polyester varnish to provide a high dielectric and flame retardant seal.
      b. The shield of varnish to the coils shall effectively impregnate the entire core and coil assembly that results in a unit which is virtually impermeable to moisture, dust, dirt, salt air, other industrial contaminants and provide high dielectric seal as well as fungus resistant.
   5. Core lamination clamping angle shall be of adequate thickness and hardness to insure a tight and rigid core assembly to eliminate movement of core plates. Welded core designs shall include multiple beads as necessary to insure a tight and rigid core assembly to eliminate core plate movement.
   6. Provide full capacity taps in the high-voltage windings as follows:
      a. 15 KVA through 500 KVA step-down transformers: 2 – 2½ % full capacity above normal and 4 – 2½ % full capacity below normal.
      b. 750 KVA and above step-down transformers: 2 – 2½ % full capacity above normal and 2 – 2½% full capacity below normal.
      c. Step-up and dual primary transformers: Provide NEMA standard taps.

D. Enclosures
   1. Ventilated enclosures shall be of heavy gauge steel construction of NEMA 3R construction for outdoor use with the addition of weather shields. Front and rear covers shall be removable to provide access to terminal compartment(s).

Terminals shall be fully sized to carry the transformer full load current and shall be arranged to accept UL listed cable connectors.

2. Enclosure wiring space and positioning of terminals shall allow for adequate cable bending space.
3. Finish enclosures in ANSI 61 gray paint.
4. Each transformer shall have a securely attached nameplate providing complete electrical ratings, wiring diagram, tap connections and catalog number, as applicable.

E. Sound
   1. Unless otherwise specified, sound levels shall be in accordance with values allowed by NEMA ST-20.

F. Accessories
   1. Provide weather shields for ventilated transformers installed outdoors conforming to the requirements of NEMA 250, Type 3R All insulating materials are to exceed NEMA ST20 standards and be rated for 220°C UL component recognized insulation system.

2.3 PACKAGED PANELBOARD AND TRANSFORMER

A. Transformers 15kVA and larger shall be 150°C temperature rise above 40°C ambient. Transformers 25kVA and larger shall have a minimum of 4 - 2.5% full capacity primary taps. Exact voltages and taps to be as designated on the plans or the transformer schedule.
B. The maximum temperature of the top of the enclosure shall not exceed 50°C rise above a 40°C ambient.
C. Transformers shall be low loss type with minimum efficiencies per NEMA TP1 when operated at 35% of full load capacity. Efficiency shall be tested in accord with NEMA TP2.
D. The transformer(s) shall be rated as indicated in the following schedule:
   Identification Number(s)
   kVA Rating
   Voltages
   Phase
   Frequency

2.3.1 CONSTRUCTION

A. Transformers are to be encapsulated using a sand-epoxy resin mixture to provide maximum protection against moisture, dust and corrosive environments.
B. All cores to be constructed with low hysteresis and eddy current losses. Magnetic flux densities are to be kept well below the saturation point to prevent core overheating.
C. The core of the transformer shall be grounded to the enclosure by means of a grounding conductor sized in accordance with applicable UL and NEC standards.
D. The packaged panelboard and transformer enclosures shall be fabricated of heavy gauge, sheet steel construction. The entire enclosure shall be finished utilizing a continuous

process consisting of degreasing, cleaning and phosphatizing, followed by electrostatic deposition of polymer polyester powder coating and baking cycle to provide uniform coating of all edges and surfaces. The coating color shall be ANSI 49.

E. All transformers shall have a minimum 2-5% full capacity primary taps below normal and shall be rated 115°C temperature rise above 40°C maximum ambient. All insulating aterials shall be in accordance with current ANSI C89.2 and NEMA ST20 standards for a 185°C UL component recognized insulation system.
F. Packaged power supplies shall include integrally mounted and wired primary and secondary main circuit breakers in accordance with the National Electrical Code requirements.
G. Branch circuit breakers shall be Square D Type QO QWIK-GARD or equal. All breakers shall be plug-in type. Trip indication shall be clearly shown by the breaker handle taking position between ON and OFF when the breaker is tripped and the VISI-TRIP indication consisting of a highly visible red tripped circuit indication.
H. A hinged access door shall be provided which maintains itself in the open position when desired, and which has padlock provisions.
I. The packaged transformer and panelboard shall constructed as separate enclosures capable of being assembled or disassembled as independent units.

2.3.2 SOUND LEVELS

A. Sound levels shall be warranted by the manufacturer not to exceed the following: 5 to 50KVA - 45dB.

2.3.3 OPTIONAL ACCESSORIES

A. Provide weather shields for units installed in damp or wet locations.
B. Provide wall mounting brackets as required for space compliance for units.

1.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install per manufacturer's recommendations and contract documents.
B. Install units plumb, level and rigid without distortion

3.2 ADJUSTMENTS AND CLEANING

A. On completion of installation, inspect components. Remove paint splatters and other spots, dirt and debris. Repair scratches and mars on finish to match original finish. Clean components internally using methods and materials recommended by manufacturer.

B. Adjust transformer taps to provide optimum voltage conditions at utilization equipment throughout normal operating cycle of facility. Record primary and secondary voltages and tap settings and submit with test results.

3.3 TESTING

A. Include the following minimum inspections and tests according to manufacturer's written instructions. Comply with IEEE C57.12.91 for test methods and data correction factors.

B. Inspect accessible components for cleanliness, mechanical and electrical integrity and damage or deterioration. Verify that temporary shipping bracing has been removed. Include internal inspection through access panels and covers.

C. Inspect bolted electrical connections for tightness according to manufacturer's published torque values or, if not available, those specified in UL 486A and UL 486B.

3.4 WARRANTY

A. Equipment manufacturer warrants that all goods supplied are free of non-conformities in workmanship and materials for one year from date of initial operation, but not more than eighteen months from date of shipment.

END OF SECTION 262200

SECTION 262416 – PANELBOARDS AND SWITCHBOARDS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes panelboards, overcurrent protective devices, and associated auxiliary equipment rated 600 V and less for the following types:

1. Lighting and appliance branch-circuit panelboards.
2. Distribution switchboards.
3. Transient voltage surge suppressor panelboards.

B. Related Sections include the following:

1. Division 26 Section "Fuses."

1.3 DEFINITIONS

A. EMI: Electromagnetic interference.

B. GFCI: Ground-fault circuit interrupter.

C. RFI: Radio-frequency interference.

D. RMS: Root mean square.

E. SPDT: Single pole, double throw.

F. TVSS: Transient voltage surge suppressor.

1.4 SUBMITTALS

A. Product Data: For each type of panelboard, switchboard, overcurrent protective device, TVSS device, accessory, and component indicated. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.

B. Shop Drawings: For each panelboard, switchboard and related equipment.

1. Dimensioned plans, elevations, sections, and details. Show tabulations of installed devices, equipment features, and ratings. Include the following:

    a. Enclosure types and details for types other than NEMA 250, Type 1.
    b. Bus configuration, current, and voltage ratings.
    c. Short-circuit current rating of panelboards and overcurrent protective devices.
    d. UL listing for series rating of installed devices.
    e. Features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.

2. Wiring Diagrams: Diagram power, signal, and control wiring and differentiate between manufacturer-installed and field-installed wiring.

C. Field Test Reports: Submit written test reports and include the following:

1. Test procedures used.
2. Test results that comply with requirements.
3. Results of failed tests and corrective action taken to achieve test results that comply with requirements.

D. Panelboard and Switchboard Schedules: For installation in panelboards. Submit final versions after load balancing.

E. Maintenance Data: For panelboards and components to include in maintenance manuals specified in Division 1. In addition to requirements specified in Division 1 Section "Contract Closeout," include the following:

1. Manufacturer's written instructions for testing and adjusting overcurrent protective devices.
2. Time-current curves, including selectable ranges for each type of overcurrent protective device.

F. Should the contractor submit any substitution (including other approved manufacturers) other than the specified product the contractor shall be responsible for all electrical, mechanical, structural, and architectural revisions as required to accommodate the installation of the substituted equipment at no additional cost to the owner.

1.5 QUALITY ASSURANCE

A. Comply with NEMA PB 1.

B. Comply with NFPA 70.

1.6 COORDINATION

A. Coordinate layout and installation of switchboards, panelboards and associated components with other construction that penetrates walls or is supported by them, including electrical and other types of equipment, raceways, piping, and encumbrances to workspace clearance requirements.

1.7 EXTRA MATERIALS

A. Keys: Four spares of each type of panelboard cabinet lock. Key all cabinets alike.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Panelboards, Overcurrent Protective Devices, Controllers, Contactors, and Accessories:

a. Eaton Corp.; Cutler-Hammer Products.
b. Schneider Electric - Square D Co. (Basis of Design)
c. General Electric
d. Or equal

2.2 FABRICATION AND FEATURES

A. Enclosures: Flush- and surface-mounted cabinets as noted on the drawings. NEMA PB 1, Type 1, to meet environmental conditions at installed location.

1. Outdoor Locations: NEMA 250, Type 3R.

B. Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box.

C. Hinged Front Cover: For boxes more than 28 inches high, entire front trim hinged to box and with standard door within hinged trim cover.

D. Finish: Manufacturer's standard enamel finish over corrosion-resistant treatment or primer coat.

E. Directory Card: With transparent protective cover, mounted inside metal frame, inside panelboard door.

F. Bus: Hard-drawn copper, 98 percent conductivity.

G. Main and Neutral Lugs: Mechanical type suitable for use with conductor material.

H. Equipment Ground Bus: Adequate for feeder and branch-circuit equipment ground conductors; bonded to box.

I. Service Equipment Label: UL labeled for use as service equipment for panelboards with main service disconnect switches.

J. Future Devices: Mounting brackets, bus connections, and necessary appurtenances required for future installation of devices.

K. Isolated Equipment Ground Bus: Adequate for branch-circuit equipment ground conductors; insulated from box.

L. Extra-Capacity Neutral Bus: Neutral bus rated 200 percent of phase bus and UL listed as suitable for nonlinear loads as noted on the drawings.

M. Split Bus: Vertical buses divided into individual vertical sections.

N. Gutter Barrier: Arrange to isolate individual panel sections.

O. Feed-through Lugs: Mechanical type suitable for use with conductor material. Locate at opposite end of bus from incoming lugs or main device. Provide wire feed same size as feeder.

P. Provide ARC Flash labeling as required by the National Electrical Code.

2.3 PANELBOARD SHORT-CIRCUIT RATING

A. UL label indicating series-connected rating with integral or remote upstream devices. Include size and type of upstream device allowable, branch devices allowable, and UL series-connected short-circuit rating.

B. Fully rated to interrupt symmetrical short-circuit current available at terminals.

C. Contractor shall confirm from local utility company prior to submittal review of minimum symmetrical short circuit rating requirements within project site, should the contract documents differ the contractor shall submit and provide the greater rated value.

2.4 LIGHTING AND APPLIANCE BRANCH-CIRCUIT PANELBOARDS

A. Branch Overcurrent Protective Devices: Bolt-on circuit breakers, replaceable without disturbing adjacent units.

B. Doors: Front mounted with concealed hinges; secured with flush latch with tumbler lock; keyed alike.

C. All panelboards shall be fully equipped with all branch breaker mounting assemblies.

D. All panelboards shall be fully equipped with a grounding bus bar assembly which must be large enough to meet a minimum of 100% of the branch circuit quantities plus 10%.

E. All panelboards shall be fully equipped with a neutral bus bar assembly which must be large enough to meet a minimum of 100% of the branch breaker quantities plus 10%.

2.5 CLASS 2 LIGHTING PANELS – WITH CONTROL SYSTEM

Lighting Control System

A. The lighting control system shall consist of microprocessor-based control electronics with remotely operated circuit breakers mounted to a UL67 listed lighting panelboard interior and enclosed in a UL50 listed panelboard enclosure. The circuit breakers shall provide overcurrent protection, and have an AIR rating or series connected rating that meets or exceeds the fault current of the system to which the panelboard is being applied.

B. Each master control panel shall meet or exceed the following capabilities:

1. Sixteen (16) 2-wire input terminals for connection to external low voltage switch contacts.
2. Time of day scheduling to automatically shut off lighting at specific programmed times
3. Direct control of branch circuits in a master/slave sub-net configuration.
4. Provide true status feedback by monitoring branch circuit breaker status based on actual system voltage at load side terminal.
5. Accept remote commands through the facilities Ethernet infrastructure.

C. All lighting control components shall be installed in a conventional panelboard 20 inches wide or column-width enclosures (as noted on drawings). Suitable barriers shall be installed to separate Class 2 wiring from power conductors.

2.6 DISTRIBUTION SWITCHBOARDS

A. Doors: Front mounted, except omit in fused-switch panelboards; secured with vault-type latch with tumbler lock; keyed alike. Door-in-door construction.

B. Main Overcurrent Protective Devices: Circuit breaker as noted. Main lugs only unless otherwise noted.

C. Branch overcurrent protective devices shall be one of the following:

1. For Circuit-Breaker Frame Sizes 125 A and Smaller: Bolt-on circuit breakers.
2. For Circuit-Breaker Frame Sizes Larger Than 125 A: Bolt-on circuit breakers; plug-in circuit breakers where individual positive-locking device requires mechanical release for removal.

2.7 OVERCURRENT PROTECTIVE DEVICES

A. Molded-Case Circuit Breaker: NEMA AB 1, with interrupting capacity to meet available fault currents.

1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
3. GFCI Circuit Breakers: Single- and two-pole configurations with 5-mA trip sensitivity.

B. Molded-Case Circuit-Breaker Features and Accessories. Standard frame sizes, trip ratings, and number of poles.

1. Lugs: Mechanical style, suitable for number, size, trip ratings, and material of conductors.
2. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HACR for ALL heating, air-conditioning, and refrigerating equipment.
3. Ground-Fault Protection: Integrally mounted relay and trip unit with adjustable pickup and time-delay settings, push-to-test feature, and ground-fault indicator.
4. Undervoltage Trip: Set to operate at 35 to 75 percent of rated voltage without intentional time delay.
5. Auxiliary Switch: Two SPDT switches with "a" and "b" contacts; "a" contacts mimic circuit-breaker contacts, "b" contacts operate in reverse of circuit-breaker contacts.
6. Lock-on clips: Install on circuit breakers for alarm, telecommunications, control systems, and refrigeration equipment.
7. Shunt Trip Device: Integrally mounted relay and trip unit with manual reset ONLY. In addition to the designated locations indicated on the contract documents it shall be required to provide a shunt trip device for any/all elevator and escalator equipment and systems. All elevator and escalator shunt trip devices shall be installed per the ASME A17.1 Safety Code for Elevators and Escalators..

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install panelboards and accessories according to NEMA PB 1.1.

B. Mounting Heights: Top of trim 74 inches (1880 mm) above finished floor, unless otherwise indicated.

C. Mounting: Plumb and rigid without distortion of box. Mount recessed panelboards with fronts uniformly flush with wall finish.

D. Circuit Directory: Create a directory to indicate installed circuit loads after balancing panelboard loads. Obtain approval before installing. Use a computer or typewriter to create directory; handwritten directories are not acceptable.

E. Install filler plates in unused spaces.

F. Provide ONE additional panelboard and accessories of each size and type used on the project to accommodate changes required to resolve interferences or as directed by the Engineer.

G. Provision for Future Circuits at Flush Panelboards: Stub four 1-inch (27-GRC) empty conduits from panelboard into accessible ceiling space or space designated to be ceiling space in the future. Stub four 1-inch (27-GRC) empty conduits into raised floor space or below slab not on grade.

H. Wiring in Panelboard Gutters: Arrange conductors into groups and bundle and wrap with wire ties after completing load balancing.

3.2 IDENTIFICATION

A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs as specified in Division 16 Section "Electrical Identification."

B. Panelboard Nameplates: Label each panelboard with engraved laminated-plastic nameplate mounted with corrosion-resistant screws.

3.3 CONNECTIONS

A. Install equipment grounding connections for panelboards with ground continuity to main electrical ground bus.

B. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

3.4 FIELD QUALITY CONTROL

A. Prepare for acceptance tests as follows:

1. Test insulation resistance for each panelboard bus, component, connecting supply, feeder, and control circuit.
2. Test continuity of each circuit.

B. Testing: After installing panelboards and after electrical circuitry has been energized, demonstrate product capability and compliance with requirements.

1. Procedures: Perform each visual and mechanical inspection and electrical test indicated in NETA ATS, Section 7.5 for switches and Section 7.6 for molded-case circuit breakers. Certify compliance with test parameters.
2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.

C. Balancing Loads: After Substantial Completion, but not more than 60 days after Final Acceptance, measure load balancing and make circuit changes as follows:

1. Measure as directed during period of normal system loading.
2. Perform load-balancing circuit changes outside normal occupancy/working schedule of the facility and at time directed. Avoid disrupting critical 24-hour services such as fax machines and on-line data-processing, computing, transmitting, and receiving equipment.
3. After circuit changes, recheck loads during normal load period. Record all load readings before and after changes and submit test records.
4. Tolerance: Difference exceeding 20 percent between phase loads, within a panelboard, is not acceptable. Rebalance and recheck as necessary to meet this minimum requirement.

3.5 ADJUSTING

A. Set field-adjustable switches and circuit-breaker trip ranges.

3.6 CLEANING

A. On completion of installation, inspect interior and exterior of panelboards. Remove paint splatters and other spots. Vacuum dirt and debris; do not use compressed air to assist in cleaning. Repair exposed surfaces to match the original finish.

END OF SECTION 262416

SECTION 262726 - WIRING DEVICES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes receptacles, connectors, switches, and finish plates.

1.3 DEFINITIONS

A. GFCI or GFI: Ground-Fault Circuit Interrupter.

B. SPD: Surge Protection Device

C. TVSS: Transient Voltage Surge Suppressor.

1.4 SUBMITTALS

A. Product Data: For each product specified.

B. Shop Drawings: Legends for receptacles and switch plates.

C. Samples: For devices and device plates for color selection and evaluation of technical features.

D. Maintenance Data: For materials and products to include in maintenance manuals specified in Division 1.

1.5 QUALITY ASSURANCE

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction.

B. Comply with NEMA WD 1.

C. Comply with NFPA 70.

1.6 COORDINATION

A. Receptacles for Owner-Furnished Equipment: Match plug configurations.

1. Cord and Plug Sets: Match equipment requirements.

1.7 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents. Deliver extra materials to Owner.
1. Floor Service-Outlet Assemblies: One for each 20, but not less than one.
2. Toggle switches with occupancy sensors: One for each five installed but not less than two.
3. TVSS Receptacles: One for each eight installed, but not less than two.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Wiring Devices:

a. Hubbell, Inc.; Wiring Devices Div.
b. Killark Electric Manufacturing Co.
c. Leviton Manufacturing Co., Inc.
d. Pass & Seymour/Legrand; Wiring Devices Div.

2. Wiring Devices for Hazardous (Classified) Locations:

a. Crouse-Hinds Electrical Co.; Distribution Equipment Div.
b. Killark Electric Manufacturing Co.
c. Pyle-National, Inc.; an Amphenol Co.

3. Multioutlet Assemblies:

a. Airey-Thompson Co.
b. Legrand/Wiremold Division.

2.2 RECEPTACLES

A. Straight-Blade (tamper resistant) and Locking Receptacles: Heavy-Duty grade.

B. GFCI Receptacles: Feed-through type, with integral NEMA WD 6, Configuration 5-20R duplex receptacle arranged to protect connected downstream receptacles on same circuit. Design units for installation in a 2-3/4-inch- (70-mm-) deep outlet box without an adapter.

C. Isolated-Ground Receptacles: Equipment grounding contacts connected only to the green grounding screw terminal of the device with inherent electrical isolation from mounting strap.

1. Devices: Listed and labeled as isolated-ground receptacles.
2. Isolation Method: Integral to receptacle construction and not dependent on removable parts.

D. TVSS Receptacles: Duplex type, NEMA WD 6, Configuration 5-20R, with integral TVSS in line to ground, line to neutral, and neutral to ground.

1. TVSS Components: Multiple metal-oxide varistors; rated a nominal clamp level of 500 transient-suppression voltage and minimum single transient pulse energy dissipation of 140 J line to neutral, and 70 J line to ground and neutral to ground.
2. Active TVSS Indication: Light visible in face of device to indicate device as "active" or "no longer active."
3. Identification: Distinctive marking on face of device denotes TVSS-type unit.

E. Industrial Heavy-Duty Receptacle: Comply with IEC 309-1.

F. Hazardous (Classified) Location Receptacles: Comply with NEMA FB 11.

2.3 PENDANT CORD/CONNECTOR DEVICES

A. Description: Matching, locking type, plug and receptacle body connector, NEMA WD 6, Configurations L5-20P and L5-20R, Heavy-Duty grade.

1. Body: Nylon with screw-open cable-gripping jaws and provision for attaching external cable grip.
2. External Cable Grip: Woven wire-mesh type made of high-strength galvanized-steel wire strand, matched to cable diameter, and with attachment provision designed for corresponding connector.

2.4 CORD AND PLUG SETS

A. Description: Match voltage and current ratings and number of conductors to requirements of equipment being connected.

1. Cord: Rubber-insulated, stranded-copper conductors, with type SOW-A jacket. Green-insulated grounding conductor, and equipment-rating ampacity plus a minimum of 30 percent.
2. Plug: Nylon body and integral cable-clamping jaws. Match cord and receptacle type for connection.

2.5 CORD REELS

A. A. Description: Match voltage and current ratings and number of conductors to requirements of equipment being connected.

1. Cord: Rubber-insulated, stranded-copper conductors, with type SOW-A jacket. Green-insulated grounding conductor, and equipment-rating ampacity plus a minimum of 30 percent.
2. Plug: GFCI type device, Nylon body. Match cord and receptacle type for connection
3. Reel: 15 Amp rated, 125V, with 25 linear feet of retractable cable (Hubbell model #HBL45123C). Provide mounting assembly as required for complete installation.

2.6 SWITCHES

A. Snap (toggle) Switches: Heavy-duty, quiet type (single, 3-way and 4-way).

1. Switch: 20 A, 120/277-V ac.

2. Switch with occupancy sensing: 20 A, 120/277-V ac. Passive infrared compaitable with LED and CFL lamps, adjustable time delay of 20 seconds to 30 minutes, 0 – 1000 watt lighting control, manual by-pass control.

3.1 WALL PLATES

A. Single and combination types match corresponding wiring devices.

1. Plate-Securing Screws: Metal with head color to match plate finish.
2. Material for Finished Spaces: 0.04-inch- (1-mm-) thick, Type 302, satin-finished stainless steel.
3. Material for Unfinished Spaces: Galvanized steel.

3.2 MULTIOUTLET ASSEMBLIES

A. Components of Assemblies: Products from a single manufacturer designed for use as a complete, matching assembly of raceways and receptacles.

B. Raceway Material: Metal, with manufacturer's standard finish.

C. Raceway Material: Nonmetal.(accepted in office areas only)

D. Wire: No. 12 AWG.

3.3 FLOOR BOXES FOR ON-GRADE AND ABOVE-GRADE CONCRETE FLOORS

1 Configurations: Boxes shall be available in one-, two-, or three-gang configurations or a single unit with two to eleven independent wiring compartments and available in stamped steel, epoxy coated stamped steel, nonmetallic and cast iron versions. Boxes shall be available in deep and shallow versions. Boxes shall provide pre- and post-pour adjustments. Multiple gang boxes shall also provide a removable barrier between the individual compartments for greater capacity when required. Refer to Drawings for size and types.

a. Acceptable Product: Resource RFB4 Series Boxes for Concrete Floors by Legrand/Wiremold.

b. Acceptable Product: Resource RFB4E-OG Series Shallow Epoxy Coated Stamped Steel Floor Boxes for Concrete Floors by Legrand/Wiremold.

2 Cover:

a. Acceptable Product: FloorPort FPCT, FPBT, and FPFFT Series Covers: Manufactured of die-cast aluminum or die-cast zinc, and available in brushed aluminum finish and powder-coated paint finishes (black, gray, bronze, nickel and brass). Activation covers shall be available in flanged and flangeless versions. Covers shall be available with options for tile or carpet inserts, or flush covers. The cover's hinge shall allow for the cover to open 180 degrees. The furniture feed covers shall come equipped with one 1 inch (25 mm) trade size screw plug opening and one combination 1-1/4 inches (32 mm) and 2 inches (52 mm) trade size screw plug.

1) Flanged covers shall be 7-3/4 inches L by 6-9/16 inches W (197 mm by 167 mm).

2) Flangeless covers shall be 6-3/4 inches L by 5-9/16 inches W (171 mm by 142 mm).

3 Metallic Floor Boxes:

a. Material: Stamped steel and painted with a fusion-bonded epoxy; box interior and exterior painted; 1-3/8 inches (35 mm) pre-pour adjustment; 3/4 inch (19 mm) post-pour adjustment.

b. Material: Epoxy coated cast iron; box interior and exterior painted; 1-3/4 inches (44 mm) pre-pour adjustment; 1/2 inch (13 mm) post-pour adjustment.

c. Box Type: Rectangular.

d. Service: Multiple.

3.4 MISCELLANEUOS WIRING CONNECTIONS AND COMPONENTS

A. Components of Assemblies: Products from a single manufacturer designed for use as a complete, matching assembly of raceways and receptacles.

B. Raceway Material: Metal, with manufacturer's standard finish.

C. Raceway Material: Nonmetal.(accepted in office areas only)

D. Wire: not less than the manufacturers recommendation unless noted otherwise.

E. Security Devices: Provide all wiring devices and connections as specified by the manufacturer and the contract documents. Unless otherwise noted.

F. IT Devices: Provide all wiring devices and connections as specified by the manufacturer and the contract documents. Unless otherwise noted.

G. Audio Visual Devices: Provide all wiring devices and connections as specified by the manufacturer and the contract documents Unless otherwise noted.

3.5 FINISHES

A. Color: Manufacturers standard, as selected by Architect.

PART 3 - EXECUTION

4.1 INSTALLATION

A. Install devices and assemblies plumb and secure.

B. Install wall plates when painting is complete.

C. Install wall dimmers to achieve indicated rating after derating for ganging as instructed by manufacturer.

D. All receptacles used for garage installations shall be GFIC type wiring devices.

E. Do not share neutral conductor on load side of dimmers.

F. Provide ten additional wiring devices (receptacles, TVSS, wallplates, switches, etc.) and accessories of each size and type used on the project to accommodate any changes required to resolve interfereces.

G. Arrangement of Devices: Unless otherwise indicated, mount flush, with long dimension vertical, and grounding terminal of receptacles on top. Group adjacent switches under single, multigang wall plates.

H. Protect devices and assemblies during painting.

I. Adjust locations at which floor service outlets and telephone/power service poles are installed to suit arrangement of partitions and furnishings.

4.2 IDENTIFICATION

A. Comply with Division 16 Section "Electrical Identification."

B. Comply with Division 16 Section "Basic Electrical Materials and Methods."

1. Switches: Where three or more switches are ganged, and elsewhere as indicated, identify each switch with approved legend engraved on wall plate.
2. Receptacles: Identify panelboard and circuit number from which served. Use machine-printed, pressure-sensitive, abrasion-resistant label tape on face of plate and durable wire markers or tags within outlet boxes.

4.3 CONNECTIONS

A. Connect wiring device grounding terminal to outlet box with bonding jumper.

B. Connect wiring device grounding terminal to branch-circuit equipment grounding conductor.

C. Isolated-Ground Receptacles: Connect to isolated-ground conductor routed to designated isolated equipment ground terminal of electrical system.

D. Tighten electrical connectors and terminals according to manufacturers published torque-tightening values. If manufacturers torque values are not indicated, use those specified in UL 486A and UL 486B.

4.4 FIELD QUALITY CONTROL

A. Test wiring devices for proper polarity and ground continuity. Operate each device at least six times.

B. Check TVSS receptacle indicating lights for normal indication.

C. Test GFCI operation with both local and remote fault simulations according to manufacturer's written instructions.

D. Replace damaged or defective components.

4.5 CLEANING

A. Internally clean devices, device outlet boxes, and enclosures. Replace stained or improperly painted wall plates or devices.

END OF SECTION 262726

SECTION 262813 - FUSES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Cartridge fuses rated 600 V ac and less for use in the following:

a. Control circuits.
b. Motor-control centers.
c. Panelboards.
d. Switchboards.
e. Enclosed controllers.
f. Enclosed switches.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

1.3 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Bussmann, by Eaton
2. Edison
3. Littlefuse, Inc.
4. Mersen USA

2.2 CARTRIDGE FUSES

A. Characteristics: NEMA FU 1, current-limiting, nonrenewable cartridge fuses with voltage ratings consistent with circuit voltages.

1. Type RK-1: 250-V, zero- to 600-A rating, 200 kAIC, time delay.
2. Type RK-5: 250-V, zero- to 600-A rating, 200 kAIC, time delay.
3. Type CC: 600-V, zero- to 30-A rating, 200 kAIC, fast acting.
4. Type CD: 600-V, 31- to 60-A rating, 200 kAIC, fast acting.
5. Type J: 600-V, zero- to 600-A rating, 200 kAIC, time delay.
6. Type L: 600-V, 601- to 6000-A rating, 200 kAIC, time delay.
7. Type T: 600-V, zero- to 1200-A rating, 200 kAIC, very fast acting.

B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

C. Comply with NEMA FU 1 for cartridge fuses.

D. Comply with NFPA 70.

E. Coordinate fuse ratings with utilization equipment nameplate limitations of maximum fuse size and with system short-circuit current levels.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install fuses in fusible devices. Arrange fuses so rating information is readable without removing fuse.

B. Install spare-fuse cabinet(s) in location shown on the Drawings or as indicated in the field by Owner.

3.2 IDENTIFICATION

A. Install labels complying with requirements for identification specified in Section 260553 "Identification for Electrical Systems" and indicating fuse replacement information inside of door of each fused switch and adjacent to each fuse block, socket, and holder.

END OF SECTION 262813

SECTION 262816 - ENCLOSED SWITCHES AND CIRCUIT BREAKERS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

A. This Section includes individually mounted enclosed switches and circuit breakers used for the following:

1. Service disconnecting means.
2. Feeder and branch-circuit protection.
3. Motor and equipment disconnecting means.

B. Related Sections include the following:

1. Division 262726 Section "Wiring Devices" for attachment plugs, receptacles, and toggle switches used for disconnecting means.
2. Division 262416 Section "Panelboards and Switchboards" for individually enclosed, fusible switches used as feeder protection.
3. Division 262813 Section "Fuses" for fusible devices.

1.3 DEFINITIONS

A. GFCI: Ground-fault circuit interrupter.

B. RMS: Root mean square.

C. SPDT: Single pole, double throw.

1.4 SUBMITTALS

A. Product Data: For each type of switch, circuit breaker, accessory, and component indicated. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.

B. Shop Drawings: For each switch and circuit breaker.

1. Dimensioned plans, elevations, sections, and details, including required clearances and service space around equipment. Show tabulations of installed devices, equipment features, and ratings. Include the following:

    a. Enclosure types and details for types other than NEMA 250, Type 1.
    b. Current and voltage ratings.
    c. Short-circuit current rating.
    d. UL listing for series rating of installed devices.
    e. Features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.

2. Wiring Diagrams: Power, signal, and control wiring. Differentiate between manufacturer-installed and field-installed wiring.

C. Qualification Data: Submit data for testing agencies indicating that they comply with qualifications specified in "Quality Assurance" Article.

D. Field Test Reports: Submit written test reports and include the following:

1. Test procedures used.
2. Test results that comply with requirements.
3. Results of failed tests and corrective action taken to achieve test results that comply with requirements.

E. Manufacturer's field service report.

F. Maintenance Data: For enclosed switches and circuit breakers and for components to include in maintenance manuals specified in Division 1. In addition to requirements specified in Division 1 Section "Closeout Procedures," include the following:

1. Routine maintenance requirements for components.
2. Manufacturer's written instructions for testing and adjusting switches and circuit breakers.
3. Time-current curves, including selectable ranges for each type of circuit breaker.

1.5 QUALITY ASSURANCE

A. Testing Agency Qualifications: Testing agency that is a member company of the InterNational Electrical Testing Association and that is acceptable to authorities having jurisdiction.

1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association or National Institute for Certification in Engineering Technologies to supervise on-site testing specified in Part 3.

B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

C. Comply with NEMA AB 1 and NEMA KS 1.

D. Comply with NFPA 70.

E. Product Selection for Restricted Space: Drawings indicate maximum dimensions for enclosed switches and circuit breakers, including clearances between enclosures, and adjacent surfaces and other items. Comply with indicated maximum dimensions.

1.6 PROJECT CONDITIONS

A. Environmental Limitations: Rate equipment for continuous operation under the following conditions, unless otherwise indicated:

1. Ambient Temperature: Not less than minus 22 deg F and not exceeding 104 deg F.
2. Altitude: Not exceeding 6600 feet.

1.7 COORDINATION

A. Coordinate layout and installation of switches, circuit breakers, and components with other construction, including conduit, piping, equipment, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

1.8 EXTRA MATERIALS

A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Spares: For the following:

a. Potential Transformer Fuses-Provide an additional 6 fuses of each type utilized on this project.
b. Control-Power Fuses-Provide an additional 6 fuses of each type utilized on this project.
c. Fuses and Fusible Devices for Fused Circuit Breakers-Provide an additional 6 fuses of each type utilized on this project.
d. Fuses for Fused Switches-Provide an additional 10 fuses of each type utilized on this project.

e. Fuses for Fused Power-Circuit Devices-Provide an additional 10 fuses of each type utilized on this project.

2. Spare Indicating Lights-Provide an additional 6 lights of each type utilized on this project.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Fusible Switches:

   a. Eaton Corp.; Cutler-Hammer Products.
   b. General Electric Co.; Electrical Distribution & Control Division.
   c. Siemens Energy & Automation, Inc.
   d. Square D Co.

2. Molded-Case Circuit Breakers:

   a. Eaton Corp.; Cutler-Hammer Products.
   b. General Electric Co.; Electrical Distribution & Control Division.
   c. Klockner-Moeller.
   d. Siemens Energy & Automation, Inc.
   e. Square D Co.

3. Combination Circuit Breaker and Ground-Fault Trip:

   a. Eaton Corp.; Cutler-Hammer Products.
   b. General Electric Co.; Electrical Distribution & Control Division.
   c. Siemens Energy & Automation, Inc.
   d. Square D Co.

4. Molded-Case, Current-Limiting Circuit Breakers:

   a. Eaton Corp.; Cutler-Hammer Products.
   b. General Electric Co.; Electrical Distribution & Control Division.
   c. Siemens Energy & Automation, Inc.
   d. Square D Co.

5. Integrally Fused, Molded-Case Circuit Breakers:

    a. Eaton Corp.; Cutler-Hammer Products.
    b. General Electric Co.; Electrical Distribution & Control Division.
    c. Siemens Energy & Automation, Inc.
    d. Square D Co.

2.2 ENCLOSED SWITCHES

A. Enclosed, Nonfusible Switch: NEMA KS 1, Type HD, minimum 600V rated, with lockable handle.

B. Enclosed, Fusible Switch, 800 A and Smaller: NEMA KS 1, Type HD, minimum 600V rated, with clips to accommodate specified fuses, lockable handle with two padlocks, and interlocked with cover in closed position.

2.3 ENCLOSED CIRCUIT BREAKERS

A. Molded-Case Circuit Breaker: NEMA AB 1, with interrupting capacity to meet available fault currents.

1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
3. Electronic Trip Unit Circuit Breakers: RMS sensing; field-replaceable rating plug; with the following field-adjustable settings:

    a. Instantaneous trip.
    b. Long- and short-time pickup levels.
    c. Long- and short-time time adjustments.
    d. Ground-fault pickup level, time delay, and I^2t response.

4. Current-Limiting Circuit Breakers: Frame sizes 400 A and smaller; let-through ratings less than NEMA FU 1, RK-5.
5. Integrally Fused Circuit Breakers: Thermal-magnetic trip element with integral limiter-style fuse listed for use with circuit breaker; trip activation on fuse opening or on opening of fuse compartment door.
6. GFCI Circuit Breakers: Single- and two-pole configurations with 5-mA trip sensitivity.
7. Molded-Case Switch: Molded-case circuit breaker without trip units.

B. Molded-Case Circuit-Breaker Features and Accessories: Standard frame sizes, trip ratings, and number of poles.

1. Lugs: Mechanical style suitable for number, size, trip ratings, and material of conductors.
2. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HACR for heating, air-conditioning, and refrigerating equipment.
3. Ground-Fault Protection: Integrally mounted relay and trip unit with adjustable pickup and time-delay settings, push-to-test feature, and ground-fault indicator.
4. Communication Capability: Circuit-breaker-mounted communication module with functions and features compatible with power monitoring and control system.
5. Shunt Trip: 120-V trip coil energized from separate circuit, set to trip at 75 percent of rated voltage.
6. Undervoltage Trip: Set to operate at 35 to 75 percent of rated voltage with field-adjustable 0.1- to 0.6-second time delay.
7. Auxiliary Switch: One SPDT switch with "a" and "b" contacts; "a" contacts mimic circuit-breaker contacts, "b"contacts operate in reverse of circuit-breaker contacts.
8. Key Interlock Kit: Externally mounted to prohibit circuit-breaker operation; key shall be removable only when circuit breaker is in off position.
9. Zone-Selective Interlocking: Integral with electronic trip unit; for interlocking ground-fault protection function.

2.4 ENCLOSURES

A. NEMA AB 1 and NEMA KS 1 to meet environmental conditions of installed location.

1. Outdoor Locations: NEMA 250, Type 3R.
2. Kitchen Areas: NEMA 250, Type 4X, stainless steel.
3. Other Wet or Damp Indoor Locations: NEMA 250, Type 4.
4. Hazardous Areas Indicated on Drawings: NEMA 250, Type 7C.

2.5 FACTORY FINISHES

A. Manufacturer's standard prime-coat finish ready for field painting.

B. Finish: Manufacturer's standard paint applied to factory-assembled and -tested enclosures before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine elements and surfaces to receive enclosed switches and circuit breakers for compliance with installation tolerances and other conditions affecting performance.

1. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

A. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from enclosures and components.

B. Provide an additional four branch breakers with enclosures and accessories of each size, phase and voltage as required to accommodate changes to resolve interferences or as directed by the Engineer.

3.3 IDENTIFICATION

A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs as specified in Division 260500 Section "Basic Electrical Materials and Methods"

B. Enclosure Nameplates: Label each enclosure with engraved metal or laminated-plastic nameplate mounted with corrosion-resistant screws.

3.4 CONNECTIONS

A. Install equipment grounding connections for switches and circuit breakers with ground continuity to main electrical ground bus.

B. Install power wiring. Install wiring between switches and circuit breakers, and control and indication devices.

C. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

3.5 FIELD QUALITY CONTROL

A. Prepare for acceptance tests as follows:

1. Test insulation resistance for each enclosed switch, circuit breaker, component, and control circuit.
2. Test continuity of each line- and load-side circuit.

B. Testing: After installing enclosed switches and circuit breakers and after electrical circuitry has been energized, demonstrate product capability and compliance with requirements.

1. Procedures: Perform each visual and mechanical inspection and electrical test indicated in NETA ATS, Section 7.5 for switches and Section 7.6 for molded-case circuit breakers. Certify compliance with test parameters.
2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.

C. Infrared Scanning: After Substantial Completion, but not more than 60 days after Final Acceptance, perform an infrared scan of each enclosed switch and circuit breaker. Open or remove doors or panels so connections are accessible to portable scanner.

1. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each unit 11 months after date of Substantial Completion.
2. Instrument: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
3. Record of Infrared Scanning: Prepare a certified report that identifies switches and circuit breakers checked and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.6 ADJUSTING

A. Set field-adjustable switches and circuit-breaker trip ranges.

3.7 CLEANING

A. On completion of installation, inspect interior and exterior of enclosures. Remove paint splatters and other spots. Vacuum dirt and debris; do not use compressed air to assist in cleaning. Repair exposed surfaces to match original finish.

END OF SECTION 262816

SECTION 264113 - LIGHTNING PROTECTION FOR STRUCTURES

PART 1 - GENERAL

1.1. SUMMARY

A. Section Includes: Traditional lightning protection system installation requirements for
   1. Ordinary structures.

B. Related Requirements
   1. 260526 Grounding and Bonding

1.2. REFERENCES

A. Abbreviations And Acronyms
   1. LPS Lightning Protection System.
   2. LPI Lightning Protection Institute.
   3. LPI-IP Lightning Protection Institute's Inspection Program an independent third party inspection program administrated by LPI and inspected by Intertek, an internationally known testing and inspection agency

B. Definitions: Terms shall be as defined in the referenced standards.

C. Reference Standards
   1. NFPA 780 Standard for the Installation of Lightning Protection Systems
   2. UL 96 Lightning Protection Components
   3. UL 96A Installation Requirements for Lightning Protection Systems
   4. LPI-175 Standard of Practice for the Design-Installation-Inspection of Lighting Protection Systems

1.3. ADMINISTRATIVE REQUIREMENTS

A. Coordination
   1. Coordinate installation of exposed rooftop conductors with roof and parapet surfaces.
   2. Coordinate installation of down conductors with exterior surfaces.

1.4. ACTION SUBMITTALS

A. Product Data: Manufacturer's catalog data for the following items:
   1. Air terminals.
   2. Main and secondary conductors.
   3. Clamp-type connectors.
   4. Lightning protection components.

B. Shop Drawings: Overall lightning protection system, including

1. Physical layout of the equipment.
2. Dimensions (if not equal spacing).
3. Atypical mounting details.
4. Relationship to other parts of the Work.

C. Qualification Statements
1. Manufacturer's qualifications.
2. Installer's qualifications.
3. Installer's LPS design qualifications.
a. LPI Master Installer/Designer Certification

1.5. CLOSEOUT SUBMITTALS

A. Operation And Maintenance Data

B. Record Documentation

C. Certificates

1.6. QUALITY ASSURANCE

A. Qualifications
1. Manufacturers
a. Regularly engaged in the production of lightning protection equipment complying with UL 96.
b. Member of the Lightning Protection Institute (LPI).
2. Installers
a. Company shall be listed by UL as a Lightning Protection Installer.
b. System installation shall be performed under the supervision of an onsite LPI Certified Master Installer.

B. Certifications: LPI-IP Master Installation Certificate for LPS on the entire structure OR LPI-IP Limited Scope Inspection – limited to the LPS within the roof area(s) that are within the scope of work for this project.

PART 2 - PRODUCTS

2.1. LIGHTNING PROTECTION COMPONENTS

A. Manufacturers
1. Manufacturer List
a. East Coast Lightning Equipment, Inc. (www.ecle.biz)
b. Warren Lightning Rod Company (www.wlrc.net) P: 856-854-7000
2. Substitution Limitations: Approved equal may be used.

B. Materials
1. Comply with UL 96.

2.2. LIGHTNING PROTECTION SYSTEM

A. Design Criteria
   1. Design the lightning protection system in accordance with NFPA 780 and UL 96A.
      a. Air terminals shall extend a minimum of 10 inches (254 mm) above elements being protected.
      b. Zone of Protection shall be determined using a 150 foot (46 m) radius rolling sphere.

2.3. ACCESSORIES

A. Fasteners: Suitable configuration for the intended application and of the same material as the conductor. Nails, screws, or bolts employed to secure the fasteners shall be of the same material as the fasteners or of material which is as resistant to corrosion as that of the fasteners. Galvanized or plated steel nails, screws, or bolts are not acceptable.
   1. Do not use mechanical fasteners on membrane roofing.

B. Adhesives: Compatible with both materials being adhered and approved by the manufacturer of any warranted material such as membrane roofing.

C. Connections and Splices: suitable configuration and type for the intended application and of the same material as the conductor.

PART 3 - EXECUTION

3.1. INSTALLERS

A. Installer List
   1. Warren Lightning Rod Company. P: 856-854-7000

B. Substitution Limitations: Approved equal may be used.

3.2. INSTALLATION

A. Comply with UL 96A and LPI-175.

B. Comply with approved shop drawings.

C. Comply with manufacturer's installation recommendations.

3.3. WATERPROOFING THROUGH-ROOF PENETRATIONS

A. The roofing contractor shall furnish and install any slip-sheets, adhesives, etc. that may be required by the roofing manufacturer.

3.4. FIELD QUALITY CONTROL

A. Field Inspections: Obtain a LPI-IP lightning protection system inspection.

B. Non-Conforming Work: Repair any non-confirming conditions, [excluding surge protection devices,]and re-inspect until the Work passes at no additional cost to Owner.

END OF SECTION 264113

265100 – LED INTERIOR LIGHTING

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes the following types of LED luminaires:

1. Cylinder.
2. Downlight.
3. Lowbay.
4. Recessed linear.
5. Strip light.
6. Surface mount, linear.
7. Surface mount, nonlinear.
8. Suspended, linear.
9. Suspended, nonlinear.
10. Materials.
11. Finishes.
12. Luminaire support.

1.2 DEFINITIONS

A. CCT: Correlated color temperature.

B. CRI: Color Rendering Index.

C. Fixture: See "Luminaire."

D. IP: International Protection or Ingress Protection Rating.

E. LED: Light-emitting diode.

F. Lumen: Measured output of lamp and luminaire, or both.

G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

1.3 ACTION SUBMITTALS

A. Product Data: For each type of product, arranged by designation.

B. Shop Drawings: For nonstandard or custom luminaires.

1. Include plans, elevations, sections, and mounting and attachment details.

2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
3. Include diagrams for power, signal, and control wiring.

C. Sustainable Design Submittals:

1. Provide point by point photometric design comparison for all areas.

D. Product Schedule: For luminaires and lamps. Use same designations indicated on Drawings.

1.4 INFORMATIONAL SUBMITTALS

A. Coordination Drawings: Reflected ceiling plan(s) and other details, drawn to scale and coordinated with each other, using input from installers of the items involved:

B. Seismic Qualification Certificates: For luminaires, accessories, and components, from manufacturer.

C. Product Certificates: For each type of luminaire.

D. Sample warranty.

1.5 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

1.6 WARRANTY

A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.

B. Warranty Period: Five (5) years (including parts, labor and materials) from date of Substantial Completion.

PART 2 - PRODUCTS

1. See Electrical Drawings for detailed lighting fixture schedule.

2.2 PERFORMANCE REQUIREMENTS

A. Seismic Performance: Luminaires and lamps shall be labeled vibration and shock resistant.

1. The term "withstand" means "the luminaire will remain in place without separation of any parts when subjected to the seismic forces specified[and the luminaire will be fully operational during and after the seismic event]."

2.3 LUMINAIRE REQUIREMENTS

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

B. Standards:

1. ENERGY STAR certified.
2. NRTL Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by an NRTL.
3. FM Global Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by FM Global.
4. UL Listing: Listed for damp location.
5. Recessed luminaires shall comply with NEMA LE 4.

C. CRI of minimum 70. CCT of 4000 K for exterior pole lights. 3500K for all interior lights, unless noted otherwise on the lighting fixture schedule.

D. Rated lamp life of 50,000 hours to L70.

E. Light fixtures shall have the ability to be dimmable minimum 0-10V.

F. Lamps dimmable from 100 percent to 0 percent of maximum light output.

G. Internal driver.

H. Nominal Operating Voltage: 120 V ac, 277 V ac (Universal) See drawings for specific application voltage.

1. Lens Thickness: At least 0.125 inch (3.175 mm) minimum unless otherwise indicated.

I. Housings:

1. Die-cast aluminum unless specified otherwise.

2.4 CYLINDER

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Include mounting bracket and/or assembly as required per the manufacturer's recommendations.

2.5 DOWNLIGHT

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Universal mounting bracket.

C. Integral junction box with conduit fittings.

D. Optics: As

2.6 LOWBAY

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Universal mounting bracket.

2.7 RECESSED LINEAR

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Integral junction box with conduit fittings.

2.8 STRIP LIGHT

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Integral junction box with conduit fittings.

2.9 SURFACE MOUNT, LINEAR

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Integral junction box with conduit fittings.

2.10 SURFACE MOUNT, NONLINEAR

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Integral junction box with conduit fittings.

2.11 SUSPENDED, LINEAR

A. See Electrical Drawings for detailed lighting fixture schedule.

2.12 SUSPENDED, NONLINEAR

A. See Electrical Drawings for detailed lighting fixture schedule.

B. Integral junction box with conduit fittings.

2.13 MATERIALS

A. Metal Parts:

1. Free of burrs and sharp corners and edges.
2. Sheet metal components shall be steel unless otherwise indicated.
3. Form and support to prevent warping and sagging

B. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.

C. Diffusers, and Globes:

D. See Electrical Drawings for detailed lighting fixture information.
1. Acrylic: One hundred percent virgin acrylic plastic, with high resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
2. Glass: Annealed crystal glass unless otherwise indicated.
3. Lens Thickness: At least 0.125 inch (3.175 mm) minimum unless otherwise indicated.

E. Housings:

1. Die-cast-aluminum housing and heat sink, unless otherwise noted.

2.14 METAL FINISHES

A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

2.15 LUMINAIRE SUPPORT

A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.

B. Single-Stem Hangers: 1/2-inch (13-mm) steel tubing with swivel ball fittings and ceiling canopy. Finish same as luminaire.

C. Rod Hangers: 3/8-inch minimum diameter, cadmium-plated, threaded steel rod.

D. Hook Hangers: Integrated assembly matched to luminaire, line voltage, and equipment with threaded attachment, cord, and locking-type plug.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Comply with NECA 1.

B. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.

C. Install lamps in each luminaire.

D. Supports: Sized and rated for luminaire weight.

E. Flush-Mounted Luminaire Support: Secured to outlet box.

F. Wall-Mounted Luminaire Support:

1. Attached to structural members in walls or attached to a minimum 20 gauge backing plate or attached to wall structural members or attached using through bolts and backing plates on either side of wall unless specified otherwise.
2. Do not attach luminaires directly to gypsum board.

G. Ceiling-Mounted Luminaire Support:
1. Ceiling mount with pendant mounted all-thread.

H. Suspended Luminaire Support:

1. Pendants and Rods: Where longer than 48 inches (1200 mm), brace to limit swinging.
2. Stem-Mounted, Single-Unit Luminaires: Suspend with twin-stem hangers. Support with approved outlet box and accessories that hold stem and provide damping of luminaire oscillations. Support outlet box vertically to building structure using approved devices.
3. Continuous Rows of Luminaires: Use tubing or stem for wiring at one point and tubing or rod for suspension for each unit length of luminaire chassis, including one at each end.
4. Do not use ceiling grid as support for pendant luminaires. Connect support wires or rods to building structure.

I. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables" for wiring connections.

J. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."

3.2 FIELD QUALITY CONTROL

A. Perform the following tests and inspections:

1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.

B. Luminaire will be considered defective if it does not pass operation tests and inspections.

C. Prepare test and inspection reports.

END OF SECTION 265100

265600 – LED EXTERIOR LIGHTING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Exterior solid-state luminaires that are designed for and exclusively use LED lamp technology.
2. Luminaire supports.
3. Luminaire-mounted photoelectric relays.

1.2 DEFINITIONS

A. CCT: Correlated color temperature.

B. CRI: Color rendering index.

C. Fixture: See "Luminaire."

D. IP: International Protection or Ingress Protection Rating

E. Lumen: Measured output of lamp and luminaire, or both.

F. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

1.3 ACTION SUBMITTALS

A. Product Data: For each type of luminaire.

B. Shop Drawings: For nonstandard or custom luminaires.

1. Include plans, elevations, sections, and mounting and attachment details.
2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
3. Include diagrams for power, signal, and control wiring.

C. Delegated-Design Submittal: For luminaire supports.

1. Include design calculations for luminaire supports with wind load restriction up to 120 MPH.

1.4 INFORMATIONAL SUBMITTALS

A. Coordination Drawings: Plans, drawn to scale and coordinated. Signed and Sealed by a certified Professional Engineer registered in the State of New Jersey.

B. Product Certificates: For each type of the following:

1. Luminaire.
2. Photoelectric relay.

C. Sample warranty.

1.5 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

1. Provide a list of all lamp types used on Project. Use ANSI and manufacturers' codes.
2. Provide a list of all photoelectric relay types used on Project; use manufacturers' codes.
3. Provide As-Built Drawings including photometrics and shield requirements.

1.6 FIELD CONDITIONS

A. Mark locations of exterior luminaires for approval by Architect prior to the start of luminaire installation.

1.7 WARRANTY

A. Warranty: Manufacturer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
1. Warranty Period: five year(s) (including parts, labor and materials) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 Approved Manufacturers:

A. Kim Lighting (Basis of Design)

B. Beacon Lighting (Basis of Design)

C. Hess America Lighting (Basis of Design)

D. Or Equal

2.2 PERFORMANCE REQUIREMENTS

A. Seismic Performance: Luminaires shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.

B. Seismic Performance: Luminaires and lamps shall be labeled vibration and shock resistant.

1. The term "withstand" means "the luminaire will remain in place without separation of any parts when subjected to the seismic forces specified."

2.3 LUMINAIRE REQUIREMENTS

A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

B. NRTL Compliance: Luminaires shall be listed and labeled for indicated class and division of hazard by an NRTL.

C. UL Compliance: Comply with UL 1598 and listed for wet location.

D. Lamp base complying with ANSI C81.61 and IEC 60061-1.

E. CRI of minimum 70. CCT of 4000 K, unless noted otherwise.

F. L70 lamp life of 50,000 hours.

G. Lamps dimmable from 100 percent to 0 percent of maximum light output.

H. Nominal Operating Voltage: 120 V ac/208Vac/240 V ac/277 V ac.

I. Lamp Rating: Lamp marked for outdoor use.

J. Source Limitations: Obtain luminaires from single source from a single manufacturer.

2.4 LUMINAIRE TYPES

A. Area and Site:
1. Luminaire Shape: see lighting fixture schedule for fixture styles.
2. Mounting: Pole (supplied with luminaire)
3. Pole – Round (supplied with luminaire)
4. Luminaire-Mounting Height: See Drawings.

5. Distribution: See lighting fixture schedule for type and specific locations: Type 2, Type 3, Type 4, Type 5QM

2.5 MATERIALS

A. Metal Parts: Free of burrs and sharp corners and edges.

B. Sheet Metal Components: Corrosion-resistant aluminum. Form and support to prevent warping and sagging.

C. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position. Doors shall be removable for cleaning or replacing lenses.

D. Diffusers and Globes:

1. Acrylic Diffusers: 100 percent virgin acrylic plastic, with high resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
2. Lens Thickness: At least 0.125 inch (3.175 mm) minimum unless otherwise indicated.

E. Lens and Refractor Gaskets: Use heat- and aging-resistant resilient gaskets to seal and cushion lenses and refractors in luminaire doors.

F. Reflecting surfaces shall have minimum reflectance as follows unless otherwise indicated:

1. White Surfaces: 85 percent.
2. Specular Surfaces: 83 percent.
3. Diffusing Specular Surfaces: 75 percent.

G. Housings:

1. Rigidly formed, weather- and light-tight enclosure that will not warp, sag, or deform in use.
2. Provide filter/breather for enclosed luminaires.

2.6 FINISHES

A. Variations in Finishes: Noticeable variations in same piece are unacceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.

B. Factory-Applied Finish for Aluminum Luminaires: Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.

1. Finish designations prefixed by AA comply with the system established by the Aluminum Association for designating aluminum finishes.
2. Class I, Color-Anodic Finish: AA-M32C22A42/A44 (Mechanical Finish: Medium satin; Chemical Finish: Etched, medium matte; Anodic Coating: Architectural Class I, integrally colored or electrolytically deposited color coating 0.018 mm or thicker), complying with AAMA 611.

    a. Color: per owner selection. Provide color samples for owner approval.

PART 3 - EXECUTION

3.1 GENERAL INSTALLATION REQUIREMENTS

A. Comply with NECA 1.

B. Use fastening methods and materials selected to resist seismic forces defined for the application and approved by manufacturer.

C. Install lamps in each luminaire.

D. Fasten luminaire to structural support.

E. Supports:

1. Sized and rated for luminaire weight.
2. Able to maintain luminaire position after cleaning and relamping.
3. Support luminaires without causing deflection of finished surface.
4. Luminaire-mounting devices shall be capable of supporting a horizontal force of 100 percent of luminaire weight and a vertical force of 400 percent of luminaire weight.
5. Luminaire shall be able to withstand minimum of 125 MPH wind load for a minimum of 60 seconds.

F. Wiring Method: Install cables in raceways. Conceal raceways and cables.

G. Install luminaires level, plumb, and square with finished grade unless otherwise indicated.

H. Coordinate layout and installation of luminaires with other construction.

I. Adjust luminaires that require field adjustment or aiming. Include adjustment of photoelectric device to prevent false operation of relay by artificial light sources, favoring a north orientation.

J. Comply with requirements in Section 260519 "Conductors and Cables" and Section 260533 "Raceways and Boxes" for wiring connections and wiring methods.

3.2 INSTALLATION OF INDIVIDUAL GROUND-MOUNTED LUMINAIRES

A. Aim as indicated on Drawings.

B. Install on colored concrete base with top 30 inches above finished grade or surface at luminaire location. Cast conduit into base, and finish by troweling and rubbing smooth. Concrete materials, installation, and finishing are specified in Section 033000 "Cast-in-Place Concrete."

3.3 CORROSION PREVENTION

A. Aluminum: Do not use in contact with earth or concrete. When in direct contact with a dissimilar metal, protect aluminum by insulating fittings or treatment.

B. Steel Conduits: Comply with Section 16130 "Raceways and Boxes for Electrical Systems." In concrete foundations, wrap conduit with 0.010-inch- (0.254-mm-) thick, pipe-wrapping plastic tape applied with a 50 percent overlap.

3.4 IDENTIFICATION

A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 16075 "Identification for Electrical Systems."

3.5 FIELD QUALITY CONTROL

A. Inspect each installed luminaire for damage. Replace damaged luminaires and components.

B. Perform the following tests and inspections with the assistance of a factory-authorized service representative:

1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
2. Verify operation of photoelectric controls.

C. Illumination Tests:

1. Measure light intensities at night. Use photometers with calibration referenced to NIST standards. Comply with the following IES testing guide(s):
   a. IES LM-52.

2. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.

D. Luminaire will be considered defective if it does not pass tests and inspections.

E. Luminaire Pole; provide a certified wind testing report by the pole manufacturer states the pole can withstand a minimum wind load requirement as mandated by the latest edition of the International Building Code for the location the poles are being installed, but not less than 125 MPH (56 m/s).

F. Prepare a written report of tests, inspections, observations, and verifications indicating and interpreting results. If adjustments are made to lighting system, retest to demonstrate compliance with standards.

3.6 DEMONSTRATION

A. Train Owner's maintenance personnel to adjust, operate, and maintain luminaires and photocell relays.

END OF SECTION 265600

SECTION 283111 - ADDRESSABLE FIRE ALARM SYSTEM, NON-VOICE NOTIFICATION

PART 1 - GENERAL

1.01 DESCRIPTION OF WORK

A. The work covered by this Section shall include all labor, equipment, materials, and services to furnish and install a complete fire alarm system. It shall include all necessary hardware, software and licenses specifically tailored for this installation to form a complete coordinated system ready for operation. All equipment and materials furnished shall be of types or models approved for use in systems and occupancies of this type in accordance with the required codes. The features and capacities described in this specification are required as a minimum for this project and shall be furnished by the successful contractor.

The system shall be a new addressable fire detection and horn/ strobe notification system in accordance with the design drawings in full compliance with all applicable codes and standards. It shall utilize a main control panel with additional remote panels and notification booster panels, as required by the equipment manufacture. The system architecture shall support future modification and supply the minimum space capacities listed in this specification.

a. The system shall provide a commercial dual path communicator for off-site status signaling to a Central or Remove Receiving Station.

b. The system shall support the capability to monitor activity and remotely view information from a PC or app for NFPA 72 Auxiliary notification.

c. The system provided shall have the capacity and expansion capability to support future tenant improvement fitouts, in compliance with relevant codes and modify the fire alarm based on the improved layout and specific occupancy type prior to any fitout construction.

d. The system shall be supplied per the Engineer of Record's design drawings, project specifications and installed in full compliance with the project's cited editions of the National, State and local Codes. All work shall be approved by the local authority having jurisdiction (AHJ) and shall be installed, tested and documented in accordance with the requirements of NFPA 72. If there is a conflict between the referenced NFPA standards, federal, state or local codes, and this specification, it shall be the Installer's responsibility to immediately bring the conflict to the attention of the Owner's Consultant for resolution. The Installer shall not attempt to resolve conflicts directly with the local authorities unless specifically authorized by the Owner. The following reference standards shall be used in conjunction with these requirements unless the applicable legally referenced documents provide more stringent requirements:

1) Underwriters Laboratories (UL) Listings.

2) Americans with Disabilities Act (ADA), the Architectural Barriers Act (ABA), and Accessibility Regulations of the local jurisdiction.
3) Applicable FM Global (Factory Mutual) Property Loss Data sheets.

e. The Installer shall be responsible for filing of all documents, paying all fees, securing all permits, inspections and approvals necessary for conducting this work. This included supplying any 3rd party reviews or certifications required by the AHJ.

2. The system shall include all required hardware, raceways, interconnecting wiring and software to accomplish the requirements of this specification and the schematic design drawings, whether or not specifically itemized herein. All devices installed outdoors or within areas exposed to unconditioned spaces or wet locations shall be listed for "outdoor use". Electrical raceway, fittings and enclosures shall be NEMA Type 4.

3. All equipment furnished shall be new and the latest state-of-the-art products of a single manufacturer, engaged in the manufacturing and sale of analog fire detection devices for over 20 years.

4. Provide the services of qualified system designers to generate shop drawings, and field technicians to provide installation oversight during construction and system startup. Technicians shall inspect, program, test and make any necessary adjustments to the completed system, to ensure compliance with the manufacturer's recommended practices and the approved shop drawings.

5. The system as specified shall be supplied, installed, tested and receive approval by the local Authority Having Jurisdiction, to be turned over to the owner in an operational condition.

6. In the interest of job coordination and responsibilities the installing contractor shall contract with a single supplier for fire alarm equipment, engineering, programming, inspection and tests. All control panel assemblies and connected field appliances shall be provided by the same system supplier and shall be designed and tested to ensure that the system operates as specified.

7. The system specified shall be that of Siemens Industry, model Desigo Modular which meets the project requirements. Being listed as an acceptable Manufacturer in no way relieves obligation to provide all equipment and features in accordance with these specifications. All references to manufacturers model numbers and other pertinent information herein is intended to establish minimum standards of performance, function, and quality. Alternate products must be submitted to the Engineer two weeks prior to bid for approval. Alternate or as-equal products submitted under this contract must provide a detailed line-by-line comparison of how the submitted product meets, exceeds, or does not comply with this specification. All system approved shall meet all the requirements spelled out in this specification. System approval shall be in writing by the Engineer and a copy shall be submitted with the system submittals.

8. An Emergency Responder Radio Communications System (ERRCS), also known as a Public Safety/ First Responder Distributed Antenna System/ Auxiliary Radio

Communication ARC System/ Public Safety Signal Booster, may be required per site conditions to boost weak emergency responder radio signals. The exact ERRCS system requirements shall be determined as required per a radio strength site survey and enforcement oby the local AHJ. Certain building elements are known to reduce radio signal strength, including metal-clad roofing, pre-cast concrete panels, metal-clad siding, low emissivity (Low-E) glass and levels located below grade. This is a separate system, but if installed, does require fire alarm monitoring.

9. Strict conformance to this specification is required to ensure that the installed and programmed system will function as design, and will accommodate the future requirements and operations of the building owner. All specified operational features must be met without exception.

1.02 DEFINITIONS AND ACRONYMS

A. AHJ: Authority Having Jurisdiction, the individual or agency that has legal responsibility for reviewing the design for conformance with local codes and regulations.

B. ASME: American Society of Mechanical Engineers.

C. EoR: The Engineer of Record responsible for the Schematic Design drawings and project specifications

D. ERRCS: Emergency Responder Radio Communications System also known as a Public Safety or First Responder Distributed Antenna System.

E. FACP: Fire alarm control panel.

F. FM: FM Global (Factory Mutual).

G. Furnish: To supply the stated equipment or materials.

H. Install: To set in position and connect or adjust for use.

I. LED: Light-emitting diode.

J. NAC Booster: Notification Appliance Circuit audio and/or visual auxiliary power supply controlled and supervised by the FACP

K. NFPA: National Fire Protection Association. Definitions in NFPA 72 apply to fire alarm terms used in this Section.

L. NICET: National Institute for Certification in Engineering Technologies.

M. Schematic design drawings: drawings which establish the objectives and design criteria of the system along with locations of fire alarm equipment, a system concept riser diagram, identification of interface(s) required with fire safety functions, and identification of all initiating device and notification appliance locations.

N. Provide: To furnish and install the stated equipment or materials.

O. UL: Underwriters Laboratories.

1.03 PERFORMANCE-BASED DESIGN REQUIREMENTS

A. The system shall incorporate an alarm verification function in the fire alarm control unit for system type smoke detectors. Alarm verification shall not be provided for manual fire alarm boxes or water flow alarm switches.

B. All fire alarm control equipment, devices and conductors shall be protected against unwanted radiated electromagnetic interference (EMI) and radio frequency interference (RFI) which can interfere with normal system processing and possibly cause unwanted alarms.

C. Fire alarm technicians must be able to perform comprehensive tests on the system with minimum disruption to occupants. Fire alarm system control must originate from the control panel and/or programmable field devices. Individual bypass switches located at the main control panel must provide system wide bypass for each type of output to accommodate testing with minimal disruption.

D. Field located transponders, NAC power booster panels, and terminal cabinets as required to support the project, if locations not specifically provided on the design drawings. Good access must be provided for testing and maintenance requirements.

E. NFPA 72 10.4.4 require smoke detection coverage above critical fire alarm components. The quantity of required NAC booster panels vary between manufactures and their installation location(s) are determined by the Installation Contractor. If area smoke detection is not provided in the vendor-selected NAC booster panel location, then a dedicated smoke detector shall be provided above the panel. These locations shall be shown on the installation shop drawings and approved by the EoR and AHJ prior to installation.

F. SLC Circuit Design: Ground Fault Detection
   1. For addressable loops, ground fault detection shall be employed which can detect a ground fault on both the positive and negative side of each circuit. The ground fault detector shall operate the general trouble devices as specified but shall not cause an alarm to be sounded. Ground faults shall not interfere with normal operation, such as alarm, or other trouble conditions.
   2. In compliance with NFPA 72, section 23.6.1, provide fault isolation for every 50 devices on any SLC, limited to a maximum area of a floor or fire/smoke barrier compartment boundaries. Provide separate ground gault detection for each floor/ level.
   3. A single fault on a pathway connected to the addressable devices shall not cause the loss of the devices in more than one zone or area. If a floor of the building is subdivided into multiple zones by fire or smoke barriers and the fire plan for the protected premises allows relocation of occupants from the zone of origin to another zone on the same floor, each zone on the floor shall be considered a separate zone.
   4. Dedicated isolator modules or ground fault detection integrated into an addressable device may be used to ensure

5. Acceptable wiring designs
    a. Install SLC loops with no more than 50 addressable devices circuit, homeran back to the panel. Each SLC must be internally isolated from shorts.
    b. Provide field circuit isolation with loop isolator devices installed as the first device and keeping the isolated legs of the circuit to fewer than 50 devices.

G. Initiating Device Installation
1. Coordinate smoke detector locations with ceiling diffusers; none maybe closer than 3 feet.
2. For ceiling tile applications, center detectors in the tile, inline with other ceiling fixtures.

1.04 SEQUENCE OF OPERATIONS

A. Alarm Sequence of Operation:
1. Activation of a manual fire alarm box, automatic detector, or fire suppression system shall initiate the system to enter "alarm" mode including the following operations:
    a. Flash local LED red on the associated addressable device.
    b. Provide local English language annunciation of device location, address and condition, and audible and visual alarm signal at control panel and remote annunciators.
    c. Provide manual "acknowledge" function at control panel to silence audible alarm signal, visual signal remains displayed until initiating alarm is cleared.
    d. Transmit "alarm" signal to off-premises equipment to notify monitoring company.
    e. Activate fire alarm notification appliances.
    f. Alarm functions shall override trouble or supervisory functions. Supervisory functions shall override trouble functions.

B. Supervisory Sequence of Operation:
1. Flash local LED red on the associated addressable device.
2. Activation of gas detection, fire sprinkler tamper, pressure switch, duct mounted smoke detector or residential smoke detector with local audible base causes system shall initiate the system to enter "supervisory" mode including the following operations:
    a. Provide local English language annunciation of device location, address and condition, and audible and visual supervisory signal at control panel and remote annunciators.
    b. Provide manual "acknowledge" function at control panel and remote annunciators to silence audible supervisory signal, visual signal remains displayed until initiating supervisory is cleared. If AHJ approved, a supervisory condition may be programmed as self-restoring.
    c. Transmit "supervisory" signal to off-premises equipment to notify monitoring company.

d. For HVAC applications: transmit signal to shut down air associated air handling unit and close associated fire/smoke dampers.
e. For CO area detection applications: activate local NFPA 72 temporal-4 notification tone.

C. Trouble Sequence of Operation:
1. System trouble, including single ground or open of supervised circuit, or power or system failure, initiate the system to enter "trouble" mode including the following operations:
a. Flash local LED amber on the associated addressable device.
b. Provide local English language annunciation of device location, address and condition, and audible and visual trouble signal at control panel and remote annunciators.
c. Provide manual "acknowledge" function at control panel and remote annunciators to silence audible trouble signal, visual signal remains displayed until initiating trouble is cleared.
d. Transmit "trouble" signal to off-premises equipment to notify monitoring company.

1.05 SEQUENCE OF INSTALLATION

A. This project is for the replacement of an existing fire alarm system
1. The new fire alarm system shall be installed in parallel (tandem) with the existing fire alarm system. Temporary relocation/ mounting of equipment in order to maintain functionality is permitted. The existing fire alarm system must stay active during construction, meeting the following:
a. Maintain manual fire alarm operation throughout the entire building (including areas under construction). Mark all non-operational manual pulls stations (existing, proposed, and/or temporary) 'OUT OF SERVICE'.
b. Maintain audible signaling devices to adequately warn building occupants and construction personnel (visual signaling is not required to comply with the ADA during construction).
c. Maintain service to automatic fire detection as much as practical. Automatic heat detection may be temporarily substituted for smoke detection, as required. Automatic fire detection is not required to operate in areas of construction at times when construction personnel are present (who can activate manual fire alarms). Other shutdowns of automatic fire detection may be considered, if approved in writing by the owner.
d. Whenever HVAC duct smoke detection systems are not operational during construction, the electrical contractor is responsible for maintaining clear and unobstructed access to HVAC controls and/or disconnecting means (to facilitate manual operation in the event of a fire).
e. Upon approval from the AHJ, the new system may be partially commissioned to accommodate phasing schedules. The new system shall be wired in such a way that when either the new or old system go into alarm, both systems go into alarm. The E.C. shall be responsible to ensure that spaces being monitored by

the existing fire alarm continue to be monitored by the existing alarm until such time that they are switched over to monitoring by the new system.

f. Whenever unable to meet the above requirements, provide a continuous fire watch per AHJ requirements.

g. To satisfy requirements above, any existing and proposed life safety systems may be used as much as practical. Where requirements cannot be satisfied using existing/proposed systems, provide suitable temporary life safety systems (including all associated temporary wiring) as required. Where existing wiring is reused provide a written guarantee that it is acceptable for use with the equipment provided under this contract.

2. Before estimating work, visit the project site and verify all measurements and field conditions affecting the work. The contractor is fully responsible for the correctness of all measurements and for any connections to existing work. Submission of bid is considered evidence that this contractor has visited and examined the site. No extra consideration, claims, charges, or compensation will be granted under any circumstance for extra work as a result of the contractor's failure to visit the site or verify conditions and measurements.

3. Upon completion of all spaces being switched over to the new fire alarm system, the existing system shall be de-commissioning and removal of all related panels, field equipment and wire.

1.06 FIRE CONTROL PANEL – The system shall be a complete, electrically supervised fire detection and notification system, with a microprocessor based operating system having the following capabilities, features, and capacities:

A. All control equipment shall be listed to the latest edition of UL Standard 864 (9^{th} Edition}

B. The FACP and auxiliary power panels shall provide power, annunciation, supervision and control for the system.

C. Audibles and visual notification signals shall be synchronized throughout the entire building.

D. Provide electrical supervision of the primary power (AC) supply, presence of the battery, battery voltage, and placement of system modules within the control panel.

E. The system shall be expandable and capable of providing a peer-to-peer network. Each panel shall have the ability to display either local panel activity or global network activity.

F. The system shall be capable of the following configurations. Both configurations are permitted on the same network.

a. The system shall support up to 252 addressable devices, which may be divided in any ratio on one, two, three, or four separate, isolated Class B circuits.

b. The system shall support two loops of 252 addressable devices, each of which may be divided in any ratio on one, or two, isolated Class A circuits.

G. The system shall be capable of remote monitoring via Windows Explorer, which provides a graphical representation of the fire alarm control panel at a remote PC when connected via Ethernet to the system. The display will show the exact state of the panel, including blinking LEDs, and with menu buttons for control.

H. Support of single-person test system and capable of providing point test reports in NFPA standard format without manual report entries.
   1. The system shall provide a field test function where one person can test the complete system or a specific area while maintaining full operational function of other areas not being tested. Alarms, supervisory signals, trouble signals shall be logged in system history during the walk-test.
   2. The control panel shall allow control and monitoring from a wireless handheld display device during maintenance, inspection and troubleshooting tasks
   3. The control panel shall allow complete control and monitoring from a wireless handheld display device during one-man testing of the system
   4. Testing supported should be real smoke testing of devices, automatically logged and made available in NFPA format reports. Manual test entries will not be accepted.

I. System shall provide an output port for monitoring purposes by external systems. Communications to an external system shall be RS-232 or RS-485 communications.

J. The local system shall provide status indicators and control switches for all of the following functions:
   1. Remote Alarm Transmission By-pass Switch: Shall prevent transmission of all signals to the main fire alarm control unit when in the "off" position. A system trouble signal shall be energized when switch is in the off position.
   2. Drill Switch: Shall activate all notification devices without tripping the remote alarm transmitter. This switch is required only for general evacuation systems specified herein.
   3. Door Holder By-Pass Switch: Shall prevent doors from releasing during fire alarm tests. A system trouble alarm shall be energized when switch is in the abnormal position.
   4. HVAC/Smoke Damper By-Pass: Provide a means to disable HVAC fans from shutting down and/or smoke dampers from closing upon operation of an initiating device designed to interconnect with these devices.
   5. Any additional status or control functions as indicated on the schematic design drawings, including but not limited to: emergency generator functions, fire pump functions, door unlocking and security with bypass capabilities.

K. The system shall be compliant with the requirements of NFPA 720 as a Carbon Monoxide Detection Control Unit and shall meet the UL 2075 listing requirements. All inputs from CO sensors shall be indicated visually and audibly at the control panel. CO sensor inputs shall be distinct and descriptively annunciated from other signals.

L. Each intelligent addressable device or conventional zone on the system shall be displayed at the main fire alarm panel and each local fire alarm remote annunciator by a unique alphanumeric label identifying its location.

1.07 PERFORMANCE REQUIREMENTS

A. Comply with NFPA 72 installation methods, all contract documents and specification requirements.

1. The FACP and auxiliary power panels shall provide power, annunciation, supervision and control for the system.
2. Strobes shall be synchronized throughout the entire building.
3. Provide electrical supervision of the primary power (AC) supply, presence of the battery, battery voltage, and placement of system modules within the control panel.
4. Incorporate firefighter emergency communication systems, as specified.

B. Circuits and Pathways

1. The number of circuits and wire gauge shall be coordinated with the supplier's shop drawings.
2. Network Communications and vertical trunk wiring: all data wiring and audio risers shall be Class X, circuits as defined in NFPA 72, utilizing physically separated outgoing and return paths.
3. Addressable Signaling Line Circuit (SLC) wiring shall be configured as Class B circuits, with a minimum Level 0.
   a. Provide ground fault isolation detection and install NFPA 72 Class X circuit if quantity of addressable devices exceed 50 per circuit per NFPA 72 SLC survivability requirements.
   b. Provide separate SLC homruns for each level or fire zone. A single wire fault shall not affect the operation of devices serving other areas.
   c. SLC capacity shall not exceed 80% of the number of each type of device the circuit is capable of supporting.
4. Notification Appliance Circuit (NAC) wiring shall be configured as Class B circuits.
   a. Appliance circuits shall be zoned to correspond with the building fire barriers and other building features.
   b. Provide separate NAC homruns for each level or evacuation signaling zone. A single wire fault shall not affect the operation of appliances serving other areas.
   c. NAC capacity shall not exceed 80% of the number of each type of appliance in active alarm condition.
   d. When NAC is used to activate an auxiliary notification booster panel, no other appliances shall be installed on that circuit.

C. Alarm functions shall override trouble or supervisory functions. Supervisory functions shall override trouble functions.

D. The system shall provide a field test function where one person can test the complete system or a specific area while maintaining full operational function of other areas not being tested. Alarms, supervisory signals and trouble signals shall be logged on the system printer and in system history during the walktest.

1.08 SUBMITTALS

A. The equipment supplier responsibilities will include the selection of equipment, devices and materials based on the schematic design drawings and project requirements, and their proper application based on the manufacturer's limitations, operating characteristics and recommended practices.

1. Equipment quantities and locations shown on the schematic design drawing floorplans shall not be altered or modified without written approval of the Engineer of Record. Any deviation from the Engineer's coordinated layout or design intent will constitute the submission as incomplete and shop drawings will not be approved.
2. Minor deviations, variations, changes, and corrections from layouts shown on the drawings (based on coordination, conditions, manufacturer's instructions, codes and standards, shop drawings, and verification of measurements and conditions) are permitted to facilitate construction provided the changes do not represent potential changes in scope of work and provided the changes are acceptable to the owner, architect, and engineer.
3. The equipment supplier shall coordinate the installation and system operation with the work of related trades.

B. Catalog manufacturer's product data sheets for all equipment, accessories and wiring with all applicable components being submitted for this project clearly noted. All equipment shall be subject to approval and no equipment shall be ordered without prior approval.

1. Data Sheets with multiple product shall highlight or identify the specific products utilized for this project.

C. System Calculations - Circuit calculations shall use the end-loading or point-to-point method described in NFPA recommended practices including both standby and active conditions. Complete calculations shall be provided which show the electrical load for all equipment and field circuits. (identify all mathematical formulas, variables, and constants used in all calculations) on the following system components:

1. Horn/ strobe 24VDC loads and spare capacity.
    a. NAC circuit (audible and visual) design shall incorporate a 20% spare capacity for future expansion.
2. Show wire size, estimated circuit length, and maximum allowable wiring distance as designed. Voltage drop calculations for wiring runs demonstrating worst-case condition.
3. Power supply rating justification showing power requirements for each of the system power supplies. Power supplies shall be sized to furnish the total connected load in a worst-case condition plus 25% spare capacity.

D. The shop drawing submittal shall clearly indicate all proposed equipment and devices (type and quantity), with wiring diagrams, detailed operational sequences, and interfaces to related systems. They shall be prepared in accordance with NFPA 72 recommended practices and include the following:

1. Floor plans showing all devices and equipment to be installed with corresponding field settings, circuit, and device designations noted. Settings shall include the device address and candela rating as applicable. Circuit identifiers, device numbers and symbols used shall be clearly defined and consistent between all related documents. Whenever possible, the drawings shall reflect other components of the building such as air diffusers, HVAC returns, etc. to determine compliance or reference the associated mechanical design drawings.
    a. Floor plans at a scale of 1/8"=1'-0"
    b. When candela ratings are not shown on the schematic design drawings, utilize NFPA 72 visual coverage area tables to select coverage.
2. Complete point-to-point riser diagrams showing all equipment including size, type, number and reference designations for all circuits and devices. Each device shall be shown with address numbers or any other required field device settings including candela rating of notification appliances.
    a. For multiple panel configurations, proved a separate block diagram to show the overall network system architecture with interconnection network circuits.
3. System panel drawings showing cabinet dimensions, internal module placement, field wiring terminations with spare capacity allowances, and any applicable operator's display and panel switch label assignments. Where multiple equipment cabinets are used in a single location these shall be shown together in elevation for coordination of equipment installation and wireways, and to ensure proper space allocation.
4. Provide a complete sequence of operation in the form of an NFPA lnput/Output programming matrix for the entire system as shown in NFPA 72. The matrix shall reflect each unique programmed sequence, whether the sequence is initiated by an individual or common group of similar devices. Matrix shall illustrate alarm input/out events in association with initiation devices. Matrix summary shall include system supervisory and trouble output functions.
5. Installation drawings shop drawings, and as-built drawings shall be prepared by a NICET II or higher individual experienced with the work specified herein.
6. Incomplete submittals shall be returned without review, unless with prior approval of the Engineer.
    a. Disposition of shop drawings shall not relieve the Contractor from responsibility for deviations from drawings and specifications, unless the deviations are specifically noted in writing at the time of submission, and written acknowledgement has been received from the Engineer or Record. The disposition of shop drawings shall not relieve the Contractor from responsibility for errors in shop drawings or schedules.
    b. Copies of the approved shop drawings shall be maintained on-site to serve as working documents during installation for preparing as-builts.

E. Delegated Design Review of Shop Drawings: As required per the AHJ, in addition to items listed above, provide a compliance and code review by an individual with the required credentials and submit documentation, including any evaluation analysis of the

shop drawing submittal. Provide the required review's credentials and seal/ signature by the qualified professional engineer responsible for the preparation, as required. The equipment supplier's shop drawings shall not be stamped or sealed by an Engineer unless the work is performed under their direct supervision and control.

1.09 QUALITY ASSURANCE

A. The following shall be adhered:

1. State and Local Building Codes as adopted and/or amended by The Authority Having Jurisdiction, ADA, and/or State and local equivalency standards as adopted by The Authority Having Jurisdiction.
2. Owner's best practices for fire alarm installations/ operations including compliance with site standard operating procedures (SOP's).

B. Equipment Supplier Qualifications

1. The supplied products must utilize multi-channel product distribution on a national basis to be considered for this bid. The distribution shall be from factory branches as well as independent distributors to allow the end user with the ability to utilize factory trained and authorized competitive service providers after system installation and commissioning. Single source system suppliers are not acceptable. The initial installation and commissioning shall be provided by a factory direct branch to ensure a high level of quality for the customer.
2. A service office must be within 50 miles of the project site.
3. The manufacturer shall provide evidence of successfully installed similar fire detection and notification systems on comparable size and scope. The owner reserves the right to reject any installer's bid for which evidence of a successful prior installation by the contractor cannot be provided.
    a. The equipment and service provider shall have a minimum of 10 years experience in the fire protective signaling systems industry.
4. Shall be licensed in the jurisdiction, if required.
5. The equipment supplier shall have a licensed fire protection engineer on staff to assist with all aspects of the installation including interfacing with the local AHJ and code consulting.
6. The technician shall supervise installation, software documentation, adjustment, preliminary testing, final testing and certification of the system. The technician shall provide the required instruction to the owner's personnel in the system operation and maintenance.
7. The Equipment Supplier shall have in-house engineering and project management capability consistent with the requirements of this project. Factory trained representatives of the system manufacturer shall perform the detailed engineering of the system.

C. Installer Qualifications:

1. Before commencing work, submit data showing that the manufacturer has successfully installed fire alarm systems of the same scope, type and design as specified.
2. The contractor shall submit copies of all required licenses and bonds as required in the State having jurisdiction.
3. The system installer shall work with the system supplier/designers to ensure all equipment is installed as shown in the Shop Drawings and manufacturer's requirements, and programmed to comply with the project requirements.
4. The installing contractor is responsible for coordination with related trades, and complete (1st party) testing of the system as installed, to include verification that the system performs as intended, and all devices and fault conditions are properly supervised and reported as specified herein.

D. Testing Agency Qualifications: Qualified for testing indicated.

E. Source Limitations for fire alarm equipment: Obtain fire alarm equipment from single source.

1.10 DELIVERY, STORAGE, AND HANDLING

A. Deliver products to project site in original, unopened packages with intact and legible manufacturers' labels identifying product and manufacturer, date of manufacture, and shelf life if applicable.

B. Store materials inside, under cover, above ground, and kept dry and protected from physical damage until ready for use. Remove from site and discard wet or damaged materials.

1.11 PROJECT CONDITIONS

A. Installed products or materials shall be free from any damage including, but not limited to, physical insult, dirt and debris, moisture, and mold damage.

B. Environmental Limitations: Do not deliver or install products or materials until spaces are enclosed and weather-tight, wet work in spaces is complete and dry, and temporary HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

1.12 WARRANTY

A. The equipment and wiring shall be warranted to be free from electrical, mechanical and performance defects, within the specified warranty period. Equipment and components that fail in materials or workmanship must be repaired or replaced. It shall include all labor/travel time, parts and programming. The warranty also provides for the adjustment of smoke detector sensitivities due to unwarranted or nuisance detector activations.
   1. Warranty Period: One year.
   2. Warranty Initiation: Commencing with start-up and owners beneficial use of any portion of the system.

3. The warranty does not cover cases involving component failure due to abuse, misuse, and/or "Acts of God" including but not limited to lightning strikes, flooding, power surges, and fire.
4. This warranty is void if the product is altered, repaired, or serviced by anyone other than original equipment installer.
5. A copy of the manufacturer's warranty shall be provided with closeout documentation and included with the operation and installation manuals.

B. All labor for administering and servicing the warranty, including actual replacement of parts, will be the responsibility of the Installer for the warranty period.

C. This Warranty does not apply to the replacement of consumable parts such as internal standby batteries. These components are designed to diminish over time unless failure has occurred due to a defect in materials, equipment malfunction, or expose to ambient conditions beyond their UL listing. As with all batteries, the maximum capacity and performance of the battery will decrease with time and use; this is not a defect. The expected lifespan of a fire alarm battery under normal conditions is 3 years. Only defective batteries and batteries that leak are covered by this warranty.

D. The Owner reserves the right to make changes to the fire alarm system during the Warranty Period. Such changes do not constitute a waiver of warranty. Contractor shall warrant parts and installation work regardless of any such changes made by Owner, unless the Contractor provides clear and convincing evidence that a specific problem is the result of such changes to the fire alarm system.

1.13 SERVICE AGREEMENT

A. Technical Support: Beginning with Substantial Completion, provide software support for 1 year.

B. Upgrade Service: Update software, firmware, to latest version at project completion. Install and program software upgrades that become available within one year from date of substantial completion. Upgrading software, firmware shall include operating system. Upgrade shall include new or revised licenses for use of software.

1. Provide 30 days' notice to Owner to allow scheduling and access to system and to allow Owner to upgrade computer equipment if necessary.

1.14 EXTRA MATERIALS

A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

B. The following spare devices shall be supplied as applicable to this project:

1. Two (2) keys for each locked cabinet.
2. Two (2) of each type of smoke detectors.
3. Two (2) of each type of heat detectors.
4. Two (2) of each type of pull stations.
5. Four (4) of each type of pull station lexan covers
6. Two (2) of each type of standard notification appliance(s) (horn, strobe & combination) installed.

7. Two (2) of each type of replaceable surge suppression modules installed.
8. Two (2) of each type of replaceable fuses installed in the system. Provide in a box or cabinet with compartments marked with fuse types, sizes and equipment locations.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

A. The equipment and service described in this specification are those supplied and supported by Siemens Industry and represent the base bid for the equipment.

1. Being listed as an acceptable Manufacturer in no way relieves obligation to provide all equipment and features in accordance with these specifications.

B. Must have multi-channel distribution for both products and equipment service. The owner shall have the ability change service provider or sales outlets. Proprietary manufactures such as single-channel suppliers are not acceptable.
1. The initial installation shall be completed by a factory direct office.

2.02 CONTROL PANEL

A. The fire alarm control panel shall be microprocessor-based using multiple microprocessors throughout the system, providing rapid processing of smoke detector and other initiation device information to control system output functions. The System Periphery board shall be capable of a minimum of 252 intelligent devices distributed between one, two, three, or four Class B SLC circuits. Any trouble on one circuit shall not affect the other circuit. The on board microprocessor provides the periphery board with the ability to function even if the main microprocessor fails. LED's on the board shall provide annunciation for the following; Power, Gnd. Fault, Alarm, Trouble.

B. There shall be a watchdog circuit, which shall verify the system processors and the software program. Problems with either the processors or the system program the panel shall activate a trouble signal and reset the panel.

C. The Signal Line Circuits (SLC) shall be tested for opens, shorts and communications with all addressable devices installed before connection to the control panel. Systems without this capability shall have a test panel installed for initial testing to eliminate any possible damage short term or long term to the control panel. After initial testing replace the test panel and proceed with complete testing.
1. The signal line circuits (SLC) shall be polarity insensitive for all addressable devices. This permits the fire detection devices to operate even when detector and module wiring polarity are inverted on the wrong screw terminals.

D. The primary control panel interface shall have the ability to view events, acknowledge, silence, and reset the system and any networked Fire control panels, when configured as a global PMI. The standard operator interface can acknowledge, silence, and reset panels via Global PMI.

E. System response time from alarm to output shall be an average of three (3) seconds.

F. To expedite system troubleshooting, the system cards shall have ground fault detection and diagnostic LEDs by card.

G. All system cards and modules shall have Flash memory for downloading the latest module firmware.

H. Passwords:

1. Maintenance/Control Password - There shall be a 5 character password that a user must enter into the control panel in order to perform such maintenance- and control-related functions.

I. Networking – Command and Control:

1. A bidirectional data communications network transmitting multiplexed input and output signals, which shall be electronically supervised, shall connect all control panel nodes on a dedicated fire alarm network. The communication network shall consist of a communication circuits transmitting all system operations in a digitally encoded format.

2. Digital two-way communication capabilities supporting Style 4 (Class B) or Style 7 (Class A) communications using either hard-wired copper or fiber optics technologies or combinations of both as required for the control panels to communicate.

3. The system shall be designed such that in the event of a network communications failure, any remaining interconnected panels will operate as a sub-network and any isolated panels will operate in standalone mode. Upon communications failure, a trouble condition will be reported across the network and the disconnected panel shall continue to function in standalone mode.

4. Capability shall exist within the system to extend the network at any node. The system shall support a maximum of two network extension circuits in series on any system branch, extending the inherent distance limitations for network communications.

5. Communication protocol shall be of the CSMA/CD (carrier sense, multiple access, collision detect) type, eliminating delays incorporated into other protocols. Communication techniques using token passing and requiring sensing of delays and re-generation of the token to re-establish network communications in the event of a fault shall not be acceptable.

J. Software Modifications: The system structure and software shall place no limit on the type or extent of software modifications on-site. Modification of software shall not require power-down of the system or loss of system fire protection while modifications are being made. Systems that require the use of external programmers or change of EPROMs are not acceptable.

K. Logic: The fire alarm system shall support generic functions that deal with binary states (True/False, high/low), and produce desired outputs from one or more binary inputs (for example, alarm outputs from spot detectors, VESDA detectors, monitor modules or manual station inputs). AND, OR, NOT, Any N, D Latch, RS Latch, Time

Base Control, Start Timer, Restart Timer are generic functions. Generic functions can be used as inputs to other function. The system shall support 2500 logic functions.

L. History: The system shall store 5000 events in history while in straight mode and 4500 in circular mode. In straight mode, trouble warnings will occur at 4000 and 4500 events. In circular mode, the control panels shall maintain a 2000 event Alarm History buffer, which consists of the 2000 most recent alarm events from the 4500 event history file.

2.03 PRIMARY POWER SUPPLY

A. The control panels, NAC power booster panels, system workstation, and any other fire alarm equipment shall receive their primary power from a dedicated 120VAC disconnect circuit.

1. The circuit must be properly sized and protected in accordance with NEC requirements.
2. This requirement does not limit that one dedicated branch circuit to serving only one power supply within a system. The dedicated branch circuit could supply several fire alarm power supplies within a control unit or within multiple interconnected control units that serve the signaling system.
   a. The dedicated circuit can be supplied from any properly installed electrical panel board or sub-panel.
   b. Minimum capacity of 6-amp that provides 24VDC power for system operation.
   c. Ability to expand the power supply without adding additional cabinets.
3. The circuit disconnecting means shall be labeled 'FIRE ALARM' and any other local identification requirements. Its location must be listed at the point of connection to the fire alarm control equipment. Provide a dedicated breaker lock unless the breaker is located in locked panel board or if it is in a locked electrical room.
4. Transfer from AC to battery power shall be instantaneous when AC voltage drops less than 90% or brown out conditions it is not sufficient for normal operation.

B. Loss of primary AC power shall sound a trouble signal at the FACP. The FACP shall indicate when the system is operating on an alternate power supply.

2.04 SECONDARY POWER SUPPLY

A. When the primary AC power is lost, the system shall automatically switch to the secondary power supply.

B. The control panels, transponders, and NAC power booster panels shall receive their secondary power from batteries.
1. Battery shall be of the sealed lead-acid, maintenance free type, 24-volt nominal, suitable for life safety application.
2. Provide sufficient capacity to operate the complete alarm system in quiescent standby load (system operating in a non alarm condition) for a period of 24 hours and shall have sufficient capacity to operate all alarm notification appliances and all other connected loads for a period of 5 minutes.

3. The battery charger shall be able to charge the system batteries up to 100 AH batteries. Battery charging shall be microprocessor controlled and programmed to select battery sizes.
4. Transfer from AC to battery power shall be instantaneous when AC voltage drops to a point where it is not sufficient for normal operation.
5. Batteries shall be secured in seismic areas 2B, 3, or 4 as defined by the Building Code.

2.05 SYSTEM ENCLOSURE

A. The control unit shall be housed in a cabinet suitable for both recessed and surface mounting. Cabinet and front shall be corrosion protected, given a rust resistant prime coat, and manufacturer's standard finish. The outer doors shall be capable of being a left hand open or a right hand open. The inner door shall have a left hand opening. System enclosure doors shall provide where required ventilation for the modules or cards in the enclosure.

B. Enclosure needed to hold all the cards and modules as specified with at least 25% spare capacity for extra cards.

C. Provide system enclosure for all amplifiers. Where required by the manufacturer, provide means for venting heat from the enclosure either by having enclosure sides and top vented or the doors vented.

2.06 DOCUMENT STORAGE BOX

1. With every new system, a documentation cabinet shall be installed at the system control unit or at another approved location at the protected premises. Where the documentation cabinet is not in the same location as the system control unit, its location shall be identified at the system control unit. It shall meet NFPA 72's record maintenance requirements and the following criteria:
   a. Enclosure to accommodate standard 8-1/2-by-11 inch and loose document records. Legend sheet will be permanently attached to door for system required documentation, key contacts, and system information.
   b. Provide two key ring holders with location to mount standard business cards for key contact personnel.
   c. Material and Finish: 18-gauge cold-rolled steel; four mounting holes.
   d. Color: Red powder-coat epoxy finish.
   e. Labeling: Permanently screened with 1 inch high lettering "SYSTEM RECORD DOCUMENTS" with white indelible ink.
   f. Security: Locked with 3/4 inch barrel lock. Provide solid 12 inch stainless steel piano hinge.

2.07 INITIATING DEVICES

A. General

1. The initiating device shall provide an alarm indication within less than four (4) seconds.

2. All initiation devices shall be insensitive to initiating loop polarity. Specifically, the devices shall be insensitive to plus/minus voltage connections.
3. Operating Voltage: 24 VDC, nominal.

B. Multi-criteria Smoke Detectors – Addressable

1. The multi-criteria fire detectors shall be an intelligent digital photoelectric detector with a programmable heat detector. Detectors shall be listed for use as open area protective coverage, in-duct installation and sampling assembly installation and shall be insensitive to air velocity changes. The detectors' communications shall allow the detectors to provide alarm input to the system and alarm output from the system within four (4) seconds. So as to minimize the effort required by the installing and maintenance technician to appropriately configure the detector to ensure optimal system design, the detectors shall be programmable as application specific. Application settings shall be selected in software for a minimum of 19 environmental fire profiles unique to the devices installed location.
   a. UL Listed as "direct in-duct" mounting.
2. The detector shall be guaranteed in writing not to false alarm when configured by the factory trained certified technician. The detector must provide different environmental algorithms that allow the detector to provide superior false alarm immunity without the need for additional alarm verification delays.
3. Smoke detectors shall be analog sensors that utilize photoelectric-type sensing principles mounted within a smoke chamber to detect particles of combustion.
4. The control panel shall continually analyze the analog signal from each sensor to determine calibration, sensitivity and environmental changes that may affect sensor operation. The analog values from each device shall be displayed (in terms of percent of obscuration) at the control panel upon command.
5. The detectors shall have a tri-color LED to streamline system maintenance/inspection by plainly indicating detector status as follows: green for normal operation, amber for maintenance required, red for alarm. Each detector shall include an LED that will flash periodically to indicate an active polling cycle. When the sensor reaches a predetermine alarm threshold (2% obscuration unless otherwise directed), the detector shall latch in LED shall flash continuously until reset at the control panel.
   a. The system shall have the ability to disable the detector's LED.
6. The detectors shall be UL listed for operation in a 95% relative humidity (RH) environment.
7. The detector shall be designed to eliminate the possibility of false indications caused by dust, moisture, RFI/EMI, chemical fumes, and air movement while factoring in conditions of ambient temperature rise, obscuration rate changes and hot/cold smoke phenomenon into the alarm decision to give the earliest possible real alarm condition report.
8. The detectors shall support the use of a relay, or LED remote indicator without requiring an additional software address.
9. The intelligent smoke detector shall be capable of providing three distinct outputs from the control panel. The outputs shall be from an input of smoke obscuration, a thermal condition or a combination of obscuration and thermal conditions. The

detector shall be designed to eliminate calibration errors associated with field cleaning of the chamber.

10. Where indicated on the schematic design drawings, provide remote indicator lamps and identification plates for detectors concealed from view. Each indicator will illuminate when the detector is in alarm. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position in the nearest common corridor or otherwise designated on the floorplans.
11. When required, the detectors shall incorporate an addressable Carbon Monoxide (CO) sensor. The CO sensor shall be selectable as an input to the multi-criteria fire detector algorithm and as an independent life-safety CO gas detector (in compliance with NFPA 720).
    a. The multi-criteria detector with CO input shall be UL 2075 compliant as a gas and vapor detector.
12. The detectors shall be RoHS-compliant: it shall meet standards for Reduction of Hazardous Substances (RoHS) by reduction in lead content and other restricted substances.

C. Heat Detectors – Addressable

1. Thermal Detectors shall be analog/addressable sensors individually programmable for either fixed temperature, rate-of-rise or combined operation, except where otherwise dictated. The thermal detector shall be Model FDT421 and have the following temperature settings:
    a. Fixed temperature at 135°F, 145°F, 155°F, 165°F, 174°F
    b. Rate of Rise at 15°F/ min at 135°F
    c. Rate of Rise at 15°F/ min at 174°F
2. The detectors shall have a tri-color LED to streamline system maintenance/inspection by plainly indicating detector status as follows: green for normal operation, amber for maintenance required, red for alarm. Each detector shall include an LED that will flash periodically to indicate an active polling cycle.
3. Analog sensors will also provide a low temperature warning (Supervisory condition) when the ambient temperature in a protected area reaches 40 degrees F.
4. Where ambient conditions dictate, provide conventional fixed temperature, weatherproof or explosion-proof heat detectors in lieu of analog detectors. Conventional devices shall be individually addressable via a dedicated addressable monitor module which shall be installed in an appropriately heated, ventilated location.
5. The detectors furnished shall have a listed spacing for coverage on smooth ceiling rating of up to 2,500 square feet and shall be installed according to the requirements of NFPA 72 for open area coverage.

D. Duct Smoke Detectors – Addressable

1. The system supplier shall select the appropriate detector type, quantity and environmental configuration based on the manufacturer limitations, code requirements and the project HVAC system operating characteristics for air flow, velocity and environmental conditions.
2. Photoelectric type FDBZ-Series, with sampling tube of design and dimensions as recommended by the manufacturer for the specific duct size and installation conditions where applied. Where required there shall be available a duct housing with an on-board relay for fan shutdown.
    a. Environmental compensation, programmable sensitivity settings, status testing, and monitoring of sensor dirt accumulation for the duct smoke sensor shall be provided by the FACP.
    b. The detector shall be mounted in a duct detector housing listed for that purpose. The duct detector shall support the use of a remote test switch, relay or LED remote indicator.
    c. Duct Housing shall have a transparent cover to monitor for the presence of smoke. Cover shall secure to housing by means of four (4) captive fastening screws.
    d. Duct Housing shall provide two (2) Test Ports for measuring airflow and for testing. These ports will allow aerosol injection in order to test the activation of the duct smoke sensor.
    e. Duct smoke detector housing shall allow use in duct systems with air velocity ranging from 100 to 4,000 feet per minute, within temperature ranges of 32°F to 120°F per minute, and with relative humidity ranging from 0 to 95%.
3. Provide a remote LED indicator associated with the duct detector, as shown on the design drawings
4. Where duct detectors are exposed to the weather a weatherproof enclosure shall be available. A NEMA-3R and NEMA-4X option shall be available. The duct housing cover shall include a test port for functional testing of the detector without cover removal. The duct housing shall include a cover removal switch capable of indicating cover removal status to the fire alarm control panel.
5. Traditional area detectors may be substituted on ducts with access hatches within the manufacturer's limitations and applicable standards. When mounted directly in the HVAC air stream, detectors shall be rated for airflows ranging from 0 – 1000 feet per minute. Utilize pendant mounting to get the device in the center of the air flow. It must be mounted to an appropriate electrical box mounted rigidly to withstand the pressure and resonant vibrations caused by the air velocity. The box pendant extension arrangement should be mounted from either the top or side walls extending to the center of the air duct stream. The access hatch shall be labeled to identify both the detector and HVAC unit it protects.

E. Detector Bases – Addressable
1. The plug-in detector bases shall be UL compatible with the selected detector head. They shall utilize screw clamp terminals and field circuits shall terminate directly to the base. Bases shall be installed directly on an industry standard 3 1/2-inch, 4-

inch octagon boxes, and 4-inch square boxes (with or without plaster). Position decorative ring around the base as required per the manufacture. Provide the ability to make the detector base tamperproof to prevent the removal of the detector head without the use of a tool.

a. The standard DB-11 base shall be - 6" version.

F. Carbon Monoxide Detectors

1. Carbon Monoxide Detectors: Provide Analog/Addressable sensors that include a CO sensing element where shown and required. Detectors may be either standalone sensors, or employ multi-sensing technology integrated with smoke sensors, and shall be Listed to the appropriate ANSI/UL standards, including UL 2075 (carbon monoxide), UL 268 (smoke) and UL 521 (thermal) as applicable.
2. The CO element shall operate between 30-560 parts per million (ppm), with a standard set point of 70ppm for exposure of 60 minutes accordance with NFPA 720. CO Sensors shall operate on non-resettable 24vdc power provided by the FACP, and provide full analog values directly to the FACP. The detector shall have associated programmable control module outputs, and an integral piezo horn that produces 85dbA at 10ft. Activation of a CO Detector shall initiate a Priority 2 Supervisory CO Alarm event at the local Control Unit and Fire Response Center, and remote system Annunciators as described herein.
3. Multi-Criteria Fire Detector Model FDOOTC441 shall be listed as providing CO detection in duct application.
4. CO Sensors that are integrated into Mechanical Systems shall be designed for duct mounting or area detection, with a CO Alarm set point of not less than 50ppm, and be appropriately Listed by a Nationally-Recognized Testing Laboratory.
5. Sensors shall be provided and installed in accordance with the manufacturer's instructions. Sensors shall be monitored by the local Fire Alarm System for multiple alarm thresholds with corresponding addressable outputs to initiate equipment shutdown procedures and related life safety functions. Sensors will support periodic functional testing.
6. CO Sensors shall be monitored and programmed for Supervisory CO Alarm reporting in accordance with NFPA 720 and applicable code.

G. Manual Pull Stations – Addressable

1. Provide single-action addressable manual stations where shown on the schematic design drawings, to be flush or surface mounted as required. Manual stations shall contain the intelligence for reporting unique numeric address, identity, alarm and trouble to the fire alarm control panel.

    a. Station will mechanically latch upon operation and remain so until manually reset by opening with a supplied alien wrench.

    b. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE".

c. The manual station shall be equipped with terminal strip and pressure style screw terminals for the connection of field wiring. Flying lead terminals are not permitted.

d. Surface mounted stations where indicated on the drawings shall be mounted using a manufacturer's prescribed matching red enamel outlet box.

2. Where shown on the schematic design drawings, provide a protective shield.

a. Shall be constructed of a clear LEXAN shield and red frame that easily fits over manual pull stations.

b. When shield is lifted to gain access to the station, a battery powered piercing warning speaker shall be activated. The horn shall be silenced by lowering and realigning the shield. The horn shall provide 85dB at 10 feet and shall be powered by a 9 VDC battery.

3. Where required, there shall also be available pull stations with break glass, capable of explosion proof installation, capable of weatherproof installation, reset key operation, and metal housings.

H. Linear Beam Smoke Detectors

1. Line-of-sight beam type smoke detectors shall consist of infrared transmitter and receivers to detect smoke obscuration across large distances. The beam shall traverse the protected area and its' signal will be processed by the receiver to initiate the appropriate alarm response.
2. The detector shall cover distances from 30 to 325 feet and shall be designed, installed and adjusted to ensure there will be no interference from sunlight or high output lighting in the space.
3. Each beam detector set shall include transmitter, receiver, addressable monitor module and remote key-operated test station with LED alarm indicator and be powered from auxiliary 24VDC power from the local Fire Alarm Control Panel.
4. For areas with direct exposed sunlight, utilize and end-to-end beam detector with powered senders and receivers.
5. For areas without direct sunlight, utilize a single-point beam detector with a prism reflector with the ability to correct for slight building movement and self-correction alignment. Flat reflectors are not acceptable.

I. Addressable Monitoring and Control Modules

1. Addressable Interface Devices shall be provided to monitor contacts for such items as water-flow, tamper, and PIV switches connected to the fire alarm system. These interface devices shall be able to monitor a single or dual contacts. An address will be provided for each contact. Where remote supervised relay is required the interface shall be equipped with a SPDT relay rated for 4 amps resistive and 3.5 amps inductive. The addressable interface modules shall be model number HTRI or FDCIO Series.

a. The modules shall support two operation modes: an isolator (polarity sensitive) or non-isolator (polarity insensitive) mode. The module shall be capable of being wired for either mode. During the isolator mode, the built-in dual

isolators will work at both sides of the module to isolate the line short in front or behind the module.

1) Supports up to 252 addressable points per SLC devices loop, and in mixed mode up to 30 devices between isolated devices

b. Modules shall support NFPA 72 survivability requirements for shorts and provide information as to the location of the fault.
c. Each Model XTRI-series device has a multi-color LED that flashes when GREEN operating in Normal mode; AMBER if the unit is in a 'Trouble' condition, and RED to indicate a change of status.
d. Provide non-obstructive front-end access to programming port and wiring terminals.

2. Isolator Module: Isolator module provides short circuit isolation for addressable notification appliance SLC wiring. Isolator shall be listed to UL 864. The Isolator shall mount directly to a minimum 2 1/8" deep, standard 4" square electrical box, without the use of special adapter or trim rings. Power and communications shall be supplied by the Addressable Controller channel SLC; dual port design shall accept communications and power from either port and shall automatically isolate one port from the other when a short circuit occurs. The following functionality shall be included in the Isolator module:

   a. Report faults to the host FACP.
   b. On-board Yellow LED provides module status.
   c. After the wiring fault is repaired, the Isolator modules shall test the lines and automatically restore the connection.

2.08 DEVICE PROGRAMMING / TEST UNIT

A. The device programming unit is a tool used for installation, commissioning, maintenance and servicing of addressable devices. It shall program the intelligent devices with the assigned addresses and provide an electronic test to ensure proper operation. Programming dipswitches and/or rotary switches shall not be acceptable. The portable unit shall provide the following features:
   1. Liquid-crystal display (LCD) screen with keypad
   2. Built in addressable base as well as two external terminals for use with all other addressable ancillary devices.
   3. Powered from on-board standard NiMH' rechargeable batteries or standard 'AA' Alkaline battery or an external AC adaptor.
   4. Reads analogue values of addressable loops and preform maintenance features such as ground fault detection.
   5. nonvolatile Flash memory with ability to download software upgrades.

B. The equipment supplier shall furnish a device programming unit to the installer for the duration of the project.

2.09 NOTIFICATION APPLIANCES

A. General requirements: Provide combination or individual audible and visual notification appliances as shown and permitted. All appliances shall be direct-wired;

devices that utilize a multi-part assembly with swipe or non-mechanical pressure-type contact connections will not be considered acceptable.

1. Appliance housing available in red or white.
2. All field adjustments shall not require special tools or programming software for setting changes.
   a. The selector switch for selecting the candela shall be tamper resistant.
3. All inputs shall employ terminals that accept #12 to #18 AWG wire sizes
4. The contractor shall provide fitted surface mount backboxes supplied by the appliance manufacturer and outdoor-rated appliances where site conditions dictate.
5. wall or ceiling-mount applications.
6. 24VDC operation, operating by reverse-polarity.
7. The appliance shall also be designed so that the audible signal may be silenced while maintaining strobe activation.
8. Provide surface or semi-flush installations
9. Provide weather-proof appliances as shown on the drawings
   a. Extended temperature range of –40°F to 150°F (-40°C to 66°C).
   b. Listed for outdoor applications under UL 1638 as well as under UL 1971

B. Audible Horn Appliances:
   a. Evacuation signal shall be the ANSI 53.41 three-pulse temporal pattern. Sleeping areas shall have low-frequency 520 Hz audible signals.
      1) Horns shall be UL Listed (for indoor use under Standard 1971 and 464).
      2) High and Low audible outputs (90 & 95 dB)
      3) Selectable temporal or steady horn output.
   b. Provide high output re-entrant-type speakers with the appropriate weatherproof listings in outdoor or other high ambient noise areas, as shown on the schematic design drawings.

C. Visual Strobe Appliances:
   a. Visual-notification appliances shall meet and be listed for UL Standard 1971 (Emergency Devices for the Hearing-Impaired) for Indoor Fire Protection Service.
   b. Strobe shall be listed for indoor use, and shall meet the requirements of FCC Part 15 Class B.
   c. Ability to mix LED and xenon strobes in the same field of view
   d. LED multi-candela strobe shall have field-selectable settings, and be rated per UL Standard 1971 for:
      1) Wall-mount: 15/30/75/110cd
      2) Ceiling mount: 15/30/75/95cd or 115/177cd ()
   2. The LED portions of the strobes shall meet the 20 millisecond light-pulse duration requirements of the 2016 edition of NFPA 72.
   3. All inputs shall be compatible with standard, reverse polarity supervision of circuit wiring by a Fire Alarm Control Panel (FACP)
   4. The selector switch for selecting the candela shall be tamper resistant
   5. The strobes shall not drift out of synchronization at any time during operation

a. If the sync module or Power Supply fails to operate, (i.e. - contacts remain closed), the strobe shall revert to a non-synchronized flash rate

2.10 MAGNETIC DOOR HOLD OPEN DEVICES

A. Door Hold Open Devices: Door hold open devices shall be operate from 24vdc power supplied by the local FACP. The Contractor shall coordinate the proper voltage of these devices with the door hardware supplier to ensure that all required hardware and wiring is provided

1. Electromagnets: Require no more than 3 W to develop 25-lbf (111-N) holding force.
2. Wall-Mounted Units: Flush mounted unless otherwise indicated.

B. Material and Finish: Match door hardware.

2.11 REMOTE ANNUNCIATOR

A. Description: Annunciator functions shall match those of fire-alarm control unit for alarm, supervisory, and trouble indications. Manual switching functions shall match those of fire-alarm control unit, including acknowledging, silencing, resetting, and testing.

1. Mounting: Flush Surface cabinet, NEMA 250, Type 1.

B. Display Type and Functional Performance: Alphanumeric display and LED indicating lights shall match those of fire-alarm control unit. Provide controls to acknowledge, silence, reset, and test functions for alarm, supervisory, and trouble signals.

2.12 OFF-SITE STATUS REPORTING

A. Central Station Digital Communicator – Cellular Technology
1. The commercial fire alarm off-site communicator shall provide general (alarm/ trouble/ supervisory) and ability for contact/ grouped event ID reporting from the fire alarm control panel (FACP). It shall be UL864 listed to provide point identification of alarm, supervisory, security and trouble events to a Central or Remove Receiving Station. It shall offer three selectable reporting paths which include: Cellular only, IP only, or IP primary/cellular backup. The Comminutor shall receive its power and supervision from the FACP.
   a. For this project, utilize cellular communications with IP communications as the primary means of communication to the off-site monitoring station, per NFPA 72 requirements. IP communications for owner selected/provided future option.
   b. The dual path communicator shall be provided with local cellular antenna. When the minimum cellular signal strength required by the manufacture's installation instructions cannot be met, provide an external antenna located and installed per field conditions, with the owners approval.

c. Support selectable reporting paths and supervision intervals to meet NFPA 72, chapter 26 requirements.
d. Cellular provide capability: With broadest coverage footprint available in Verizon or AT&T networks.
e. Future IP communication works over any type of customer provided Ethernet 10/100 based network connection (LAN or WAN), DSL modem or cable modem. The equipment shall support both dynamic (DHCP) or Public and Private Static IP addressing.

B. The system shall provide the ability for real-time Fire Alarm Control Panel (FACP) remote connectivity and visibility of events from any iOS Android mobile device or computer browser interface. Cloud connectivity via client's IP network with optional cellular connectivity via separate modem using MQTT protocol. Features shall include:
1. Dashboard with a live point-ID system status
2. Communication shall be encrypted and secured by the manufacture's Gateway
3. Email and App notifications customizable by the user
4. Ability to view and download status reports
5. Single portal application capable of viewing multiple connected FACPs
6. Ability to remotely provide cybersecurity tests & updates
7. Built-in firewall
8. UL listed as ancillary notification

PART 3 - EXECUTION

3.01 EXAMINATION

A. Examine areas and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of the work.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 INSTALLATION

A. Perform work in accordance with the requirements of NFPA 70, NFPA 72, NFPA 13, NFPA 2001, and NECA , Standard of Good Workmanship in Electrical Contracting.

B. Fasten equipment to structural members of building or metal supports attached to structure, or to concrete surfaces.

C. In the event that limited energy cable installation is allowed, all cable runs shall be run at right angles to building walls, supported from structure at intervals not exceeding 3 feet and where installed in environmental air plenums, be rated for such use and tied/supported by components listed for environmental air plenums installation.

D. Backing Boards: Provide 3/4-inch marine plywood backing boards for support of all fire alarm equipment panels surface mounted on masonry walls.
1. Paint both sides of boards with two (2) coats of Gray enamel, including all edges.

E. Wiring Method: Install cables in raceways and cable trays except within consoles, cabinets, desks, and counters and except in accessible ceiling spaces and in gypsum board partitions where unenclosed wiring method may be used. Conceal raceway and cables except in unfinished spaces.

F. Wiring Integrity and survivability requirements – Specified on shop drawings per NFPA72, Chapter 12

G. Wiring Method: Conceal conductors and cables in accessible ceilings, walls, and floors where possible.

H. Provide Surge Protection Devices (SPD) on all fire alarm wiring, which extends beyond the main building. Locate the SPD as close as practicable to the point at which the circuit leave or enter the building where the Fire Alarm Control Panel is located. Protection devices shall be shown on the schematic design drawings and shall be UL listed or in accordance with written manufacturer's requirements.

1. Provide equipment ground and connected to the building grounding electrode system per NEC.
2. Provide a dedicated enclosure to house the SPD and label it.

I. Wiring within Enclosures: Bundle, lace, and train conductors to terminal points with no excess and without exceeding manufacturer's limitations on bending radii. Provide and use lacing bars and distribution spools.

J. Provide primary power for each panel from normal/ emergency panels as indicated on the Electrical Power Plans. Power shall be 120V AC service, transformed through a two-winding, isolation type transformer and rectified to low voltage DC for operation of all circuits and devices.

3.03 BOXES, ENCLOSURES AND WIRING DEVICES

A. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas.

B. Fire Alarm: Terminal cabinets shall be provided in locations shown and as otherwise required to support wiring terminations, troubleshooting and future tenant fit-up. Cabinets shall be painted red and contain terminal blocks to support the system wiring where the Control Panels are remote from the devices served. Cabinets shall include accommodation for all wiring including SLCs, notification circuits, and related addressable and fault isolation modules for future expansion and modification.

1. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.

C. Boxes shall be installed plumb and firmly in position.

D. Extension rings with blank covers shall be installed on junction boxes where required.

E. Junction boxes served by concealed conduit shall be flush mounted.

F. Upon initial installation, all wiring outlets, junction, pull and outlet boxes shall have dust covers installed. Dust covers shall not be removed until wiring installation when permanent dust covers or devices are installed.

G. "Fire alarm system" decal or silk-screened label shall be applied to all junction box covers.

H. Panel enclosures shall be installed to meet clearance requirements per NFPA 70 and local codes. Minimum requirements shall be 3 foot clearance in front of the enclosure

3.04 CONDUCTORS

A. Each conductor shall be identified as shown on the shop drawings at each with wire markers at terminal points. Attach permanent wire markers within 2 inches of the wire termination. Marker legends shall be visible.

B. All wiring shall be supplied and installed in compliance with the requirements of the National Electric Code, NFPA 70, Article 760, and that of the manufacturer.

C. All splices shall be made using solder-less connectors. All connectors shall be installed in conformance with the manufacturer recommendations.

D. Crimp-on type spade lugs shall be used for terminations of stranded conductors to binder screw or stud type terminals. Spade lugs shall have upset legs and insulation sleeves sized for the conductors.

E. The installation contractor shall submit for approval prior to installation of wire, a proposed color code for system conductors to allow rapid identification of circuit types.

F. Wiring within sub panels shall be arranged and routed to allow accessibility to equipment for adjustment and maintenance.

3.05 DEVICES

A. Relays and other devices to be mounted in auxiliary panels are to be securely fastened to avoid false indications and failures due to shock or vibration.

B. Wiring within panels shall be arranged and routed to allow accessibility to equipment for adjustment and maintenance.

C. All devices and appliances shall be mounted to or in an approved electrical box.

3.06 IDENTIFICATION

A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Division 26 Section "Identification for Electrical Systems."

B. Permanently label or mark each conductor with alphanumeric wire markers at the main control panel, transponders, terminal cabinet and NAC booster panels.

C. A consistent color code for fire alarm system conductors throughout the installation.

3.07 FIELD QUALITY CONTROL

A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.

B. Testing General:

1. All Alarm Initiating Devices shall be observed and logged for correct zone and sensitivity. These devices and their bases shall be tagged with adhesive tags

located in an area not visible when installed, showing the initials of the installing technician and date.

2. Wiring runs shall be tested for continuity, short circuits and grounds before system is energized. Resistance, current and voltage readings shall be made as work progresses.
3. The acceptance inspector shall be notified before the start of the required tests. All items found at variance with the schematic design drawings or this specification during testing or inspection by the acceptance inspector shall be corrected.
4. Test reports shall be delivered to the acceptance inspector as completed.
5. All test equipment, instruments, tools and labor required to conduct the system tests shall be made available by the installing contractor. The following equipment shall be a minimum for conducting the tests:
   a. Ladders and scaffolds as required to access all installed equipment.
   b. Multi-meter for reading voltage, current and resistance.
   c. Two-way radios and flashlights.
   d. A manufacturer recommended device for measuring air flow through air duct smoke detector sampling assemblies.
   e. Decibel meter
   f. In addition to the testing specified to be performed by the installing contractor, the installation shall be subject to test by the authority having jurisdiction.

3.08 ACCEPTANCE TESTING

A. A written acceptance test procedure (ATP) for testing the fire alarm system components and installation will be prepared by the engineer in accordance with NFPA 72 and this specification. The contractor shall be responsible for the performance of the ATP, demonstrating the function of the system and verifying the correct operation of all system components, circuits, and programming.
   1. A program matrix shall be prepared by the installing contractor referencing each alarm input to every output function affected as a result of an alarm condition on that input.
   2. The installing contractor prior to the ATP shall prepare a complete listing of all device labels for alphanumeric annunciator displays.

B. Preliminary Testing: Conduct preliminary tests to ensure that all devices and circuits are functioning properly. After preliminary testing is complete, provide a letter certifying that the installation is complete and fully operable. The letter shall state that each initiating and indicating device was tested in place and functioned properly. The letter shall also state that all panel functions were tested and operated properly. The Contractor and an authorized representative from each supplier of equipment shall be in attendance at the preliminary testing to make necessary adjustments.

1. Verify that the control unit is in the normal condition as detailed in the manufacturer's O&M manual.
2. Visually inspect wiring.
3. Test the battery charger and batteries.
4. Verify that software control and data files have been entered or programmed into the FACP.
5. Measure the current in circuits to ensure there is the calculated spare capacity for the circuits.
6. Measure voltage readings for circuits to ensure that voltage drop is not excessive.
7. Measure the voltage drop at the most remote appliance (based on wire length) on each notification appliance circuit.
8. Megger Tests: After wiring has been installed, and prior to making any connections to panels or devices, wiring shall be megger tested for insulation resistance, grounds, and/or shorts. Conductors with 300 volt rated insulation shall be tested at a minimum of 250 VDC. Conductors with 600 volt rated insulation shall be tested at a minimum of 500 VDC. Test results recorded for use at the final acceptance test.
9. Loop Resistance Tests: Measure and record the resistance of each circuit with each pair of conductors in the circuit short-circuited at the farthest point from the circuit origin. The tests shall be witnessed by the owner and test results recorded for use at the final acceptance test.
10. Verify the absence of unwanted voltages between circuit conductors and ground. The tests shall be accomplished at the preliminary test with results available at the final system test.
11. Test each initiating device and notification appliance and circuit for proper operation and response at the control unit. Smoke sensors shall be tested in accordance with manufacturer's recommended calibrated test method. Use of magnets is prohibited. Testing of duct smoke detectors shall comply with the requirements of NFPA 72 except that, for item 12(e) (Supervision) in Table 14.4.2.2, disconnect at least 20 percent of devices. If there is a failure at these devices, then supervision shall be tested at each device.
12. All readings for Sound Pressure Level (SPL) shall be recorded on the installation drawings next to the speaker symbol. The readings shall then be added on the "as-Built" drawings to be submitted at the conclusion of the Final Acceptance test.
13. Verify with all parties the required survivability of wiring, raceways, and junction boxes
14. Determine that the system is operable under trouble conditions as specified.

C. Final Acceptance Test: Notify the owner in writing when the system is ready for final acceptance testing. Submit request for test at least 30 calendar days prior to the test date. A final acceptance test will not be scheduled until the Preliminary Testing has been completed.
   1. Provide documentation of Preliminary Testing results.
   2. Test the system in accordance with the procedures outlined in NFPA 72 acceptance testing.

3. Demonstrate the performance of the required number and type of initiating devices and notification appliances per the AHJ's requirements.
4. Verify that Shop Drawings reflecting as-built conditions are accurate. Upon final approval by all parties, provide two sets of AS-built documents in a cabinet adjacent to the main FACP or designated area within the building. Per NFPA 72 7.7.2Measure the current in Notification appliance circuits under full load to assure that there is the calculated spare capacity for every circuit.

D. The acceptance inspector shall use the system record drawings in combination with the documents specified in this specification during the testing procedure to verify operation as programmed. In conducting the ATP, the acceptance inspector shall request demonstration of any or all input and output functions. The items tested shall include but not be limited to the following:
   1. System wiring shall be tested to demonstrate correct system response and correct subsequent system operation in the event of:
      a. Open, shorted and grounded signal line circuits.
      b. Open, shorted and grounded notification, releasing circuits.
      c. Primary power or battery disconnected.
   2. System notification appliances shall be demonstrated as follows:
      a. All alarm notification appliances actuate as programmed
      b. Audibility and visibility at required levels.
   3. System indications shall be demonstrated as follows:
      a. Correct message display for each alarm input at the control display.
      b. Correct annunciator light for each alarm input at each annunciator and graphic display as shown on the drawings.
      c. Correct history logging for all system activity.
   4. System off-site reporting functions shall be demonstrated as follows:
      a. Correct zone transmitted for each alarm input
      b. Trouble signals received for disconnect
   5. Secondary power capabilities shall be demonstrated as follows:
      a. System primary power shall be disconnected for a period of time as specified herein. At the end of that period, an alarm condition shall be created and the system shall perform as specified for a period as specified.
      b. System primary power shall be restored for forty-eight hours and system-charging current shall be normal trickle charge for a fully charged battery bank.
      c. System battery voltages and charging currents shall be checked at the fire alarm control panel.

3.09 DOCUMENTATION

A. System documentation shall be furnished to the owner and shall include but not be limited to the following:

1. System record drawings and wiring details including one set of reproducible drawings, and a CD ROM or memory stick (thumb drive) with digital copies of the record drawings in PDF format.
2. System operation, installation and maintenance manuals.
3. System matrix showing interaction of all input signals with output commands.
4. Documentation of system voltage, current and resistance readings taken during the installation, testing and ATP phases of the system installation.
5. System program showing system functions, controls and labeling of equipment and devices.

3.10 PROTECTION

A. Remove and replace devices and panel components that are wet, moisture damaged, or mold damaged.

3.11 DEMONSTRATION

A. Include in the project the services of a factory-trained instructor, regarding the system operations, inspection requirements, and maintenance of the system provided. The instructor shall train the employees designated by the owner, in the care, adjustment, and operation of the fire alarm system.

1. Required Instruction Time: Provide 2 hours of instruction after final acceptance of the system. The instruction shall be given during working hours on such dates and times as are selected by the owner. The instruction may be divided into two periods and videotaped at the discretion of the owner.

B. Provide a printed instruction card in a conspicuous location observable from the FACP. The card shall show those steps to be taken by an operator when a signal is received as well as the functional operation of the system under all conditions, normal, alarm, supervisory and trouble.

END OF SECTION 283111

SECTION 311000

SITE CLEARING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Protecting existing vegetation to remain.
2. Removing existing vegetation.
3. Clearing and grubbing.
4. Stripping and stockpiling topsoil.
5. Removing above- and below-grade site improvements.
6. Disconnecting, capping, or sealing site utilities.
7. Temporary erosion and sedimentation control.

1.2 MATERIAL OWNERSHIP

A. Except for materials indicated to be stockpiled or otherwise remain Owner's property, cleared materials shall become Contractor's property and shall be removed from Project site.

B. Surplus soil material shall be placed at pump station site on Walters Road as dictated by Owner.

1.3 FIELD CONDITIONS

A. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during site-clearing operations.

1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
2. Provide alternate routes around closed or obstructed trafficways if required by Owner or authorities having jurisdiction.

B. Salvageable Improvements: Carefully remove items indicated to be salvaged and store on Owner's premises where indicated.

C. Utility Locator Service: Notify utility locator service for area where Project is located before site clearing.

D. Do not commence site clearing operations until temporary erosion- and sedimentation-control measures are in place.

E. Traffic control shall be provided along Colson Lane and Walters Road as required. Traffic control shall not interfere with DPW operations.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Satisfactory Soil Material: Requirements for satisfactory soil material are specified in Section 312000 "Earth Moving."

1. Obtain approved borrow soil material off-site when satisfactory soil material is not available on-site.

PART 3 - EXECUTION

3.1 PREPARATION

A. Protect and maintain benchmarks and survey control points from disturbance during construction.

B. Verify that trees, shrubs, and other vegetation to remain or to be relocated have been flagged and that protection zones have been identified and enclosed according to requirements in Section 015639 "Temporary Tree and Plant Protection."

C. Protect existing site improvements to remain from damage during construction.

1. Restore damaged improvements to their original condition, as acceptable to Owner.

3.2 TEMPORARY EROSION AND SEDIMENTATION CONTROL

A. Provide temporary erosion- and sedimentation-control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to erosion- and sedimentation-control Drawings and requirements of authorities having jurisdiction.

B. Verify that flows of water redirected from construction areas or generated by construction activity do not enter or cross protection zones.

C. Inspect, maintain, and repair erosion- and sedimentation-control measures during construction until permanent vegetation has been established.

D. Remove erosion and sedimentation controls, and restore and stabilize areas disturbed during removal.

3.3 TREE AND PLANT PROTECTION

A. Protect trees and plants remaining on-site according to requirements in Section 015639 "Temporary Tree and Plant Protection."

B. Repair or replace trees, shrubs, and other vegetation indicated to remain or be relocated that are damaged by construction operations according to requirements in Section 015639 "Temporary Tree and Plant Protection."

3.4 EXISTING UTILITIES

A. Locate, identify, disconnect, and seal or cap utilities indicated to be removed or abandoned in place.

1. Arrange with utility companies to shut off indicated utilities.

B. Interrupting Existing Utilities: Do not interrupt utilities serving facilities occupied by Owner or others, unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:

1. Notify Architect not less than two days in advance of proposed utility interruptions.
2. Do not proceed with utility interruptions without Architect's written permission.

C. Removal of underground utilities is included in earthwork sections; in applicable fire suppression, plumbing, HVAC, electrical, communications, electronic safety and security, and utilities sections; and in Section 024116 "Structure Demolition" and Section 024119 "Selective Demolition."

3.5 CLEARING AND GRUBBING

A. Remove obstructions, trees, shrubs, and other vegetation to permit installation of new construction.

1. Grind down stumps and remove roots larger than 3 inches (75 mm) in diameter, obstructions, and debris to a depth of 18 inches (450 mm) below exposed subgrade.
2. Use only hand methods or air spade for grubbing within protection zones.

B. Fill depressions caused by clearing and grubbing operations with satisfactory soil material unless further excavation or earthwork is indicated.

1. Place fill material in horizontal layers not exceeding a loose depth of 8 inches (200 mm) and compact each layer to a density equal to adjacent original ground.

3.6 TOPSOIL STRIPPING

A. Remove sod and grass before stripping topsoil.

B. Strip topsoil to depth of 6 inches in a manner to prevent intermingling with underlying subsoil or other waste materials.

C. Stockpile topsoil away from edge of excavations without intermixing with subsoil or other materials. Grade and shape stockpiles to drain surface water. Cover to prevent windblown dust and erosion by water.

3.7 SITE IMPROVEMENTS

A. Remove existing above- and below-grade improvements as indicated and necessary to facilitate new construction.

3.8 DISPOSAL OF SURPLUS AND WASTE MATERIALS

A. Remove unsuitable topsoil, obstructions, demolished materials, and waste materials including trash and debris, and legally dispose of them off Owner's property.

B. Separate recyclable materials produced during site clearing from other nonrecyclable materials. Store or stockpile without intermixing with other materials, and transport them to recycling facilities. Do not interfere with other Project work.

END OF SECTION 311000

SECTION 312000

EARTH MOVING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Removal of un-consolidated fill from the building demolition footprint and backfilling the resulting excavation to final subgrade elevation.
2. Excavating and filling for rough grading the Site.
3. Preparing subgrades for slabs-on-grade, walks, pavements, turf and grasses and plants.
4. Excavating and backfilling for buildings and structures.
5. Drainage course for concrete slabs-on-grade.
6. Subbase course for concrete walks and pavements.
7. Subbase course and base course for asphalt paving.
8. Excavating and backfilling trenches for utilities and pits for buried utility structures.

1.2 DEFINITIONS

A. Backfill: Soil material used to fill an excavation.

1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
2. Final Backfill: Backfill placed over initial backfill to fill a trench.

B. Base Course: Aggregate layer placed between the subbase course and hot-mix asphalt paving.

C. Bedding Course: Aggregate layer placed over the excavated subgrade in a trench before laying pipe.

D. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill.

E. Drainage Course: Aggregate layer supporting the slab-on-grade that also minimizes upward capillary flow of pore water.

F. Excavation: Removal of material encountered above subgrade elevations and to lines and dimensions indicated.

1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Architect. Authorized additional excavation and replacement material will be paid for according to Contract provisions for changes in the Work.

2. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Architect. Unauthorized excavation, as well as remedial work directed by Architect, shall be without additional compensation.

G. Fill: Soil materials used to raise existing grades.

H. Structures: Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.

I. Subbase Course: Aggregate layer placed between the subgrade and base course for hot-mix asphalt pavement, or aggregate layer placed between the subgrade and a cement concrete pavement or a cement concrete or hot-mix asphalt walk.

J. Subgrade: Uppermost surface of an excavation or the top surface of a fill or backfill immediately below subbase, drainage fill, drainage course, or topsoil materials.

K. Utilities: On-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.

1.3 INFORMATIONAL SUBMITTALS

A. Qualification Data: For qualified testing agency.

B. Material Test Reports: For each borrow soil material proposed for fill and backfill as follows:

1. Classification according to ASTM D2487.
2. Laboratory compaction curve according to ASTM D1557.

1.4 QUALITY ASSURANCE

A. Geotechnical Testing Agency Qualifications: Qualified according to ASTM E329 and ASTM D3740 for testing indicated.

1.5 FIELD CONDITIONS

A. Utility Locator Service: Notify utility locator service for area where Project is located before beginning earth-moving operations.

B. Do not commence earth-moving operations until plant-protection measures specified in Section 015639 "Temporary Tree and Plant Protection" are in place.

2.1 SOIL MATERIALS

A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from excavations.

B. Satisfactory Soils: Soil Classification Groups GW, GP, GM, SW, SP, and SM according to ASTM D 2487 or a combination of these groups; free of rock or gravel larger than 3 inches in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter.

C. Unsatisfactory Soils: Soil Classification Groups GC, SC, CL, ML, OL, CH, MH, OH, and PT according to ASTM D 2487 or a combination of these groups.

1. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction.

D. Subbase Material: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940/D 2940M; with at least 90 percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.

E. Base Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 294/D 2940M 0; with at least 95 percent passing a 1-1/2-inch sieve and not more than 8 percent passing a No. 200 sieve.

F. Engineered Fill: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940/D 2940M; with at least 90 percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.

G. Bedding Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940/D 2940M; except with 100 percent passing a 1-inch sieve and not more than 8 percent passing a No. 200 sieve.

H. Drainage Course: Narrowly graded mixture of washed crushed stone, or crushed or uncrushed gravel; ASTM D 448; coarse-aggregate grading Size 57; with 100 percent passing a 1-1/2-inch sieve and zero to 5 percent passing a No. 8 sieve.

I. Sand: ASTM C33/C33M; fine aggregate.

2.2 ACCESSORIES

A. Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, 6 inches wide and 4 mils thick, continuously inscribed with a description of the utility; colored to comply with local practice or requirements of authorities having jurisdiction.

B. Detectable Warning Tape: Acid- and alkali-resistant, polyethylene film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches wide and 4 mils thick, continuously inscribed with a description of the utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches deep; colored to comply with local practice or requirements of authorities having jurisdiction.

PART 3 - EXECUTION

3.1 PREPARATION

A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by earth-moving operations.

B. Protect and maintain erosion and sedimentation controls during earth-moving operations.

C. Protect subgrades and foundation soils from freezing temperatures and frost. Remove temporary protection before placing subsequent materials.

3.2 DEWATERING

A. Provide dewatering system of sufficient scope, size, and capacity to control hydrostatic pressures and to lower, control, remove, and dispose of ground water and permit excavation and construction to proceed on dry, stable subgrades.

B. Prevent surface water and ground water from entering excavations, from ponding on prepared subgrades, and from flooding Project site and surrounding area.

C. Protect subgrades from softening, undermining, washout, and damage by rain or water accumulation.

1. Reroute surface water runoff away from excavated areas. Do not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches.

D. Dispose of water removed by dewatering in a manner that avoids endangering public health, property, and portions of work under construction or completed. Dispose of water and sediment in a manner that avoids inconvenience to others.

3.3 EXCAVATION, GENERAL

A. Unclassified Excavation: Excavate to subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, soft or loose soils, saturated soils, demolition debris, wood and obstructions. No

changes in the Contract Sum or the Contract Time will be authorized for rock excavation or removal of obstructions.

1. If excavated materials intended for fill and backfill include unsatisfactory soil materials and rock, replace with satisfactory soil materials.

3.4 EXCAVATION FOR STRUCTURES

A. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 1 inch. If applicable, extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, and for inspections.

1. Excavations for Footings and Foundations: Do not disturb bottom of excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.
2. Excavation for Underground Tanks, Basins, and Mechanical or Electrical Utility Structures: Excavate to elevations and dimensions indicated within a tolerance of plus or minus 1 inch. Do not disturb bottom of excavations intended as bearing surfaces.

B. Excavations at Edges of Tree- and Plant-Protection Zones:

1. Excavate by hand or with an air spade to indicated lines, cross sections, elevations, and subgrades. If excavating by hand, use narrow-tine spading forks to comb soil and expose roots. Do not break, tear, or chop exposed roots. Do not use mechanical equipment that rips, tears, or pulls roots.
2. Cut and protect roots according to requirements in Section 015639 "Temporary Tree and Plant Protection."

3.5 EXCAVATION FOR WALKS AND PAVEMENTS

A. Excavate surfaces under walks and pavements to indicated lines, cross sections, elevations, and subgrades.

3.6 EXCAVATION FOR UTILITY TRENCHES

A. Excavate trenches to indicated gradients, lines, depths, and elevations.

B. Excavate trenches to uniform widths to provide the following clearance on each side of pipe or conduit. Excavate trench walls vertically from trench bottom to 12 inches higher than top of pipe or conduit unless otherwise indicated.

1. Clearance: 12 inches each side of pipe or conduit.

C. Trench Bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduit. Shape subgrade to provide continuous support for bells, joints, and barrels

of pipes and for joints, fittings, and bodies of conduits. Remove projecting stones and sharp objects along trench subgrade.

1. Excavate trenches 6 inches deeper than elevation required in rock or other unyielding bearing material to allow for bedding course.

D. Trenches in Tree- and Plant-Protection Zones:

1. Hand-excavate to indicated lines, cross sections, elevations, and subgrades. Use narrow-tine spading forks to comb soil and expose roots. Do not break, tear, or chop exposed roots. Do not use mechanical equipment that rips, tears, or pulls roots.
2. Do not cut main lateral roots or taproots; cut only smaller roots that interfere with installation of utilities.
3. Cut and protect roots according to requirements in Section 015639 "Temporary Tree and Plant Protection."

3.7 SUBGRADE INSPECTION

A. Proof-roll subgrade below the building slabs and pavements with a 10-ton vibratory roller or a loaded 10 ton pneumatic-tired dump truck to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.

B. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Architect, without additional compensation.

3.8 UNAUTHORIZED EXCAVATION

A. Fill unauthorized excavation under foundations or wall footings by extending bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill, with 28-day compressive strength of 2500 psi, may be used when approved by Architect.

1. Fill unauthorized excavations under other construction, pipe, or conduit as directed by Architect.

3.9 STORAGE OF SOIL MATERIALS

A. Stockpile borrow soil materials and excavated satisfactory soil materials without intermixing. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.

1. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

3.10 UTILITY TRENCH BACKFILL

A. Place backfill on subgrades free of mud, frost, snow, or ice.

B. Place and compact bedding course on trench bottoms and where indicated. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits.

C. Trenches under Footings: Backfill trenches excavated under footings and within 18 inches of bottom of footings with satisfactory soil; fill with concrete to elevation of bottom of footings. Concrete is specified in Section 033000 "Cast-in-Place Concrete."

D. Trenches under Roadways: Provide 4-inch- thick, concrete-base slab support for piping or conduit less than 30 inches below surface of roadways. After installing and testing, completely encase piping or conduit in a minimum of 4 inches of concrete before backfilling or placing roadway subbase course. Concrete is specified in Section 033000 "Cast-in-Place Concrete."

E. Initial Backfill: Place and compact initial backfill of subbase materials, free of particles larger than 1 inch in any dimension, to a height of 12 inches over the pipe or conduit.

1. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of piping or conduit to avoid damage or displacement of piping or conduit. Coordinate backfilling with utilities testing.

F. Final Backfill: Place and compact final backfill of satisfactory soil to final subgrade elevation.

G. Warning Tape: Install warning tape directly above utilities, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

3.11 SOIL FILL

A. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so fill material will bond with existing material.

B. Place and compact fill material in layers to required elevations as follows:

1. Under grass and planted areas, use satisfactory soil material.
2. Under walks and pavements, use satisfactory soil material.
3. Under steps and ramps, use engineered fill.
4. Under building slabs, use engineered fill.
5. Under footings and foundations, use engineered fill.

3.12 SOIL MOISTURE CONTROL

A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within 2 percent of optimum moisture content.

1. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
2. Remove and replace, or scarify and air dry, otherwise satisfactory soil material that exceeds optimum moisture content by 2 percent and is too wet to compact to specified dry unit weight.

3.13 COMPACTION OF SOIL BACKFILLS AND FILLS

A. Place backfill and fill soil materials in layers not more than 8 inches in loose depth for material compacted by heavy compaction equipment and not more than 4 inches in loose depth for material compacted by hand-operated tampers.

B. Place backfill and fill soil materials evenly on all sides of structures to required elevations and uniformly along the full length of each structure.

C. Compact soil materials to not less than the following percentages of maximum dry unit weight according to Modified Proctor Test (ASTM D 1557):

1. Under structure foundations and filling of the demolition excavation, compact each layer of backfill or fill soil material at 98 percent.
2. Under structures, building slabs, steps, and pavements, compact each layer of backfill or fill soil material at 95 percent.
3. Under walkways, compact each layer of backfill or fill soil material at 90 percent.
4. Under turf or unpaved areas, compact each layer of backfill or fill soil material at 90 percent.
5. For utility trenches, compact each layer of initial to 90 percent and final backfill soil material at 95 percent.

3.14 GRADING

A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.

B. Site Rough Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to elevations required to achieve indicated finish elevations, within the following subgrade tolerances:

1. Turf or Unpaved Areas: Plus or minus 1 inch.
2. Walks: Plus or minus 1 inch.
3. Pavements: Plus or minus 1/2 inch.

C. Grading inside Building Lines: Finish subgrade to a tolerance of 1/2 inch when tested with a 10-foot straightedge.

3.15 SUBBASE AND BASE COURSES UNDER PAVEMENTS AND WALKS

A. Place subbase course and base course on subgrades free of mud, frost, snow, or ice.

B. On prepared subgrade, place subbase course and base course under pavements and walks as follows:

1. Shape subbase course and base course to required crown elevations and cross-slope grades.
2. Place subbase course and base course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
3. Compact subbase course and base course at optimum moisture content to required grades, lines, cross sections, and thickness to not less than 95 percent of maximum dry unit weight according to ASTM D 1557.

3.16 DRAINAGE COURSE UNDER CONCRETE SLABS-ON-GRADE

A. Place drainage course on subgrades free of mud, frost, snow, or ice.

B. On prepared subgrade, place and compact drainage course under cast-in-place concrete slabs-on-grade as follows:

1. Place drainage course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
2. Compact each layer of drainage course to required cross sections and thicknesses to not less than 95 percent of maximum dry unit weight according to ASTM D 1557.

3.17 FIELD QUALITY CONTROL

A. Special Inspections: Contractor will engage a qualified special inspector to perform inspections:

B. Testing Agency: Contractor will engage a qualified geotechnical engineering testing agency to perform tests and inspections.

C. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earth moving only after test results for previously completed work comply with requirements.

D. Footing Subgrade: At footing subgrades, at least one test of each soil stratum will be performed to verify design bearing capacities. Subsequent verification and approval of other footing subgrades may be based on a visual comparison of subgrade with tested subgrade when approved by Architect.

E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil materials to depth required; recompact and retest until specified compaction is obtained.

3.18 PROTECTION

A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.

B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.

C. Where settling occurs before Project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.

1. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

3.19 DISPOSAL OF SURPLUS AND WASTE MATERIALS

A. Remove surplus satisfactory soil and waste materials, including unsatisfactory soil, trash, and debris, and legally dispose of them off Owner's property.

END OF SECTION 312000

SECTION 321216

ASPHALT PAVING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Hot-mix asphalt paving.

B. Related Requirements:

1. Section 312000 "Earth Moving" for subgrade preparation, fill material, unbound-aggregate subbase and base courses, and aggregate pavement shoulders.
2. Section 321373 "Concrete Paving Joint Sealants" for joint sealants and fillers at pavement terminations.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

1.3 QUALITY ASSURANCE

A. Manufacturer Qualifications: A paving-mix manufacturer registered with and approved by the New Jersey Department of Transportation (NJDOT).

B. Regulatory Requirements: Comply with materials, workmanship, and other applicable requirements of NJDOT for asphalt paving work.

1. Measurement and payment provisions and safety program submittals included in standard specifications do not apply to this Section.

PART 2 - PRODUCTS

2.1 AGGREGATES

A. Coarse Aggregate: ASTM D 692/D 692M, sound; angular crushed stone, crushed gravel, or cured, crushed blast-furnace slag.

B. Fine Aggregate: **ASTM D,** sharp-edged natural sand or sand prepared from stone, gravel, cured blast-furnace slag, or combinations thereof.

C. Mineral Filler: ASTM D 242/D 242M, rock or slag dust, hydraulic cement, or other inert material.

2.2 ASPHALT MATERIALS

A. Asphalt Binder: Shall conform with NJDOT requirements.

B. Tack Coat: Shall conform with NJDOT requirements.

2.3 AUXILIARY MATERIALS

A. Recycled Materials for Hot-Mix Asphalt Mixes: Reclaimed asphalt pavement; reclaimed, unbound-aggregate base material; and recycled tires, asphalt shingles, or glass from sources and gradations that have performed satisfactorily in previous installations, equal to performance of required hot-mix asphalt paving produced from all new materials.

B. Herbicide: Commercial chemical for weed control, registered by the EPA, and not classified as "restricted use" for locations and conditions of application. Provide in granular, liquid, or wettable powder form.

2.4 MIXES

A. Recycled Content of Hot-Mix Asphalt: Shall conform to NJDOT requirements.

B. Hot-Mix Asphalt: Dense-graded, hot-laid, hot-mix asphalt plant mixes approved by NJDOT and complying with the following requirements:

1. Provide mixes with a history of satisfactory performance in geographical area where Project is located.
2. Base Course: 19M64.
3. Surface Course: 9.5M64.

PART 3 - EXECUTION

3.1 PATCHING

A. Asphalt Pavement: Saw cut perimeter of patch and excavate existing pavement section to sound base. Excavate rectangular or trapezoidal patches, extending 12 inches (300 mm) into perimeter of adjacent sound pavement, unless otherwise indicated. Cut excavation faces vertically. Remove excavated material. Recompact existing unbound-aggregate base course to form new subgrade.

B. Portland Cement Concrete Pavement: Break cracked slabs and roll as required to reseat concrete pieces firmly.

1. Remove disintegrated or badly cracked pavement. Excavate rectangular or trapezoidal patches, extending into perimeter of adjacent sound pavement, unless otherwise indicated. Cut excavation faces vertically. Recompact existing unbound-aggregate base course to form new subgrade.

C. Tack Coat: Before placing patch material, apply tack coat uniformly to vertical asphalt surfaces abutting the patch. Apply at a rate of 0.05 to 0.15 gal./sq. yd. (0.2 to 0.7 L/sq. m).

1. Allow tack coat to cure undisturbed before applying hot-mix asphalt paving.
2. Avoid smearing or staining adjoining surfaces, appurtenances, and surroundings. Remove spillages and clean affected surfaces.

D. Placing Patch Material: Fill excavated pavement areas with hot-mix asphalt base mix for full thickness of patch and, while still hot, compact flush with adjacent surface.

3.2 SURFACE PREPARATION

A. General: Immediately before placing asphalt materials, remove loose and deleterious material from substrate surfaces. Ensure that prepared subgrade is ready to receive paving.

B. Proof-roll subgrade below pavements with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.

C. Herbicide Treatment: Apply herbicide according to manufacturer's recommended rates and written application instructions. Apply to dry, prepared subgrade or surface of compacted-aggregate base before applying paving materials.

D. Tack Coat: Apply uniformly to surfaces of existing pavement at a rate of 0.05 to 0.15 gal./sq. yd. (0.2 to 0.7 L/sq. m).

1. Allow tack coat to cure undisturbed before applying hot-mix asphalt paving.
2. Avoid smearing or staining adjoining surfaces, appurtenances, and surroundings. Remove spillages and clean affected surfaces.

3.3 PLACING HOT-MIX ASPHALT

A. Machine place hot-mix asphalt on prepared surface, spread uniformly, and strike off. Place asphalt mix by hand in areas inaccessible to equipment in a manner that prevents segregation of mix. Place each course to required grade, cross section, and thickness when compacted.

1. Spread mix at a minimum temperature of 250 deg F (121 deg C).
2. Regulate paver machine speed to obtain smooth, continuous surface free of pulls and tears in asphalt-paving mat.

B. Place paving in consecutive strips not less than 10 feet (3 m) wide unless infill edge strips of a lesser width are required.

C. Promptly correct surface irregularities in paving course behind paver. Use suitable hand tools to remove excess material forming high spots. Fill depressions with hot-mix asphalt to prevent segregation of mix; use suitable hand tools to smooth surface.

3.4 JOINTS

A. Construct joints to ensure a continuous bond between adjoining paving sections. Construct joints free of depressions, with same texture and smoothness as other sections of hot-mix asphalt course.

1. Clean contact surfaces and apply tack coat to joints.
2. Offset longitudinal joints, in successive courses, a minimum of 6 inches (150 mm).
3. Offset transverse joints, in successive courses, a minimum of 24 inches (600 mm).
4. Construct transverse joints at each point where paver ends a day's work and resumes work at a subsequent time. Construct these joints using either "bulkhead" or "papered" method according to AI MS-22, for both "Ending a Lane" and "Resumption of Paving Operations."

3.5 COMPACTION

A. General: Begin compaction as soon as placed hot-mix paving will bear roller weight without excessive displacement. Compact hot-mix paving with hot, hand tampers or with vibratory-plate compactors in areas inaccessible to rollers.

1. Complete compaction before mix temperature cools to 185 deg F (85 deg C).

B. Breakdown Rolling: Complete breakdown or initial rolling immediately after rolling joints and outside edge. Examine surface immediately after breakdown rolling for indicated crown, grade, and smoothness. Correct laydown and rolling operations to comply with requirements.

C. Intermediate Rolling: Begin intermediate rolling immediately after breakdown rolling while hot-mix asphalt is still hot enough to achieve specified density. Continue rolling until hot-mix asphalt course has been uniformly compacted to the following density:

1. Average Density: 92 percent of reference maximum theoretical density according to ASTM D 2041, but not less than 90 percent or greater than 96 percent.

D. Finish Rolling: Finish roll paved surfaces to remove roller marks while hot-mix asphalt is still warm.

E. Edge Shaping: While surface is being compacted and finished, trim edges of pavement to proper alignment. Bevel edges while asphalt is still hot; compact thoroughly.

F. Protection: After final rolling, do not permit vehicular traffic on pavement until it has cooled and hardened.

G. Erect barricades to protect paving from traffic until mixture has cooled enough not to become marked.

3.6 INSTALLATION TOLERANCES

A. Pavement Thickness: Compact each course to produce the thickness indicated within the following tolerances:

1. Base Course: Plus or minus 1/2 inch (13 mm).
2. Surface Course: Plus 1/4 inch (6 mm), no minus.

B. Pavement Surface Smoothness: Compact each course to produce a surface smoothness within the following tolerances as determined by using a 10-foot (3-m) straightedge applied transversely or longitudinally to paved areas:

1. Base Course: 1/4 inch (6 mm).
2. Surface Course: 1/8 inch (3 mm).
3. Crowned Surfaces: Test with crowned template centered and at right angle to crown. Maximum allowable variance from template is 1/4 inch (6 mm).

3.7 FIELD QUALITY CONTROL

A. Testing Agency: Owner will engage a qualified testing agency to perform tests and inspections.

B. Replace and compact hot-mix asphalt where core tests were taken.

C. Remove and replace or install additional hot-mix asphalt where test results or measurements indicate that it does not comply with specified requirements.

3.8 WASTE HANDLING

A. General: Handle asphalt-paving waste according to approved waste management plan required in Section 017419 "Construction Waste Management and Disposal."

END OF SECTION 321216

SECTION 321313

CONCRETE PAVING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes Concrete Paving including the following

1. Driveways.
2. Curbs.
3. Walks.
4. Concrete Pads.
5. Walks.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Samples: For each type of product, ingredient, or admixture requiring color selection.

C. Design Mixtures: For each concrete paving mixture. Include alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.

1.3 QUALITY ASSURANCE

A. Ready-Mix-Concrete Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.

1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities" (Quality Control Manual - Section 3, "Plant Certification Checklist").

1.4 PRECONSTRUCTION TESTING

A. Preconstruction Testing Service: Engage a qualified independent testing agency to perform preconstruction testing on concrete paving mixtures.

2.1 CONCRETE, GENERAL

A. ACI Publications: Comply with ACI 301 (ACI 301M) unless otherwise indicated.

2.2 STEEL REINFORCEMENT

A. Recycled Content: Postconsumer recycled content plus one-half of preconsumer recycled content not less than 25 percent.

B. Plain-Steel Welded-Wire Reinforcement: ASTM A 1064/A 1064M, fabricated from as-drawn steel wire into flat sheets.

C. Deformed-Steel Welded-Wire Reinforcement: ASTM A 1064/A 1064M, flat sheet.

D. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (Grade 420); deformed.

E. Joint Dowel Bars: ASTM A 615/A 615M, Grade 60 (Grade 420) plain-steel bars[; zinc coated (galvanized) after fabrication according to ASTM A 767/A 767M, Class I coating]. Cut bars true to length with ends square and free of burrs.

F. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded-wire reinforcement, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice" from steel wire, plastic, or precast concrete of greater compressive strength than concrete specified.

2.3 CONCRETE MATERIALS

A. Regional Materials: Concrete shall be manufactured within 500 miles (800 km) of Project site from aggregates and cement that have been extracted, harvested, or recovered, as well as manufactured, within 500 miles (800 km) of Project site.

B. Cementitious Materials: Shall be in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Road and Bridge Construction, 2007 Edition.

C. Normal-Weight Aggregates: ASTM C 33/C 33M, Class 4S, uniformly graded. Provide aggregates from a single source.

D. Air-Entraining Admixture: ASTM C 260/C 260M.

E. Chemical Admixtures: Admixtures certified by manufacturer to be compatible with other admixtures and to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material.

F. Water: Potable and complying with ASTM C 94/C 94M.

2.4 CURING MATERIALS

A. Absorptive Cover: AASHTO M 182, Class 3, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. (305 g/sq. m) dry or cotton mats].

B. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.

C. Water: Potable.

D. Evaporation Retarder: Waterborne, monomolecular, film forming, manufactured for application to fresh concrete.

E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, dissipating.

F. White, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 2, Class B, dissipating.

2.5 RELATED MATERIALS

A. Joint Fillers: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork in preformed strips.

B. Slip-Resistive Aggregate Finish: Factory-graded, packaged, rustproof, nonglazing, abrasive aggregate of fused aluminum-oxide granules or crushed emery aggregate containing not less than 50 percent aluminum oxide and not less than 20 percent ferric oxide; unaffected by freezing, moisture, and cleaning materials.

2.6 CONCRETE MIXTURES

A. Prepare design mixtures, proportioned according to ACI 301 (ACI 301M), for each type and strength of normal-weight concrete, and as determined by either laboratory trial mixtures or field experience.

B. Cementitious Materials: In accordance with NJDOT Standard Specifications. Add air-entraining admixture at manufacturer's prescribed rate to result in normal-weight concrete at point of placement having an air content as follows:

1. Air Content: In accordance with NJDOT Standard Specifications.

C. Chemical Admixtures: Use admixtures according to manufacturer's written instructions.

D. Concrete Mixtures: In accordance with NJDOT Standard Specifications.

2.7 CONCRETE MIXING

A. Ready-Mixed Concrete: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M [and ASTM C 1116/C 1116M]. Furnish batch certificates for each batch discharged and used in the Work.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Proof-roll prepared subbase surface below concrete paving to identify soft pockets and areas of excess yielding.

3.2 PREPARATION

A. Remove loose material from compacted subbase surface immediately before placing concrete.

3.3 EDGE FORMS AND SCREED CONSTRUCTION

A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides to required lines, grades, and elevations. Install forms to allow continuous progress of work and so forms can remain in place at least 24 hours after concrete placement.

B. Clean forms after each use and coat with form-release agent to ensure separation from concrete without damage.

3.4 STEEL REINFORCEMENT INSTALLATION

A. Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.

3.5 JOINTS

A. General: Form construction, isolation, and contraction joints and tool edges true to line, with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to centerline unless otherwise indicated.

B. Construction Joints: Set construction joints at side and end terminations of paving and at locations where paving operations are stopped for more than one-half hour unless paving terminates at isolation joints.

C. Isolation Joints: Form isolation joints of preformed joint-filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, other fixed objects, and where indicated.

D. Contraction Joints: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of the concrete thickness[, to match jointing of existing adjacent concrete paving]:

E. Edging: After initial floating, tool edges of paving, gutters, curbs, and joints in concrete with an edging tool to a 1/4-inch radius. Repeat tooling of edges after applying surface finishes. Eliminate edging-tool marks on concrete surfaces.

3.6 CONCRETE PLACEMENT

A. Moisten subbase to provide a uniform dampened condition at time concrete is placed. Do not place concrete around manholes or other structures until they are at required finish elevation and alignment.

B. Comply with ACI 301 (ACI 301M) requirements for measuring, mixing, transporting, and placing concrete.

C. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.

D. Screed paving surface with a straightedge and strike off.

E. Commence initial floating using bull floats or darbies to impart an open-textured and uniform surface plane before excess moisture or bleedwater appears on the surface. Do not further disturb concrete surfaces before beginning finishing operations or spreading surface treatments.

3.7 FLOAT FINISHING

A. General: Do not add water to concrete surfaces during finishing operations.

1. Float Finish: In accordance with NJDOT Standard Specifications.

3.8 CONCRETE PROTECTION AND CURING

A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.

B. Comply with ACI 306.1 for cold-weather protection.

C. Evaporation Retarder: Apply evaporation retarder to concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h (1 kg/sq. m x h) before and during

finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete but before float finishing.

D. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.

E. Curing Methods: Cure concrete by moisture curing, moisture-retaining-cover curing curing compound or a combination of these.

3.9 PAVING TOLERANCES

A. Comply with tolerances in ACI 117 (ACI 117M) and the NJDOT Standard Specifications

3.10 REPAIR AND PROTECTION

A. Remove and replace concrete paving that is broken, damaged, or defective or that does not comply with requirements in this Section. Remove work in complete sections from joint to joint unless otherwise approved by Architect.

B. Protect concrete paving from damage. Exclude traffic from paving for at least 14 days after placement. When construction traffic is permitted, maintain paving as clean as possible by removing surface stains and spillage of materials as they occur.

C. Maintain concrete paving free of stains, discoloration, dirt, and other foreign material. Sweep paving not more than two days before date scheduled for Substantial Completion inspections.

END OF SECTION 321313

SECTION 321723

PAVEMENT MARKINGS

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes painted markings applied to asphalt pavement.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 PAVEMENT-MARKING PAINT

A. Pavement-Marking Paint: Shall be in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Roadway and Bridge Construction.

PART 3 - EXECUTION

3.1 PAVEMENT MARKING

A. Do not apply pavement-marking paint until layout, colors, and placement have been verified with Architect.

B. Allow paving to age for a minimum of 30 days before starting pavement marking.

C. Sweep and clean surface to eliminate loose material and dust.

D. Apply paint with mechanical equipment to produce pavement markings, of dimensions indicated, with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils (0.4 mm).

1. Apply graphic symbols and lettering with paint-resistant, die-cut stencils. Apply paint so that it cannot run beneath the stencil.
2. Broadcast glass beads uniformly into wet markings at a rate of 6 lb/gal. (0.72 kg/L).

END OF SECTION 321723

SECTION 329200

TURF AND GRASSES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Topsoiling.
2. Seeding.
3. Sodding.

1.2 DEFINITIONS

A. Pesticide: A substance or mixture intended for preventing, destroying, repelling, or mitigating a pest. This includes insecticides, miticides, herbicides, fungicides, rodenticides, and molluscicides. It also includes substances or mixtures intended for use as a plant regulator, defoliant, or desiccant.

B. Planting Soil: Existing, on-site soil; imported soil; or manufactured soil that has been modified with soil amendments and perhaps fertilizers to produce a soil mixture best for plant growth.

C. Topsoil: Natural, fertile soil capable of sustaining vigorous plant growth.

1.3 INFORMATIONAL SUBMITTALS

A. Certification of grass seed.

1. Certification of each seed mixture.

B. Product certificates.

1. Testing data for topsoil.

1.4 QUALITY ASSURANCE

A. Installer Qualifications: A qualified landscape Installer whose work has resulted in successful turf establishment.

1. Installer's Field Supervision: Require Installer to maintain an experienced full-time supervisor on Project site when work is in progress.

2. Personnel Certifications: Installer's field supervisor shall have certification in one of the following categories from the Professional Landcare Network:

   a. Landscape Industry Certified Technician - Exterior.
   b. Landscape Industry Certified Lawncare Manager.
   c. Landscape Industry Certified Lawncare Technician.

3. Pesticide Applicator: State licensed, commercial.

1.5 DELIVERY, STORAGE, AND HANDLING

A. Seed and Other Packaged Materials: Deliver packaged materials in original, unopened containers showing weight, certified analysis, name and address of manufacturer, and indication of compliance with state and Federal laws, as applicable.

PART 2 - PRODUCTS

2.1 SEED

A. Grass Seed: Fresh, clean, dry, new-crop seed complying with AOSA's "Rules for Testing Seeds" for purity and germination tolerances.

B. Grass-Seed Mix:

1. Products: NJDOT Type A-3 seed mix.

2.2 TURFGRASS SOD

2.3 FERTILIZERS

A. Commercial Fertilizer: Commercial-grade complete fertilizer of neutral character, consisting of fast- and slow-release nitrogen, 50 percent derived from natural organic sources of urea formaldehyde, phosphorous, and potassium in the following composition:

1. Composition: [1 lb/1000 sq. ft. (0.45 kg/92.9 sq. m) of actual nitrogen, 4 percent phosphorous, and 2 percent potassium, by weight.

2.4 MULCHES

A. Straw Mulch: Provide air-dry, clean, mildew- and seed-free, salt hay or threshed straw of wheat, rye, oats, or barley.

B. Sphagnum Peat Mulch: Partially decomposed sphagnum peat moss, finely divided or of granular texture, and with a pH range of 3.4 to 4.8.

C. Muck Peat Mulch: Partially decomposed moss peat, native peat, or reed-sedge peat, finely divided or of granular texture, with a pH range of 6 to 7.5, and having a water-absorbing capacity of 1100 to 2000 percent, and containing no sand.

D. Compost Mulch: Well-composted, stable, and weed-free organic matter, pH range of 5.5 to 8; moisture content 35 to 55 percent by weight; 100 percent passing through 1-inch (25-mm) sieve; soluble salt content of 2 to 5 decisiemens/m; not exceeding 0.5 percent inert contaminants and free of substances toxic to plantings; and as follows:

2.5 PESTICIDES

A. General: Pesticide, registered and approved by the EPA, acceptable to authorities having jurisdiction, and of type recommended by manufacturer for each specific problem and as required for Project conditions and application. Do not use restricted pesticides unless authorized in writing by authorities having jurisdiction.

2.5 TOPSOIL

A. General: Topsoil shall be loamy sand, sandy loam, clay-loam, loam, silt loam, or other soil approved by the Engineer. It shall be natural, fertile soil capable of sustaining vigorous plant growth and shall be of a uniform quality, free from subsoil, slag, cinders, stones 1 inch or larger in any dimension, lumps of soil, sticks, roots, trash, or other extraneous, undesirable materials. Topsoil shall also be free of viable plants or plant parts of Bermuda grass, quackgrass, Johnson grass, nut sedge, poison ivy, Canada thistle, or similar material. The contractor shall have all topsoil tested by a reputable laboratory with resulting documentation submitted to the Engineer.

B. If testing reveals that the topsoil does not conform to the requirements of this section, the contractor shall be responsible for adjusting the ph range and/or percent of organic matter by means of approved additives.

C. Topsoil shall meet the following requirements:

1. ph range - 5.0 to 7.0.
2. Organic matter - four (4) percent (loss on ignition).
3. Soluble salts no higher than 500 parts per million.
4. Sieve Analysis:

Sieve Size	Percent Passing
1"	100%
½"	97%
#10	60-80%
#40	40-60%
#60	40-60%
#100	10-30%
#200	10-20%

D. When topsoil, stockpiled on site, is to be reused, soil debris to include roots, sods, stones, clay lumps, and other extraneous materials harmful to plant growth shall be removed prior to reuse.

E. Materials stripped from the following sources shall not be considered suitable for use as topsoil:

1. Soils having less than 4.1 ph value.
2. Chemically contaminated soils.
3. Areas from which the original surface has been stripped and/or covered over such as borrow pits, open mines, demolition sites, dumps, and sanitary landfills.
4. Wet excavation.

PART 3 - EXECUTION

3.1 TURF AREA PREPARATION

A. General: Prepare graded area for topsoil placement

B. Scarify the area to be topsoiled to improve the bond between slope and topsoil. Remove from the scarified area stones 2 inches or larger in any dimension and other debris such as wires, cables, tree roots, pieces of concrete, clods and lumps.

C. After the Engineer has approved the prepared surface elevations, spread topsoil and smooth to grade to produce the required thickness.

D. Ensure that ground areas are not damaged by the delivery, handling or storage of materials; by washouts due to drainage diversion; by workers; or by equipment. Repair such damage by grading, fertilizing, seeding and mulching as specified herein.

3.2 SEEDING

A. Sow seed with spreader or seeding machine. Do not broadcast or drop seed when wind velocity exceeds 5 mph (8 km/h).

1. Evenly distribute seed by sowing equal quantities in two directions at right angles to each other.
2. Do not use wet seed or seed that is moldy or otherwise damaged.
3. Do not seed against existing trees. Limit extent of seed to outside edge of planting saucer.

B. Sow seed at a total rate of 3 to 4 lb/1000 sq. ft.

C. Rake seed lightly into top 1/8 inch (3 mm) of soil, roll lightly, and water with fine spray.

D. Protect seeded areas with slopes not exceeding 1:6 by spreading straw mulch. Spread uniformly at a minimum rate of 2 tons/acre to form a continuous blanket in loose thickness over seeded areas.

1. Anchor straw mulch by crimping into soil with suitable mechanical equipment.

3.3 SODDING

A. Lay sod within 24 hours of harvesting. Do not lay sod if dormant or if ground is frozen or muddy.

B. Lay sod to form a solid mass with tightly fitted joints. Butt ends and sides of sod; do not stretch or overlap. Stagger sod strips or pads to offset joints in adjacent courses. Avoid damage to soil or sod during installation. Tamp and roll lightly to ensure contact with soil, eliminate air pockets, and form a smooth surface. Work sifted soil or fine sand into minor cracks between pieces of sod; remove excess to avoid smothering sod and adjacent grass.

1. Lay sod across slopes exceeding 1:3.
2. Anchor sod on slopes exceeding 1:6 with wood pegs or steel staples spaced as recommended by sod manufacturer but not less than two anchors per sod strip to prevent slippage.

C. Saturate sod with fine water spray within two hours of planting. During first week after planting, water daily or more frequently as necessary to maintain moist soil to a minimum depth of 1-1/2 inches below sod.

3.4 TURF MAINTENANCE

A. General: Maintain and establish turf by watering, fertilizing, weeding, mowing, trimming, replanting, and performing other operations as required to establish healthy, viable turf. Roll, regrade, and replant bare or eroded areas and remulch to produce a uniformly smooth turf. Provide materials and installation the same as those used in the original installation.

B. Mow turf as soon as top growth is tall enough to cut. Repeat mowing to maintain specified height without cutting more than one-third of grass height. Remove no more than one-third of grass-leaf growth in initial or subsequent mowings.

3.5 SATISFACTORY TURF

A. Turf installations shall meet the following criteria as determined by Engineer:

1. Satisfactory Seeded Turf: At end of maintenance period, a healthy, uniform, close stand of grass has been established, free of weeds and surface irregularities, with coverage exceeding 90 percent over any 10 sq. ft. and bare spots not exceeding 5 by 5 inches.

B. Use specified materials to reestablish turf that does not comply with requirements, and continue maintenance until turf is satisfactory.

4.0 QUANTITY AND PAYMENT

Separate payment will not be made for restoration of disturbed areas with topsoiling, fertilizing and seeding, but the cost shall be included in the various items of the proposal.

END OF SECTION 329200

SECTION 329201

TEMPORARY SOIL EROSION & SEDIMENT CONTROL MEASURES

PART 1 - GENERAL

1.1 GENERAL REQUIREMENTS

A. Refer to Divisions 0 and 1 as they form a part of this Section.

B. This work shall consist of temporary control measures ordered by the Engineer during the life of the contract and as shown on plans, to control erosion and sediment through use of berms, dikes, dams, sediment basins, fiber mats, netting, gravel, mulches, grasses and other erosion control devices or methods.

C. The primary objective of this specification is to control soil erosion to the maximum extent practicable commensurate with reasonable and economical construction practices.

D. The temporary control provisions contained herein shall be coordinated with the permanent erosion control features (grass, pavement and other restorations) specified elsewhere in the contract to the extent practical to assure economical, effective and continuous erosion control throughout the construction and post-construction period.

E. The erosion control measures described herein shall be continued until the construction is complete and final restorations installed.

F. Wherever construction exposes work which is subject to erosion, the extent of such exposure in advance of the subsequent construction shall be subject to the approval of the Engineer. Erosion control features or other work to be completed within such areas shall follow as soon after exposure as practicable.

G. All materials and methods of construction shall be in accordance with the New Jersey State Standards for Soil Erosion and Sediment Control, and as depicted on the Soil Erosion and Sediment Control Plans.

PART 2 - PRODUCTS

2.1 MATERIALS

A. Materials shall conform to that depicted on the Soil Erosion and Sediment Control Plan.

PART 3 - EXECUTION

3.1 METHODS OF CONSTRUCTION

A. Preconstruction Conference

1. At the preconstruction conference or prior to the start of the applicable construction, the Contractor shall submit for acceptance his schedules for accomplishment of temporary and permanent erosion control work, as are applicable for excavation work, and any other elements of the project which may contribute to ground erosion of siltation. No work shall be started until the erosion control schedules and methods of operations have been accepted by the Engineer.

B. Construction Requirements

1. The Engineer has the authority to limit the surface area of erodible earth material exposed by excavation and grading operations, and to direct the Contractor to provide immediate permanent or temporary pollution control measures to prevent contamination of adjacent streams, water courses, or bodies of water. Such work may involve the construction of temporary berms, dikes, dams, sediment basins, slope drains, and use of temporary mulches, mats, seeding or other control devices or methods as necessary to control erosion. Cut slopes shall be temporarily seeded and mulched as the excavation proceeds to the extent considered desirable and practicable.
2. The Contractor will be required to incorporate all permanent erosion control features to include the required pavement and grass restorations into the project at the earliest practicable times as outlined in his accepted schedule. Temporary control measures will be used to correct conditions that develop during construction that were not foreseen during the design stages that are needed prior to installation of permanent control features; or that are needed temporarily to control erosion that develops during normal construction practices, but are not associated with permanent control features on the project.
3. Where erosion is likely to be a problem, excavation and grading operations shall be so scheduled and performed that permanent erosion control features can follow immediately; otherwise temporary erosion control measures may be required between successive construction stages.
4. In the event of conflict between these requirements and pollution control laws, rules, or regulations of other federal or state or location agencies, the more restrictive, laws, rules or regulations shall apply.
5. The Contractor will be responsible for maintaining all soil erosion and sediment control measures in an acceptable manner. All temporary measures shall be removed by the Contractor as directed by the Engineer.

END OF SECTION 329201

SECTION 330500

COMMON WORK RESULTS FOR UTILITIES

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Piping joining materials.
2. Dielectric fittings.
3. Sleeves.
4. Identification devices.
5. Grout.
6. Piping system common requirements.
7. Equipment installation common requirements.
8. Concrete bases.
9. Metal supports and anchorages.

1.2 DEFINITIONS

A. Exposed Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions.

B. Concealed Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.

1.3 SUBMITTALS

A. Product Data: For the following:

1. Dielectric fittings.
2. Identification devices.

B. Welding certificates.

1.4 QUALITY ASSURANCE

A. Steel Support Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

B. Steel Piping Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."

1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.

C. Comply with ASME A13.1 for lettering size, length of color field, colors, and viewing angles of identification devices.

PART 2 - PRODUCTS

2.1 PIPING JOINING MATERIALS

A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.

1. ASME B16.21, nonmetallic, flat, asbestos free, 1/8-inch (3.2-mm) maximum thickness, unless otherwise indicated.

a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.

2. AWWA C110, rubber, flat face, 1/8 inch (3.2 mm) thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.

B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.

C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.

E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAg1, silver alloy for refrigerant piping, unless otherwise indicated.

F. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

G. Solvent Cements for Joining Plastic Piping:

1. ABS Piping: ASTM D 2235.
2. CPVC Piping: ASTM F 493.
3. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
4. PVC to ABS Piping Transition: ASTM D 3138.

H. Fiberglass Pipe Adhesive: As furnished or recommended by pipe manufacturer.

2.2 DIELECTRIC FITTINGS

A. Dielectric Fittings, General: Assembly of copper alloy and ferrous materials or ferrous material body with separating nonconductive insulating material suitable for system fluid, pressure, and temperature.

B. Dielectric Unions:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Capitol Manufacturing Co.
b. Central Plastics Company.
c. Epco Sales, Inc.
d. Hart Industries, International, Inc.
e. Watts Water Technologies, Inc.
f. Zurn Plumbing Products Group; Wilkins Div., or
g. Approved equal.

2. Description: Factory fabricated, union, NPS 2 (DN 50) and smaller.

a. Pressure Rating: 150 psig (1035 kPa) minimum at 180 deg F (82 deg C).
b. End Connections: Solder-joint copper alloy and threaded ferrous; threaded ferrous.

C. Dielectric Flanges:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Capitol Manufacturing Co.
b. Central Plastics Company.
c. Epco Sales, Inc.
d. Watts Water Technologies, Inc., or
e. Approved equal.

2. Description: Factory-fabricated, bolted, companion-flange assembly, NPS 2-1/2 to NPS 4 (DN 65 to DN 100) and larger.

a. Pressure Rating: 150 psig (1035 kPa) minimum.
b. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.

D. Dielectric Couplings:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Calpico, Inc.

b. Lochinvar Corporation., or
c. Approved equal.

2. Description: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining, NPS 3 (DN 80) and smaller.

a. Pressure Rating: 300 psig (2070 kPa) at 225 deg F (107 deg C).
b. End Connections: Threaded.

E. Dielectric Nipples:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

a. Perfection Corporation.
b. Precision Plumbing Products, Inc.
c. Victaulic Company; or
d. Approved equal.

2. Description: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining.

a. Pressure Rating: 300 psig (2070 kPa) at 225 deg F (107 deg C).
b. End Connections: Threaded or grooved.

2.3 SLEEVES

A. Mechanical sleeve seals for pipe penetrations are specified in Division 22 Section "Common Work Results for Plumbing."

B. Galvanized-Steel Sheet Sleeves: 0.0239-inch (0.6-mm) minimum thickness; round tube closed with welded longitudinal joint.

C. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized, plain ends.

D. Cast-Iron Sleeves: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

E. Molded PVC Sleeves: Permanent, with nailing flange for attaching to wooden forms.

F. PVC Pipe Sleeves: ASTM D 1785, Schedule 40.

G. Molded PE Sleeves: Reusable, PE, tapered-cup shaped, and smooth outer surface with nailing flange for attaching to wooden forms.

2.4 IDENTIFICATION DEVICES

A. Equipment Nameplates: Metal permanently fastened to equipment with data engraved or stamped.

1. Data: Manufacturer, product name, model number, serial number, capacity, operating and power characteristics, labels of tested compliances, and essential data.
2. Location: Accessible and visible.

B. Snap-on Plastic Pipe Markers: Manufacturer's standard preprinted, semirigid, snap-on type. Include color-coding according to ASME A13.1, unless otherwise indicated.

C. Pressure-Sensitive Pipe Markers: Manufacturer's standard preprinted, color-coded, pressure-sensitive-vinyl type with permanent adhesive.

D. Pipes with OD, Including Insulation, Less Than 6 Inches (150 mm): Full-band pipe markers, extending 360 degrees around pipe at each location.

E. Pipes with OD, Including Insulation, 6 Inches (150 mm) and Larger: Either full-band or strip-type pipe markers, at least three times letter height and of length required for label.

F. Lettering: Use piping system terms indicated and abbreviate only as necessary for each application length.

1. Arrows: Either integrally with piping system service lettering to accommodate both directions of flow, or as separate unit on each pipe marker to indicate direction of flow.

G. Plastic Tape: Manufacturer's standard color-coded, pressure-sensitive, self-adhesive vinyl tape, at least 3 mils (0.08 mm) thick.

1. Width: 1-1/2 inches (40 mm) on pipes with OD, including insulation, less than 6 inches (150 mm); 2-1/2 inches (65 mm) for larger pipes.
2. Color: Comply with ASME A13.1, unless otherwise indicated.

H. Valve Tags: Stamped or engraved with 1/4-inch (6.4-mm) letters for piping system abbreviation and 1/2-inch (13-mm) sequenced numbers. Include 5/32-inch (4-mm) hole for fastener.
1. Material: Valve manufacturer's standard solid plastic.
2. Size: 1-1/2 inches (40 mm) in diameter, unless otherwise indicated.
3. Shape: As indicated for each piping system.

I. Valve Tag Fasteners: Brass, wire-link or beaded chain; or brass S-hooks.

J. Engraved Plastic-Laminate Signs: ASTM D 709, Type I, cellulose, paper-base, phenolic-resin-laminate engraving stock; Grade ES-2, black surface, black phenolic core, with white melamine subcore, unless otherwise indicated. Fabricate in sizes required for message. Provide holes for mechanical fastening.

1. Engraving: Engraver's standard letter style, of sizes and with terms to match equipment identification.
2. Thickness: 1/16 inch (1.6 mm), unless otherwise indicated.
3. Fasteners: Self-tapping, stainless-steel screws or contact-type permanent adhesive.

K. Plastic Equipment Markers: Manufacturer's standard laminated plastic, in the following color codes:

1. Green: Cooling equipment and components.
2. Yellow: Heating equipment and components.
3. Brown: Energy reclamation equipment and components.
4. Blue: Equipment and components that do not meet criteria above.
5. Hazardous Equipment: Use colors and designs recommended by ASME A13.1.
6. Terminology: Match schedules as closely as possible. Include the following:

    a. Name and plan number.
    b. Equipment service.
    c. Design capacity.
    d. Other design parameters such as pressure drop, entering and leaving conditions, and speed.

7. Size: 2-1/2 by 4 inches (65 by 100 mm) for control devices, dampers, and valves; 4-1/2 by 6 inches (115 by 150 mm) for equipment.

2.5 GROUT

A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.

1. Characteristics: Post hardening, volume adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
2. Design Mix: 5000-psi (34.5-MPa), 28-day compressive strength.
3. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 DIELECTRIC FITTING APPLICATIONS

A. Dry Piping Systems: Connect piping of dissimilar metals with the following:

1. NPS 2 (DN 50) and Smaller: Dielectric unions.
2. NPS 2-1/2 (DN 65) and Larger: Dielectric flanges.

B. Wet Piping Systems: Connect piping of dissimilar metals with the following:

1. NPS 2 (DN 50) and Smaller: Dielectric couplings or dielectric nipples.
2. NPS 2-1/2 (DN 65) and Larger: Dielectric nipples.

3.2 PIPING INSTALLATION

A. Install piping according to the following requirements and Division 33 Sections specifying piping systems.

B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on the Coordination Drawings.

C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

D. Install piping to permit valve servicing.

E. Install piping at indicated slopes.

F. Install piping free of sags and bends.

G. Install fittings for changes in direction and branch connections.

H. Select system components with pressure rating equal to or greater than system operating pressure.

I. Sleeves are not required for core-drilled holes.

J. Permanent sleeves are not required for holes formed by removable PE sleeves.

K. Install sleeves for pipes passing through concrete and masonry walls and concrete floor and roof slabs.

1. Cut sleeves to length for mounting flush with both surfaces.

    a. Exception: Extend sleeves installed in floors of equipment areas or other wet areas 2 inches (50 mm) above finished floor level.

2. Install sleeves in new walls and slabs as new walls and slabs are constructed.

    a. PVC Pipe Sleeves: For pipes smaller than NPS 6 (DN 150).
    b. Steel Sheet Sleeves: For pipes NPS 6 (DN 150) and larger, penetrating gypsum-board partitions.

L. Verify final equipment locations for roughing-in.

M. Refer to equipment specifications in other Sections for roughing-in requirements.

3.3 PIPING JOINT CONSTRUCTION

A. Join pipe and fittings according to the following requirements and Division 33 Sections specifying piping systems.

B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.

D. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.

E. Welded Joints: Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.

F. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

G. Grooved Joints: Assemble joints with grooved-end pipe coupling with coupling housing, gasket, lubricant, and bolts according to coupling and fitting manufacturer's written instructions.

H. Soldered Joints: Apply ASTM B 813 water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy (0.20 percent maximum lead content) complying with ASTM B 32.

I. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.

J. Pressure-Sealed Joints: Assemble joints for plain-end copper tube and mechanical pressure seal fitting with proprietary crimping tool to according to fitting manufacturer's written instructions.

K. Plastic Piping Solvent-Cemented Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:

1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
2. ABS Piping: Join according to ASTM D 2235 and ASTM D 2661 appendixes.
3. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
4. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
5. PVC Nonpressure Piping: Join according to ASTM D 2855.
6. PVC to ABS Nonpressure Transition Fittings: Join according to ASTM D 3138 Appendix.

L. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.

M. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.

N. Plastic Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D 2657.

1. Plain-End PE Pipe and Fittings: Use butt fusion.
2. Plain-End PE Pipe and Socket Fittings: Use socket fusion.

O. Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

3.4 PIPING CONNECTIONS

A. Make connections according to the following, unless otherwise indicated:

1. Install unions, in piping NPS 2 (DN 50) and smaller, adjacent to each valve and at final connection to each piece of equipment.
2. Install flanges, in piping NPS 2-1/2 (DN 65) and larger, adjacent to flanged valves and at final connection to each piece of equipment.
3. Install dielectric fittings at connections of dissimilar metal pipes.

3.5 EQUIPMENT INSTALLATION

A. Install equipment level and plumb, unless otherwise indicated.

B. Install equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference with other installations. Extend grease fittings to an accessible location.

C. Install equipment to allow right of way to piping systems installed at required slope.

3.6 IDENTIFICATION

A. Piping Systems: Install pipe markers on each system. Include arrows showing normal direction of flow.

1. Plastic markers, with application systems. Install on insulation segment if required for hot noninsulated piping.
2. Locate pipe markers on exposed piping according to the following:

a. Near each valve and control device.
b. Near each branch, excluding short takeoffs for equipment and terminal units. Mark each pipe at branch if flow pattern is not obvious.
c. Near locations where pipes pass through walls or floors or enter inaccessible enclosures.
d. At manholes and similar access points that permit view of concealed piping.
e. Near major equipment items and other points of origination and termination.

B. Equipment: Install engraved plastic-laminate sign or equipment marker on or near each major item of equipment.

1. Lettering Size: Minimum 1/4 inch (6.4 mm) high for name of unit if viewing distance is less than 24 inches (610 mm), 1/2 inch (13 mm) high for distances up to 72 inches (1800 mm), and proportionately larger lettering for greater distances. Provide secondary lettering two-thirds to three-fourths of size of principal lettering.
2. Text of Signs: Provide name of identified unit. Include text to distinguish among multiple units, inform user of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations.

C. Adjusting: Relocate identifying devices that become visually blocked by work of this or other Divisions.

3.7 CONCRETE BASES

A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.

1. Construct concrete bases of dimensions indicated, but not less than 4 inches (100 mm) larger in both directions than supported unit.
2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch (450-mm) centers around the full perimeter of base.
3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
5. Install anchor bolts to elevations required for proper attachment to supported equipment.
6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
7. Use 3000-psi (20.7-MPa, 28-day compressive-strength concrete and reinforcement as specified in Division 03 Section "Cast-in-Place Concrete."

3.8 ERECTION OF METAL SUPPORTS AND ANCHORAGES

A. Refer to Division 05 Section "Metal Fabrications" for structural steel.

B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor piped utility materials and equipment.

C. Field Welding: Comply with AWS D1.1/D1.1M.

3.9 GROUTING

A. Mix and install grout for equipment base bearing surfaces, pump and other equipment base plates, and anchors.

B. Clean surfaces that will come into contact with grout.

C. Provide forms as required for placement of grout.

D. Avoid air entrapment during placement of grout.

E. Place grout, completely filling equipment bases.

F. Place grout on concrete bases and provide smooth bearing surface for equipment.

G. Place grout around anchors.

H. Cure placed grout.

END OF SECTION 330500

SECTION 334100

STORM UTILITY DRAINAGE PIPING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Pipe and fittings.
2. Manholes.
3. Cleanouts.
4. Nonpressure transition couplings.
5. Stormwater inlets.
6. Pipe outlets.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings:

1. Manholes: Include plans, elevations, sections, details, frames, and covers.
2. Stormwater inlets. Include plans, elevations, sections, details, frames, covers, and grates.
3. Pipe outlets: Include plans, elevations, sections and details for concrete headwalls.

1.3 INFORMATIONAL SUBMITTALS

A. Coordination Drawings: Show pipe sizes, locations, and elevations. Show other piping in same trench and clearances from storm drainage system piping. Indicate interface and spatial relationship between manholes, piping, and proximate structures.

B. Profile Drawings: Show system piping in elevation. Draw profiles at horizontal scale of not less than 1 inch equals 50 feet (1:500) and vertical scale of not less than 1 inch equals 5 feet (1:50). Indicate manholes and piping. Show types, sizes, materials, and elevations of other utilities crossing system piping.

C. Product Certificates: For each type of pipe and fitting, from manufacturer.

D. Field quality-control reports.

1.4 PROJECT CONDITIONS

A. Interruption of Existing Storm Drainage Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary service according to requirements indicated:

1. Notify Architect no fewer than two days in advance of proposed interruption of service.
2. Do not proceed with interruption of service without [Architect's written permission.

PART 2 - PRODUCTS

2.1 CONCRETE PIPE AND FITTINGS

A. Reinforced-Concrete Sewer Pipe and Fittings: ASTM C 76 (ASTM C 76M).

1. Bell-and-spigot ends and gasketed joints with ASTM C 443 (ASTM C 443M), rubber gaskets
2. Class III.

2.2 NONPRESSURE TRANSITION COUPLINGS

A. Comply with ASTM C 1173, elastomeric, sleeve-type, reducing or transition coupling, for joining underground nonpressure piping. Include ends of same sizes as piping to be joined, and corrosion-resistant-metal tension band and tightening mechanism on each end.

B. Sleeve Materials:

1. For Concrete Pipes: ASTM C 443 (ASTM C 443M), rubber.
2. For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
3. For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.

C. Unshielded, Flexible Couplings:

1. Description: Elastomeric sleeve with stainless-steel shear ring and corrosion-resistant-metal tension band and tightening mechanism on each end.

D. Shielded, Flexible Couplings:

1. Description: ASTM C 1460, elastomeric or rubber sleeve with full-length, corrosion-resistant outer shield and corrosion-resistant-metal tension band and tightening mechanism on each end.

E. Ring-Type, Flexible Couplings:

1. Description: Elastomeric compression seal with dimensions to fit inside bell of larger pipe and for spigot of smaller pipe to fit inside ring.

2.3 CLEANOUTS

A. Plastic Cleanouts:

1. Description: PVC body with PVC threaded plug. Include PVC sewer pipe fitting and riser to cleanout of same material as sewer piping.

2.4 MANHOLES

A. Standard Precast Concrete Manholes in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Road and Bridge Construction, 2007 Edition.

B. Manhole Frames and Covers shall be in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Road and Bridge Construction, 2007 Edition.

2.5 CONCRETE

A. General: Cast-in-place concrete according to ACI 318, ACI 350/350R (ACI 350M/350RM), and the following:

1. Cement: ASTM C 150, Type II.
2. Fine Aggregate: ASTM C 33, sand.
3. Coarse Aggregate: ASTM C 33, crushed gravel.
4. Water: Potable.

B. Portland Cement Design Mix: 4000 psi (27.6 MPa) minimum, with 0.45 maximum water/cementitious materials ratio.

1. Reinforcing Fabric: ASTM A 185/A 185M, steel, welded wire fabric, plain.
2. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (420 MPa) deformed steel.

C. Ballast and Pipe Supports: Portland cement design mix, 3000 psi (20.7 MPa) minimum, with 0.58 maximum water/cementitious materials ratio.

1. Reinforcing Fabric: ASTM A 185/A 185M, steel, welded wire fabric, plain.
2. Reinforcing Bars: ASTM A 615/A 615M, Grade 60 (420 MPa) deformed steel.

2.6 STORMWATER INLETS

A. All inlets shall be in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Road and Bridge Construction, 2016 Edition.

B. Frames and Grates shall be in conformance with New Jersey Department of Transportation (NJDOT) Standard Specifications for Road and Bridge Construction, 2016 Edition.

2.7 PIPE OUTLETS

A. Head Walls: Cast-in-place reinforced concrete, with apron and tapered sides.

B. Riprap Basins: Broken, irregularly sized and shaped, graded stone according to NSSGA's "Quarried Stone for Erosion and Sediment Control."

1. Average Stone Size as shown on Construction Plans.

2.8 EARTHWORK

A. Excavation, trenching, and backfilling are specified in Section 312000 "Earth Moving."

2.9 PIPING INSTALLATION

A. General Locations and Arrangements: Drawing plans and details indicate general location and arrangement of underground storm drainage piping. Location and arrangement of piping layout take into account design considerations. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.

B. Install piping beginning at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements.

C. Install manholes for changes in direction unless fittings are indicated. Use fittings for branch connections unless direct tap into existing sewer is indicated.

D. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.

E. When installing pipe under streets or other obstructions that cannot be disturbed, use pipe-jacking process of microtunneling.

F. Install gravity-flow, nonpressure drainage piping according to the following:

1. Install piping pitched down in direction of flow.
2. Install PVC sewer piping according to ASTM D 2321 and ASTM F 1668.
3. Install reinforced-concrete sewer piping according to ASTM C 1479 and ACPA's "Concrete Pipe Installation Manual."

2.10 PIPE JOINT CONSTRUCTION

A. Join gravity-flow, nonpressure drainage piping according to the following:

1. Join reinforced-concrete sewer piping according to ACPA's "Concrete Pipe Installation Manual" for rubber-gasketed joints.
2. Join dissimilar pipe materials with nonpressure-type flexible couplings.

2.11 CLEANOUT INSTALLATION

A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade. Use cast-iron soil pipe fittings in sewer pipes at branches for cleanouts and cast-iron soil pipe for riser extensions to cleanouts. Install piping so cleanouts open in direction of flow in sewer pipe.

1. Use Light-Duty, top-loading classification cleanouts in earth or unpaved foot-traffic areas.
2. Use Medium-Duty, top-loading classification cleanouts in paved foot-traffic areas.
3. Use Heavy-Duty, top-loading classification cleanouts in vehicle-traffic service areas.
4. Use Extra-Heavy-Duty, top-loading classification cleanouts in roads.

B. Set cleanout frames and covers in earth in cast-in-place concrete block, 18 by 18 by 12 inches deep. Set with tops 1 inch above surrounding earth grade.

C. Set cleanout frames and covers in concrete pavement and roads with tops flush with pavement surface.

2.12 MANHOLE INSTALLATION

A. General: Install manholes, complete with appurtenances and accessories indicated.

B. Install precast concrete manhole sections with sealants according to ASTM C 891.

C. Where specific manhole construction is not indicated, follow manhole manufacturer's written instructions.

D. Set tops of frames and covers flush with finished surface of manholes that occur in pavements. Set tops 3 inches above finished surface elsewhere unless otherwise indicated.

2.13 STORMWATER INLET AND OUTLET INSTALLATION

A. Construct inlet head walls, aprons, and sides of reinforced concrete, as indicated.

B. Construct riprap of broken stone, as indicated.

2.14 CONCRETE PLACEMENT

A. Place cast-in-place concrete according to ACI 318.

2.15 FIELD QUALITY CONTROL

A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Inspect after approximately 24 inches (610 mm) of backfill is in place, and again at completion of Project.

1. Submit separate reports for each system inspection.
2. Defects requiring correction include the following:

    a. Alignment: Less than full diameter of inside of pipe is visible between structures.
    b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
    c. Damage: Crushed, broken, cracked, or otherwise damaged piping.
    d. Infiltration: Water leakage into piping.
    e. Exfiltration: Water leakage from or around piping.

3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
4. Reinspect and repeat procedure until results are satisfactory.

B. Test new piping systems, and parts of existing systems that have been altered, extended, or repaired, for leaks and defects.

1. Do not enclose, cover, or put into service before inspection and approval.
2. Test completed piping systems according to requirements of authorities having jurisdiction.
3. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours' advance notice.
4. Submit separate report for each test.
5. Gravity-Flow Storm Drainage Piping: Test according to requirements of authorities having jurisdiction, UNI-B-6, and the following:

    a. Exception: Piping with soiltight joints unless required by authorities having jurisdiction.
    b. Option: Test plastic piping according to ASTM F 1417.
    c. Option: Test concrete piping according to ASTM C 924 (ASTM C 924M).

C. Leaks and loss in test pressure constitute defects that must be repaired.

D. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.

END OF SECTION 334100

APPENDIX - A

GEOTECHNICAL REPORT

EWING LAWRENCE SEWERAGE AUTHORITY

VEHICLE STORAGE BUILDING

PROJECT – 1102M026

REMINGTON & VERNICK ENGINEERS

RVE HQ:
2059 Springdale Road
Cherry Hill, NJ 08003
O: (856) 795-9595
F: (856) 795-1882

March 7, 2024

S. Robert Filler, Executive Director
Ewing-Lawrence Sewerage Authority
600 Whitehead Road
Lawrenceville, NJ 08648

Re: Letter Report on Geotechnical Investigation
Proposed Garage Storage Building
Ewing-Lawrence Sewerage Authority Wastewater Treatment Complex
Ewing Township, Mercer County, New Jersey
RVA Ref. No. 1102M026

Dear Mr. Filler:

Remington & Vernick Engineers (RVE) has performed a geotechnical investigation for the referenced project. The purpose of the investigation was to determine subsurface conditions at the site of the proposed garage storage building and to make recommendations, from a soils engineering viewpoint, for the design and construction of the building. All of the information obtained, together with our interpretation of the findings, is presented herein.

Sincerely,
REMINGTON & VERNICK ENGINEERS

K. Charles Westen

K. Charles Westen, P.E.
NJ PE License No. 47013

attachments

cc: Dennis Yoder, PE
Jacqueline Trovato, PE

Introduction

Remington & Vernick Engineers (RVE) has been retained by the Ewing-Lawrence Sewerage Authority (ELSA) to carry out a geotechnical investigation for the proposed construction of a garage storage building. The location of the proposed building is in the rear of the Authority's Wastewater Treatment Plant complex located at 600 Whitehead Road in Lawrence Township, New Jersey. The purpose of the investigation was to determine the subsurface conditions at the garage storage building site and to provide recommendations for the design and construction of the proposed building foundations. All of the information obtained, together with our interpretation of the findings, is presented herein.

Fieldwork & Subsurface Conditions

The field work for the geotechnical investigation consisted of standard penetration test (SPT) borings and test pit excavations. The test boring investigation was conducted on October 31, 2023, and consisted of three (3) geotechnical test borings, drilled to depths ranging between 23.5 to 29 feet below existing grade. The test borings were performed by Boring Brothers, Inc. utilizing a track mounted drill rig and the mud rotary drilling method at locations selected in the field by RVE. All drilling and soil sampling operations were supervised by RVE and the field logging of the soil samples was performed by a representative of RVE.

Soil samples were recovered via a two-inch O.D. split-spoon sampler; driven by a hydraulically activated 140-pound hammer, free falling 30 inches (ASTM D 1586). The number of hammer blows required to advance the 24-inch spoon in 6-inch increments (four increments in all) were recorded. The number of blows required to penetrate the middle two increments (6 to 18 inches) is known as the Standard Penetration Resistance (N). Soil samples were obtained continuously in the upper 12 ft and at 5 ft intervals thereafter. Recovered soil samples were visually classified in the field using the Burmister Soil Identification System and the Unified Soil Classification System. The results of the visual analyses were utilized to prepare the attached Soil Boring Logs.

The test pit excavations were performed on February 16, 2024, and consisted of three (3) test pits, excavated to depths of approximately 8 to 10 feet below existing grade. The test pits were excavated by ELSA personnel, utilizing a Case 580 rubber tire backhoe at locations selected in the field by RVE. All excavation operations were supervised by RVE and the field logging of the test pits was performed by a representative of RVE. The locations of the test borings and test pits are shown on the attached boring and test pit location plan.

Test Boring Investigation

At grade in all three (3) SPT borings, granular fill soils was encountered, which extend to depths ranging from 2 to 15 feet below existing grade. The fill soils can be described as dark brown and gray coarse to fine sand with little to no silt, some to trace medium to fine crushed stone and

trace to no clay. In boring B-1, what appeared to be assorted boulders, cobbles and possible concrete debris were encountered down to a depth of 10 feet below existing grade. It had been reported that portions of the site was filled in with concrete fill material during prior construction at the site. Underlaying the fill soils, granular and cohesive marsh deposits were encountered down to depths ranging from 10 to 25 feet below existing grade. The granular marsh deposits can be described as dark gray and brown fine sand or silt with some clayey silt or little clay and trace to no gravel. The cohesive march deposits can be described as dark gray and dark brown clayey silt with trace fine sand and trace to no organics. Underlaying the marsh deposits, granular alluvium soils were encountered, and extended to the refusal depths of the borings. The alluvial soils can be described as gray and brown coarse to fine sand with some to no medium to fine gravel, little to no silt and little to no clay. The relative density of the granular fill soils varies from compact to dense, with SPT N_{60} and $N1_{60}$ values ranging from 15 to 35 blows per foot (bpf). The relative density of the granular marsh soils varies from very loose to very dense, with SPT $N1_{60}$-values ranging from 2 to 48 bpf. The relative consistency of the cohesive marsh deposits varies from firm to stiff with SPT $N1_{60}$-values ranging from 5 to 16 bpf. The relative density of the granular alluvial soils ranges from dense to very dense with SPT $N1_{60}$-values ranging from 34 to over 50 bpf. All three borings were terminated at drilling refusal, which was assumed to be bedrock, at depths ranging from 23.5 to 29 feet below existing grade.

Test Pit Investigation

In general, the soils observed in the test pits are in general agreement with the soils observed in the test boring investigation.

In test pit TP-01, underlaying 8-inches of topsoil, brown and grayish brown granular fill was encountered, consisting of medium to fine sand with little to some silt, little medium to fine crushed stone, brick and concrete fragments, and trace clay. At a depth of 9 feet below existing grade dark brown cohesive fill, consisting of clayey silt with little medium to fine crushed stone was encountered and extended to the termination depth of the test pit. The test pit was terminated at a depth of 10 feet below existing grade due to excessive caving of the test pit sidewalls.

In test pit TP-02, underlaying 8-inches of topsoil, a 1-foot thick layer of brown clayey silt with little fine sand was encountered, and was underlain by brown and light brown granular fill. The granular fill consists of medium to fine sand with little silt, little medium to fine crushed stone, brick and concrete fragments, and trace clay. This stratum becomes slightly more granular with depth and extended to the termination depth of the test pit. The test pit was terminated at a depth of 10 feet below existing grade due to excessive caving of the test pit sidewalls.

In test pit TP-03, underlaying a 2 inch layer of crushed stone, a 3 foot layer of dark brown granular fill was encountered, consisting of coarse to fine sand, little silt, little medium to fine crushed stone and little clay. Underlaying this 3 foot layer of granular fill, cohesive fill soils were encountered, consisting of gray clayey silt, some fine sand and little medium to fine crushed

stone and brick and concrete fragments. A long length of discarded coiled up rubber hose was also encountered in the test pit in the cohesive fill. Underlaying the cohesive fill, dark brown and gray granular fill soils were encountered, consisting of medium to fine sand with little clayey silt and extended to the termination depth of the test pit. At a depth of 7 feet below existing grade, a corrugated metal pipe was encountered and pierced with the backhoe bucket. Flowing water was observed flowing from the pipe, however the was observed not to extend through the test pit. It is assumed that this pipe is possibly abandoned and sealed at one end. The test pit was terminated at a depth of 8 feet below existing grade due to the introduction of water from the existing pipe causing caving of the sidewalls.

Groundwater

Groundwater was encountered at approximately 12 feet below existing grade in borings B-2 and B-3 at the time of drilling. Groundwater was not observed in boring B-1 before the introduction of drilling mud. Flowing or standing natural groundwater was not observed in any of the test pits at the time of the test pit investigation. No visual indications of the seasonal high groundwater table were also observed in the test pits at the time of excavation. Groundwater levels generally can fluctuate due to changes in precipitation, infiltration, surface run-off and other hydrogeological factors. Therefore, the groundwater level present at the time of construction may vary from that observed at the time of the drilling operations. Shallow perched groundwater may be encountered during construction, especially if work commences after a wet weather period.

Recommendations

General

Based on the results of our field investigation we have evaluated the existing subsurface soils to determine their engineering properties. On the basis of this evaluation, we have made the following recommendations for the proposed structure, from a geotechnical perspective. It is our understanding that the proposed garage storage building will be a single story pre-engineered metal building with a slab on grade and having a building footprint of approximately 9,000 square feet (sf).

Site Preparation Procedures & Earthwork Operations

The proposed construction area is defined as the area within the proposed building limits, and a 5-foot and 3-foot wide zone outside the building and pavements, respectively.

1. Clear and strip from the construction area, any existing vegetation, topsoil or any other deleterious material. Any existing utilities found within the proposed building limits will have to be rerouted outside the building footprint. Any debris, old foundations or abandoned pipes encountered during excavation, will have to be removed completely

from the area under the proposed building to a minimum depth of 2 feet below the bottom slab elevation and completely from the area of the foundations. If any pipes are to be left in place, they must be completely filled with cement grout.

2. Excavate the site, where necessary, to proposed subgrade elevations. Over-excavate any unsuitable material or soils encountered below this elevation in the zone of influence of the foundations. The zone of influence is the volume of soil within lines drawn downward and outward, from the lower edges of a foundation, at a slope of 1.5H:1V. Unsuitable material includes all deleterious material, bricks, debris, rubble, or any other undesirable material designated by the on-site representative of the Geotechnical Engineer. Undesirable soils include all soft and loose soils encountered under the bottom of the foundation elevation. Replace the over-excavated material with controlled structural fill as defined herein.

3. After excavation to proposed subgrade and prior to the placement of any fill, the resulting subgrade should be rigorously proof rolled and compacted with a 10-ton heavy-duty vibratory roller. This should be done during a dry and favorable weather period, and under the technical supervision of a representative of the Geotechnical Engineer. A minimum of 8 overlapping passes is recommended to densify the upper 2 to 4 feet of on-site soils. The vibratory mode should be turned off within 20 feet of existing structures. No heavy equipment should be operated within 5 feet of existing structures. Compaction in the vicinity of existing structures should be accomplished using a mechanical compactor such as a walk behind roller or similar device as approved by the Geotechnical Engineer.

4. Undercut any zones of instability disclosed by the proof rolling, as determined by the on-site representative of the Geotechnical Engineer and replace the undercut material with controlled structural fill as defined herein. As required, raise the ground surface to the proposed subgrade elevation with controlled structural fill. All material used as controlled structural fill material in the building area should comply with the requirements given herein and approved by the on-site representative of the Geotechnical Engineer.

5. All load-bearing fill should be controlled structural fill placed in loose horizontal lifts with a maximum thickness of 8 inches. Controlled structural fill should consist of inorganic, readily compactable, predominantly well-graded granular soils with no more than 12% fines (material passing the No. 200 sieve), and a maximum particle size of 3 inches. The moisture content of the fill materials should be controlled to within 2% of the optimum moisture content, as determined by ASTM D 1557, by wetting, aeration or blending, as necessary. It is recommended that controlled fill within the construction area be compacted to at least 98% and 95% of the maximum dry density, as determined by the Modified Proctor Test (ASTM D 1557), below and above the footing subgrade elevations, respectively. In addition, it is recommended that all fills

be stable without significant movement under construction traffic, as judged by the on-site representative of the Geotechnical Engineer. Quality control testing of in-place fill densities should be conducted throughout the entire earthwork operation.

6. Permanent slopes should not be steeper than 2H:1V and provision should be made to protect the surface against erosion by covering the surface with riprap or a suitable vegetative cover.

Excavation

On the basis of the information provided to us concerning the project, we expect relatively shallow excavations for foundation construction. Deeper excavations may be required for the placement of underground utilities.

Open excavations are feasible provided there is enough room so that the stability of the existing underground utilities and adjacent structures are not affected. The existing utilities and structures may be considered not affected by the open cut excavation if a line projected downward from the bottom of the existing utility or structure foundation at a 1.5H:1V does not intersect the excavation slope. Any section of the existing utilities and structures affected by the excavation should be supported by temporary sheeting and shoring. The side slopes of the open cut should not be steeper than 2H:1V.

If temporary shoring is utilized, the soil parameters presented in the table below are suggested for the design of the shoring. All excavations should be in compliance with "Excavating and Trenching Operations," manual (latest revision), issued by the US Department of Labor, OSHA 2226, and local requirements.

Temporary Shoring Design Parameters

Unit Weight of Soil (pcf)	120
Angle of Internal Friction (ϕ)	30°
Coefficient of Active Earth Pressure (K_a)	0.33
Coefficient of Earth Pressure At-rest (K_o)	0.50
Coefficient of Passive Earth Pressure (K_p)	3.0*

* A suitable factor of safety should be applied to K_p

The lateral load information presented in this report should be used only as a guideline by the contractor, and it should be a requirement for the excavation contractor to prepare a proposed sheeting design certified by a licensed professional engineer prior to construction. The excavation contractor should be responsible for the design, installation, and maintenance of all sheeting and shoring.

Regardless of the excavation option chosen, excavated soils should not be stockpiled adjacent to the sides of the excavations to avoid the imposition of additional loads, unless these loads are considered in the design of the temporary shoring or excavation side slopes. Additionally, the effect of excavation machinery should be included in the stability of the open cut slopes, as well as any temporary shoring design.

Excavated granular soils approved by the Geotechnical Engineer may be stockpiled on-site for use as a component of the backfill material. The moisture content will have to be kept as close as possible to the optimum moisture content of this material if it is to be placed successfully as controlled fill.

Backfill

The clean granular portions of the excavated soils can be reused for backfill after approval by the Geotechnical Engineer. Soils with organic or other deleterious materials, soft clays, clayey silts or silts and materials having particle sizes greater than 3 inches shall be discarded. The moisture content of the backfill soil must be within 2% of the optimum value for proper compaction. Therefore, some adjustment of the moisture content may be necessary prior to use as backfill material. If imported fill materials are required to complete backfilling of the excavations, they should consist of uncontaminated, relatively well-graded granular soils as defined in Item 5 of the Site Preparation & Earthwork Operations portion of this report.

Backfilling against the foundations and for utility trenches, or other structural uses, should be accomplished using controlled structural fill, as defined in this report, compacted to 95% of the maximum dry density as determined by the Modified Proctor Test, ASTM D 1557. Compaction of the backfill within 5 feet of any existing structures should be carried out with relatively light equipment such as a jumping jack, a walk behind roller, or similar device as approved by the on-site representative of the Geotechnical Engineer. The backfill should be placed in 8-inch lifts and compacted to at least 95% and 90% of maximum dry density, as determined by the ASTM D-1557 test procedure, in structural areas and in paved or landscaped areas respectively.

Dewatering

The results obtained at the time of the drilling operation indicate that groundwater was encountered at a depth of 12 feet below existing grade. Therefore, continuous dewatering operations should not be required on this site for excavations shallower than 12 feet below existing grade. Dewatering of perched water, run-off water and any water encountered during construction can be performed using sump pumps.

If groundwater encountered in excavations deeper than 12 feet cannot be controlled by sump pumps, more elaborate dewatering methods such as deep wells or well points may be required. Dewatering with more elaborate dewatering methods will require a dewatering specification. Dewatering specifications should be of the performance type requiring that the contractor

maintains the groundwater level at least 2 feet below the prevailing bottom of the excavation. The dewatering should be continuous during construction operations and until backfill has been placed and compacted to at least 2 feet above natural groundwater level.

Foundations

After site preparation operations have been satisfactorily completed, as recommended herein, the densified on-site soils and/or structural fill may be utilized to support the proposed structure. We recommend a shallow foundation system consisting of continuous wall and isolated column footings be used to support the proposed structure. For design purposes, a maximum net allowable bearing pressure of 1,500 pounds per square foot (psf) can be used. With the use of the recommended allowable bearing capacity, a satisfactory factor of safety will be provided against a shear failure and total and differential settlement will be within tolerable limits.

Wall and column footing widths should not be less than 2 and 3 feet, respectively. Exterior footings should be founded at a minimum depth of 3 feet beneath the exterior finished grades for frost protection. Interior footings in heated areas of the building can be founded at any convenient depth provided that the bottom of the floor slab and top of the concrete footings are separated by a minimum 6-inch thick layer of clean structural fill or granular base material.

The footing subgrades should be thoroughly compacted prior to the placement of the concrete utilizing a mechanical compactor such as a jumping jack, walk-behind roller, or similar device as approved by the on-site representative of the Geotechnical Engineer. It must be reiterated, due to portions of proposed construction that will be supported on approximately 8 to 10 feet of compacted controlled structural fill, that the structural fill must be placed in 8-inch lifts and compacted to at least 98% of maximum dry density, as determined by the ASTM D-1557 test procedure, below the footing founding level.

Prior to the placement of concrete, the foundation subgrade must be inspected by a qualified representative of the Geotechnical Engineer in order to confirm the soil bearing capacity. The contractor should exercise extreme caution not to disturb the subgrade soils. Should the subgrade be disturbed, the loosened soil should be compacted in-place or excavated down to firm soil. Any water which accumulates in the excavation bottom should be removed promptly.

Floor Slabs

Proposed reinforced concrete floor slabs can be uniformly supported on the densified site soils or controlled structural fill after site preparation procedures have been successfully completed as discussed herein. The slabs should be structurally independent of walls and footings. Large floor areas should be provided with joints at frequent intervals as determined by the structural engineer. A minimum of 4 inches of ¾-inch clean crushed stone or a 12-inch thick layer (minimum) of well-graded sand and gravel with not more than 5% non-plastic fines is

recommended below the slab to assure uniform bearing conditions and to act as a capillary break. A vapor barrier should be placed between the slab and base course, as directed by the Architect, to minimize moisture migration to the surface. All structural fill supporting the floor slab should be compacted to 95% of the maximum dry density (ASTM D 1557).

Concrete slabs placed on the subgrade, prepared as described herein, can be designed using a modulus of subgrade reaction of 100 pounds per cubic inch (pci).

Seismic Zone

According to the New Jersey Edition of the 2021 International Building Code, Section 1613.2.2 referencing ASCE 7, Chapter 20 the project site is categorized as a Site Class "D" for seismic design purposes (see attached). This classification is based on subsoil conditions encountered in the borings.

Limitations


The conclusions and recommendations contained in this report are based upon the subsurface data obtained during this investigation and on details stated in this report. It is understood that the number of test pits made are consistent with good engineering practice but actual conditions encountered may differ significantly from those projected in this report. Should conditions arise which differ from those described in this report, **RVE** should be notified immediately and provided with all information regarding differing subsurface conditions.

Our recommendations are based upon the assumption that the services of a qualified engineer will be retained during construction for the observation of all critical earthwork operations and foundation installation. **RVE** cannot minimize, or provide recommended solutions for, any problems resulting from construction or differing soil conditions unless our services include full-time construction inspection to determine that the work performed is in compliance with **RVE's** recommendations, and to ensure the work is carried out in the owner's best interests.

Environmental considerations and contaminants, such as petroleum products, hazardous waste, radioactivity, irritants, pollutants, radon or other dangerous substances and conditions were not the subject of this study. Their presence and/or absence are not implied, inferred or suggested by this report or results of this study.

This report is intended for use with regard to the specific project discussed herein, and any changes in the design of the structure or location, however slight, should be brought to our attention so that we may determine how they may affect our conclusions. We are responsible for the conclusions and opinions contained in this report based on the data relating only to the specific project and location discussed herein.

Site Location Map/USGS Quadrangle

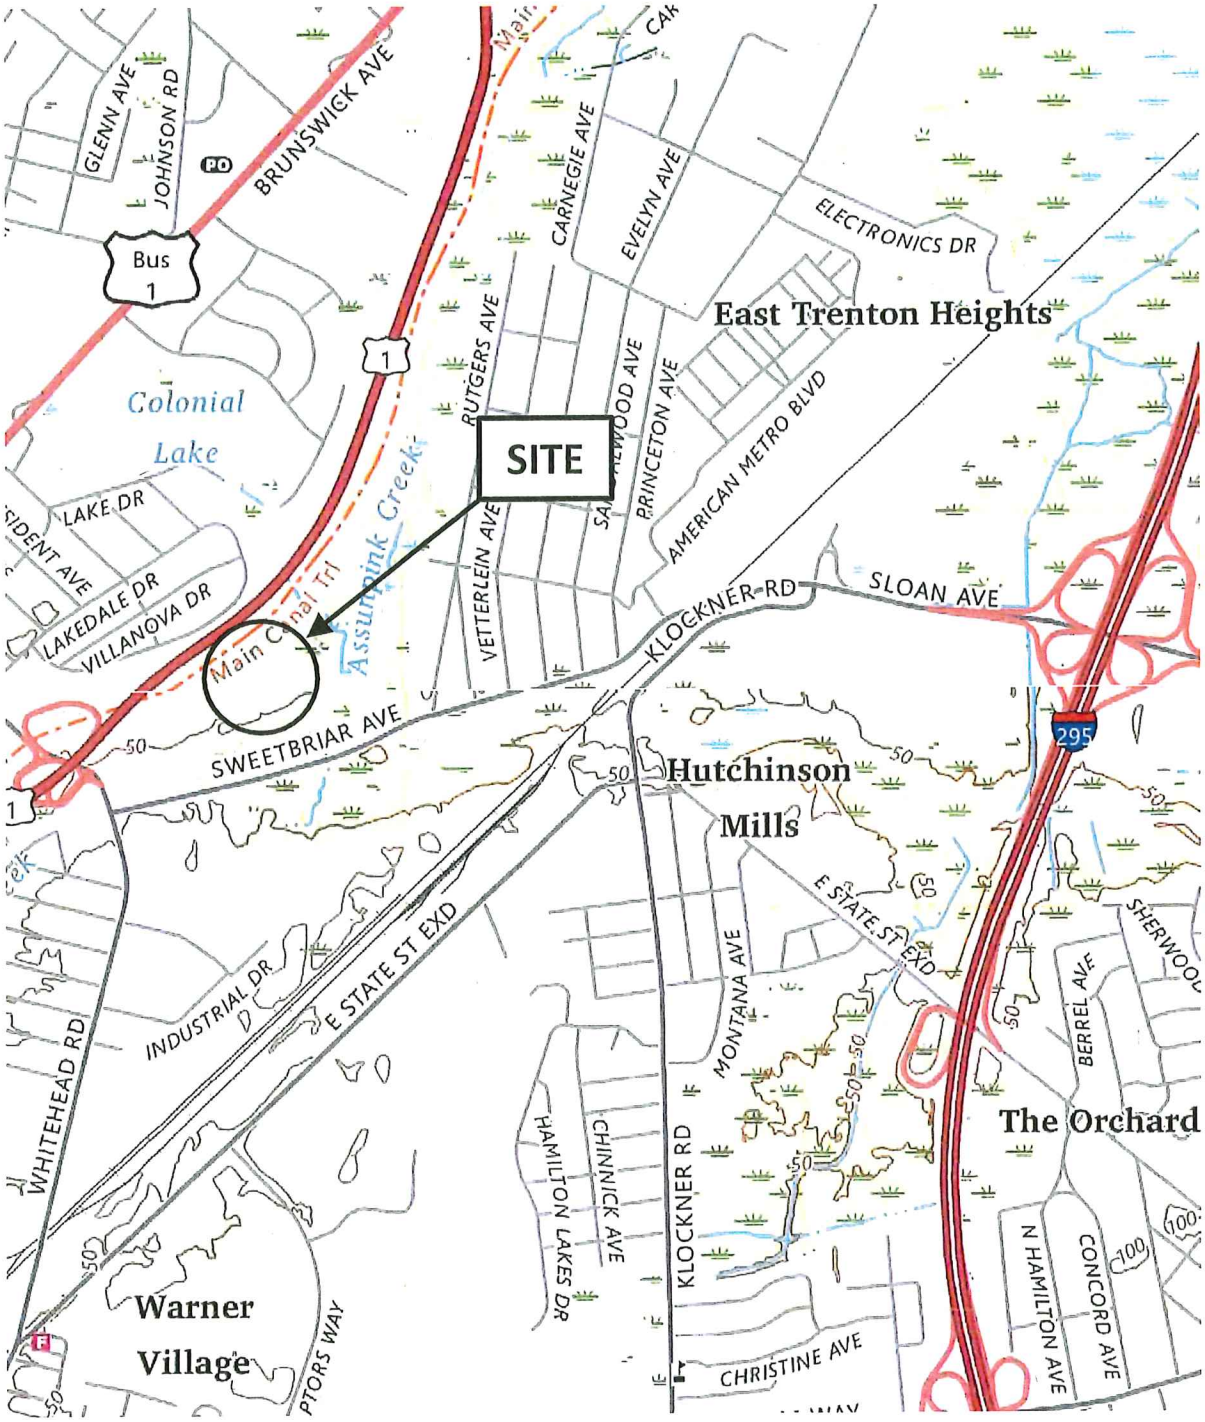


Site Location Map/USGS Quadrangle

Proposed Garage Storage Building

Ewing - Lawrence Sewerage Authority

Lawrence Township, Mercer County, New Jersey

Soil Boring & Test Pit Location Plan

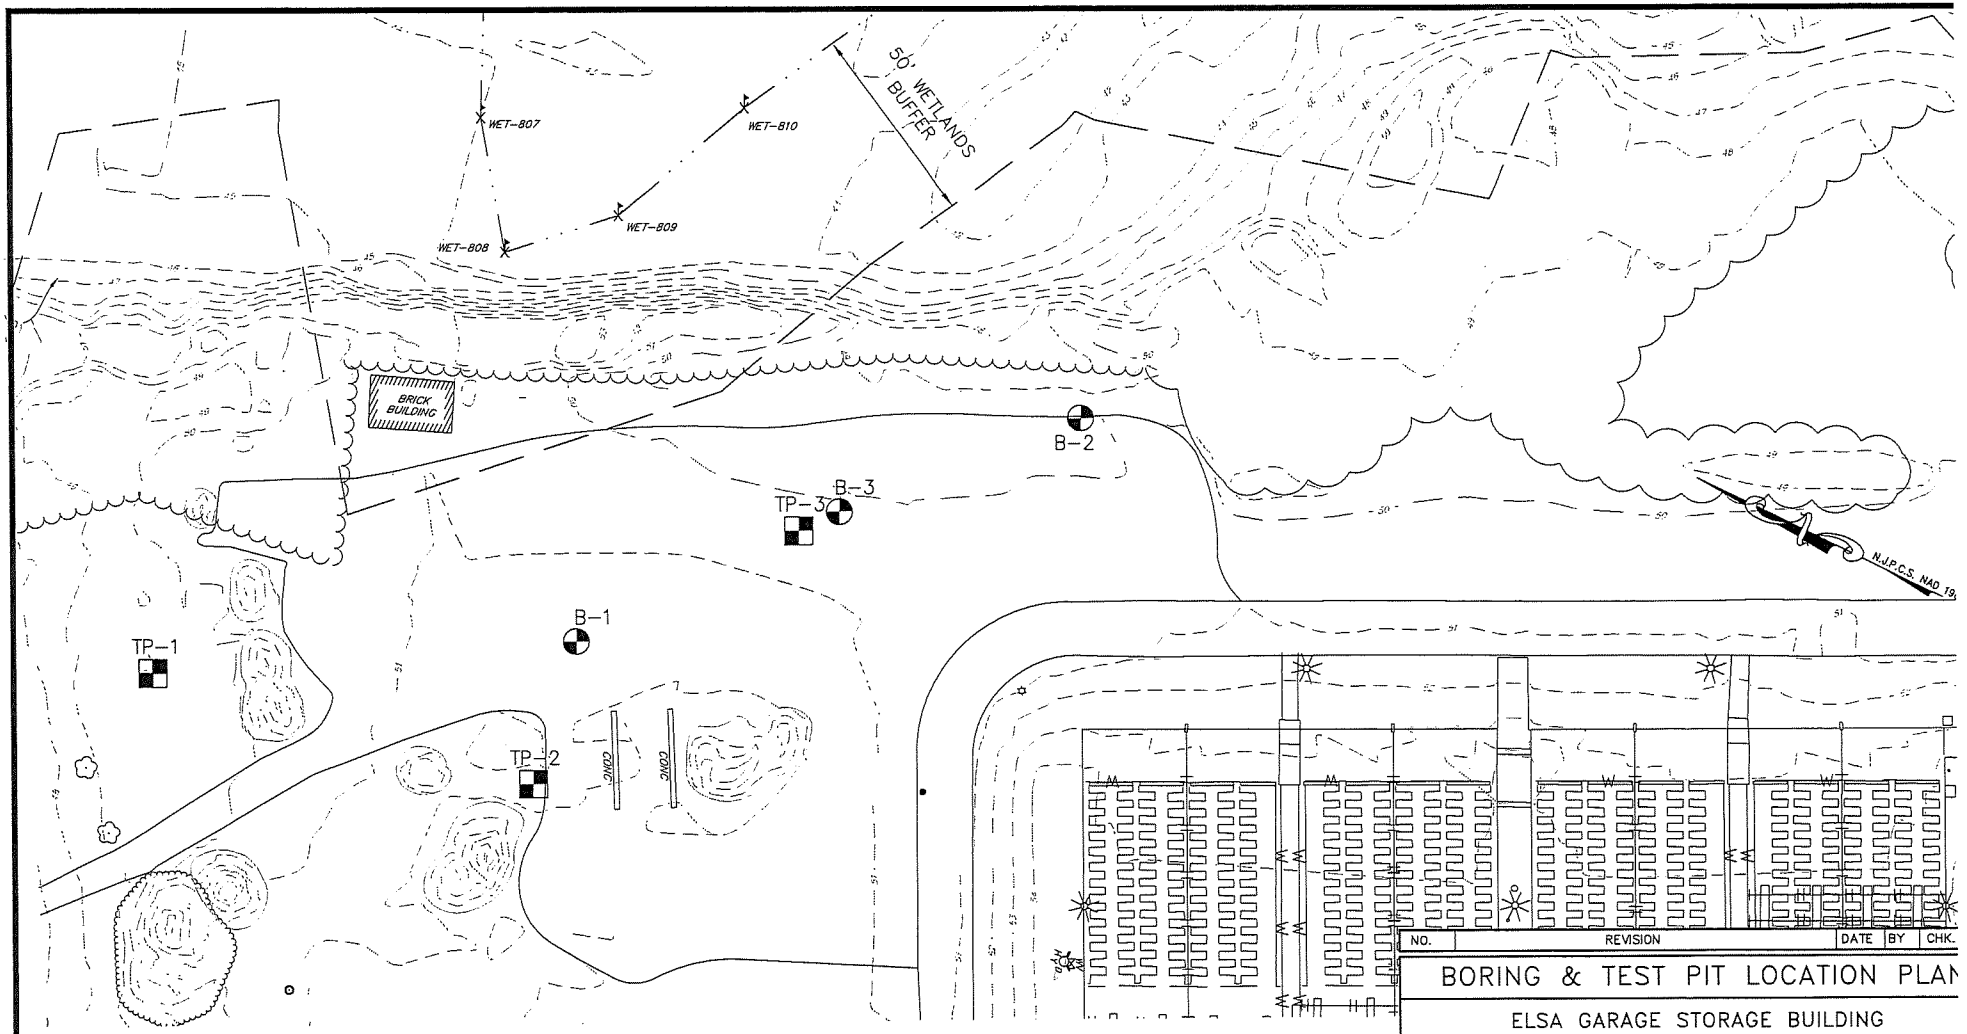

LEGEND

B-1 DENOTES NUMBER AND APPROXIMATE LOCATION OF TEST BORINGS

TP-1 DENOTES NUMBER AND APPROXIMATE LOCATION OF TEST PITS

GRAPHIC SCALE

20 0 10 20

(IN FEET)

1 inch = 20 ft.

NO.	REVISION	DATE	BY	CHK.

BORING & TEST PIT LOCATION PLAN

ELSA GARAGE STORAGE BUILDING

LAWRENCE TOWNSHIP, MERCER COUNTY, NEW JERSEY

REMINGTON & VERNICK ENGINEERS GA 2

2059 SPRINGDALE ROAD, CHERRY HILL, NJ 08002

(856) 795-9595, FAX (856) 795-1882, WEB SITE ADDRESS: WWW.RVE.COM

SCALE	DATE	DRAWN BY	DSGN. BY	CHK'D. BY	DWG. NO.	SHEET
1"=20'	3/2024	C.O.G.	K.C.W.	K.C.W.		1 OF

DWG FILE PATH/NAME

Soil Test Boring Logs

REMINGTON & VERNICK ENGINEERS

SOIL BORING LOG

Project No. 1102M026 **Project** Proposed Garage Storage Building **Boring No.** B-1

Date Started: 10/31/23 **Location** 600 Whitehead Road, Lawrence Township, NJ **Sheet** 1 **of** 1

Date Finished: 10/31/23 **Client** Ewing Lawrence Sewerage Authority **Surface Elev.** Ex. Grade

Drilling Contractor: Boring Brothers Inc. **Groundwater Data**

Drilling Method: Mud Rotary **Depth** 12 ft

Hammer Type: Automatic **Driller:** Mike Beveridge **Date** 10/31/23

Equipment: CME-75 Track Rig **Inspector:** Chris Gilbert **Time** During

Depth (ft.)	Sample Type	Sample Number	Blow Count (Blows per 6 inches)	Recovery	Lithology	Classification of Materials (Based upon samples recovered and observation of materials returned between samples)	Stratum	Moisture Content, %	Other Tests
0		S-1	8-13-7-8	12"		Dark brown & dark gray m-f SAND, little Silt, little m-f Crushed Stone (Fill)			
						Assorted BOULDERS & COBBLES. Evidence of concrete debris also observed in drill cutting.			
5			AUGER						
10		S-2	4-3-4-6	NR					
15		S-3	3-3-3-4	18"		Dark gray CLAYEY SILT, trace f Sand, trace Organics			
20		S-4	3-9-11-12	NR					
25		S-5	29-28-22-26	14"		Gray c-f SAND, little Clay, little Silt, trace f Gravel			
30						Drilling Refusal At 29 Feet boring end			
35									

REMINGTON & VERNICK ENGINEERS

SOIL BORING LOG

Project No. 1102M026 **Project** Proposed Garage Storage Building **Boring No.** B-2

Date Started: 10/31/23 **Location** 600 Whitehead Road, Lawrence Township, NJ **Sheet** 1 **of** 1

Date Finished: 10/31/23 **Client** Ewing Lawrence Sewerage Authority **Surface Elev.** Ex. Grade

Drilling Contractor: Boring Brothers Inc. **Groundwater Data**

Drilling Method: Mud Rotary **Depth** 12 ft

Hammer Type: Automatic **Driller:** Mike Beveridge **Date** 10/31/23

Equipment: CME-75 Track Rig **Inspector:** Chris Gilbert **Time** During

Depth (ft.)	Sample Type	Sample Number	Blow Count (Blows per 6 inches)	Recovery	Lithology	Classification of Materials (Based upon samples recovered and observation of materials returned between samples)	Stratum	Moisture Content, %	Other Tests
0		S-1	10-14-12-15	20"		Dark brown & gray m-f SAND, little Silt, trace Clay, trace f Crushed Stone (Fill)			
		S-2	20-18-18-14	16"		Dark gray f SAND, some Clayey Silt, trace f Gravel			
5		S-3	8-5-4-5	18"					
		S-4	2-2-2-2	18"		Dark brown CLAYEY SILT, trace f Sand, trace Organics			
		S-5	WH/24"	12"		Brown SILT, some f Sand, little Clay			
10		S-6	5-9-13-7	18"		Brown f SAND, little Silt, little Clay			
15		S-7	4-3-4-4	NR					
20		S-8	7-18-17-16	10"		Brown c-f SAND, some f Gravel, little Silt			
25		S-9	24-41-34-23	NR					
30						Drilling Refusal at 29 Feet boring end			
35									

REMINGTON & VERNICK ENGINEERS

SOIL BORING LOG

Project No. 1102M026 **Project** Proposed Garage Storage Building **Boring No.** B-3

Date Started: 10/31/23 **Location** 600 Whitehead Road, Lawrence Township, NJ **Sheet** 1 **of** 1

Date Finished: 10/31/23 **Client** Ewing Lawrence Sewerage Authority **Surface Elev.** Ex. Grade

Drilling Contractor: Boring Brothers Inc. **Groundwater Data**

Drilling Method: Mud Rotary **Depth** 12 ft

Hammer Type: Automatic **Driller:** Mike Beveridge **Date** 10/31/23

Equipment: CME-75 Track Rig **Inspector:** Chris Gilbert **Time** During

Depth (ft.)	Sample Type	Sample Number	Blow Count (Blows per 6 inches)	Recovery	Lithology	Classification of Materials (Based upon samples recovered and observation of materials returned between samples)	Stratum	Moisture Content, %	Other Tests
0		S-1	8-5-6-4	12"		Dark brown & gray c-f SAND, some m-f Crushed Stone (Fill)			
		S-2	4-8-4-3	10"					
5		S-3	1-1-1-2	4"		Light brown SILT, little Clay, little f Sand			
		S-4	1-3-4-3	18"		Brown SILT, little f Sand, little Clay			
		S-5	5-5-5-3	10"		Dark brown & gray CLAYEY SILT, trace f Sand			
10		S-6	4-2-3-2	20"		Dark gray CLAYEY SILT, trace f Sand			
15		S-7	5-11-13-11	4"		Gray c-f SAND, some m-f Gravel, little Silt			
20		S-8	50/5"	4"		Gray m-f GRAVEL, trace c-f Sand			
						Drilling Refusal at 23.5 boring end			
25									
30									
35									


Seismic Information


ASCE Hazards Report

Address:
No Address at This Location

Standard: ASCE/SEI 7-16
Risk Category: III
Soil Class: D - Stiff Soil

Latitude: 40.250789
Longitude: -74.721202
Elevation: 49.7389074643484 ft (NAVD 88)

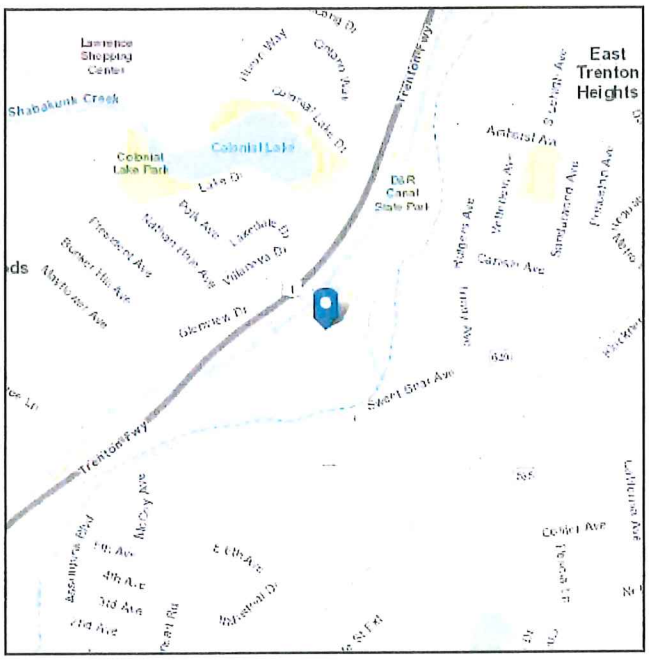

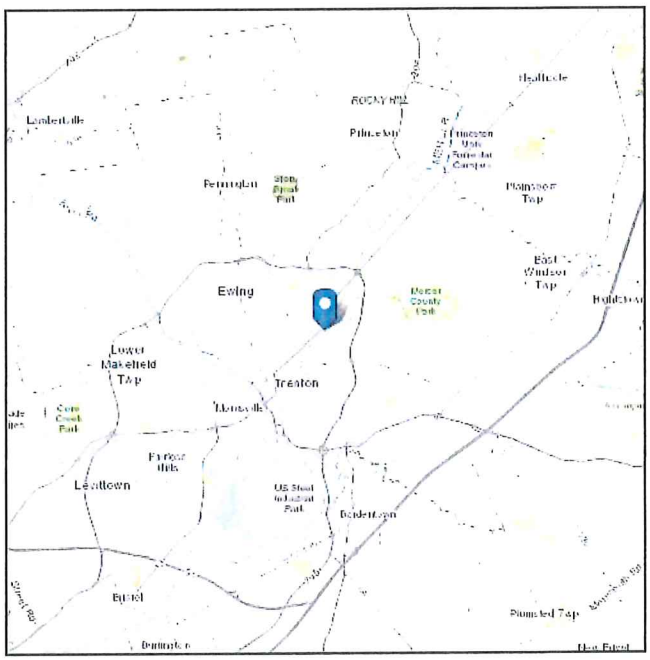

ASCE
AMERICAN SOCIETY OF CIVIL ENGINEERS

Seismic


Site Soil Class: D - Stiff Soil

Results:


S_S :	0.215	S_{D1} :	0.082
S_1 :	0.051	T_L :	6
F_a :	1.6	PGA :	0.124
F_v :	2.4	PGA_M :	0.193
S_{MS} :	0.345	F_{PGA} :	1.551
S_{M1} :	0.123	I_e :	1.25
S_{DS} :	0.23	C_v :	0.731

Seismic Design Category: B


MCE_R Response Spectrum

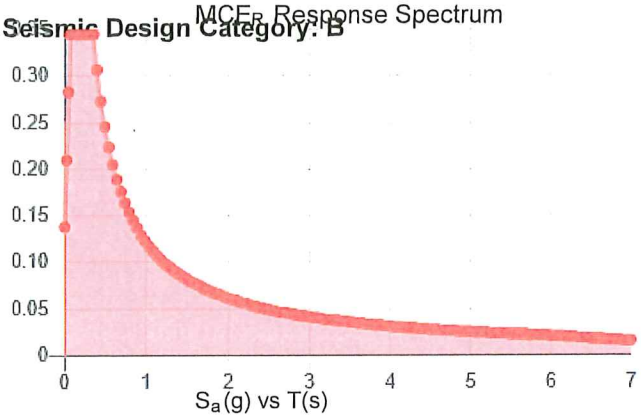


Design Response Spectrum

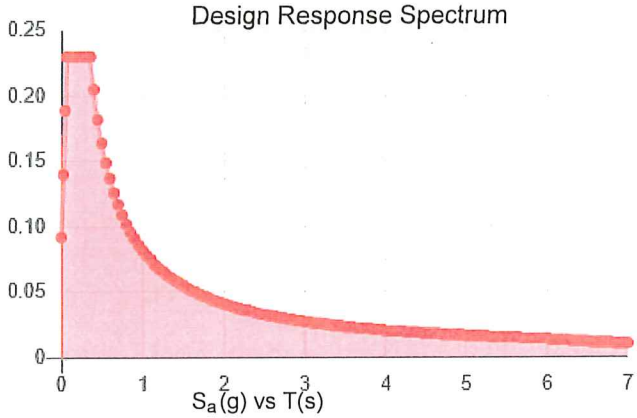

MCE_R Vertical Response Spectrum

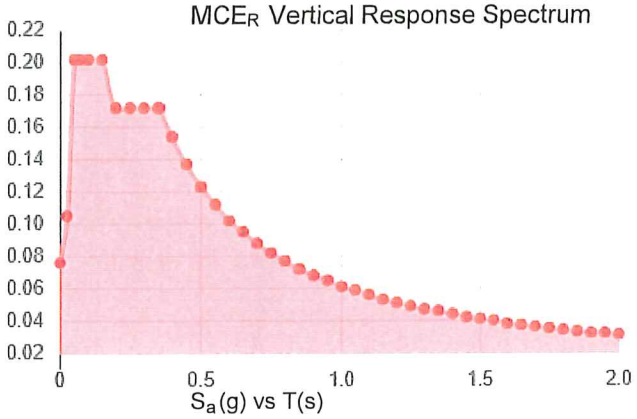

Design Vertical Response Spectrum

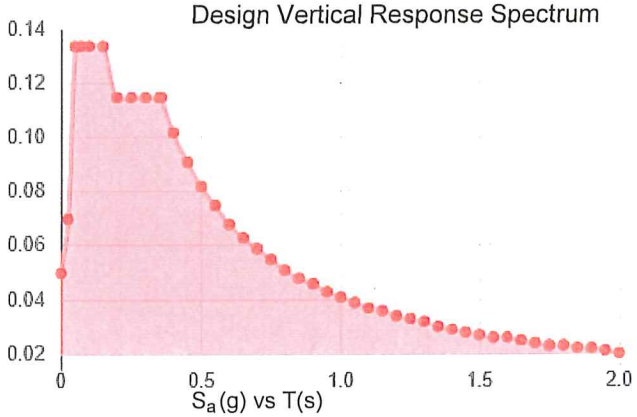

Data Accessed: Thu Mar 07 2024

Date Source:

USGS Seismic Design Maps based on ASCE/SEI 7-16 and ASCE/SEI 7-16 Table 1.5-2. Additional data for site-specific ground motion procedures in accordance with ASCE/SEI 7-16 Ch. 21 are available from USGS.

The ASCE Hazard Tool is provided for your convenience, for informational purposes only, and is provided "as is" and without warranties of any kind. The location data included herein has been obtained from information developed, produced, and maintained by third party providers; or has been extrapolated from maps incorporated in the ASCE standard. While ASCE has made every effort to use data obtained from reliable sources or methodologies, ASCE does not make any representations or warranties as to the accuracy, completeness, reliability, currency, or quality of any data provided herein. Any third-party links provided by this Tool should not be construed as an endorsement, affiliation, relationship, or sponsorship of such third-party content by or from ASCE.

ASCE does not intend, nor should anyone interpret, the results provided by this Tool to replace the sound judgment of a competent professional, having knowledge and experience in the appropriate field(s) of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the contents of this Tool or the ASCE standard.

In using this Tool, you expressly assume all risks associated with your use. Under no circumstances shall ASCE or its officers, directors, employees, members, affiliates, or agents be liable to you or any other person for any direct, indirect, special, incidental, or consequential damages arising from or related to your use of, or reliance on, the Tool or any information obtained therein. To the fullest extent permitted by law, you agree to release and hold harmless ASCE from any and all liability of any nature arising out of or resulting from any use of data provided by the ASCE Hazard Tool.

APPENDIX - B

ENVIRONMENTAL PERMITS

EWING LAWRENCE SEWERAGE AUTHORITY

VEHICLE STORAGE BUILDING

PROJECT – 1102M026

STATE OF NEW JERSEY
DEPARTMENT OF ENVIRONMENTAL PROTECTION
WATERSHED & LAND MANAGEMENT
Mail Code 501-02A, P.O. Box 420, Trenton, New Jersey 08625-0420
Telephone: (609) 777-0454 or Fax: (609) 777-3656
www.nj.gov/dep/landuse

PERMIT

In accordance with the laws and regulations of the State of New Jersey, the Department of Environmental Protection hereby grants this permit to perform the activities described below. This permit is revocable with due cause and is subject to the terms, conditions, and limitations listed below and on the attached pages. For the purpose of this document, "permit" means "approval, certification, registration, authorization, waiver, etc." Violation of any term, condition, or limitation of this permit is a violation of the implementing rules and may subject the permittee to enforcement action.	Approval Date **December 9, 2024** Expiration Date **December 8, 2029**

Permit Number(s):	**Type of Approval(s):**	**Governing Rule(s):**
1107-01-1004.2 LUP240001	Flood Hazard Area Individual Permit Flood Hazard Area Verification	N.J.A.C. 7:13-1.1(b)

Permittee:	**Site Location:**
Ewing-Lawrence Sewerage Authority (ELSA) Attn: Robert Filler 600 Whitehead Road Lawrence, NJ 08648	Block and Lot: [1202; 2] Municipality: Lawrence Township County: Mercer

Description of Authorized Activities:

This permit authorizes the construction of a vehicle storage building (garage), paved parking area, utilities, stormwater management features, and other appurtenant structures within the northeastern portion of the above referenced parcel, within the flood hazard area of both the Shabakunk Creek and the Assunpink Creek, in association with an existing ELSA wastewater treatment plant facility. This also verifies the regulatory Flood Hazard Elevation onsite of 52.2 feet, NAVD.

The Department has determined that the herein approved activities meet the requirements of the (FHACA) rules. This approval does not obviate the local Floodplain Administrator's responsibility to ensure all development occurring within their community's Special Flood Hazard Area is compliant with the local Flood Damage Prevention Ordinance, and minimum NFIP standards, regardless of any state-issued permits. FEMA requires communities to review and permit all proposed construction or other development within their SFHA in order to participate in the NFIP.

Prepared by: **Erin Signor**	**Received and/or Recorded by County Clerk:**
If the permittee undertakes any regulated activity, project, or development authorized under this permit, such action shall constitute the permittee's acceptance of the permit in its entirety as well as the permittee's agreement to abide by the requirements of the permit and all conditions therein.	

This permit is not valid unless authorizing signature appears on the last page.

STATEMENT OF AUTHORIZED IMPACTS:

The authorized activities allow for the permittee to undertake impacts to regulated areas as described below. Additional impacts to regulated areas without prior Department approval shall constitute a violation of the rules under which this document is issued and may subject the permittee and/or property owner to enforcement action, pursuant to N.J.A.C. 7:13-24.

FHA-IP Riparian Zone	Area of riparian zone disturbance
Permanent Disturbance	752 square feet (0.017 acres)
Temporary Disturbance	0

PRE-CONSTRUCTION CONDITIONS:

1. **Timing**: If this permit contains a condition that must be satisfied prior to the commencement of construction, the permittee shall comply with such condition(s) within the time required by the permit or, if no time specific requirement is imposed, then the permittee shall comply with such condition(s) within six months of the effective date of the permit, or provide evidence satisfactory to the Division that such condition(s) cannot be satisfied.

2. Prior to the commencement of site clearing, grading, or construction onsite, the permittee shall install a sediment barrier at the limits of disturbance authorized herein which is sufficient to prevent the sedimentation of the regulated waters and regulated areas onsite and shall serve as a physical barrier protecting all regulated areas from encroachment by construction vehicles or other soil-disturbing activities. All sediment barriers and soil erosion control measures shall be kept in place and maintained throughout the duration of construction, until such time that the site is stabilized.

SPECIAL CONDITIONS:

1. The Department has determined that the onsite riparian zone along the Shabakunk Creek tributary is 50 feet. Therefore, vegetation within 50 feet of top of the bank shall only be disturbed in the areas specifically shown on the approved drawings and upon completion of the project, all temporarily disturbed areas conducted under N.J.A.C. 7:13-11.2(k), 11.2(y), and/or 11.2(f)3 shall be replanted and restored in accordance with N.J.A.C. 7:13-11.2(z).

2. In order to protect warm water fish within the Shabakunk Creek tributary from sediment generating activities, special caution shall be taken for any grading, excavation, or construction activities conducted near the banks of the channel between **May 1 and July 31** of each year. In addition, any activity within the flood hazard area or riparian zone of this watercourse which does not minimize the introduction of sediment into said stream or which could cause more than a minimum increase in the natural level of turbidity, is also prohibited anytime but especially during this period. The Department reserves the right to require additional soil conservation measures if it becomes evident that additional measures are required to protect State regulated resources, or the right to suspend all regulated activities onsite should it be determined that the permittee has not taken proper precautions to ensure continuous compliance with this condition.

3. The permittee shall ensure that special care is taken during horizontal directional drilling activities to prevent any inadvertent returns or discharges.

4. The permittee shall ensure that no disturbance or access is conducted within the regulated water onsite for installation of the sanitary sewer main. Any temporarily disturbed areas shall be immediately restored to replicate pre-construction conditions of the channel such as shape, width, thalweg, meander, ratio of shallow areas to deep areas, anticipated flow rate and velocity, and substrate type.

5. Any pipes laid through a regulated area which have been authorized by a Department permit shall be properly sealed to prevent leaking or infiltration. Pipes and backfilled materials shall be placed entirely beneath the preexisting ground elevation.

6. Construction equipment shall not be stored, staged, or driven within any regulated channel or areas onsite, unless expressly approved by this permit or described on the approved plans.

7. All excavated and dredged material must be disposed of in a lawful manner outside of any flood hazard area, riparian zone, open water, freshwater wetland, and adjacent transition area, and in such a way as to not interfere with the positive drainage of the receiving area.

8. In accordance with N.J.A.C. 7:13-12.6(g)4, the permittee must provide signs in the parking lot indicating that the lot will be subject to inundation during flood events.

9. In accordance with N.J.A.C.7:13-12.5(p)3, an adequate number of flood vents must be installed for any enclosed area below the floodplain.

10. All foundations, slabs, footings and walls of the proposed structure/s shall be designed to resist uplift, flotation, collapse and displacement due to hydrostatic and hydrodynamic forces resulting from flooding up to an elevation of one foot above the flood hazard area design flood elevation. Furthermore, all structural components shall be designed to resist the same forces.

11. The area within the proposed building shall remain open and accessible to the passage of floodwaters at all times. In order to relieve hydrostatic pressure on the proposed building during flooding, permanent flood vents shall be constructed within the walls of the building to allow water to freely enter and exit during a flood as shown on the approved plans. These vents shall be maintained in good working order at all times and shall not be blocked under any circumstances.

12. For the purposes of this permit, the Department has determined that this project is not a Major Development as defined in the Stormwater Management rules at N.J.A.C. 7:8-1.2. Therefore, the Department did not review the proposed project for compliance with these rules.

13. All sediment barriers and other soil erosion control measures shall be installed prior to commencing any clearing, grading or construction onsite, and shall be maintained in proper working condition throughout the entire duration of the project.

14. Construction equipment shall not be stored, staged or driven within any channel, freshwater wetland or transition area, unless expressly approved by this permit and/or described on the approved plans.

15. Any new, reconstructed, enlarged, or elevated structure within a flood hazard area shall be secured to resist flotation, collapse, and displacement due to hydrostatic and hydrodynamic forces from floodwaters.

16. In accordance with N.J.A.C.7:13-12.5(p), the deed for the lot on which the enclosure (garage) below the flood hazard area design flood elevation is constructed must be modified to:
    a. Explain that the garage is likely to be inundated by floodwaters, which may result in damage and/or inconvenience,
    b. Disclose the depth of flooding that the garage would experience during the FEMA 100-year flood and flood hazard area design flood,
    c. Prohibit habitation of the garage, and
    d. Explain that converting the enclosure or garage into a habitable area may subject the property owner to enforcement under N.J.A.C. 7:13.

    Within 90 calendar days of the issuance of this permit for the enclosure, a copy of the modified deed as filed with the local county clerk shall be provided to the Department at the address set forth at N.J.A.C. 7:13-1.3.

17. This portion of the permit verifies the flood hazard area design flood elevation of 52.2 feet NAVD 1988. It also verifies the riparian zone width and that there is no floodway on site which the project encounters. This permit shall be recorded in its entirety in the office of the County Clerk or the Registrar of Deeds and Mortgages for each county where this project is located. Verified notice of this action shall be forwarded to the Division immediately thereafter. NOTE: The following information is to be submitted to the clerk for all Flood Hazard Area Verifications:
    a. The Department file number for the verification;
    b. The approval and expiration dates of the verification;
    c. A metes and bounds description of any flood hazard area limit approved under the verification;
    d. The flood hazard area design flood elevation, or range of elevations if variable, approved under the verification;
    e. The width and location of any riparian zone approved under the verification; and
    f. The following statement: "The State of New Jersey has determined that all or a portion of this lot lies in a flood hazard area. Certain activities in flood hazard areas are regulated by the New Jersey Department of Environmental Protection and some activities may be prohibited on this site or may first require a permit. Contact the Watershed and Land Management Program at (609) 777-0454 for more information prior to any construction onsite."

18. In accordance with N.J.A.C. 7:13-12.6(h), the deed for each lot on which the private roadway or parking area is constructed, as well as any lot served by the private roadway or parking area, and each lease or rental agreement for a unit within the multi-residence building served by a private roadway or parking area that lies below the flood hazard area design flood elevation shall be modified to:
    a. Explain that the private roadway or parking area is likely to be inundated by floodwaters, which may result in damage and/or inconvenience; and
    b. Disclose the depth of flooding that the private roadway or parking area would experience during the FEMA 100-year flood, if available, and the flood hazard area design flood; and
    c. The modified deeds are recorded in the Office of the County Clerk or the registrar of deeds and mortgages of the county in which the building is located, and proof that the modified deed has been recorded is provided to the Department prior to the sooner of either:
        (1) The start of any site disturbance (including pre-construction earth movement, removal of vegetation or structures, or construction of the project); or
        (2) The date that is 90 calendar days after the issuance of the permit.

STANDARD CONDITIONS:

1. The issuance of a permit shall in no way expose the State of New Jersey or the Department to liability for the sufficiency or correctness of the design of any construction or structure(s). Neither the State nor the Department shall, in any way, be liable for any loss of life or property that may occur by virtue of the activity or project conducted as authorized under a permit.

2. The issuance of a permit does not convey any property rights or any exclusive privilege.

3. The permittee shall obtain all applicable Federal, State, and local approvals prior to commencement of regulated activities authorized under a permit.

4. A permittee conducting an activity involving soil disturbance, the creation of drainage structures, or changes in natural contours shall obtain any required approvals from the Soil Conservation District or designee having jurisdiction over the site.

5. The permittee shall take all reasonable steps to prevent, minimize, or correct any adverse impact on the environment resulting from activities conducted pursuant to the permit, or from noncompliance with the permit.

6. The permittee shall immediately inform the Department of any unanticipated adverse effects on the environment not described in the application or in the conditions of the permit. The Department may, upon discovery of such unanticipated adverse effects, and upon the failure of the permittee to submit a report thereon, notify the permittee of its intent to suspend the permit.

7. The permittee shall immediately inform the Department by telephone at (877) 927-6337 (WARN DEP hotline) of any noncompliance that may endanger public health, safety, and welfare, or the environment. The permittee shall inform the Watershed & Land Management by telephone at (609) 777-0454 of any other noncompliance within two working days of the time the permittee becomes aware of the noncompliance, and in writing within five working days of the time the permittee becomes aware of the noncompliance. Such notice shall not, however, serve as a defense to enforcement action if the project is found to be in violation of this chapter. The written notice shall include:

    i. A description of the noncompliance and its cause;
    ii. The period of noncompliance, including exact dates and times;
    iii. If the noncompliance has not been corrected, the anticipated length of time it is expected to continue; and
    iv. The steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.

8. Any noncompliance with a permit constitutes a violation of this chapter and is grounds for enforcement action, as well as, in the appropriate case, suspension and/or termination of the permit.

9. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the authorized activity in order to maintain compliance with the conditions of the permit.

10. The permittee shall employ appropriate measures to minimize noise where necessary during construction, as specified in N.J.S.A. 13:1G-1 et seq. and N.J.A.C. 7:29.

11. The issuance of a permit does not relinquish the State's tidelands ownership or claim to any portion of the subject property or adjacent properties.

12. The issuance of a permit does not relinquish public rights to access and use tidal waterways and their shores.

13. The permittee shall allow an authorized representative of the Department, upon the presentation of credentials, to:

    i. Enter upon the permittee's premises where a regulated activity, project, or development is located or conducted, or where records must be kept under the conditions of the permit;
    ii. Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permit; and
    iii. Inspect, at reasonable times, any facilities, equipment, practices, or operations regulated or required under the permit. Failure to allow reasonable access under this paragraph shall be considered a violation of this chapter and subject the permittee to enforcement action.

14. The permittee shall not cause or allow any unreasonable interference with the free flow of a regulated water by placing or dumping any materials, equipment, debris or structures within or adjacent to the channel while the regulated activity, project, or development is being undertaken. Upon completion of the regulated activity, project, or development, the permittee shall remove and dispose of in a lawful manner all excess materials, debris, equipment, and silt fences and other temporary soil erosion and sediment control devices from all regulated areas.

15. The permittee and its contractors and subcontractors shall comply with all conditions, site plans, and supporting documents approved by the permit.

16. All conditions, site plans, and supporting documents approved by a permit shall remain in full force and effect, so long as the regulated activity, project, or development, or any portion thereof, is in existence, unless the permit is modified pursuant to the rules governing the herein approved permits.

17. The permittee shall perform any mitigation required under the permit in accordance with the rules governing the herein approved permits.

18. If any condition or permit is determined to be legally unenforceable, modifications and additional conditions may be imposed by the Department as necessary to protect public health, safety, and welfare, or the environment.

19. Any permit condition that does not establish a specific timeframe within which the condition must be satisfied (for example, prior to commencement of construction) shall be satisfied within six months of the effective date of the permit.

20. A copy of the permit and all approved site plans and supporting documents shall be maintained at the site at all times and made available to Department representatives or their designated agents immediately upon request.

21. The permittee shall provide monitoring results to the Department at the intervals specified in the permit.

22. A permit shall be transferred to another person only in accordance with the rules governing the herein approved permits.

23. A permit can be modified, suspended, or terminated by the Department for cause.

24. The submittal of a request to modify a permit by the permittee, or a notification of planned changes or anticipated noncompliance, does not stay any condition of a permit.

25. Where the permittee becomes aware that it failed to submit any relevant facts in an application, or submitted incorrect information in an application or in any report to the Department, it shall promptly submit such facts or information.

26. The permittee shall submit email notification to the Bureau of Coastal & Land Use Compliance & Enforcement at CLU_tomsriver@dep.nj.gov at least 3 days prior to commencement of site preparation and/or regulated activities, whichever comes first. The notification shall include proof of completion of all pre-construction conditions, including proof of recording of permits, approved plans and/or conservation easements, if required. The permittee shall allow an authorized Bureau representative on the site to inspect to ensure compliance with this permit.

27. The permittee shall record the permit, including all conditions listed therein, with the Office of the County Clerk (the Registrar of Deeds and Mortgages, if applicable) of each county in which the site is located. The permit shall be recorded within 30 calendar days of receipt by the permittee, unless the permit authorizes activities within two or more counties, in which case the permit shall be recorded within 90 calendar days of receipt. Upon completion of all recording, a copy of the recorded permit shall be forwarded to Watershed & Land Management through the DEP Online service. The uploaded documents will go directly into the Department's database, and staff will be notified that information has been received. The service can be found at: https://dep.nj.gov/wlm/eservices/lrp-eservices/.

APPROVED PLAN(S):

The drawings hereby approved consist of nine (9) sheets prepared by Remington & Vernick Engineers, dated May 16, 2024, last revised as noted below, and entitled:

"EWING LAWRENCE SEWAGE AUTHORITY ELSA VEHICLE STORAGE BUILDING TOWNSHIP OF LAWRENCE MERCER COUNTY NEW JERSEY",

- "FHA PARTIAL VERIFICATION PLAN,", Sheet No. 1, last revised June 3, 2024,
- "FLOOD HAZARD AREA ENVIRONMENTAL IMPACT PLAN", Sheet No. EV-1, last revised December 5, 2024,
- BUILDING FLOOR PLAN, Sheet No. S-3, last revised December 2024,
- EXTERIOR ELEVATIONS, Sheet No. S-4, last revised December 2024,

"EWING LAWRANCE SEWAGE AUTHORITY, TOWNSHIP OF LAWRENCE MERCER COUNTY NEW JERSEY, MINOR SITE PLAN - ELSA VEHICLE STORAGE BUILDING 600 WHITEHEAD ROAD; BLOCK 1202, LOT 2",

- "DEMOLITION PLAN", Sheet No. C-6, last revised December 2, 2024,

- "SITE PLAN", Sheet No. C-7, last revised December 2, 2024,
- "GRADING AND UTILITIES PLAN", Sheet No. C-8, last revised December 9, 2024,
- "DRAINAGE & UTILITIES PLAN", Sheet No. C-9, last revised December 2, 2024,
- "FORCE MAIN PROFILE", Sheet No. C-10, last revised December 2, 2024.

APPEAL OF DECISION:

Any person who is aggrieved by this decision may submit an adjudicatory hearing request within 30 calendar days after public notice of the decision is published in the DEP Bulletin (available at https://dep.nj.gov/bulletin/). If a person submits the hearing request after this time, the Department shall deny the request. The hearing request must include a completed copy of the Administrative Hearing Request Checklist (available at https://dep.nj.gov/wlm/forms/). A person requesting an adjudicatory hearing shall submit the original hearing request to: NJDEP Office of Administrative Hearings and Dispute Resolution, Attention: Adjudicatory Hearing Requests, Mail Code 401-07A, P.O. Box 420, 401 East State Street, 7th Floor, Trenton, NJ 08625-0420. Additionally, a copy of the hearing request shall be submitted to the Director of Watershed & Land Management at the address listed on page one of this permit. In addition to your hearing request, you may file a request with the Office of Dispute Resolution to engage in alternative dispute resolution. Please see www.nj.gov/dep/odr for more information on this process.

If you need clarification on any section of this permit or conditions, please contact Watershed & Land Management's Technical Support Call Center at (609) 777-0454.

Approved By:

Digitally signed by Chingwah Liang
Date: 2024.12.09 16:04:37 -05'00'

Chingwah Liang, Environmental Engineer 4
Bureau of Flood Hazard and Stormwater Engineering
Watershed & Land Management

e-copy: Municipal Clerk, Lawrence Twp
Municipal Construction Official, Lawrence Twp
Agent – Dennis Yoder

State of New Jersey

PHILIP D. MURPHY
Governor

TAHESHA L. WAY
Lt. Governor

DEPARTMENT OF ENVIRONMENTAL PROTECTION
Division of Land Resource Protection
Mail Code 501-02A
P.O. Box 420
Trenton, New Jersey 08625-0420
www.dep.nj.gov/wlm/lrp

SHAWN M. LATOURETTE
Commissioner

March 24, 2025

Ewing-Lawrence Sewerage Authority
c/o S. Robert Filler
600 Whitehead Road
Lawrence Twp, NJ 08648

RE: Freshwater Wetlands Letter of Interpretation: **Partial Line Verification**
File and Activity No.: 1107-01-1004.2 FWW240001
Applicant: Ewing-Lawrence Sewerage Authority c/o S. Robert Filler, Executive Dir.
Block and Lot: [1202; 2]
Lawrence Township, Mercer County
Watershed: Assunpink Creek (below Shipetaukin Ck)
Sub-watersheds (2): Shabakunk Creek & Assunpink Creek (below Shipetaukin Ck)

Dear Mr. Robert Filler:

This letter is in response to your request for a Partial Letter of Interpretation to have the Division of Land Resource Protection (Division) staff verify the boundary of the freshwater wetlands, transition areas, and/or State open waters within a portion of the referenced property.

In accordance with agreements between the State of New Jersey Department of Environmental Protection (NJDEP), the U.S. Army Corps of Engineers (USACOE) Philadelphia and New York Districts, and the U.S. Environmental Protection Agency (USEPA), the NJDEP is the lead agency for establishing the extent of State and Federally regulated wetlands and waters. The USEPA and/or USACOE retain the right to reevaluate and modify the jurisdictional determination at any time should the information prove to be incomplete or inaccurate.

Based upon the information submitted, and upon site inspections conducted by Division staff on September 19 and October 9, 2024, the Division has determined that the wetlands and waters boundary line(s) within the partial limits are accurate as shown on the survey plan entitled: "**EXISTING TOPOGRAPHIC CONDITIONS WATER TREATMENT PLANT TOWNSHIP OF EWING FOURTH STREET PUMP STATION SANITARY SEWER IMPROVEMENTS TOWNSHIP OF EWING MERCER COUNTY NEW JERSEY**", Sheet No. 1 of 1, dated April 4, 2022, last revised February 11, 2025, and prepared by Remington & Vernick Engineers.

The freshwater wetlands and waters boundary line(s), as determined in this letter, must be shown on any future site development plans. The line(s) should be labeled with the above File and Activity number and the following note:

"**Freshwater Wetlands/Waters Boundary Line as verified by NJDEP.**"

Wetlands Resource Value Classification ("RVC")

In addition, the Division has determined that the resource value and standard transition area or buffer required adjacent to the delineated wetlands are as follows:

Intermediate: WET-806 to WET-807 and to WET-810 to WET-814. [50-foot transition area]

State Open Water: All remaining flag Nos. not otherwise identified in this section, and within the wetland boundaries. [No transition area]

Please be advised that additional freshwater wetlands, transition areas, and/or State open waters exist onsite beyond the boundary of the Partial Line Verification limits. RVC and all other designations may affect requirements for wetland, State open water, and/or transition area permitting, such as the requirements for an Individual Wetlands Permit (N.J.A.C. 7:7A-9 and 10), the types of General Permits by Certification or General Permits available (N.J.A.C. 7:7A-5, 6, and 7), and any modification available through a Transition Area Waiver (N.J.A.C. 7:7A-8). Please refer to the Freshwater Wetlands Protection Act (N.J.S.A. 13:9B-1 *et seq.*) and implementing rules for additional information.

Wetlands resource value classification is based on the best information available to the Division. The classification is subject to reevaluation at any time if additional or updated information is made available, including, but not limited to, information supplied by the applicant.

General Information

Pursuant to the Freshwater Wetlands Protection Act rules, you are entitled to rely upon this jurisdictional determination for a period of five years from the date of this letter unless it is determined that the letter is based on inaccurate or incomplete information. Should additional information be disclosed or discovered, the Division reserves the right to void the original letter of interpretation and issue a revised letter of interpretation.

Regulated activities proposed within a freshwater wetland, State open water, or transition area, as defined under N.J.A.C. 7:7A-2.2 and 2.3 of the Freshwater Wetlands Protection Act rules, require a permit from this office unless specifically exempted at N.J.A.C. 7:7A-2.4. The approved plan(s) and supporting jurisdictional limit information are now part of the Division's public records.

Please be advised that any surface water features on the site or adjacent to the site may possess flood hazard areas and/or riparian zones and development within these areas may be subject to the Flood Hazard Area Control Act rules at N.J.A.C. 7:13. The Department can verify the extent of flood hazard areas and/or riparian zones through a flood hazard area verification under the application procedures set forth at N.J.A.C. 7:13-5.1.

This letter in no way legalizes any fill which may have been placed, or other regulated activities which may have occurred on-site. This determination of jurisdiction extent or presence does not make a finding that wetlands or water areas are "isolated" or part of a surface water tributary system unless specifically called out in this letter as such. Furthermore, obtaining this determination does not affect your responsibility to obtain any local, State, or Federal permits which may be required.

Recording

Within 90 calendar days of the date of this letter, the applicant shall submit the following information to the clerk of each county in which the site is located, and shall send proof to the Division that this information is recorded on the deed of each lot referenced in the letter of interpretation:

1. The Department File and Activity number for the letter of interpretation;

2. The approval and expiration date of the letter of interpretation;

3. A metes and bounds description of the wetland boundary approved under the letter of interpretation;

4. The width and location of any transition area approved under the letter of interpretation; and

5. The following statement: "The State of New Jersey has determined that all or a portion of this site lies in a freshwater wetland, State open water, and/or transition area. Certain activities within these areas are regulated by the New Jersey Department of Environmental Protection and some activities may be prohibited on this site or may first require a freshwater wetland permit. Contact the Division of Land Resource Protection at (609) 777-0454 or visit https://dep.nj.gov/wlm/lrp for more information prior to the commencement of any construction onsite."

Failure to have this information recorded in the deed of each lot and/or to submit proof of recording to the Division constitutes a violation of the Freshwater Wetlands Protection Act rules and may result in suspension or termination of the letter of interpretation and/or subject the applicant to enforcement action pursuant to N.J.A.C. 7:7A-22.

Appeal Process

In accordance with N.J.A.C. 7:7A-21, any person who is aggrieved by this decision may request a hearing within 30 days of the date the decision is published in the DEP Bulletin by writing to: New Jersey Department of Environmental Protection, Office of Administrative Hearings and Dispute Resolution, Attention: Adjudicatory Hearing Requests, 401 E. State Street, Mail Code 401-07A, P.O. Box 420, Trenton, NJ 08625-0420. This request must include a completed copy of the Administrative Hearing Request Checklist found at www.dep.nj.gov/wlm/forms. Hearing requests received after 30 days of publication notice may be denied. The DEP Bulletin is available at www.dep.nj.gov/bulletin. In addition to your hearing request, you may file a request with the Office of Dispute Resolution to engage in alternative dispute resolution. Please visit the website www.nj.gov/dep/odr for more information on this process.


If you have any questions regarding this letter, please contact Ariana Tsiattalos of our staff by e-mail at Ariana.Tsiattalos@dep.nj.gov or by phone at (609) 777-0454. Be sure to indicate the Department's file number in all communication.


Sincerely,

Rebecca Grike Date: 2025.03.24 15:05:41 -04'00'

Rebecca Grike, Environmental Specialist IV
Division of Land Resource Protection

e-copy: Municipal Clerk
Agent

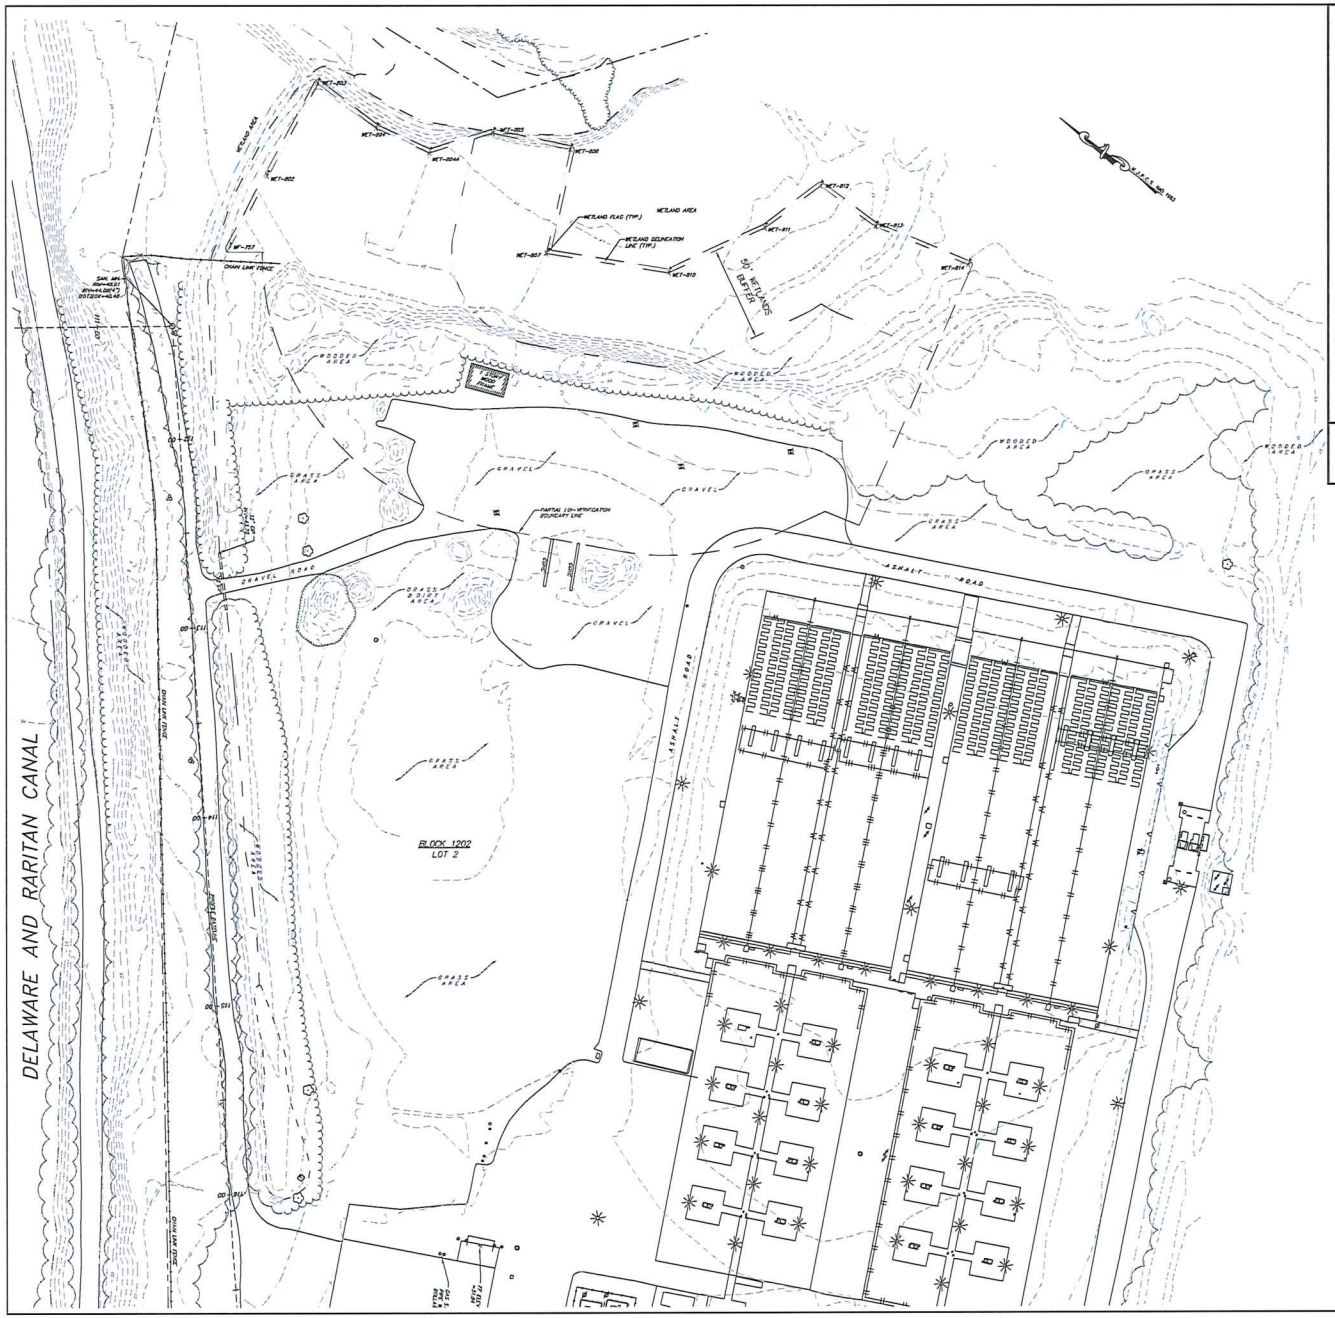

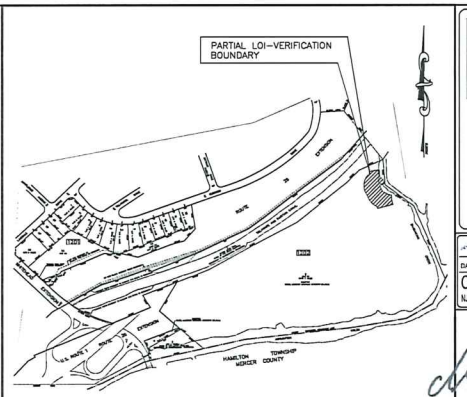

LOCATION MAP

SCALE: N.T.S.

APPROVED

File No.: 1107-01-1004.2
Activity No.: FWW240001
Date: 3/24/2025

State of New Jersey
Department of Environmental Protection
Watershed and Land Management

ACREAGE CHART

TOTAL ACREAGE OF PARCEL= 23.3 ACRES
TOTAL ACREAGE OF AREA CONFINED WITHIN THE PARTIAL LOI-VERIFICATION BOUNDARY= 1.3 ACRES

SURVEY NOTES & REFERENCES:

1. THE HORIZONTAL DATUM IS BASED ON THE NEW JERSEY STATE PLANE COORDINATE SYSTEM (NAD-1983 / 2011 ADJ.) AND THE VERTICAL DATUM IS BASED ON NAVD-1988 / GEOID 2018 (ADD 1.07 FEET TO THESE ELEVATIONS TO CONVERT TO NGVD-1929 DATUM).
2. PROPERTY AND RIGHT-OF-WAY LINES SHOWN ON THESE PLANS ARE APPROXIMATE LOCATIONS BASED ON THE CURRENT TAX MAPS OF THE TOWNSHIP OF EWING, MERCER COUNTY, NEW JERSEY. ADJOINING PROPERTY AND RIGHT-OF-WAY LINES ARE SHOWN FOR GRAPHICAL INFORMATION ONLY AND HAVE NOT BEEN FIELD VERIFIED.
3. EXISTING TOPOGRAPHIC CONDITIONS SHOWN ON THE PLAN ARE BASED ON AERIAL MAPPING PREPARED BY COOPER NOR EAST MAPPING, DATE OF FLIGHT FEBRUARY 12, 2022 AND WERE FIELD EDITED AND VERIFIED BY REMINGTON & VERNICK ENGINEERS UNDER THE SUPERVISION OF CHARLES E. ADAMSON, N.J.P.L.S. LICENSE NO. 42627. THE SURVEY WORK WAS COMPLETED ON FEBRUARY 1, 2024.
4. THIS PLAN AND SURVEY DOES NOT CERTIFY TO THE LOCATION, BOTH HORIZONTAL AND VERTICAL OF ANY UNDERGROUND UTILITY OR STRUCTURE THAT WAS NOT EXPOSED FOR DIRECT MEASUREMENT.
5. THE WETLANDS DELINEATION WAS COMPLETED BY REMINGTON AND VERNICK ENGINEERS ON FEBRUARY 16, 2023.

GRAPHIC SCALE

(IN FEET)
1 inch = 30 ft.

RVE 1901
REMINGTON & VERNICK ENGINEERS
2059 SPRINGDALE ROAD
CHERRY HILL, NJ 08003
(856) 795-0595, FAX (856) 795-1882
WEB SITE ADDRESS : WWW.RVE.COM
Certificate of Authorization: 24 GA 28001200
-ENGINEERING EXCELLENCE-

DATE:
CHARLES E. ADAMSON
NJ PROFESSIONAL LAND SURVEYOR LIC. No. 42627

PLANS WHICH DO NOT BEAR AN EMBOSSED SEAL ARE NOT VALID.

ALL DOCUMENTS PREPARED BY REMINGTON & VERNICK ENGINEERS (RVE) AND AFFILIATES ARE INSTRUMENTS OF SERVICE IN RESPECT OF THE PROJECT. THEY ARE NOT INTENDED OR REPRESENTED TO BE SUITABLE FOR REUSE BY OWNER OR OTHERS ON EXTENSIONS OF THE PROJECT OR ON ANY OTHER PROJECT. ANY REUSE, WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY RVE FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT OWNER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO REMINGTON & VERNICK ENGINEERS AND AFFILIATES AND OWNER SHALL INDEMNIFY AND HOLD HARMLESS REMINGTON & VERNICK ENGINEERS AND AFFILIATES FROM ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM.

No.	REVISION	DATE	BY	CK'D
2	REVISED WETLANDS BUFFER LINE	3/11/25	MJ	CEA
1	PER NJDEP COMMENT	1/30/25	MJ	CEA

EXISTING TOPOGRAPHIC CONDITIONS WATER TREATMENT PLAN

TOWNSHIP OF EWING
FOURTH STREET PUMP STATION
SANITARY SEWER IMPROVEMENTS
TOWNSHIP OF EWING — MERCER COUNTY — NEW JERSEY

DESIGNED: MJ	DRAWN BY:	CHECKED BY: CEA	SCALE: NOTED
DATE: 4/4/2022		SHEET No.: 1 of 1	
JOB No.: 1102 TM 0121			